


SUBSTATION B - BAY L1 - AC CURRENT SCHEMATIC, CT 52-L1 CORE 1 (PROTECTION)

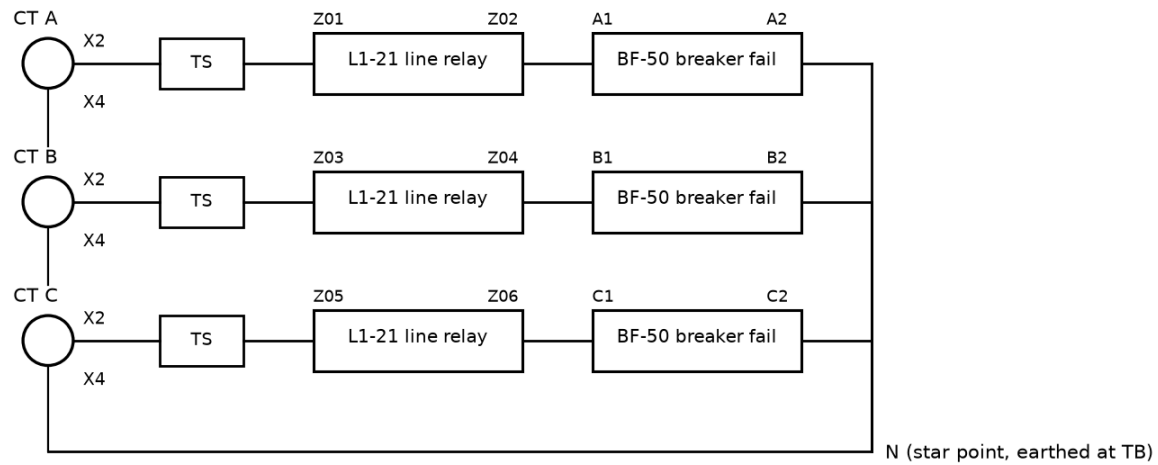

Design: all devices on core 1 are connected in SERIES in each phase (CT X2 -> TS -> device 1 in/out -> device 2 in/out -> N).


Tap X2-X4 per relay CTR 240 (1200:5). Terminal numbers of each device as shown (in / out).

DWG B-E-3301 REV A

230 kV protection, bay L1

Design issue 2023

SUBSTATION B - BAY L2 - AC CURRENT SCHEMATIC, CT 52-L2 CORE 1 (PROTECTION)

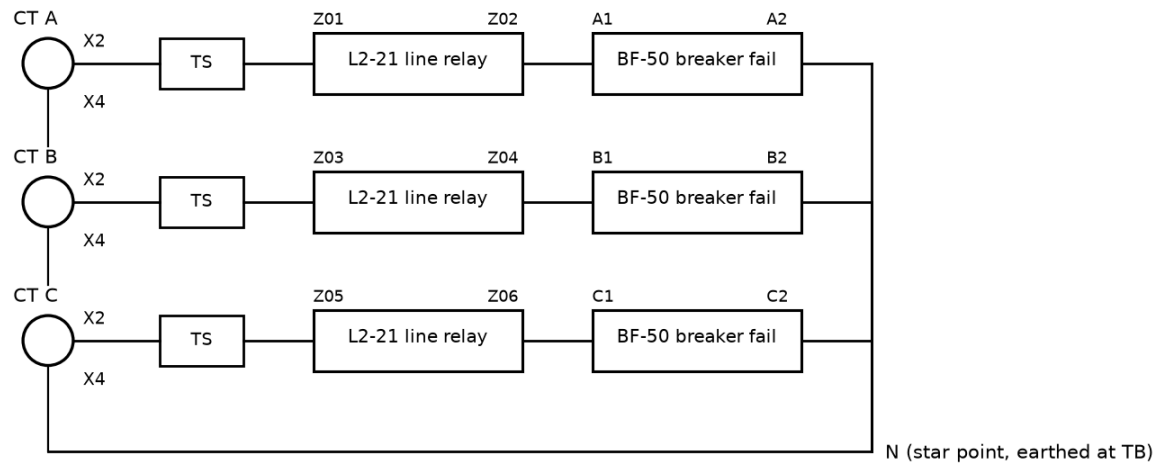

Design: all devices on core 1 are connected in SERIES in each phase (CT X2 -> TS -> device 1 in/out -> device 2 in/out -> N).

Tap X2-X4 per relay CTR 240 (1200:5). Terminal numbers of each device as shown (in / out).

DWG B-E-3302 REV A

230 kV protection, bay L2

Design issue 2023