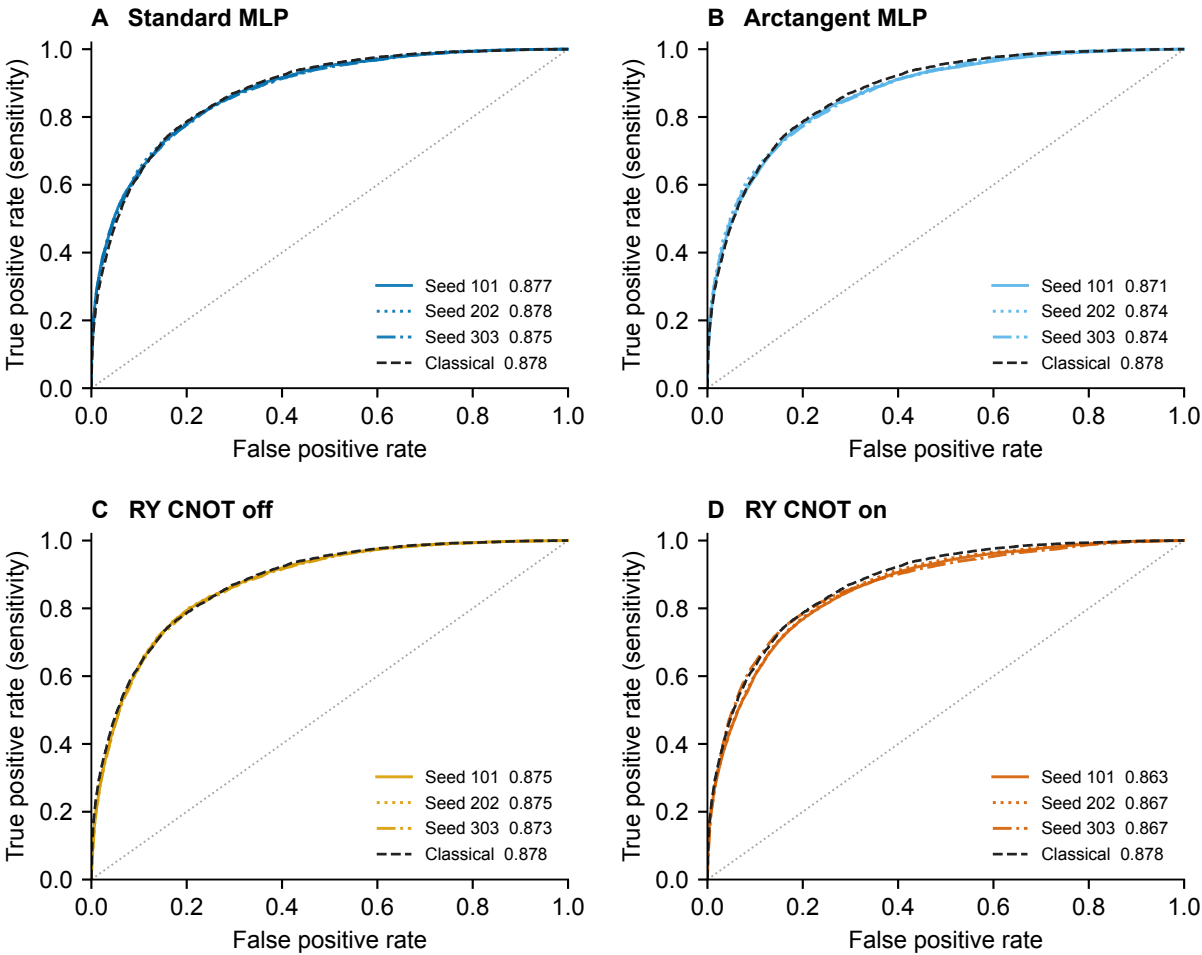

A Standard MLP
True positive rate (sensitivity)
False positive rate
Seed 101 0.877
Seed 202 0.878
Seed 303 0.875
Classical 0.878
B Arctangent MLP
True positive rate (sensitivity)
False positive rate
Seed 101 0.871
Seed 202 0.874
Seed 303 0.874
Classical 0.878
C RY CNOT off
True positive rate (sensitivity)
False positive rate
Seed 101 0.875
Seed 202 0.875
Seed 303 0.873
Classical 0.878
D RY CNOT on
True positive rate (sensitivity)
False positive rate
Seed 101 0.863
Seed 202 0.867
Seed 303 0.867
Classical 0.878