



ELEVATION — STUDY WALL

SCALE 1:25 · BOOKCASE · PANEL FOR PAINTING · WINDOW

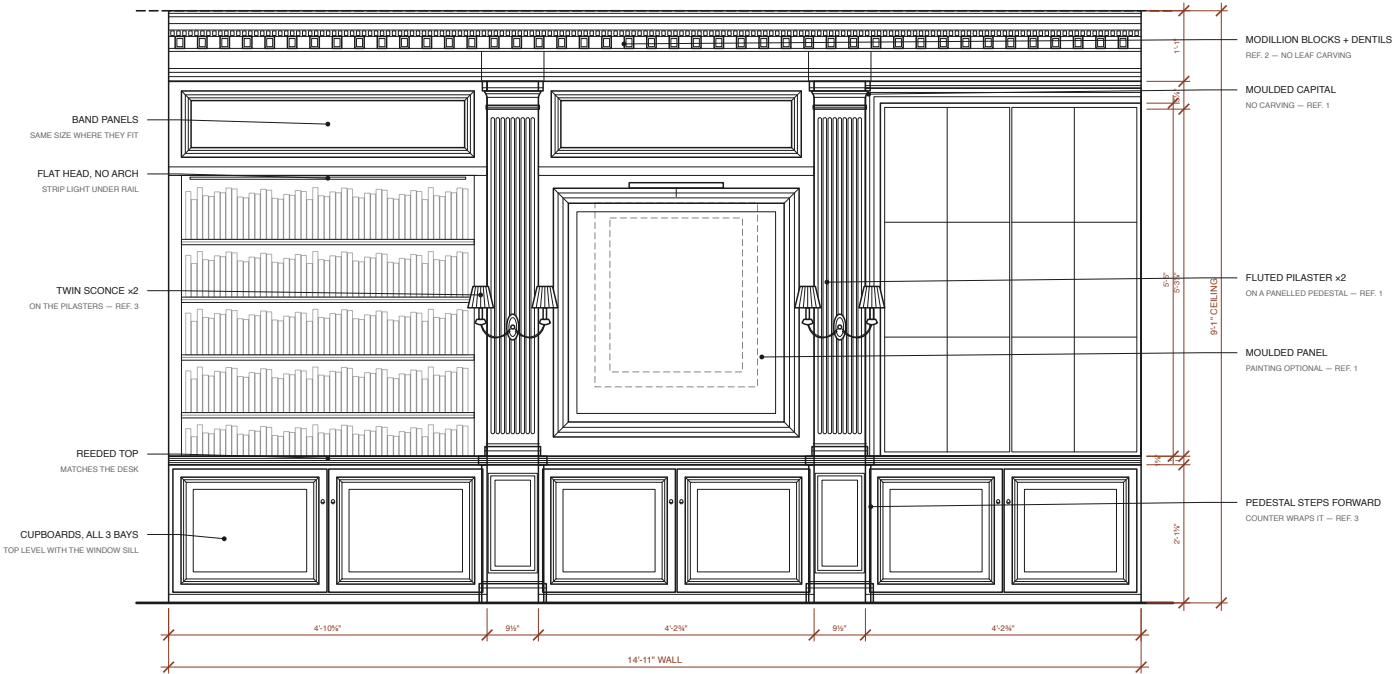


PLAN

CUT AT 1200 · SCALE 1:25 · ROOM BELOW, WALL ABOVE

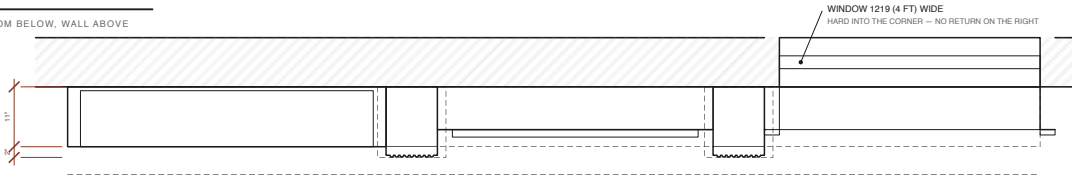

SECTION A-A

THROUGH BOOKCASE · 1:25

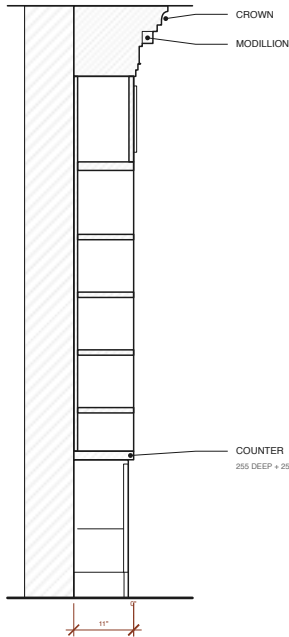

NOTES

REVISION 9

Wall 14 ft 11 in, ceiling 9 ft 1 in (measured).
Centre panel set equal to the window bay so the two
plasters frame a matched pair; the bookcase takes
the remainder as the anchor at the end of the wall.
Window measured: 4 ft wide, 5 ft 5 in tall, hard into
the right corner. Sill 2 ft 3 in (686) — CONFIRMED.
OPEN: sill 2 ft 3 + height 5 ft 5 + your 1 ft 3 to the
ceiling makes 8 ft 11, two inches short of the 9 ft 1
ceiling. Sill and height are drawn as measured, so the
head falls 1 ft 5 down, not 1 ft 3. Laser it.
Counter top is set to the sill at 686, so the two are
one surface; this datum runs on round to the right
wall rail.
Cupboards under all three bays. Gold on handles only.

A STUDY IN TEAK

Particulars of the room

STUDY WALL — GENERAL ARRANGEMENT

Elevation · Plan · Section

SCALE
AS NOTED @ A3


DATE
19.09.2026

REV
9 — sill datum confirmed at 686

DWG
AST-DR-005


1 · PILASTER

CAPITAL AND BASE · ELEVATION · SCALE 1:5 · REF. 1

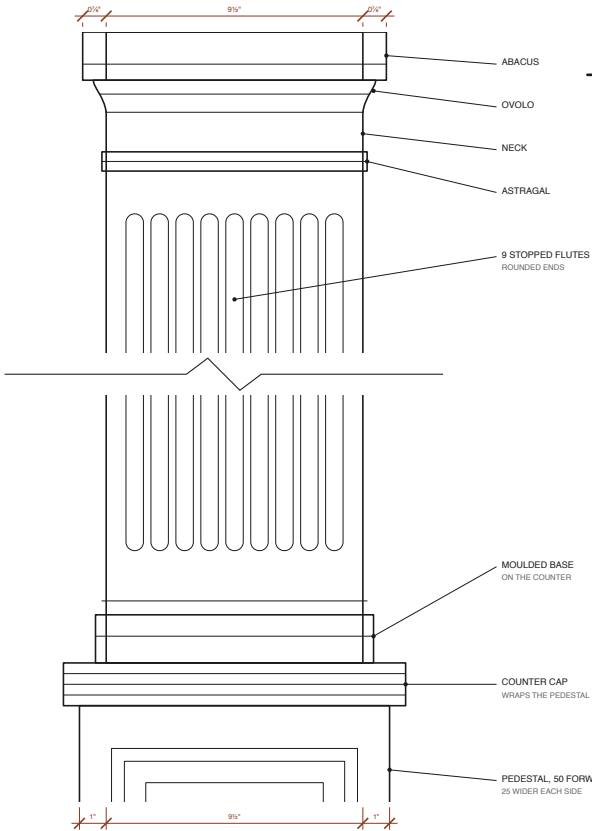


2 · PILASTER SECTION

PLAN · SCALE 1:2

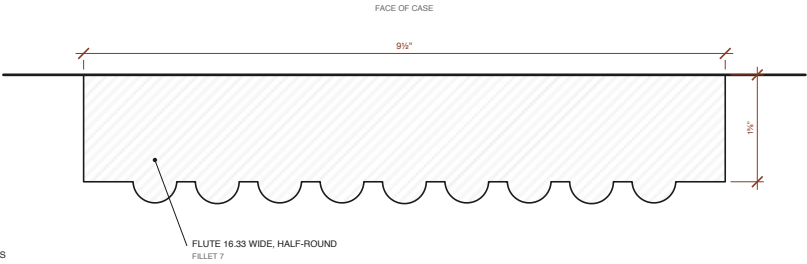


4 · MODILLION + DENTILS

FRONT · SCALE 1:2 · PLAIN

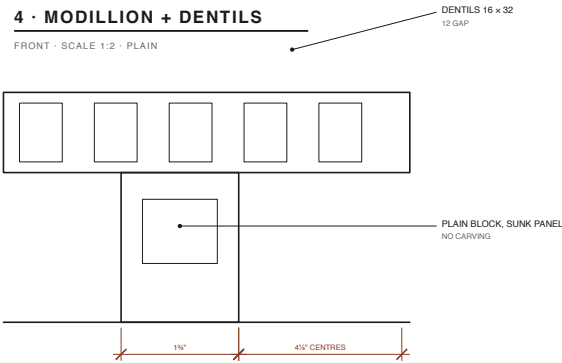


3 · CORNICE

SECTION · SCALE 1:6

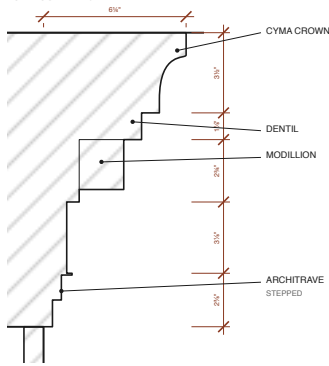


5 · PAINTING PANEL

BOLECTION MOULDING · SECTION · SCALE 1:2

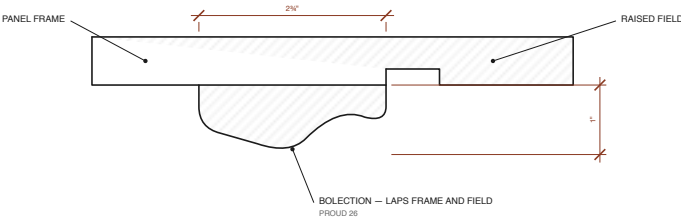


6 · BAND PANEL + SCONCE

ELEVATION · SCALE 1:25 · SAME PANEL OVER EVERY BAY

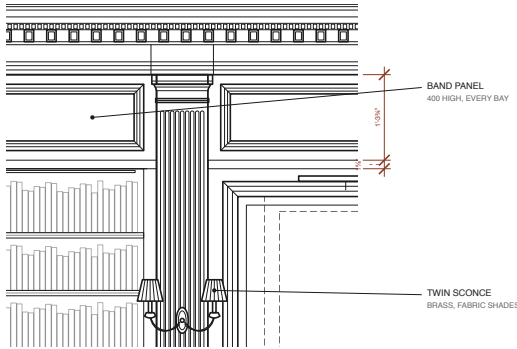

7 · COUNTER EDGE

SECTION · SCALE 1:2 · SAME REEDS AS THE DESK

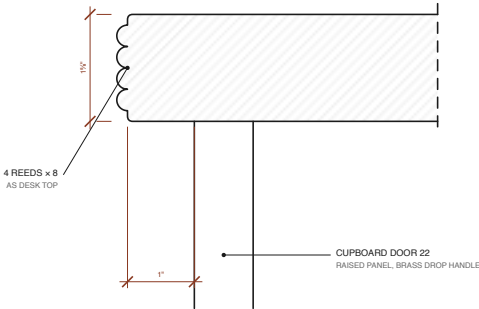

NOTES

DETAILS

No carving on pilasters or modillions — mouldings only.
Flute and modillion spacing to be set out on site
so they finish symmetrically on the wall.
Mock up profiles 3, 5 and 7 full size before cutting.

A STUDY IN TEAK

Particulars of the room

STUDY WALL — DETAILS

Pilaster · Cornice · Modillion · Panel · Band · Counter

SCALE
AS NOTED @ A3

DATE
19.09.2026

REV
9 — sill datum confirmed at 686

DWG
AST-DR-006