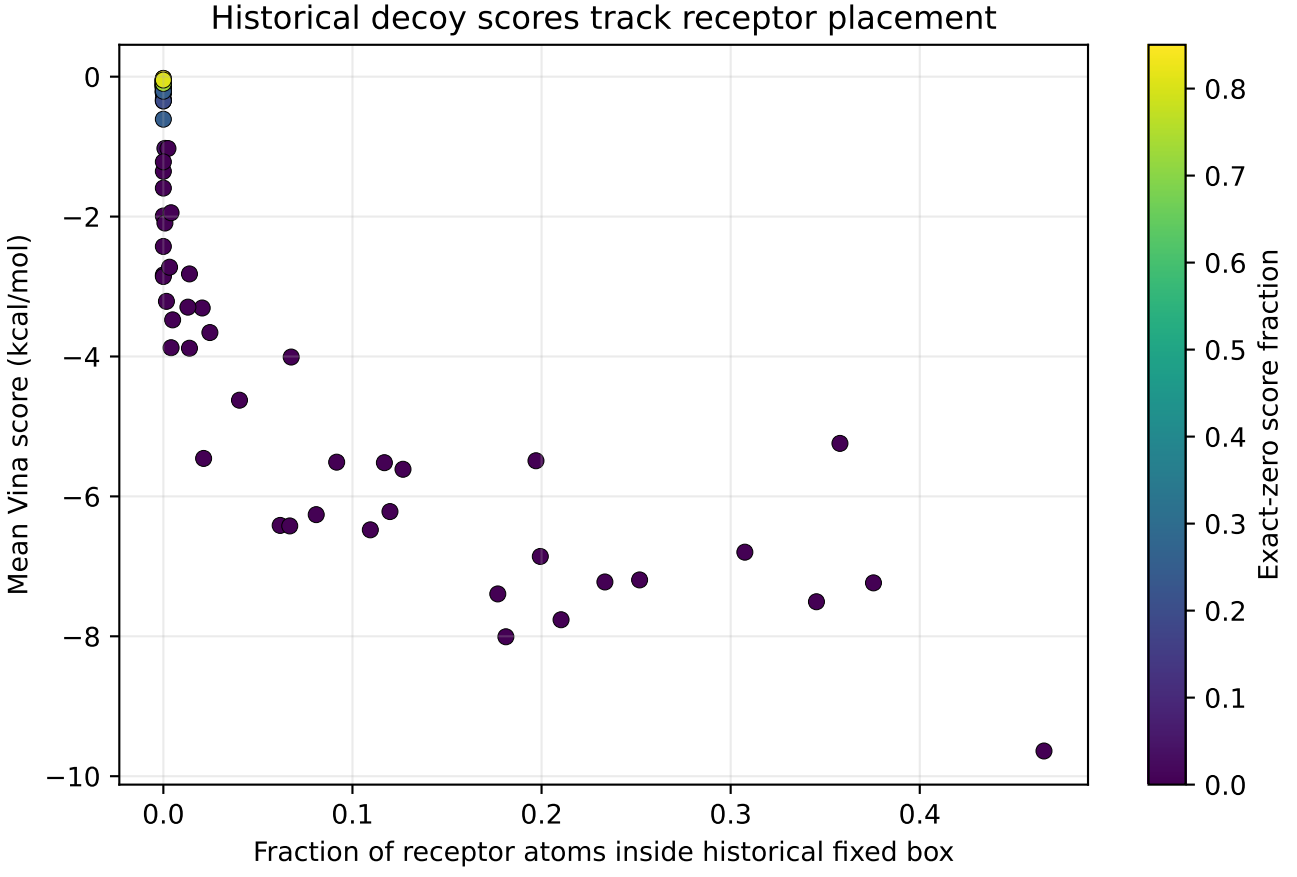
Historical decoy scores track receptor placement
Mean Vina score (kcal/mol)
0
−2
−4
−6
−8
−10
0.0
0.1
0.2
0.3
0.4
Fraction of receptor atoms inside historical fixed box
Exact-zero score fraction
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
0.8