




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

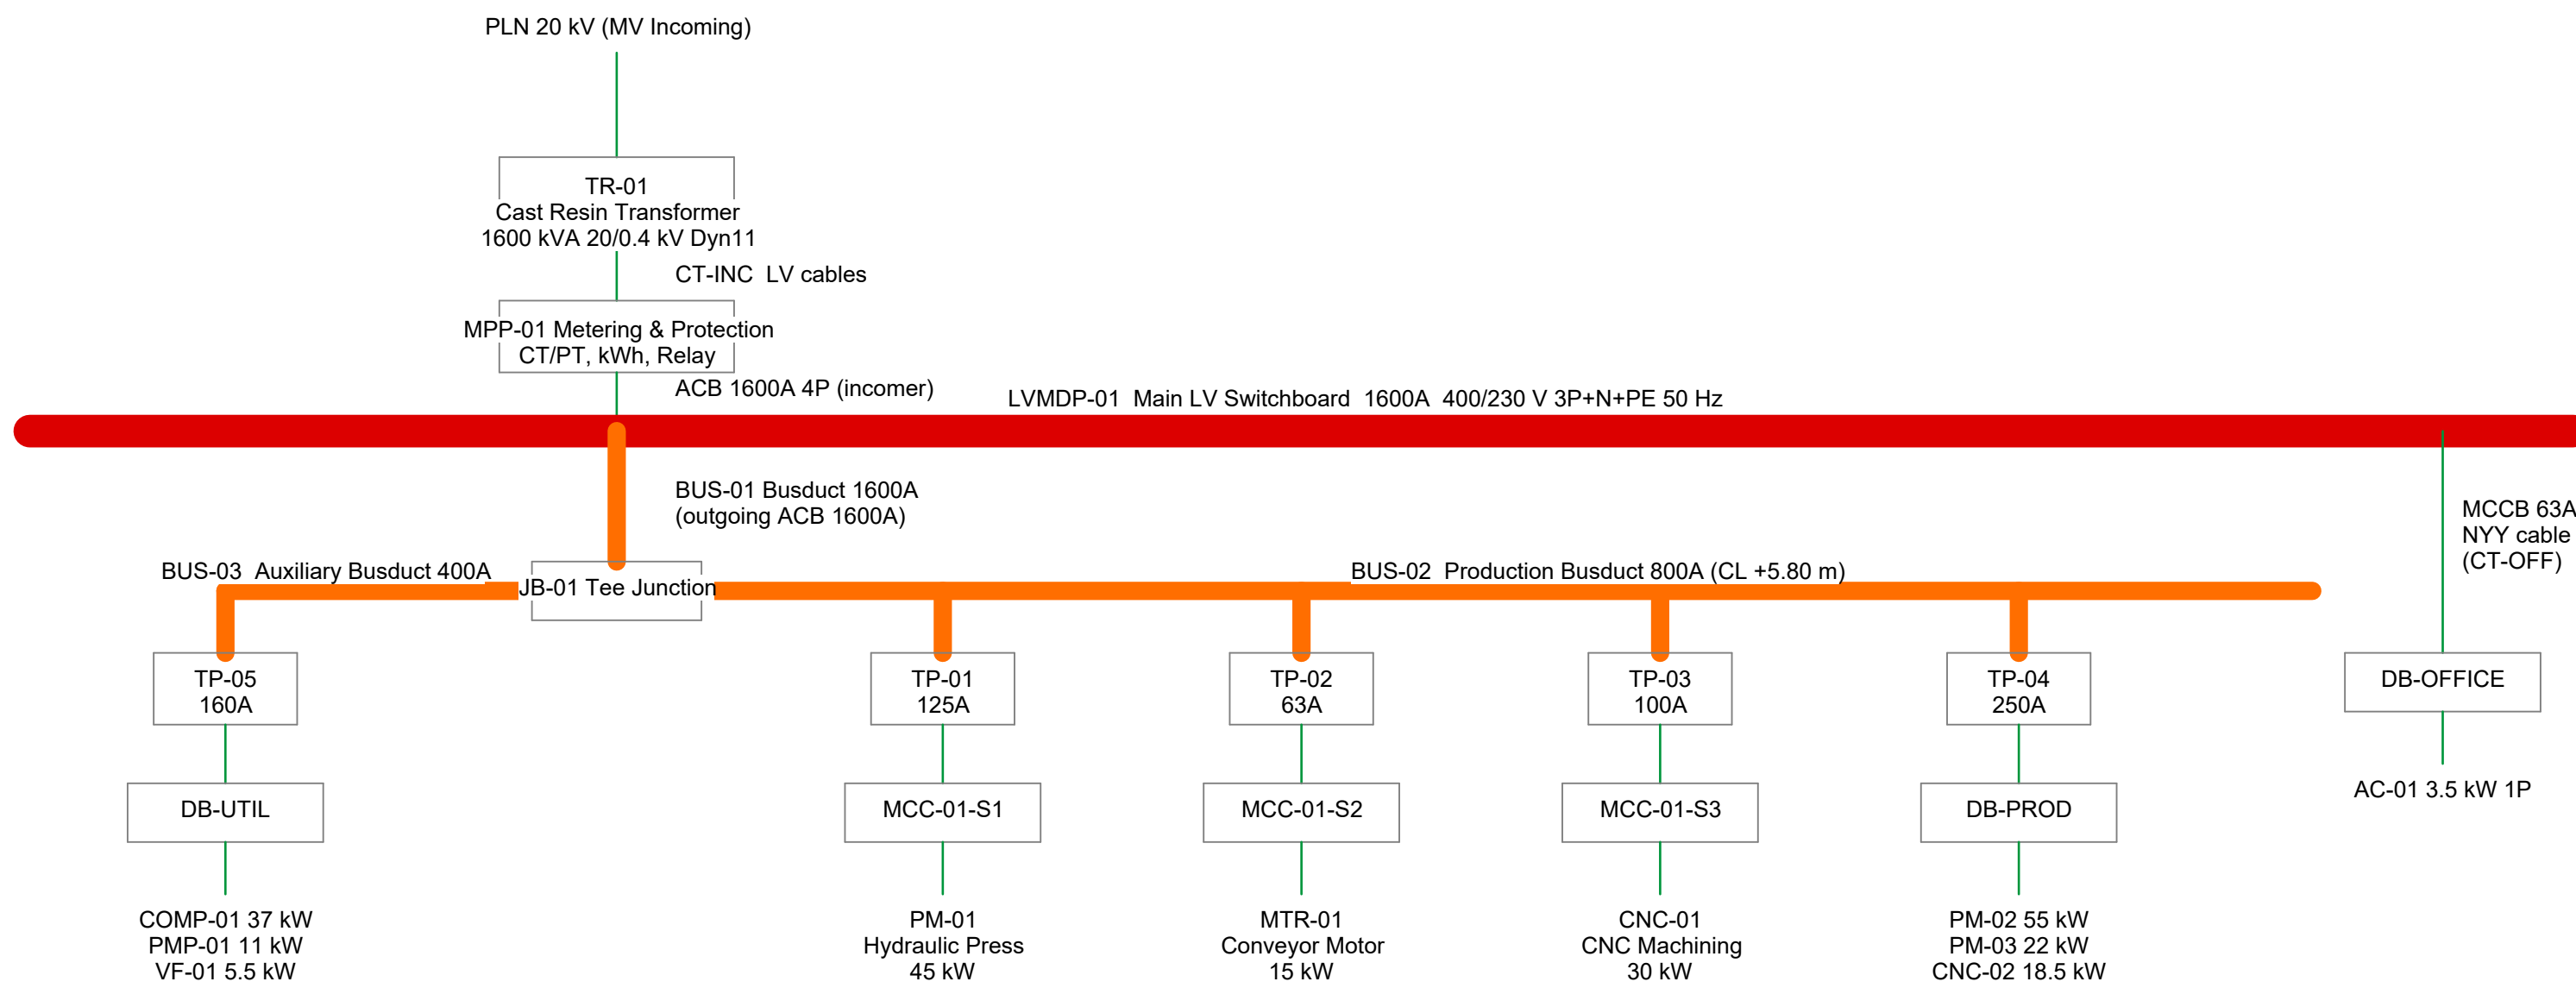

LEGENDA: Oranye tebal = Busduct | Merah = Busbar LVMDP | Hijau = Kabel / cable tray feeder

CATATAN: Semua rating (kVA, A, kW, ukuran kabel) adalah CONTOH LATIHAN. Nilai final wajib berdasarkan load calculation, voltage drop, short-circuit calculation, protection coordination, dan standar/proyek yang berlaku (mis. PUIL 2020 / IEC 60364 / IEC 61439-6).

SLD-01 Single Line Diagram

1 (Simplified)

1 : 100

ALUR SISTEM: Transformer TR-01 -> LVMDP-01 -> Main Busduct BUS-01 (1600A) -> JB-01 -> BUS-02 (800A) / BUS-03 (400A) -> Tap-off TP-01..05 -> MCC-01 / DB -> Industrial Loads

WARNA (View Filter): Oranye = Busduct | Kuning = Tap-off | Merah = TR & LVMDP | Biru = MCC/DB | Hijau = Feeder tray | Cyan = Outgoing tray | Ungu = Beban

SISTEM: 400/230 V, 50 Hz, 3P+N+PE (TN-S). Distribution System Revit: "400/230V 3P4W 50Hz". Busduct & tap-off = family Electrical Equipment (tanpa kategori busduct native di Revit). Koneksi panel-beban & panel-LVMDP dibuat sebagai Revit Power Circuit (native) -> panel schedule & total beban otomatis. Jalur busduct dicatat di komentar circuit & parameter Connected From/To.

SEMUA RATING = CONTOH LATIHAN, bukan hasil electrical calculation final.

[illegible]

Latihan BIM / Portfolio

Industrial Facility - Busduct Distribution

Single Line Diagram & Legend

Project number	IND-BD-003
Date	25-09-2026
Drawn by	Claude
Checked by	Checker
E-000	
Scale	1 : 100




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

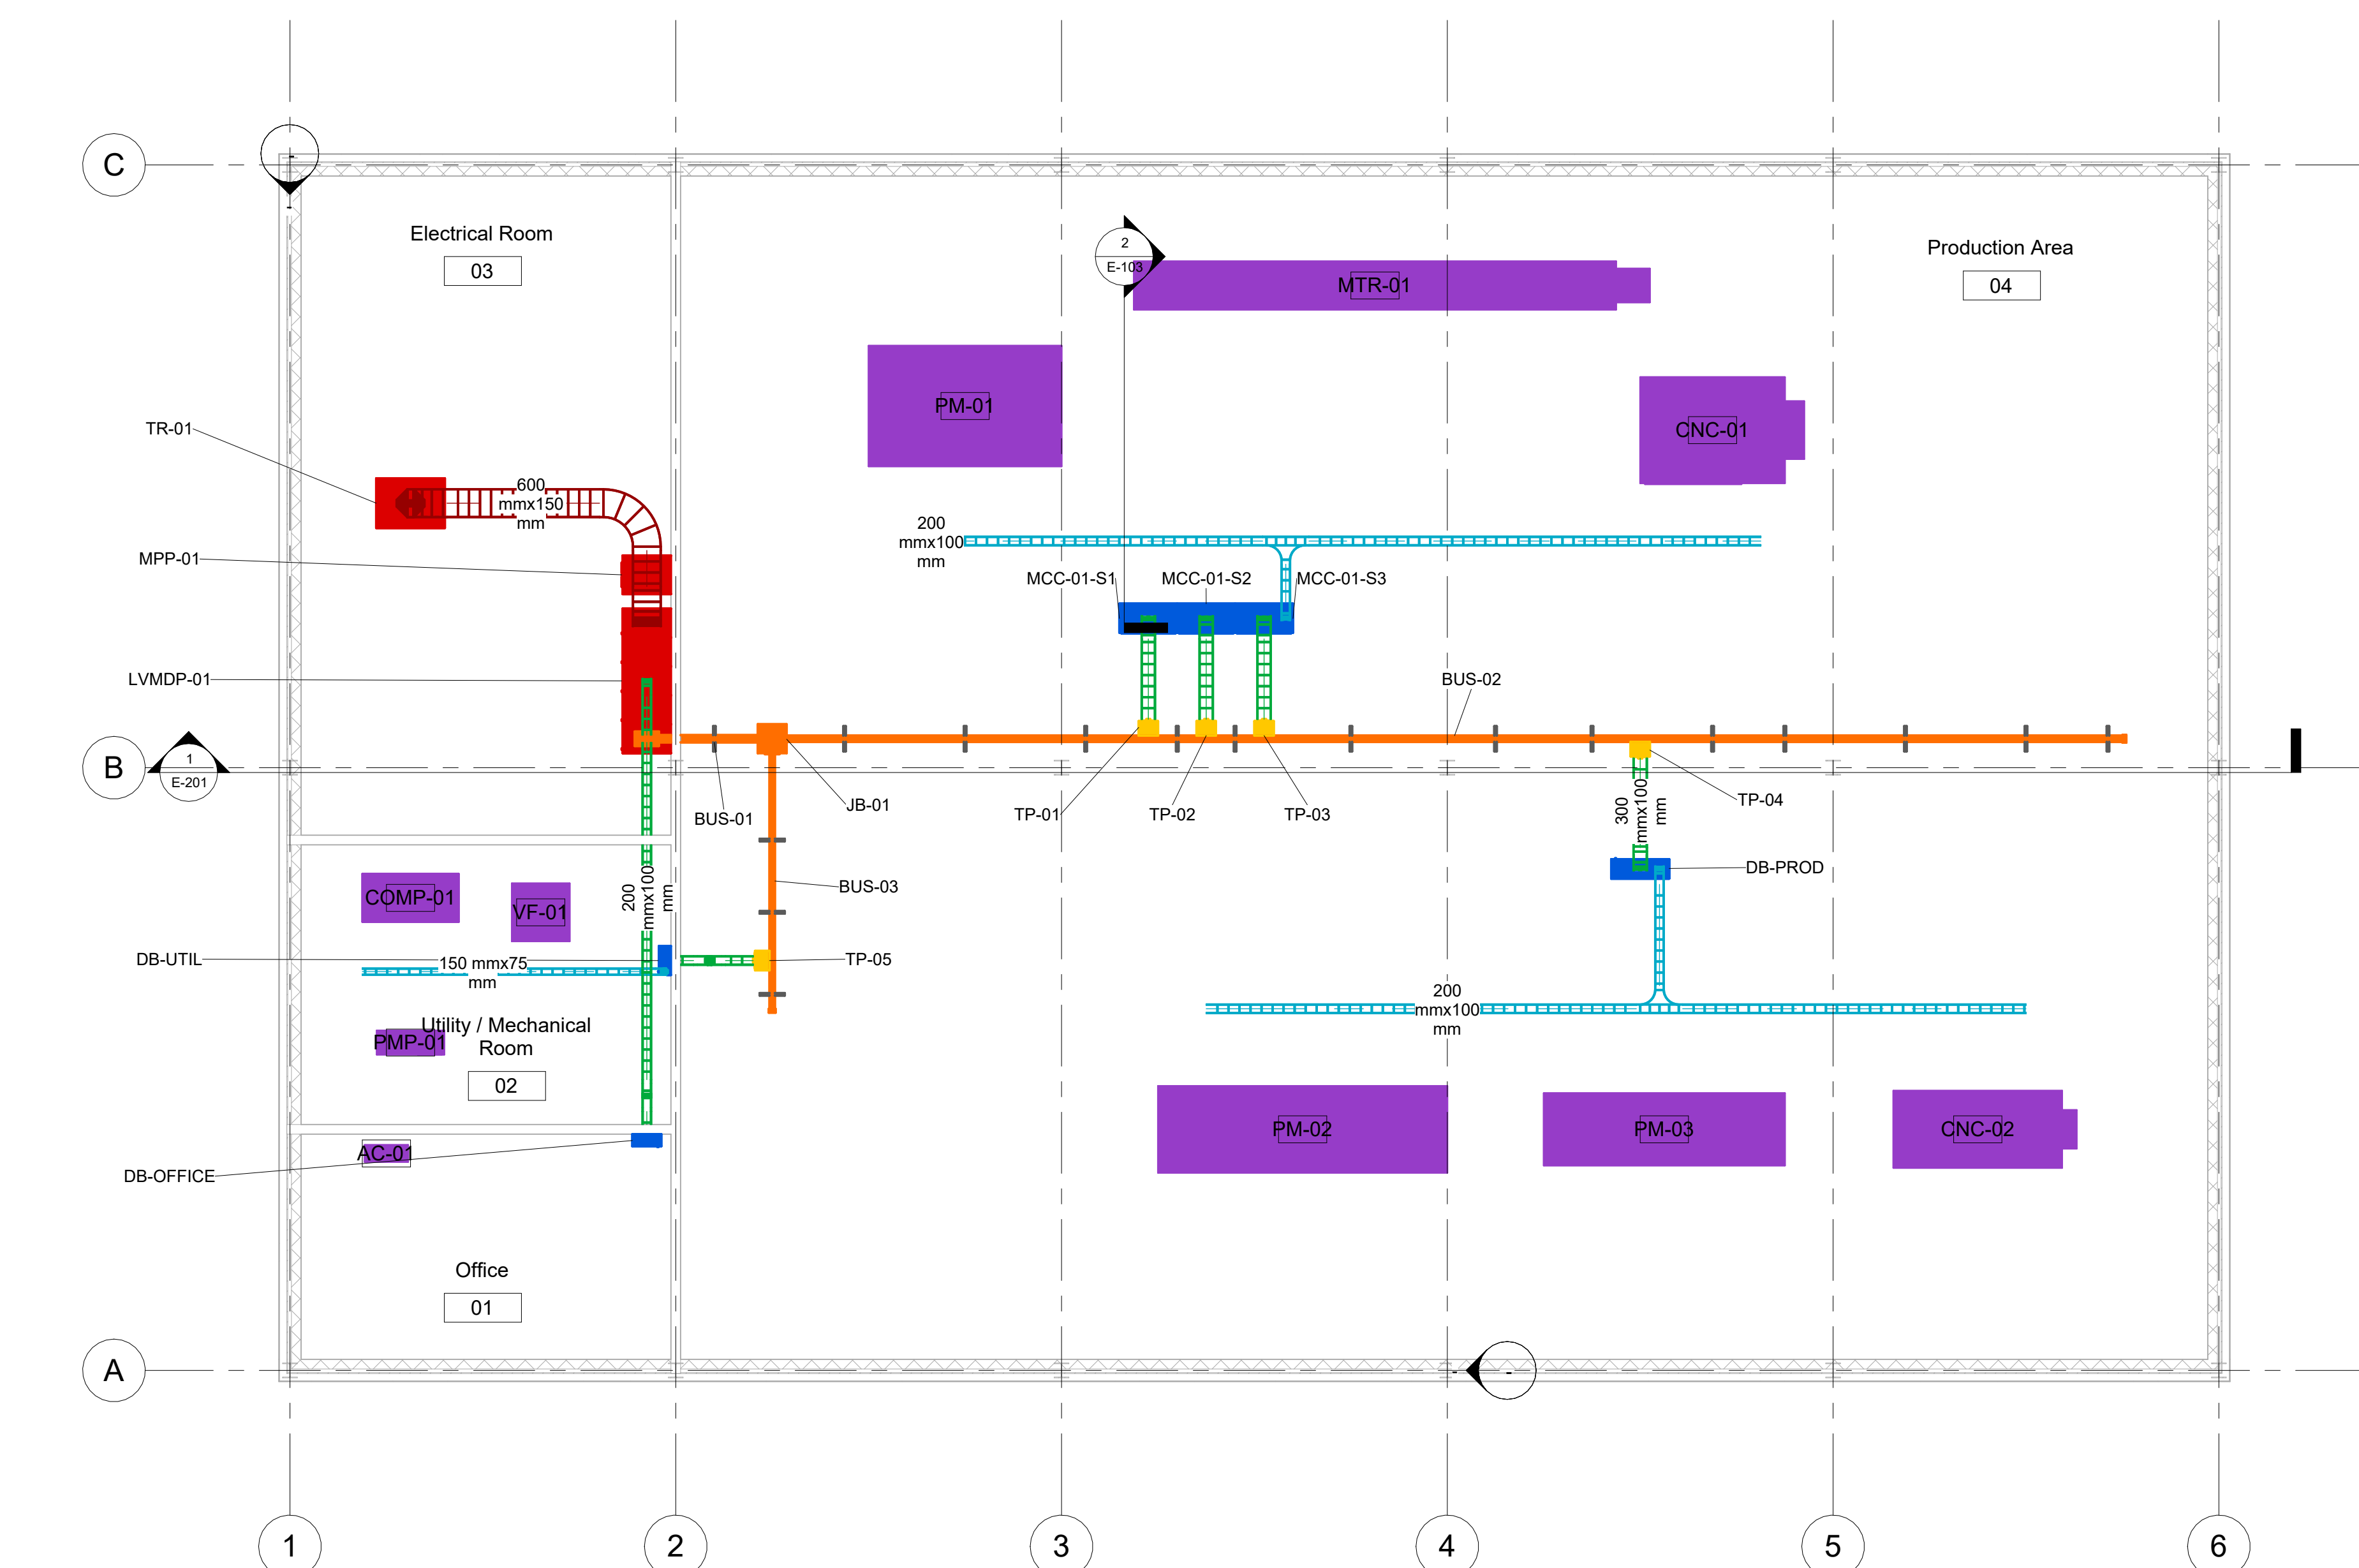

1 EL-01 Electrical Layout Plan
1 : 100

[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Electrical Layout Plan

Project number	IND-BD-003
Date	25-09-2026
Drawn by	Claude
Checked by	Checker
E-101	
Scale	1 : 100




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

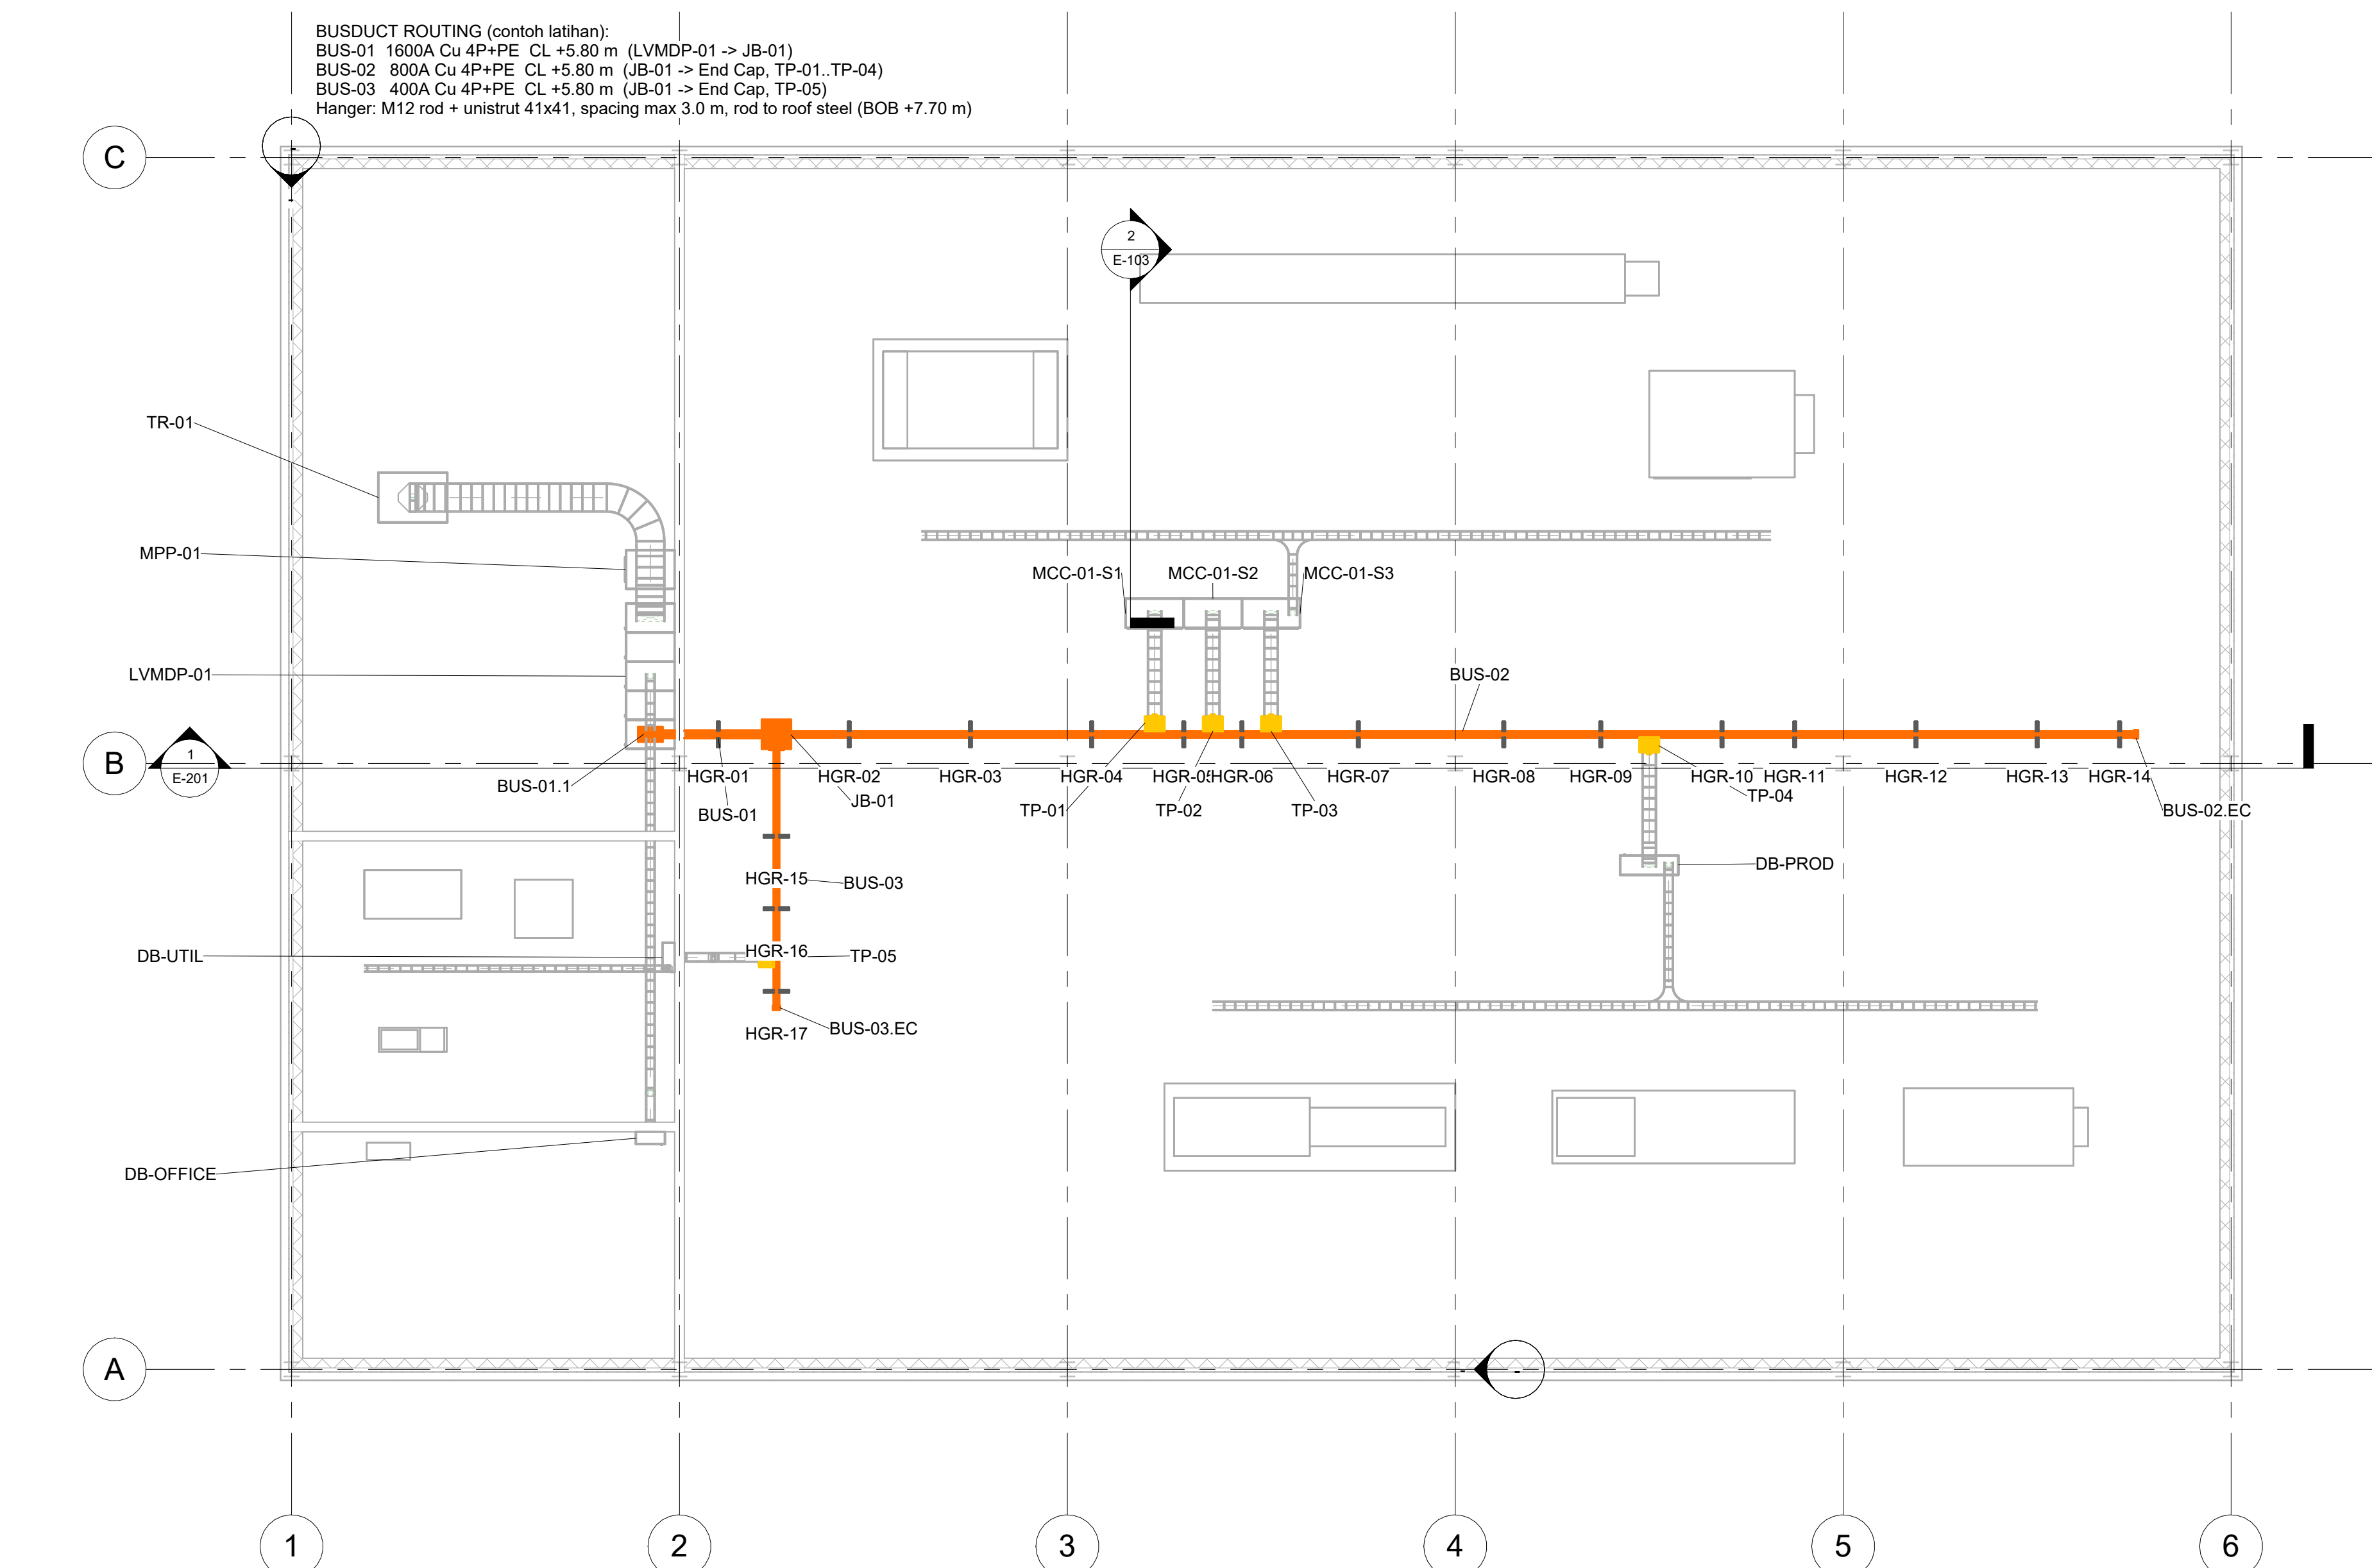

1 EL-02 Busduct Layout Plan
1 : 100

[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Busduct Layout Plan

Project number	IND-BD-003
Date	25-09-2026
Drawn by	Claude
Checked by	Checker
E-102	
Scale	1 : 100



www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Latihan BIM / Portfolio

Industrial Facility - Busduct Distribution

Electrical Room & Section B-B

Project number	IND-BD-003
----------------	------------

Date 25-09-2026


Drawn by Claude

Checked by	Checker
------------	---------

E-103


Scale 1 : 50

25/09/2026 13.52.25

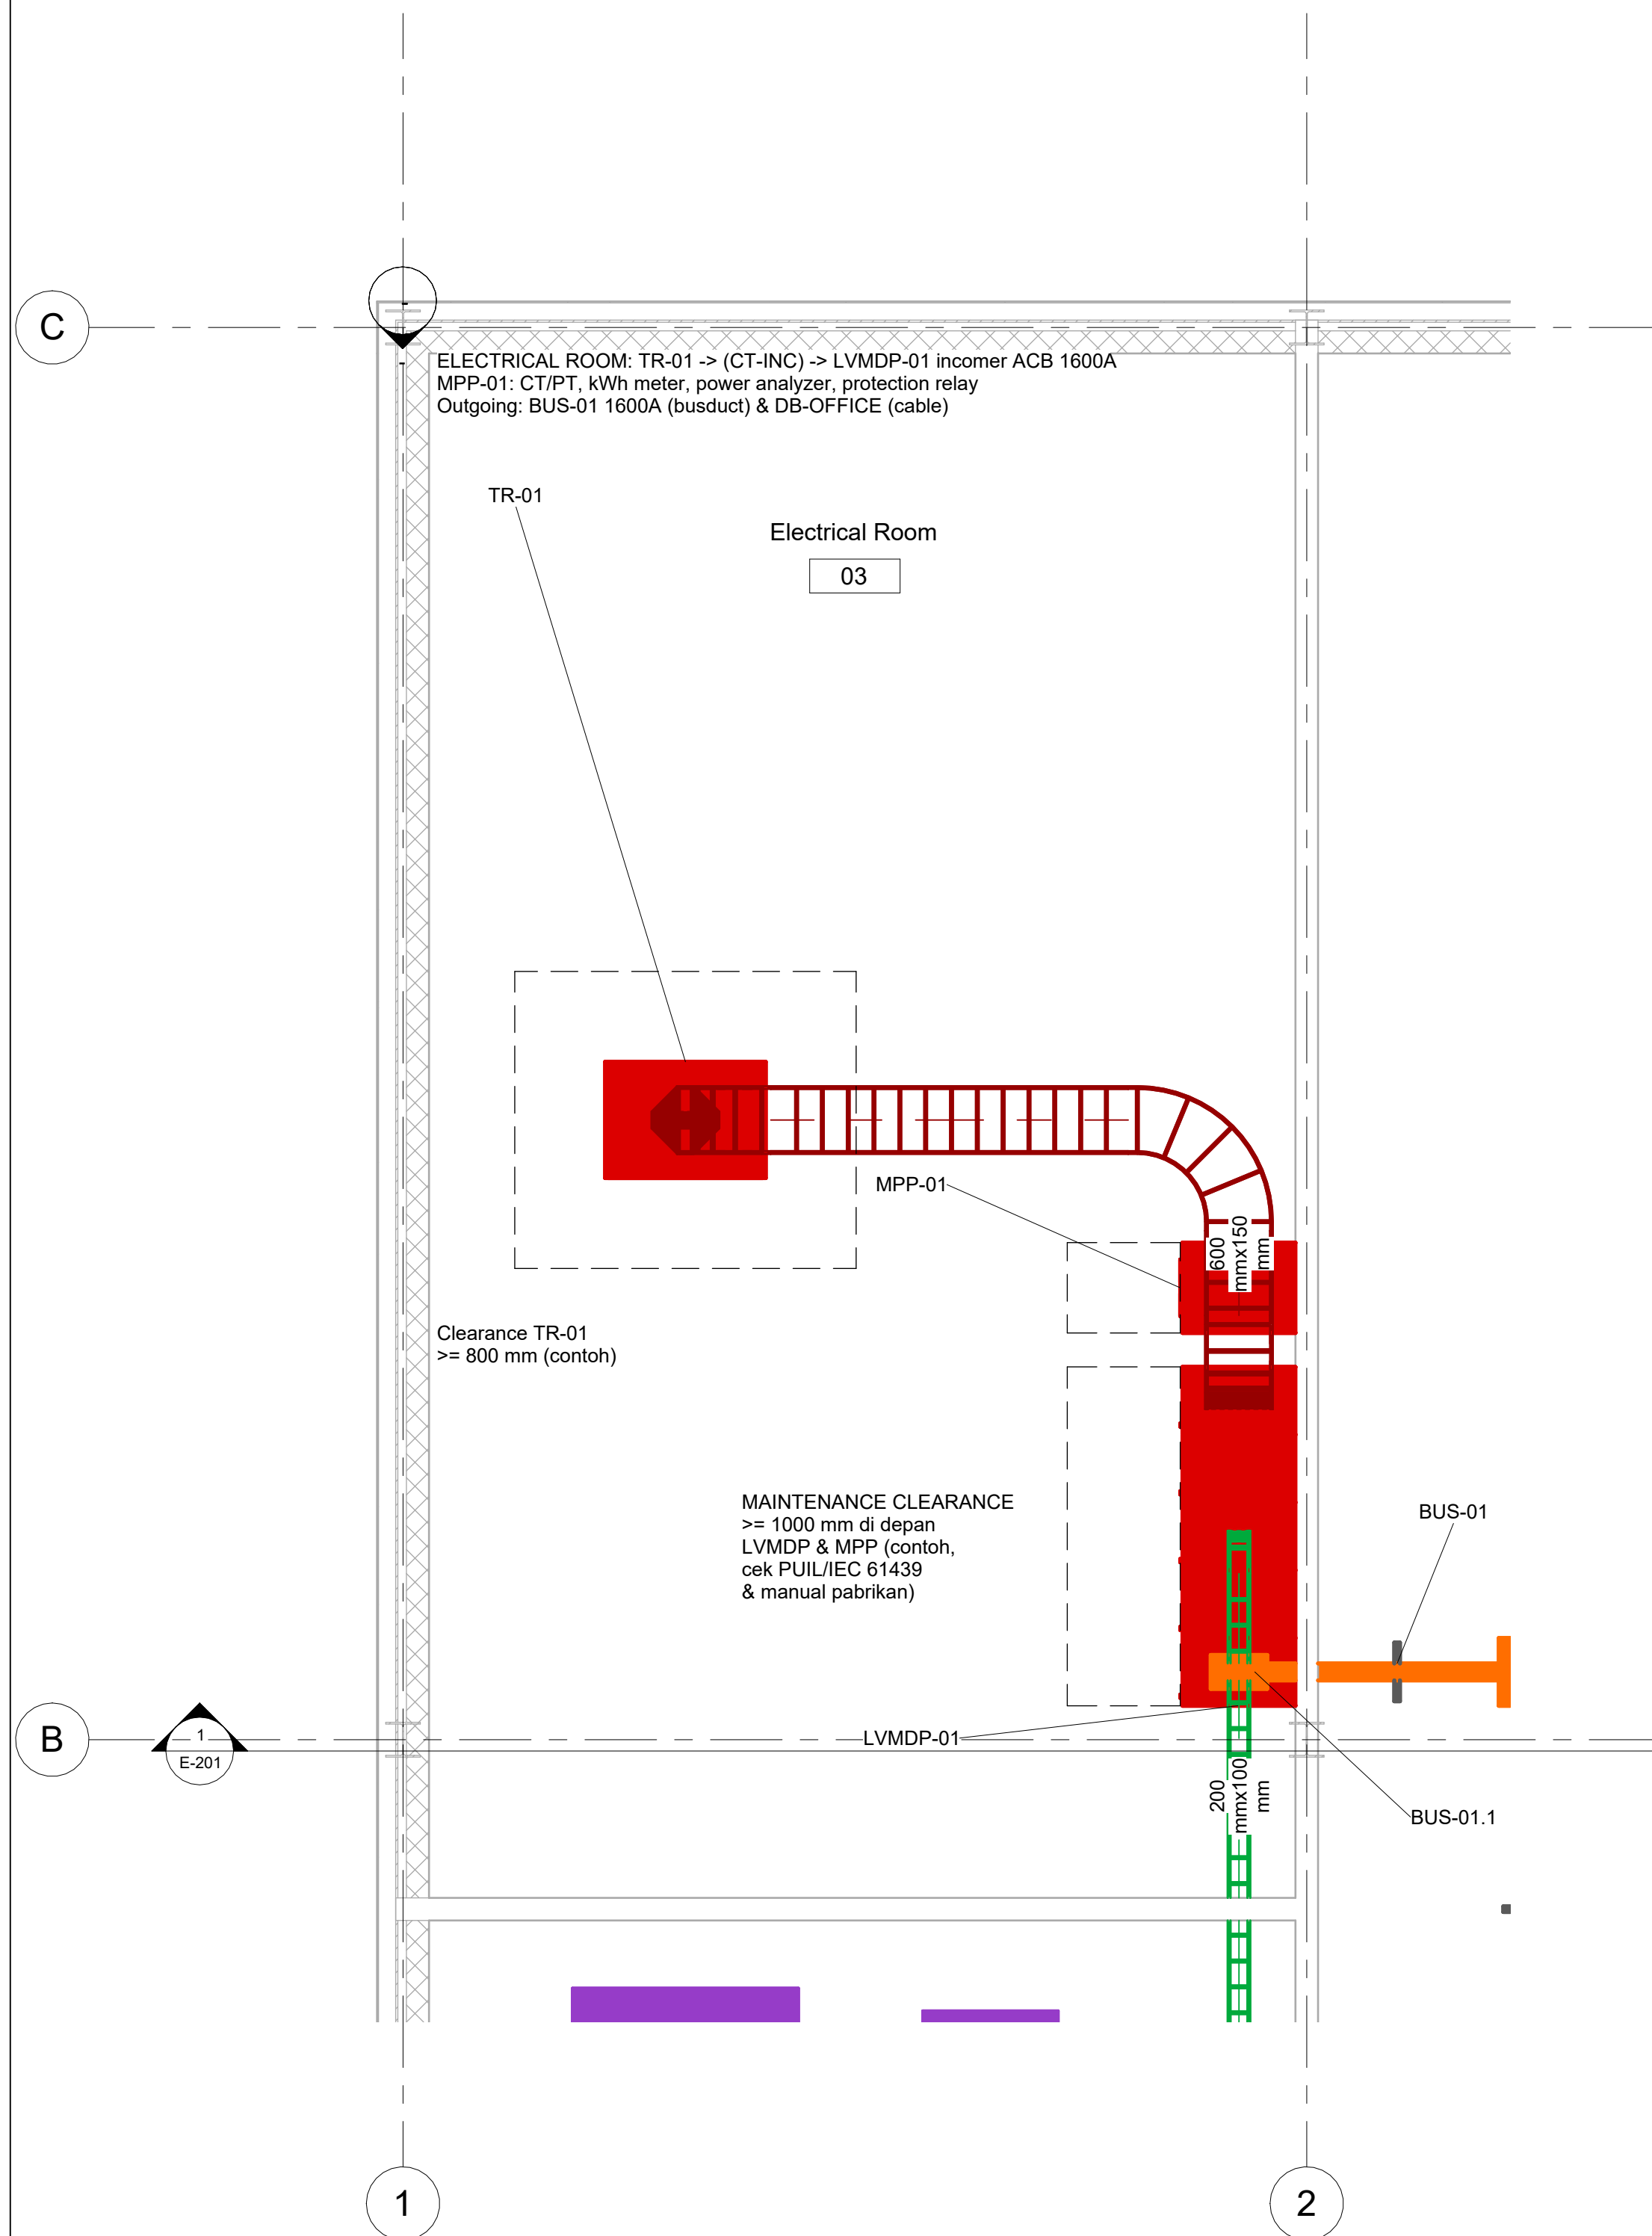

EL-03 Electrical Room Plan

1 : 50

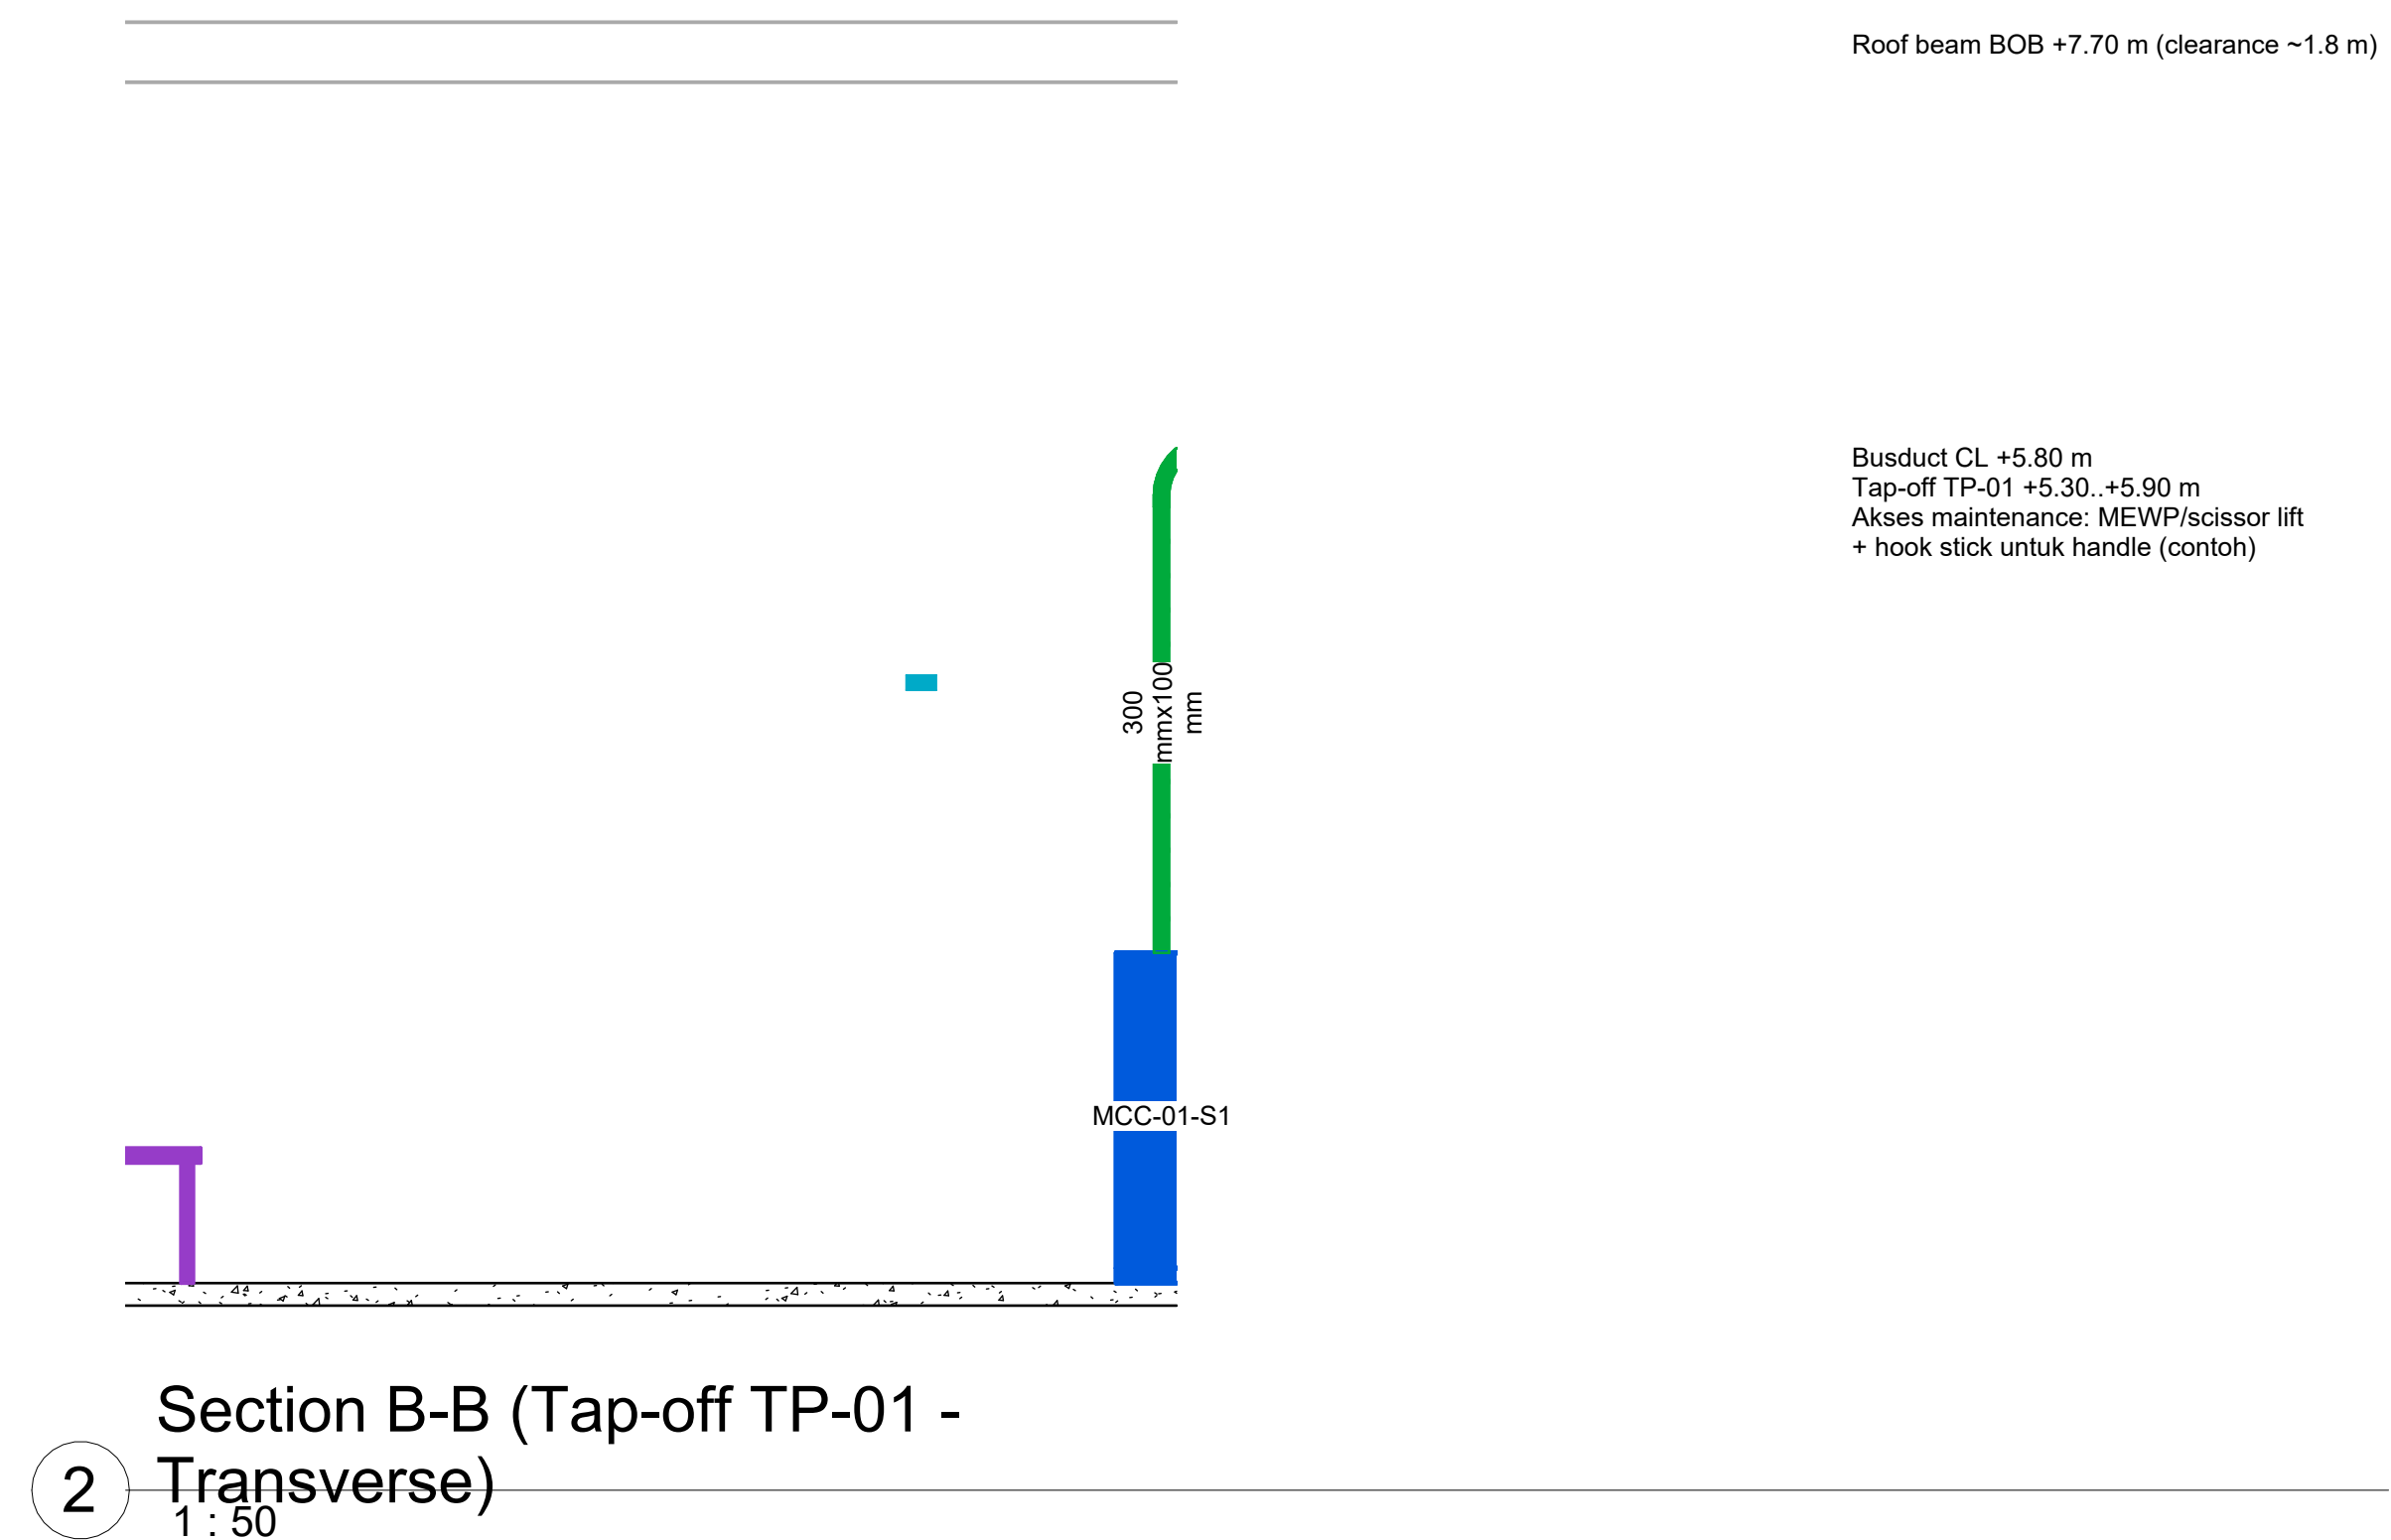

Section B-B (Tap-off TP-01 - Transverse)

1 : 50




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

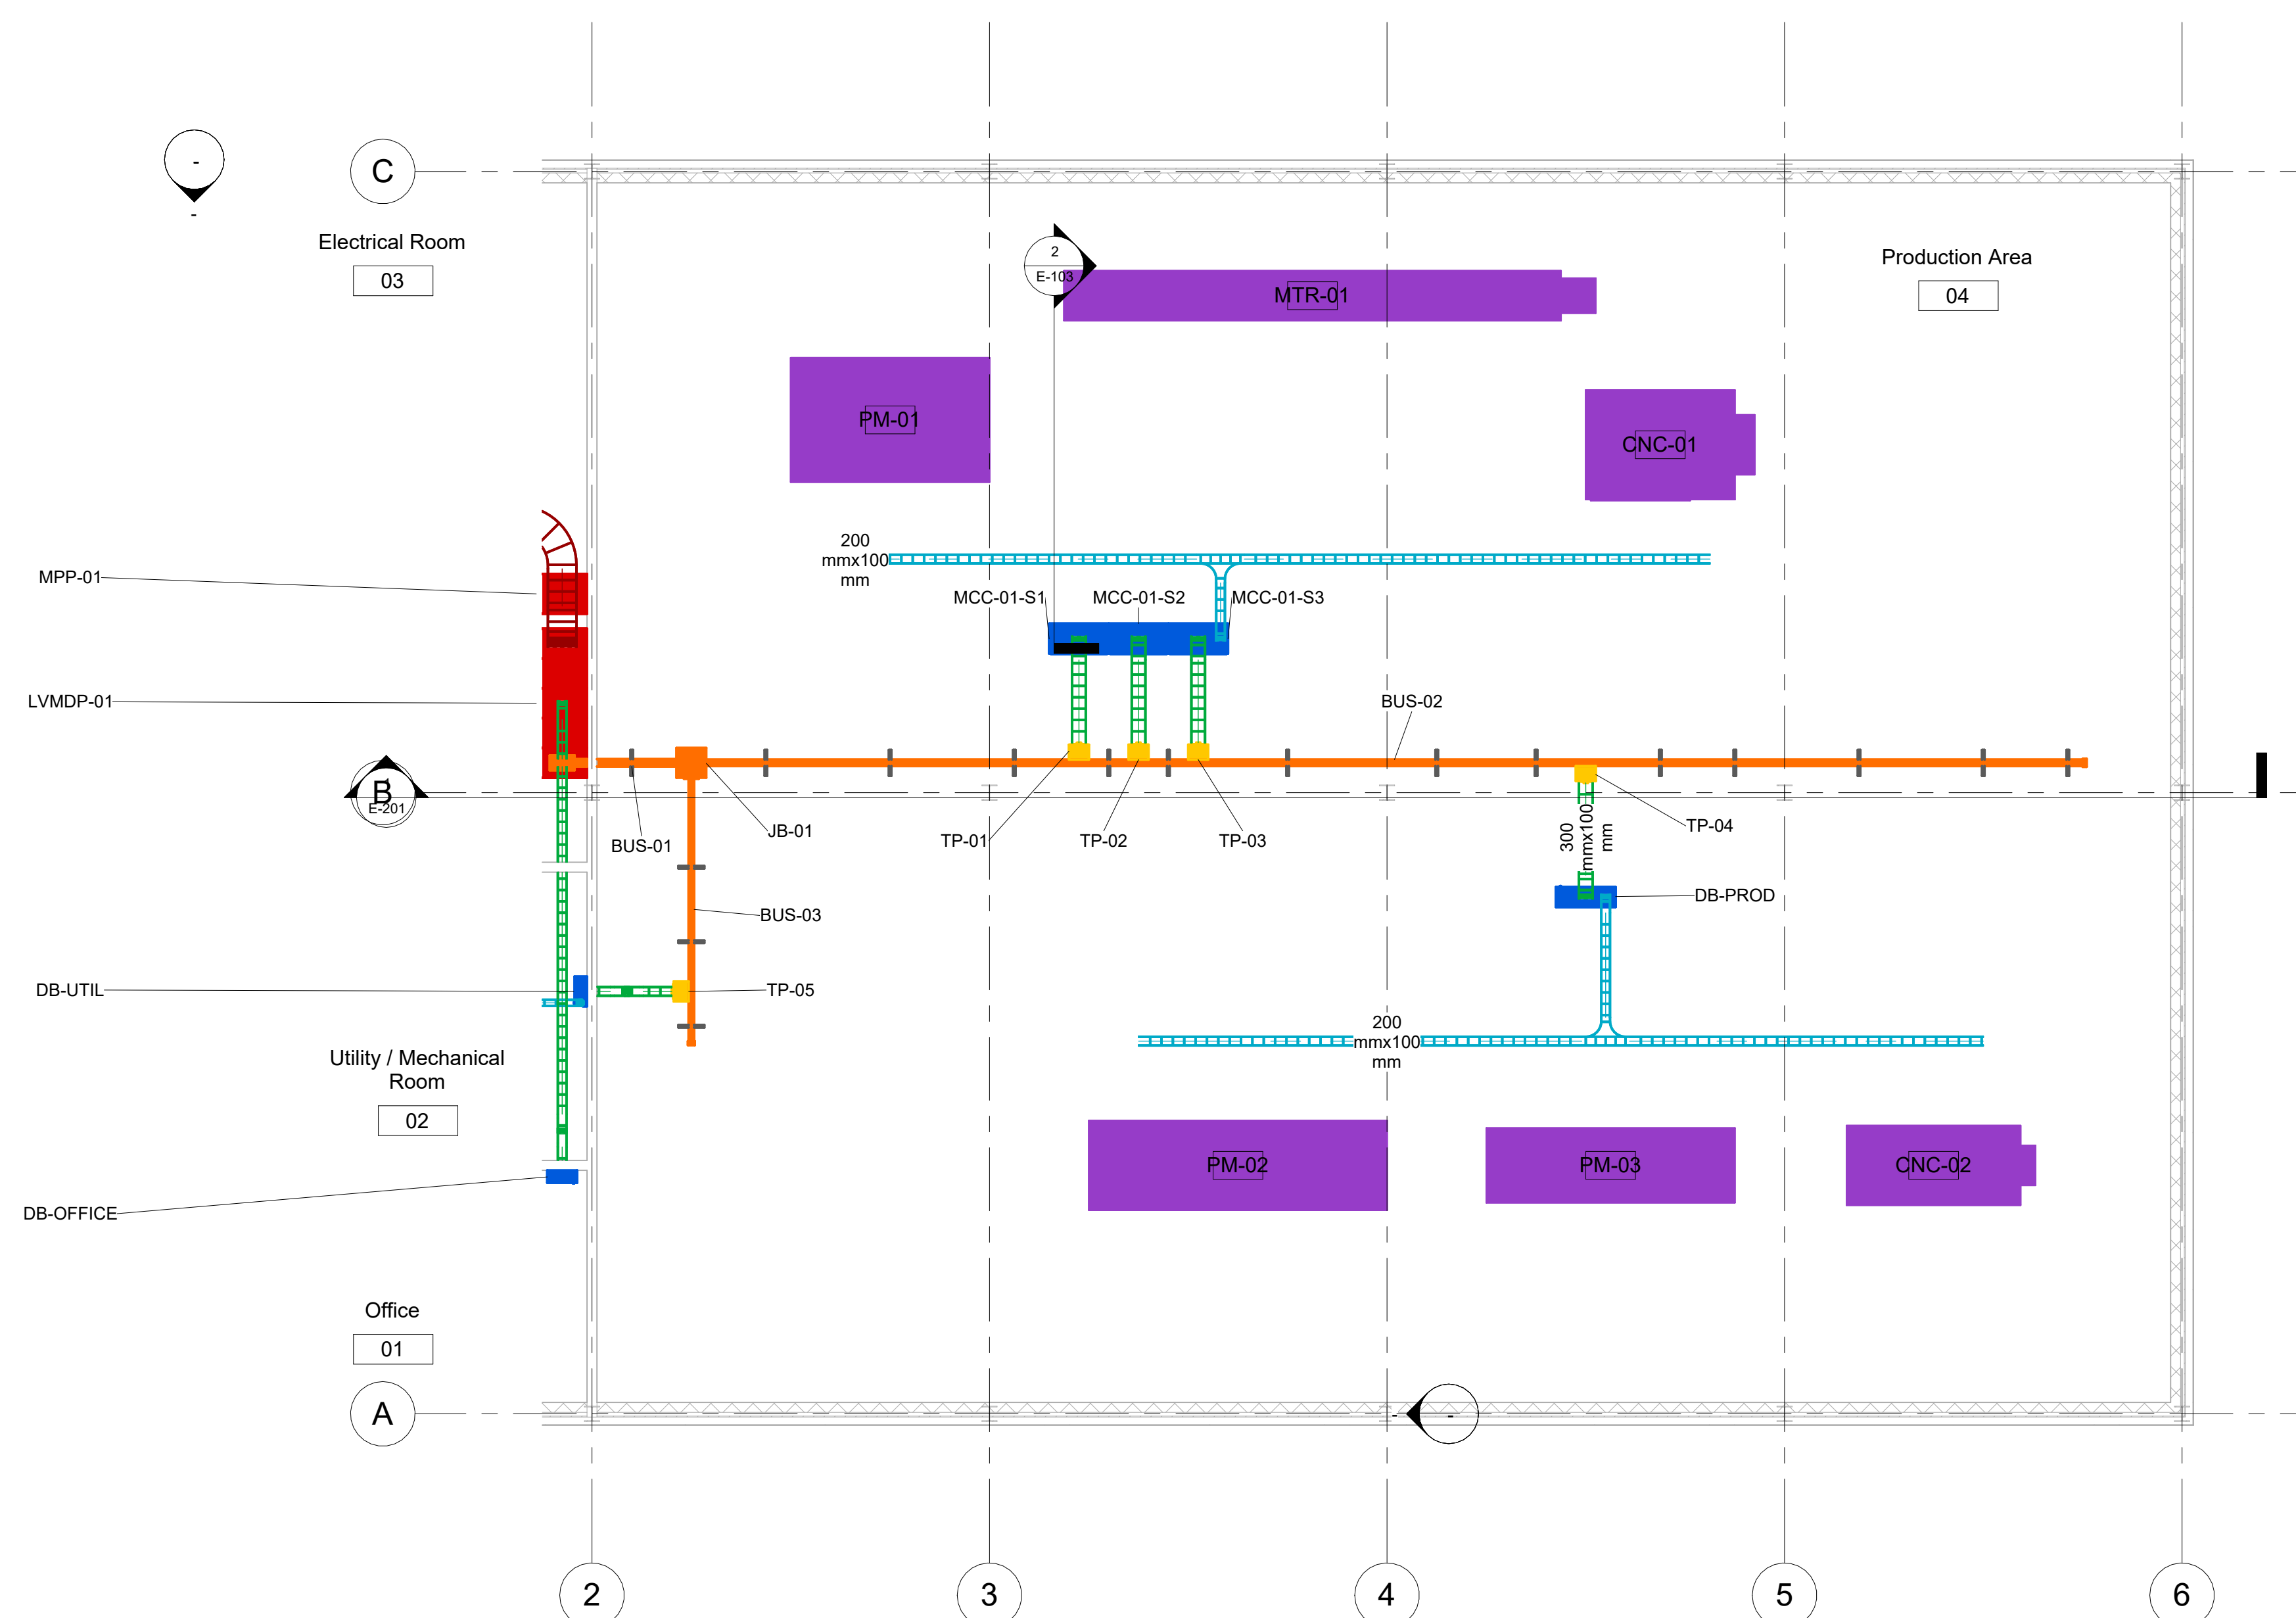

EL-04 Production Area Plan

1 : 100

[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Production Area Plan

Project number	IND-BD-003
Date	25-09-2026
Drawn by	Claude
Checked by	Checker

E-104

Scale	1 : 100
-------	---------




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

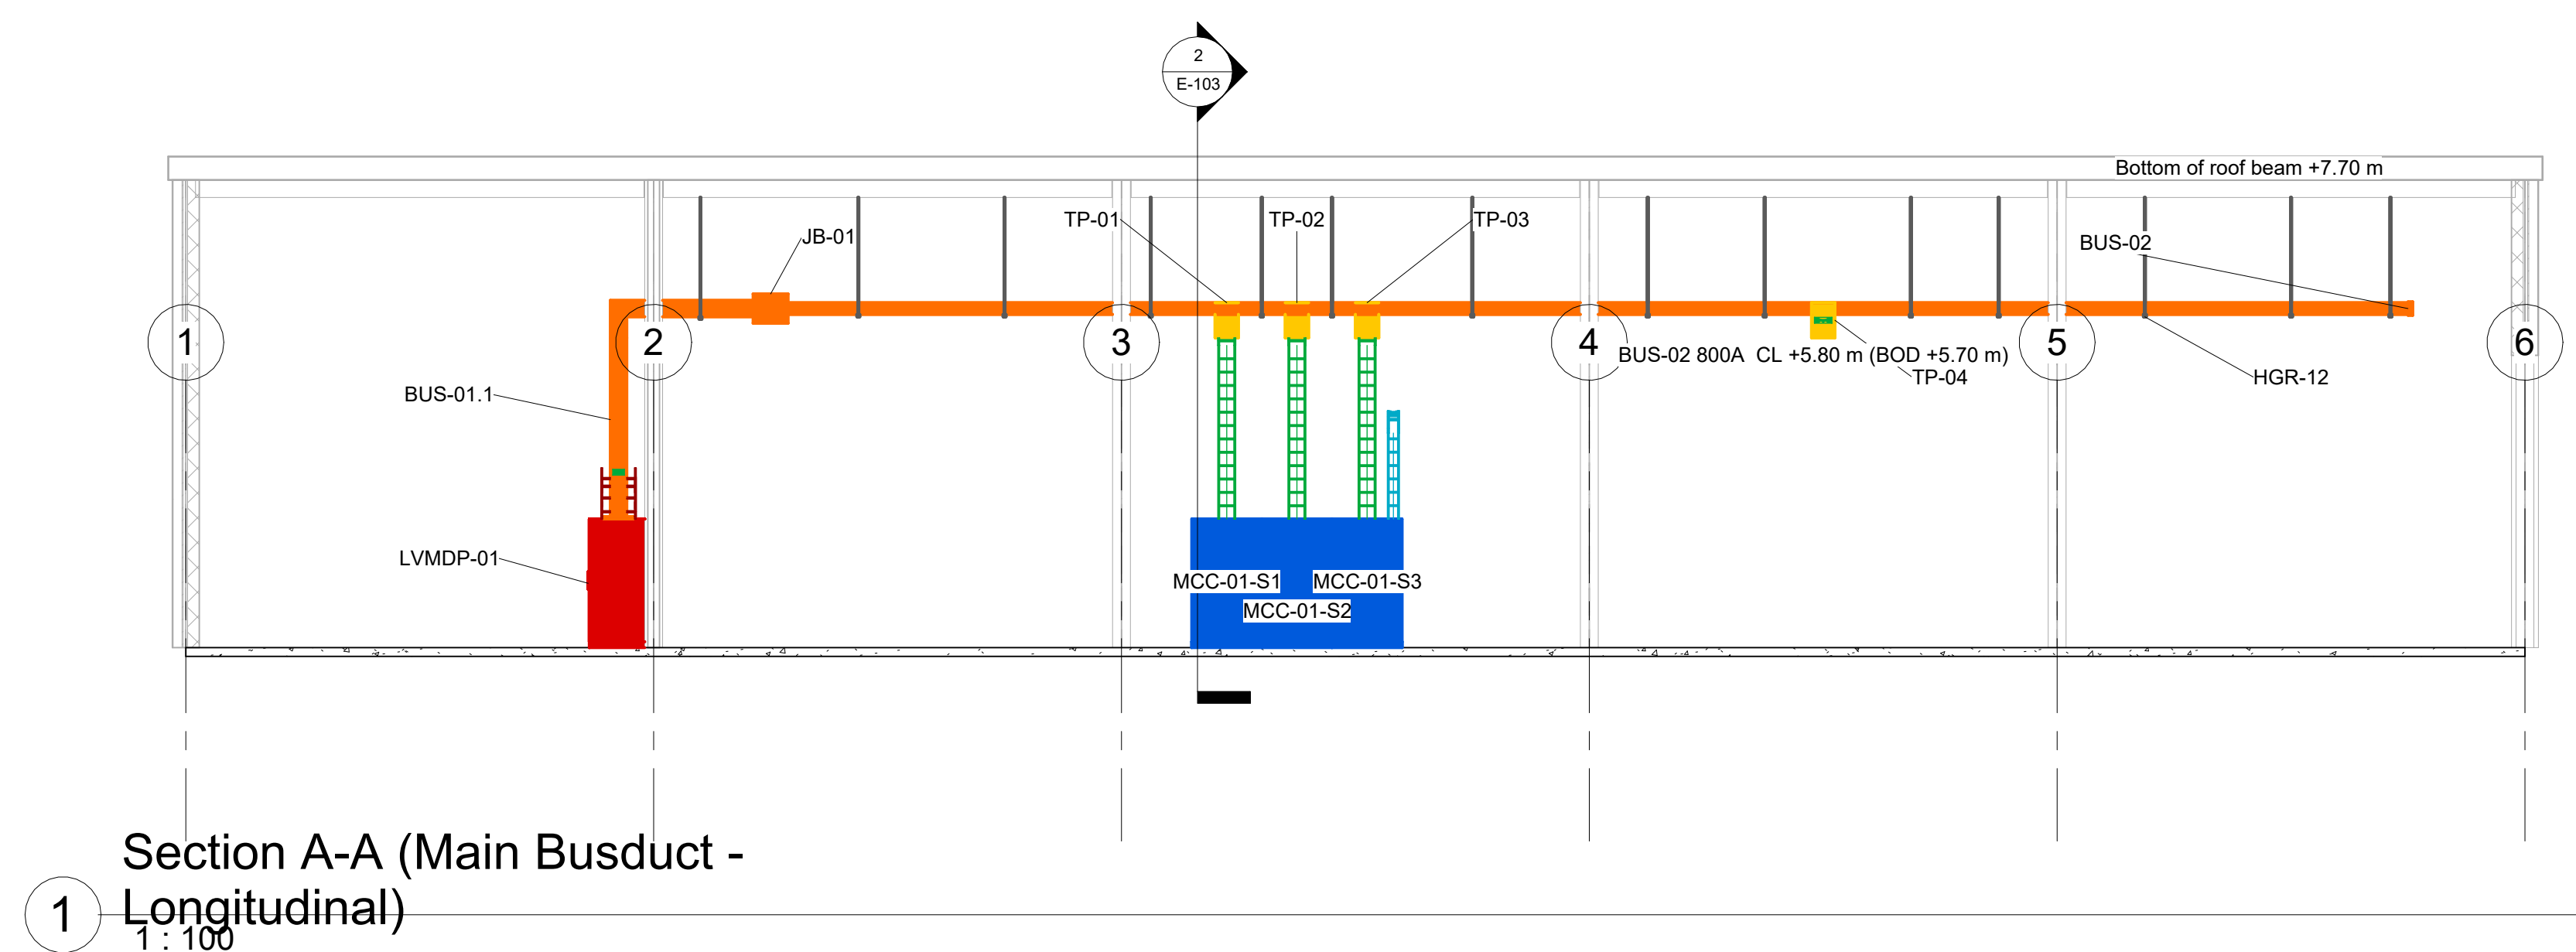[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Section A-A (Main Busduct)

Project number	IND-BD-003
----------------	------------

Date	25-09-2026
------	------------

Drawn by	Claude
----------	--------

Checked by	Checker
------------	---------

E-201

Scale	1 : 100
-------	---------

[illegible]

Branch Panel: DB-PROD																			
Location: Production Area 04				Volts: 400/230V 3P4W 50Hz				A.I.C. Rating:											
Supply From: LVMDP-01				Phases: 3				Mains Type:											
Mounting:				Wires: 4				Mains Rating:											
Enclosure:				MCB Rating: 1 A															
Notes:																			
CKT	Circuit Description	Trip	Poles	A		B		C	Poles	Trip	Circuit Description		CKT						
1	PM-02	125 A	3	2156...	8633...					63 A	PM-03		2						
3	--	--	--			2156...	8633...			--	--	--	4						
5	--	--	--					2156...	8633...	--	--	--	6						
7	CNC-02	50 A	3	7267...									8						
9	--	--	--			7267...							10						
11	--	--	--					7267...					12						
13													14						
15													16						
17													18						
19													20						
21													22						
23													24						
25													26						
27													28						
29													30						
31													32						
33													34						
35													36						
37													38						
39													40						
41													42						
Total Load:				37467 VA		37467 VA		37467 VA											
Total Amps:				163 A		163 A		163 A											
Legend:																			
Load Classification				Connected Load		Demand Factor		Estimated Demand		Panel Totals									
Other				112400 VA		100.00%		112400 VA											
										Total Conn. Load: 112400 VA									
										Total Est. Demand: 112400 VA									
										Total Conn.: 162 A									
										Total Est. Demand: 162 A									



Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Branch Panel: DB-UTIL															
Location: Utility / Mechanical Room 02 Supply From: LVMDP-01 Mounting: Enclosure:								Volts: 400/230V 3P4W 50Hz Phases: 3 Wires: 4				A.I.C. Rating: Mains Type: Mains Rating: MCB Rating: 1 A			
Notes:															
CKT	Circuit Description	Trip	Poles	A	B	C	Poles	Trip	Circuit Description	CKT					
1	COMP-01	100 A	3	1450...	4300...		3	32 A	PMP-01	2					
3	--	-- --			1450..	4300..	-- --	-- --	--	4					
5	--	-- --				1450... 4300...	-- --	-- --	--	6					
7	VF-01	20 A	3	2167...						8					
9	--	-- --			2167...					10					
11	--	-- --				2167...				12					
13										14					
15										16					
17										18					
19										20					
21										22					
23										24					
25										26					
27										28					
29										30					
31										32					
33										34					
35										36					
37										38					
39										40					
41										42					
		Total Load:		20967 VA	20967 VA	20967 VA									
		Total Amps:		91 A	91 A	91 A									
Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals											
Other	62900 VA	100.00%	62900 VA												
				Total Conn. Load: 62900 VA											
				Total Est. Demand: 62900 VA											
				Total Conn.: 91 A											
				Total Est. Demand: 91 A											

Panel Schedules DB

Scale

[illegible][illegible][illegible][illegible]

www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Panel Schedules MCC & LVMDP

Date	25-09-2026
------	------------

Checked by	Checker
------------	---------

E-404
Scale

Scale