




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

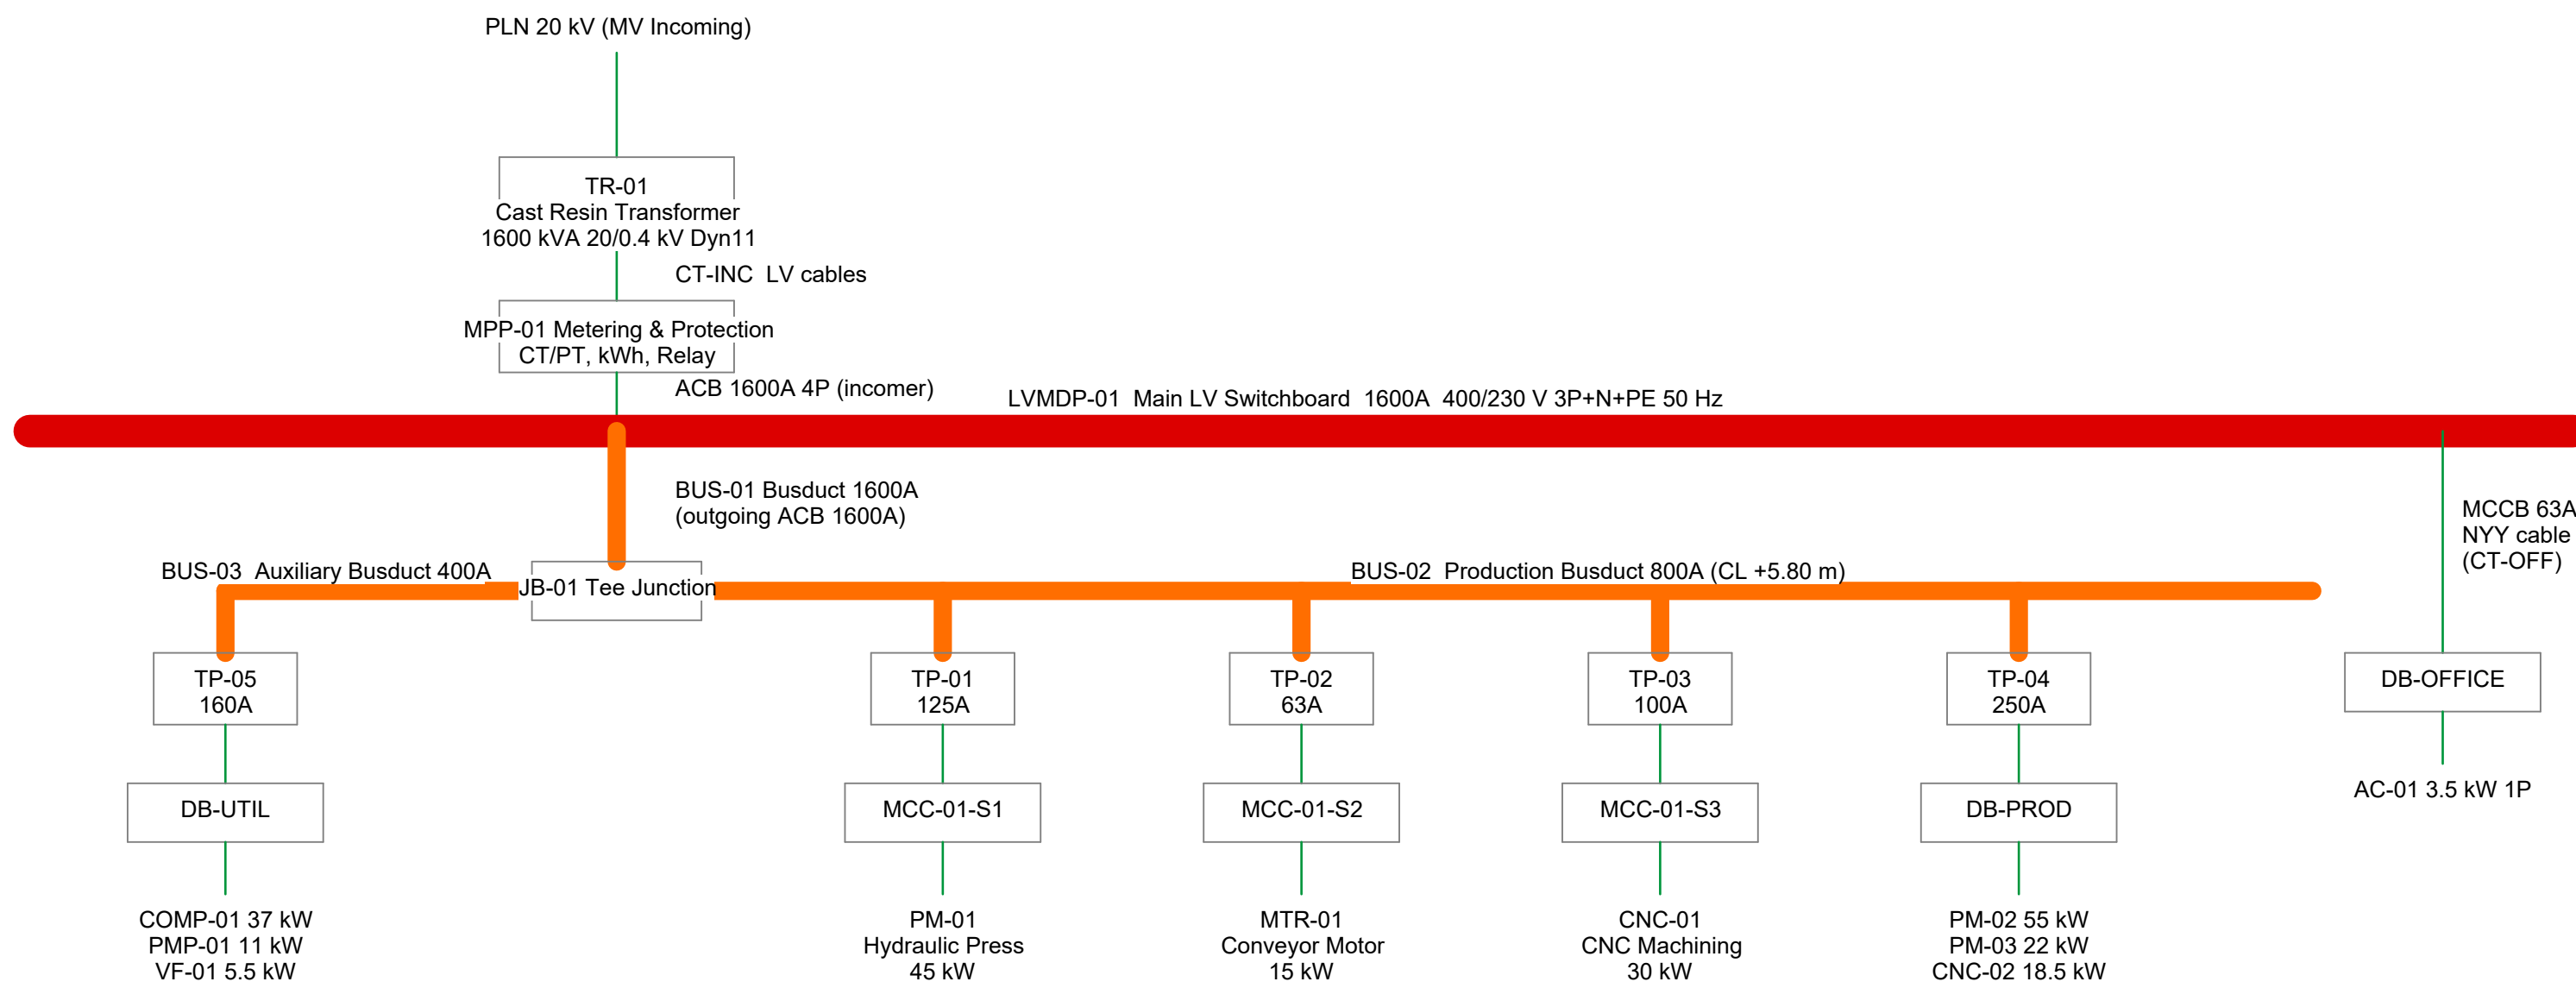

LEGENDA: Oranye tebal = Busduct | Merah = Busbar LVMDP | Hijau = Kabel / cable tray feeder

CATATAN: Semua rating (kVA, A, kW, ukuran kabel) adalah CONTOH LATIHAN. Nilai final wajib berdasarkan load calculation, voltage drop, short-circuit calculation, protection coordination, dan standar/proyek yang berlaku (mis. PUIL 2020 / IEC 60364 / IEC 61439-6).

SLD-01 Single Line Diagram

1 (Simplified)
1:100

1 : 100

ALUR SISTEM: Transformer TR-01 -> LVMDP-01 -> Main Busduct BUS-01 (1600A) -> JB-01 -> BUS-02 (800A) / BUS-03 (400A) -> Tap-off TP-01..05 -> MCC-01 / DB -> Industrial Loads

WARNA (View Filter): Oranye = Busduct | Kuning = Tap-off | Merah = TR & LVMDP | Biru = MCC/DB | Hijau = Feeder tray | Cyan = Outgoing tray | Ungu = Beban

SISTEM: 400/230 V, 50 Hz, 3P+N+PE (TN-S). Distribution System Revit: "400/230V 3P4W 50Hz". Busduct & tap-off = family Electrical Equipment (tanpa kategori busduct native di Revit). Koneksi panel-beban & panel-LVMDP dibuat sebagai Revit Power Circuit (native) -> panel schedule & total beban otomatis. Jalur busduct dicatat di komentar circuit & parameter Connected From/To.

SEMUA RATING = CONTOH LATIHAN, bukan hasil electrical calculation final.

[illegible]

Latihan BIM / Portfolio

Industrial Facility - Busduct Distribution

Single Line Diagram & Legend

Project number	IND-BD-003
----------------	------------

Date 25-09-2026

Muhammad Sabiq Almuttadin

Checked by	Checker
------------	---------

E-000

Scale 1 : 100



Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Project number	IND-BD-003
----------------	------------


Date	25-09-2026
------	------------

Muhammad Sabiq Almuttaqin

Checked by	Checker
------------	---------

E-101

Scale	1 : 100
-------	---------

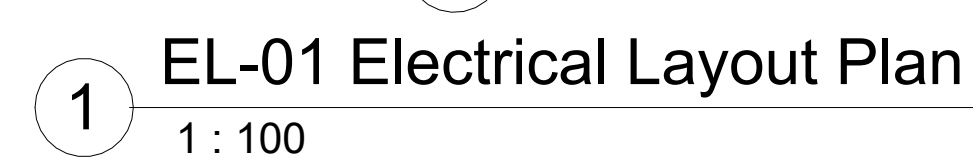


Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

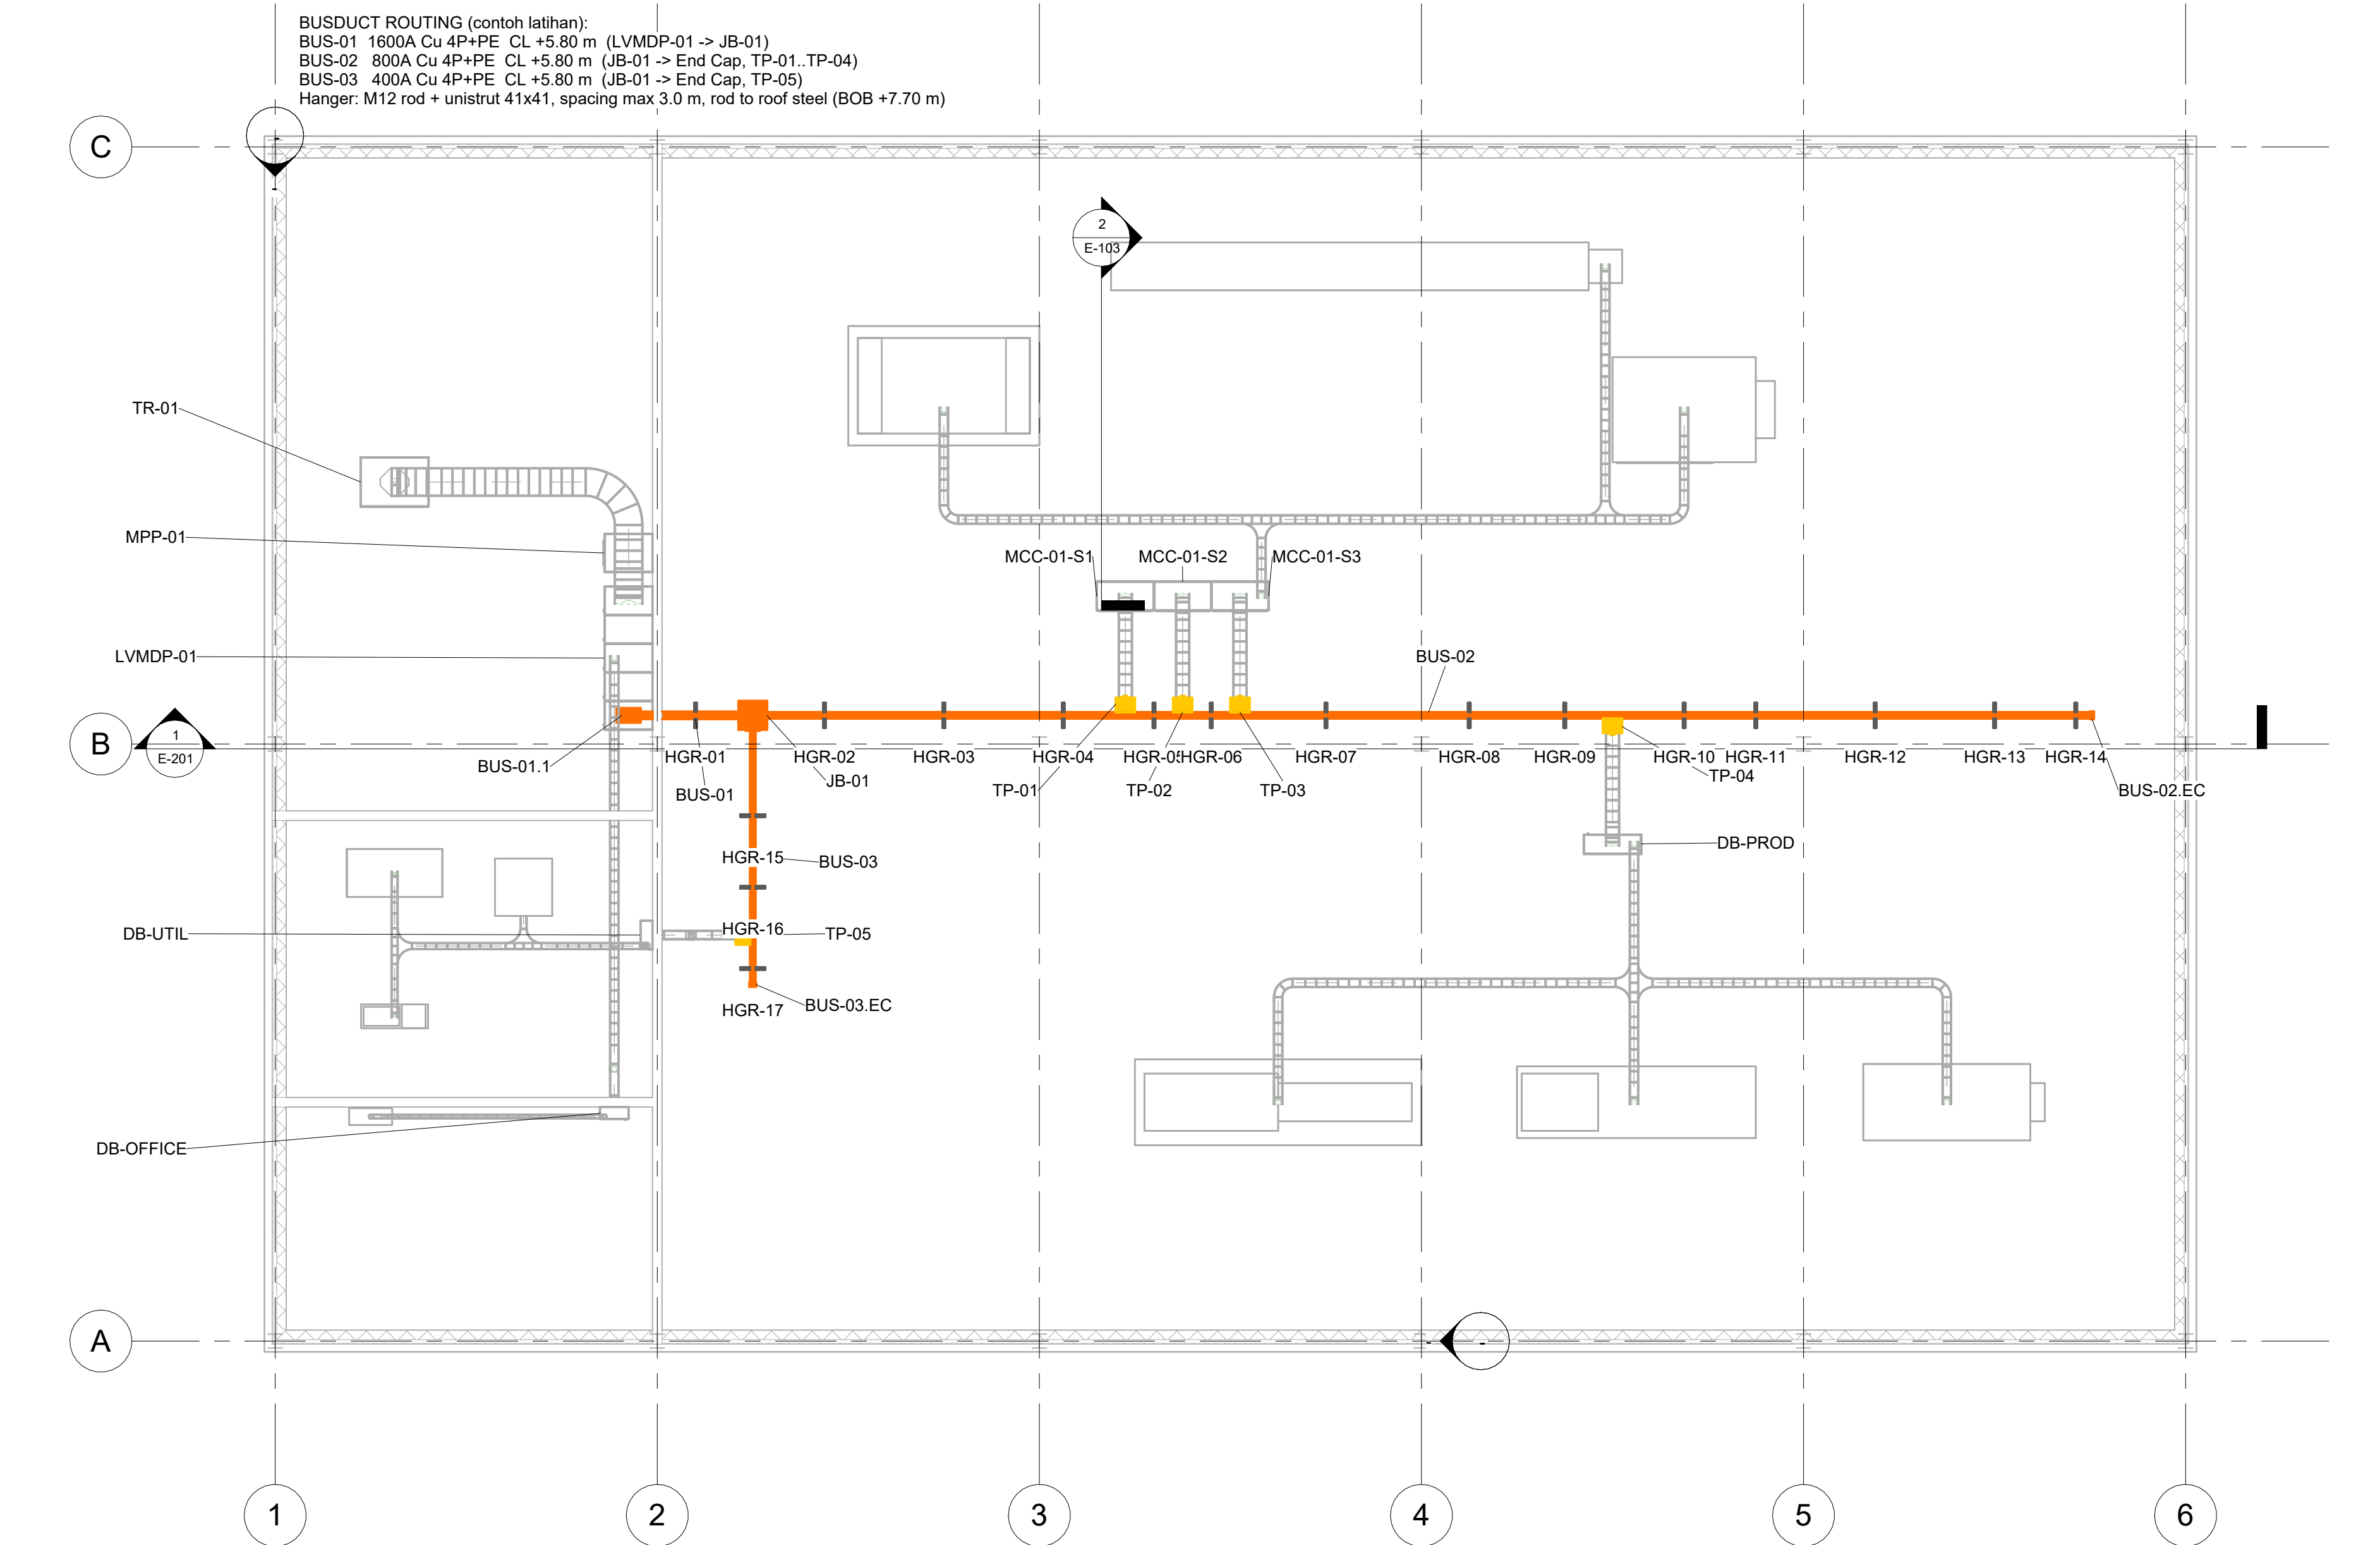

1 EL-02 Busduct Layout Plan
1 : 100

Latihan BIM / Portfolio
Industrial Facility -
Busduct Distribution

Busduct Layout Plan

Project number IND-BD-003

Date 25-09-2026

Mohammad Sabiq Almuttaqin

Checked by Checker

E-102

Scale 1 : 100



www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Latihan BIM / Portfolio

Industrial Facility - Busduct Distribution

Electrical Room & Section B-B

Project number	IND-BD-003
----------------	------------


Date 25-09-2026

Muhammad Sabiq Almuttaqin

Checked by	Checker
------------	---------


E-103

Scale 1 : 50

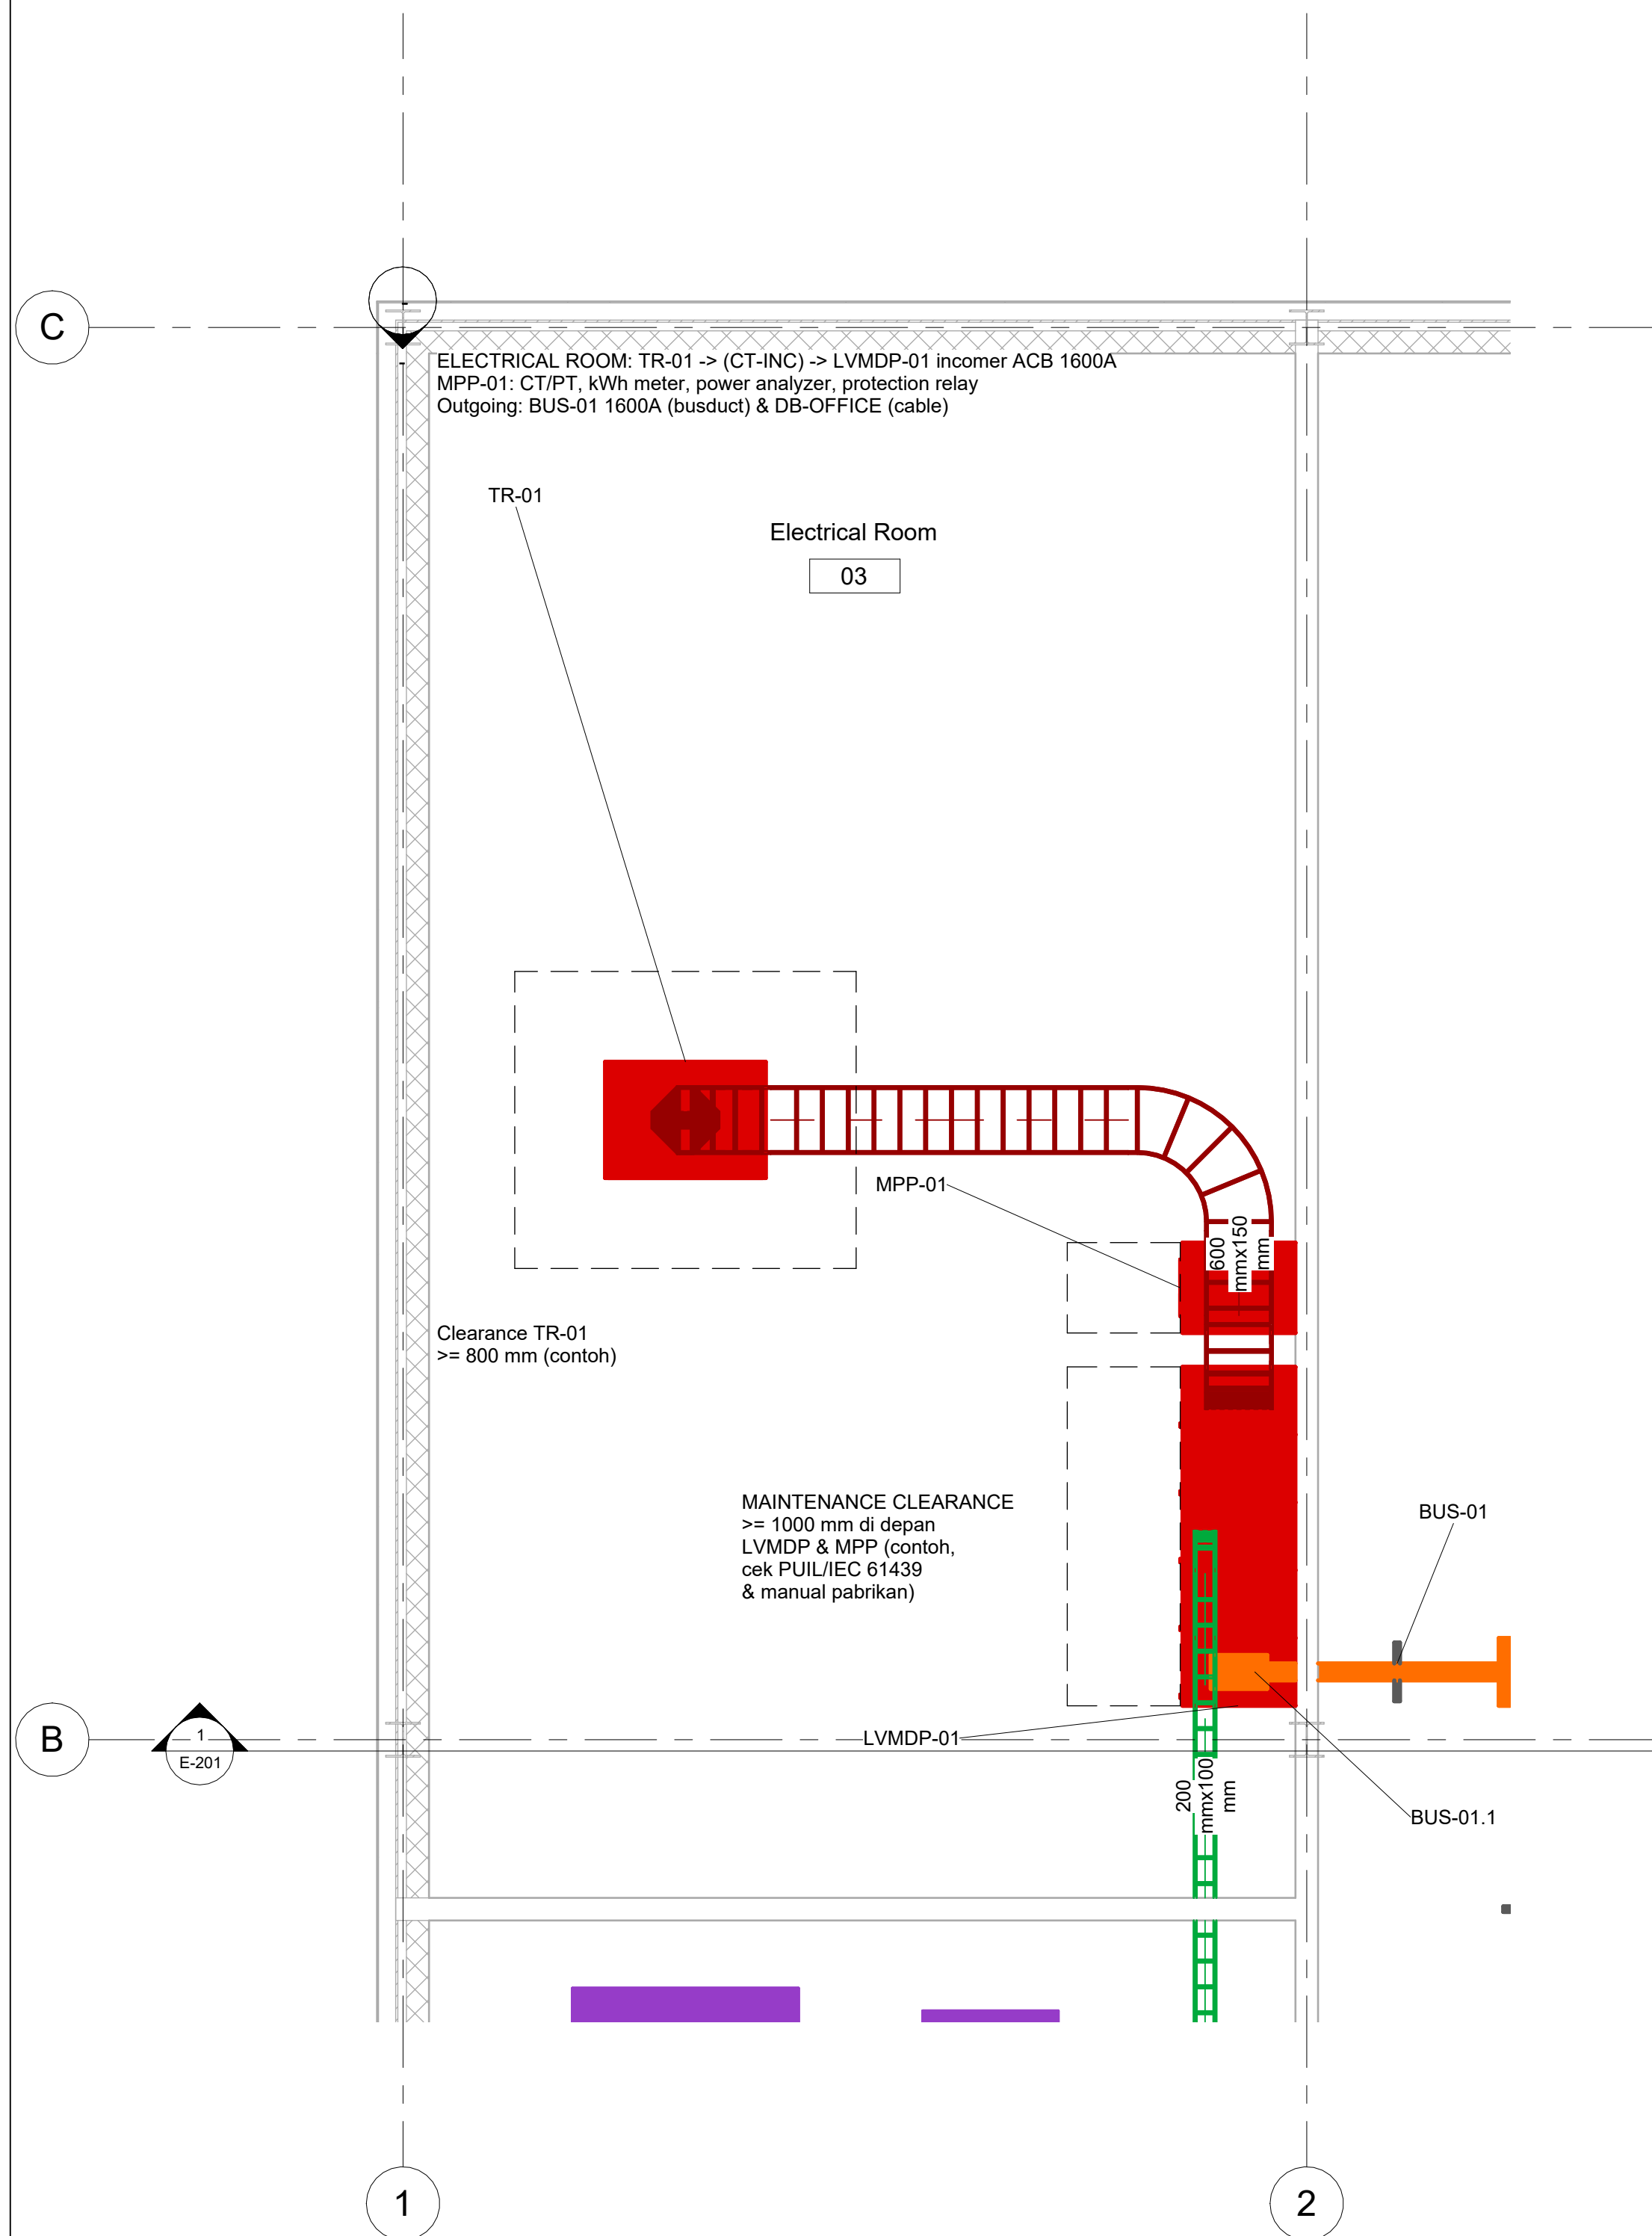

EL-03 Electrical Room Plan

1 : 50

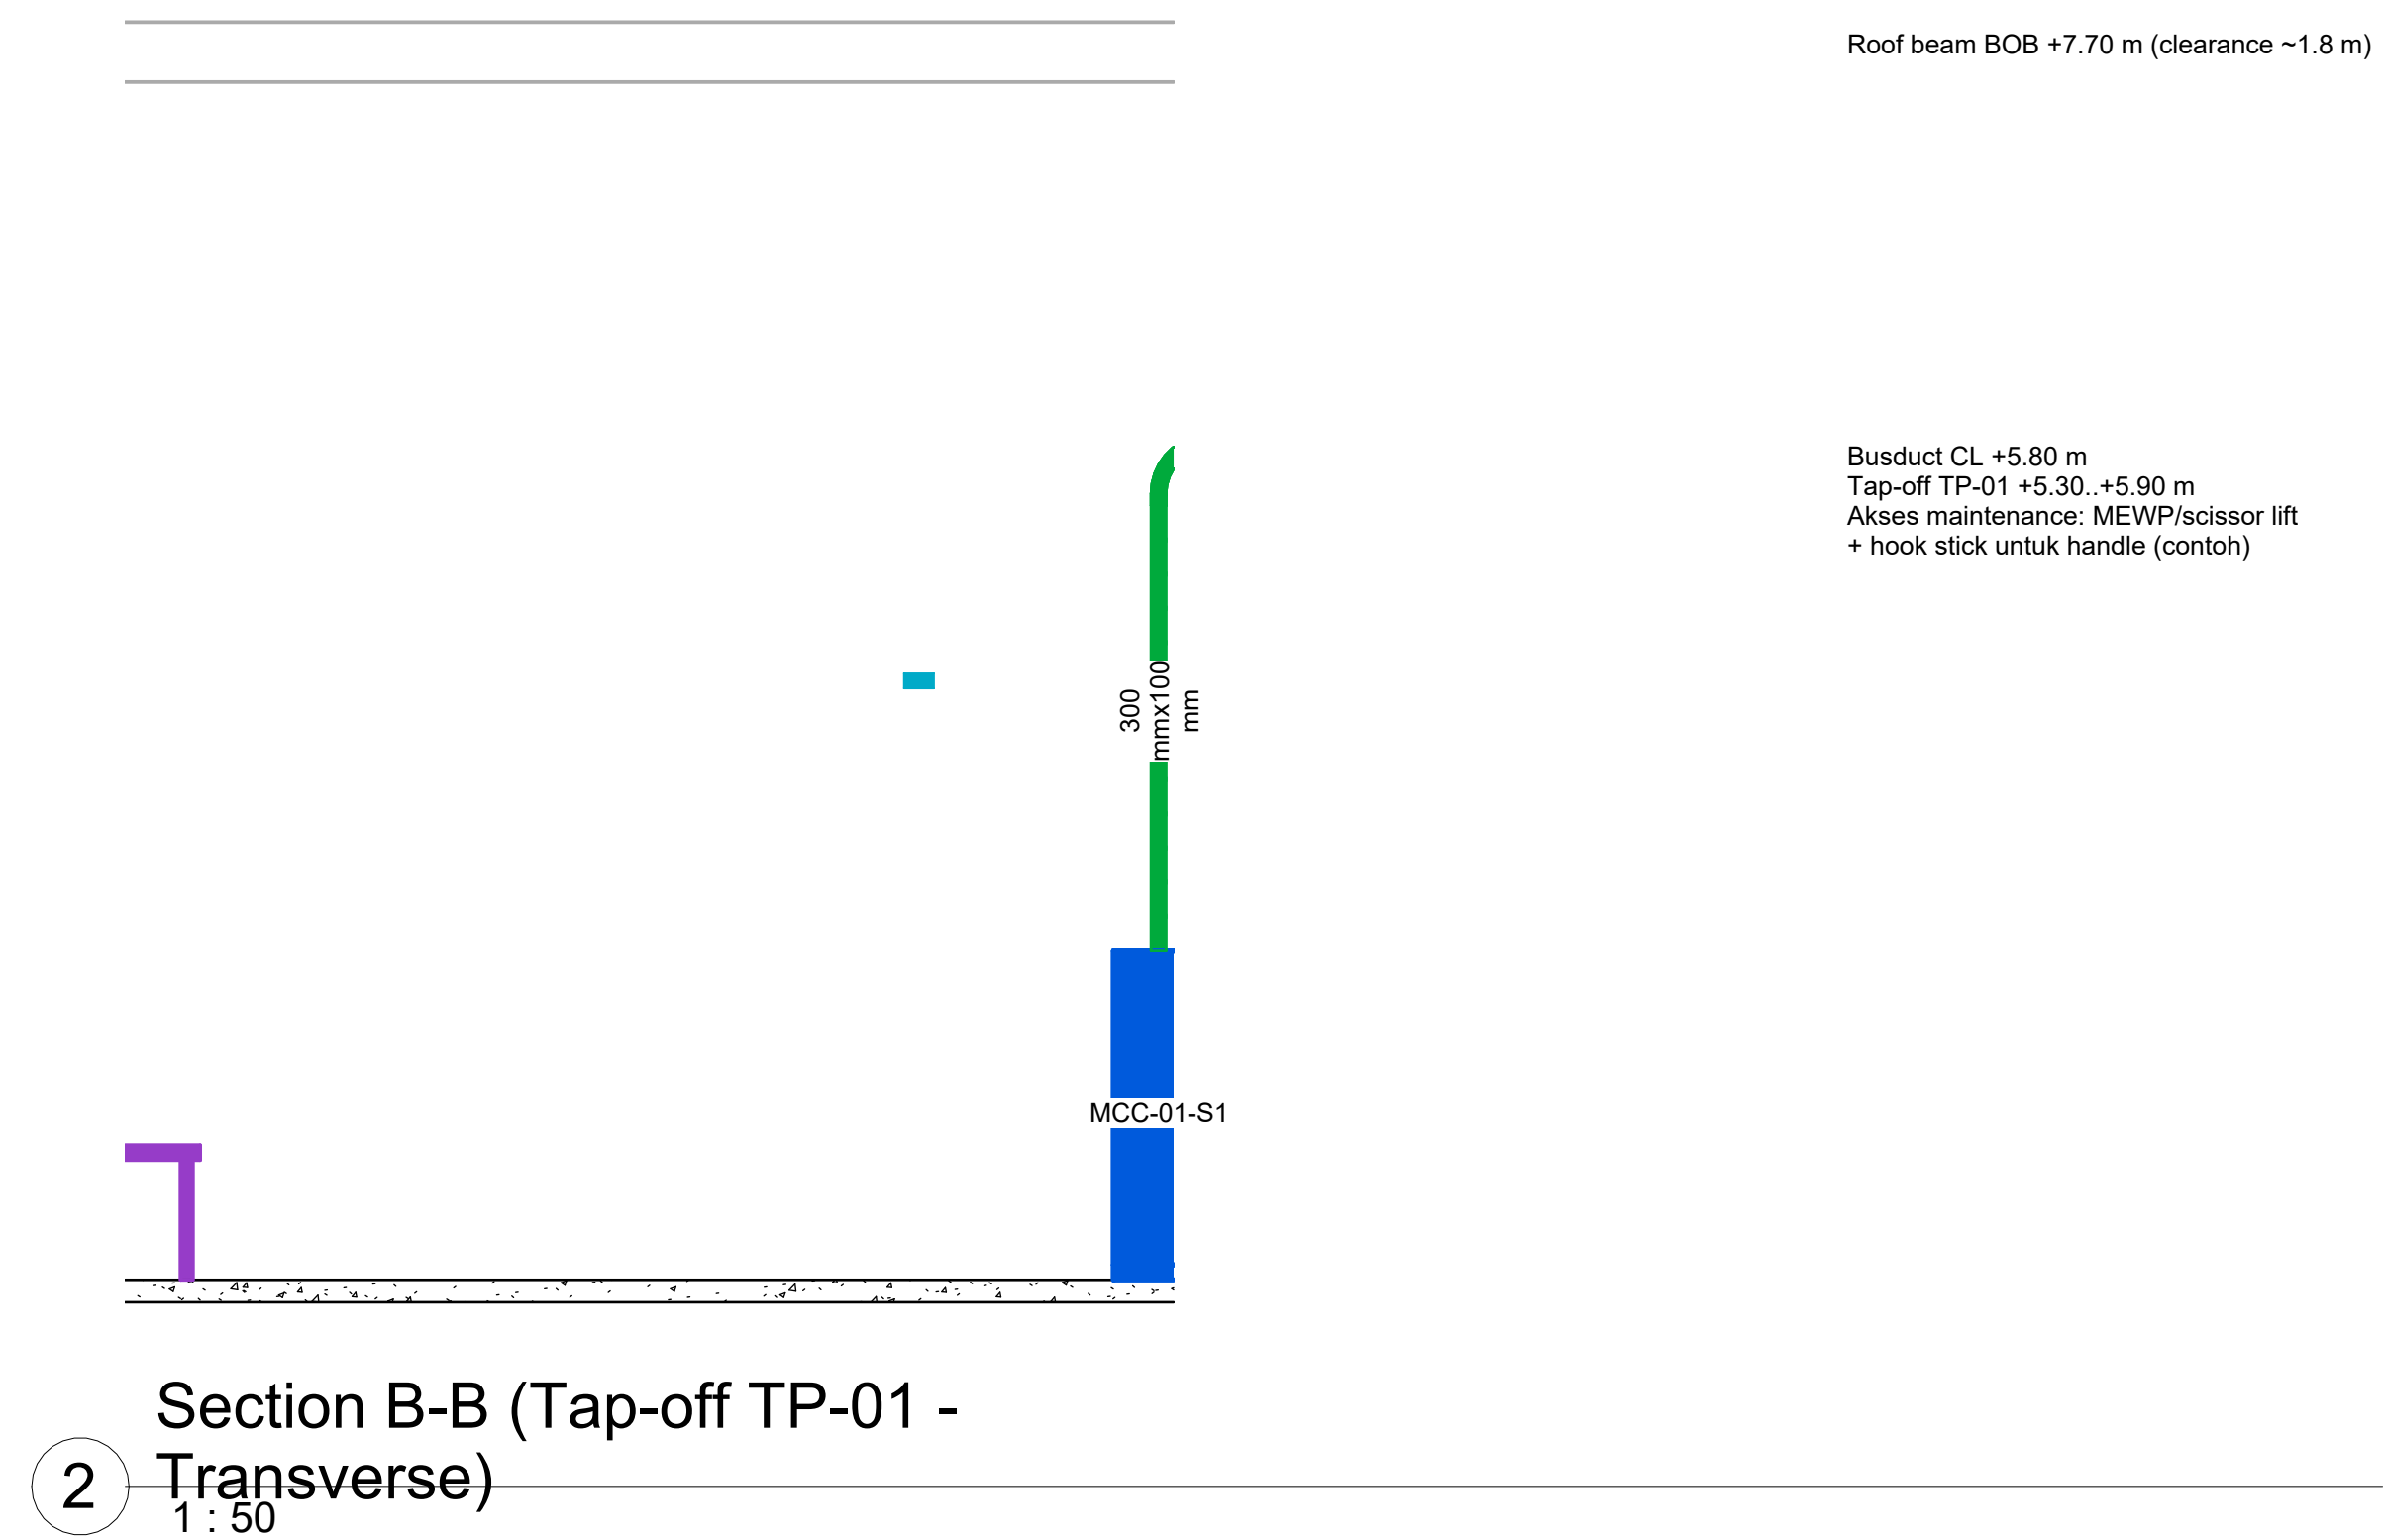

Section B-B (Tap-off TP-01 - Transverse)

1 : 50




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

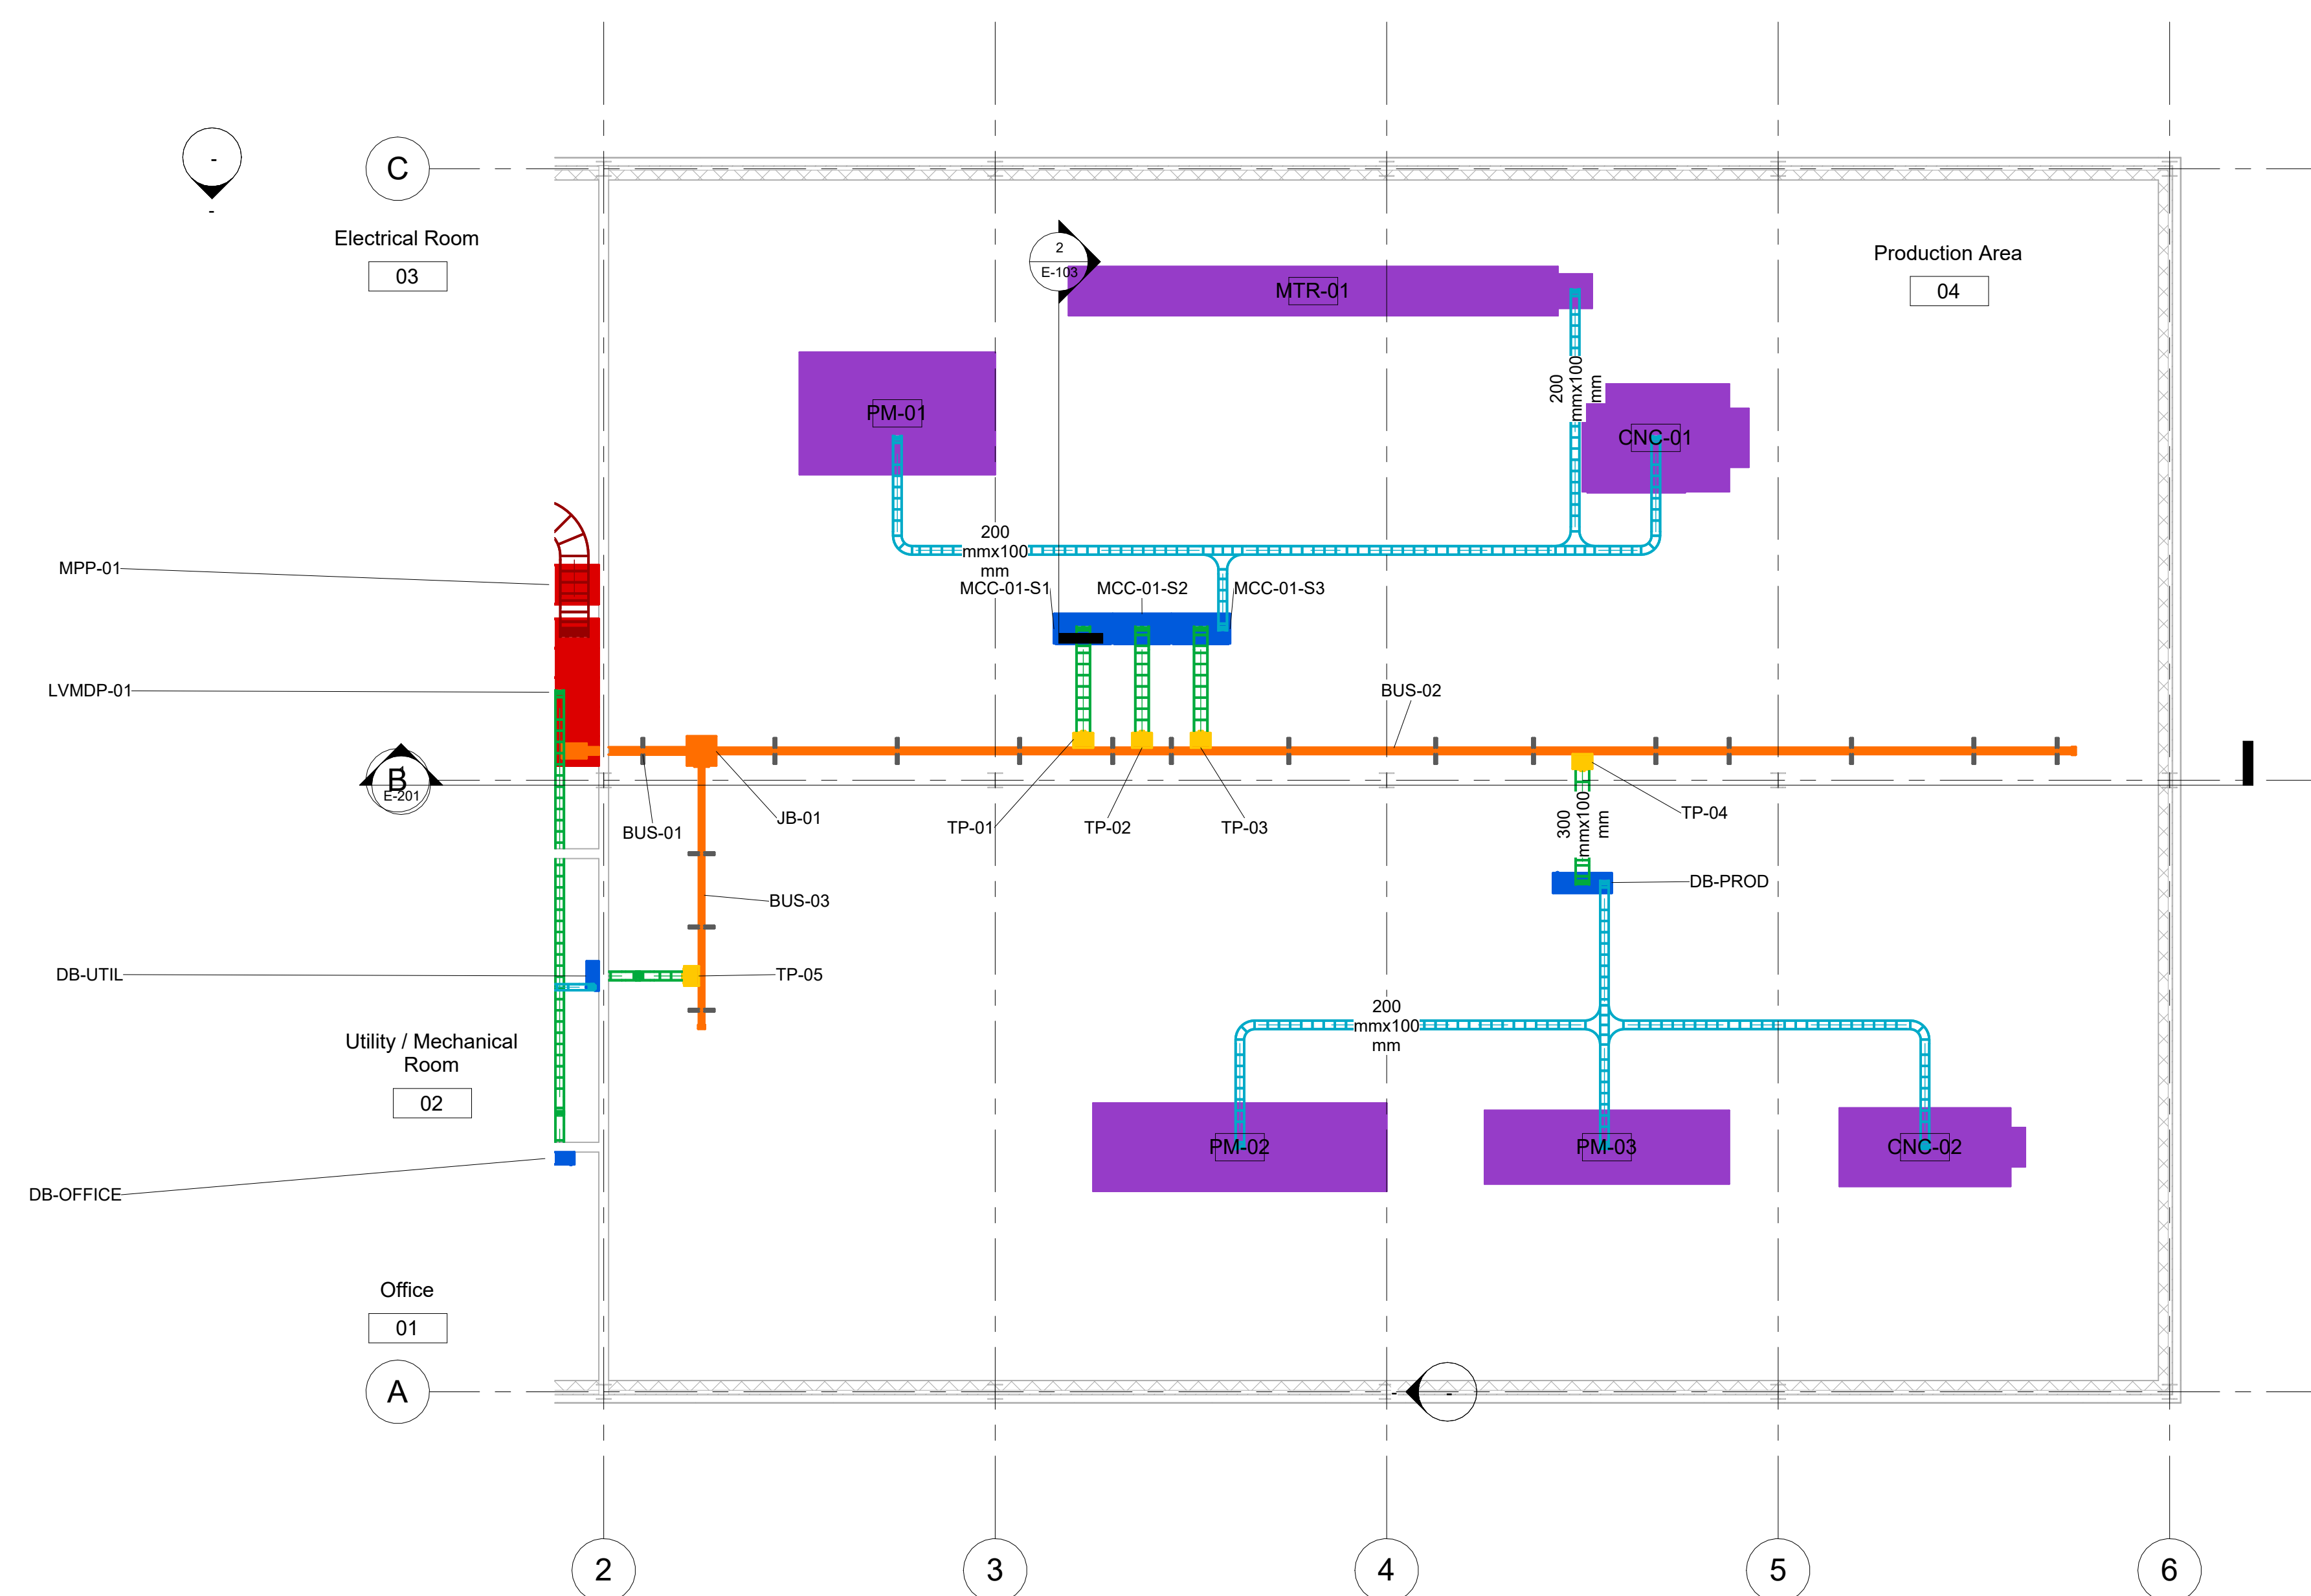

EL-04 Production Area Plan

1 : 100

[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Production Area Plan

Project number	IND-BD-003
----------------	------------

Date	25-09-2026
------	------------

Muhammad Sabiq Almuttadin

Checked by	Checker
------------	---------

E-104

Scale 1 : 100




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

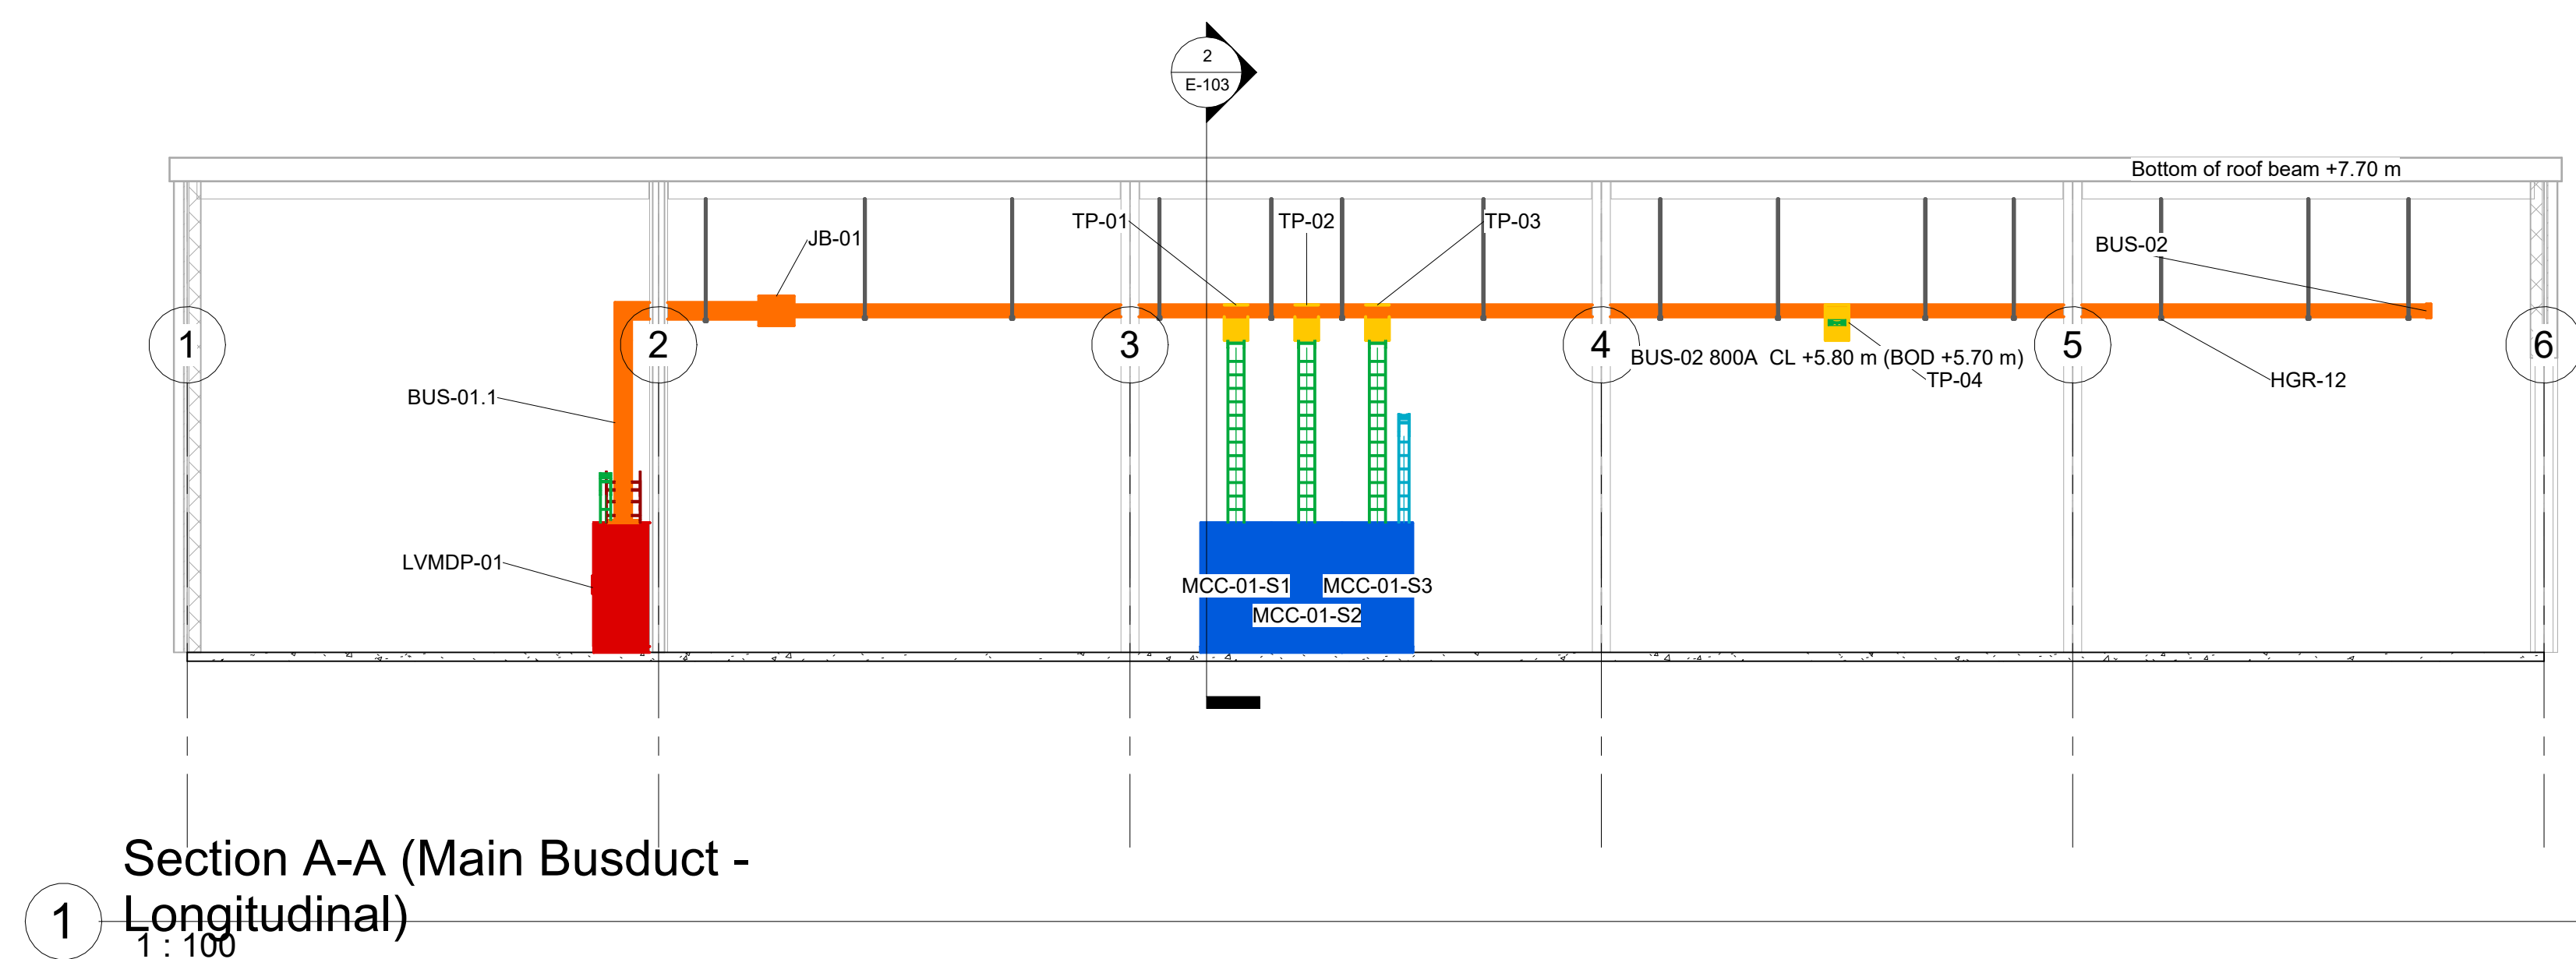[illegible]

Latihan BIM / Portfolio Industrial Facility - Busduct Distribution

Section A-A (Main Busduct)

Project number	IND-BD-003
----------------	------------

Date	25-09-2026
------	------------

Muhammad Sabiq Almuttadin

Checked by	Checker
------------	---------

E-201

Scale	1 : 100
-------	---------

				26/09/2026	18.07.31
--	--	--	--	------------	----------

Branch Panel: DB-OFFICE													
Location: Office 01 Supply From: LVMDP-01 Mounting: Enclosure:			Volts: 400/230V 3P4W 50Hz Phases: 3 Wires: 4			A.I.C. Rating: Mains Type: Mains Rating: MCB Rating: 1 A							
Notes:													
CKT	Circuit Description	Trip	Poles	A	B	C	Poles	Trip	Circuit Description	CKT			
1	AC-01	20 A	1	4100...						2			
3										4			
5										6			
7										8			
9										10			
11										12			
13										14			
15										16			
17										18			
19										20			
21										22			
23										24			
25										26			
27										28			
29										30			
31										32			
33										34			
35										36			
37										38			
39										40			
41										42			
		Total Load:		4100 VA	0 VA	0 VA							
		Total Amps:		18 A	0 A	0 A							
Legend:													
Load Classification		Connected Load		Demand Factor	Estimated Demand	Panel Totals							
Other		4100 VA		100.00%	4100 VA								
						Total Conn. Load: 4100 VA							
						Total Est. Demand: 4100 VA							
						Total Conn.: 6 A							
						Total Est. Demand: 6 A							
Notes:													

Branch Panel: DB-PROD

Location: Production Area 04
Supply From: LVMDP-01
Mounting:
Enclosure:

Volts: 400/230V 3P4W 50Hz
Phases: 3
Wires: 4

A.I.C. Rating:
Mains Type:
Mains Rating:
MCB Rating: 1 A

Notes:

CKT	Circuit Description	Trip	Poles	A	B	C	Poles	Trip	Circuit Description	CKT
1	PM-02	125 A	3	2156...	8633...		3	63 A	PM-03	2
3	--	--	--		2156...	8633...	--	--	--	4
5	--	--	--			2156...	8633...	--	--	6
7	CNC-02	50 A	3	7267...						8
9	--	--	--		7267...					10
11	--	--	--			7267...				12
13										14
15										16
17										18
19										20
21										22
23										24
25										26
27										28
29										30
31										32
33										34
35										36
37										38
39										40
41										42
		Total Load:		37467 VA	37467 VA	37467 VA				
		Total Amps:		163 A	163 A	163 A				

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
Other	112400 VA	100.00%	112400 VA	
				Total Conn. Load: 112400 VA
				Total Est. Demand: 112400 VA
				Total Conn.: 162 A
				Total Est. Demand: 162 A

Notes:



Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Branch Panel: DB-UTIL																			
Location: Utility / Mechanical Room 02					Volts: 400/230V 3P4W 50Hz					A.I.C. Rating:									
Supply From: LVMDP-01					Phases: 3					Mains Type:									
Mounting:					Wires: 4					Mains Rating:									
Enclosure:					MCB Rating: 1 A														
Notes:																			
CKT	Circuit Description	Trip	Poles	A		B		C		Poles	Trip	Circuit Description		CKT					
1	COMP-01	100 A	3	1450...	4300...					3	32 A	PMP-01		2					
3	--	--	--			1450...	4300...			--	--	--		4					
5	--	--	--					1450...	4300...	--	--	--		6					
7	VF-01	20 A	3	2167...										8					
9	--	--	--			2167...								10					
11	--	--	--					2167...						12					
13														14					
15														16					
17														18					
19														20					
21														22					
23														24					
25														26					
27														28					
29														30					
31														32					
33														34					
35														36					
37														38					
39														40					
41														42					
Total Load:				20967 VA		20967 VA		20967 VA											
Total Amps:				91 A		91 A		91 A											
Legend:																			
Load Classification				Connected Load		Demand Factor		Estimated Demand		Panel Totals									
Other				62900 VA		100.00%		62900 VA											
										Total Conn. Load: 62900 VA									
										Total Est. Demand: 62900 VA									
										Total Conn.: 91 A									

Panel Schedules DB

Scale

[illegible][illegible][illegible][illegible]

www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Panel Schedules MCC & LVMDP

Date 25-09-2026

Checked by _____ Checker _____

Scale