




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail


Consultant
Address
Address
Phone
Fax
e-mail

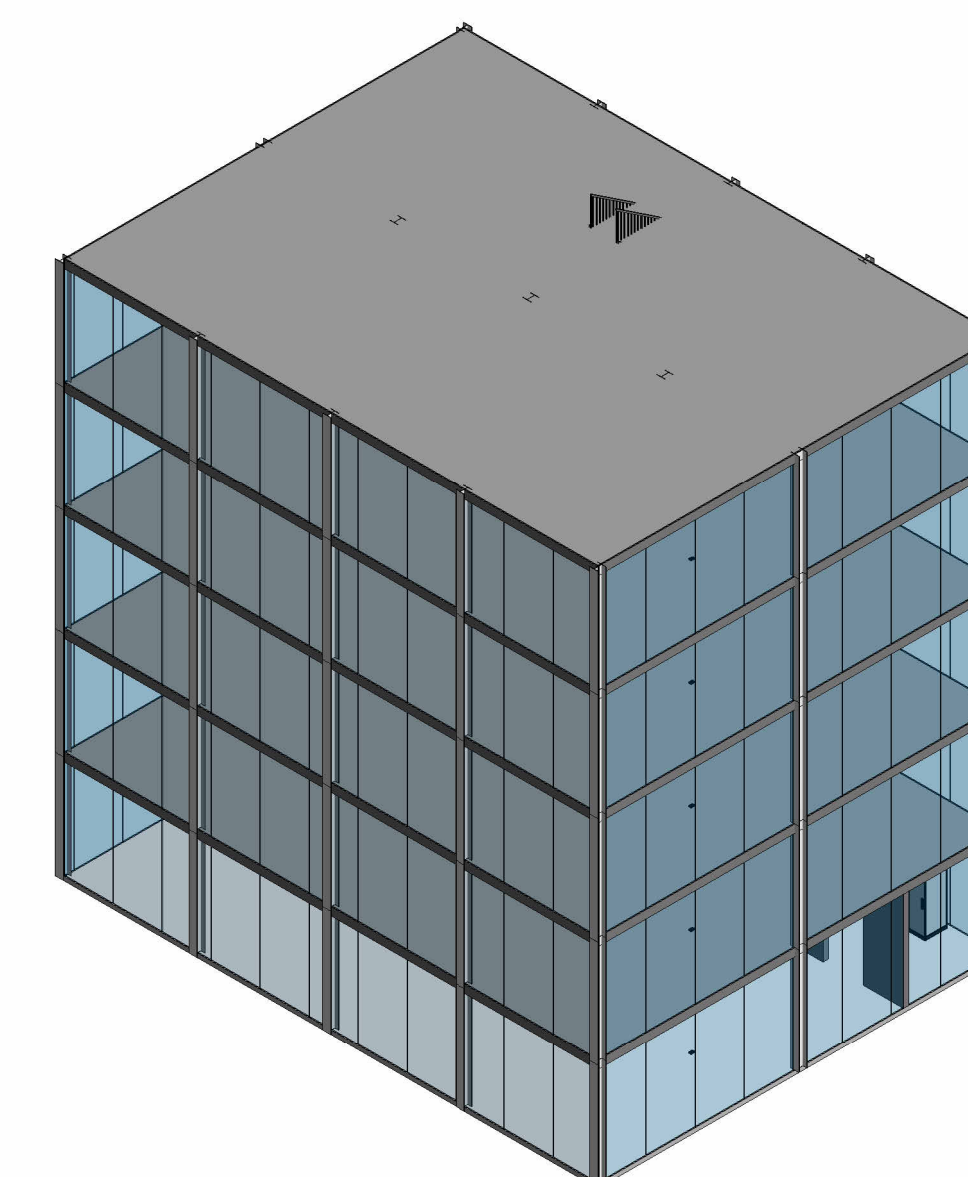

2 3D - Gedung 5 Lantai

LEGENDA SISTEM (GRAPHIC OVERRIDE)
 ORANYE : LV Busduct 800A Cu 4P+PE (3P+N+PE) 400/230V
 MERAH : LVMDP 1250A & DB-L1 s/d DB-L5 (250A)
 HIJAU : Feeder Cable Tray Tap-off -> DB
 BIRU : Branch Cable Tray DB -> Beban
 UNGU : Beban (Lighting, Socket Outlet, AHU/HVAC)
 ABU-ABU (halfstone) : Arsitektur & Struktur

ALUR DISTRIBUSI:
Trafo -> LVMDP -> Busduct Horizontal (BD-H01) -> Elbow ->
Vertical Busduct Riser (BD-R01..R05) -> Tap-Off (TO-Lx) ->
Feeder Tray -> DB-Lx -> Branch Tray -> Beban

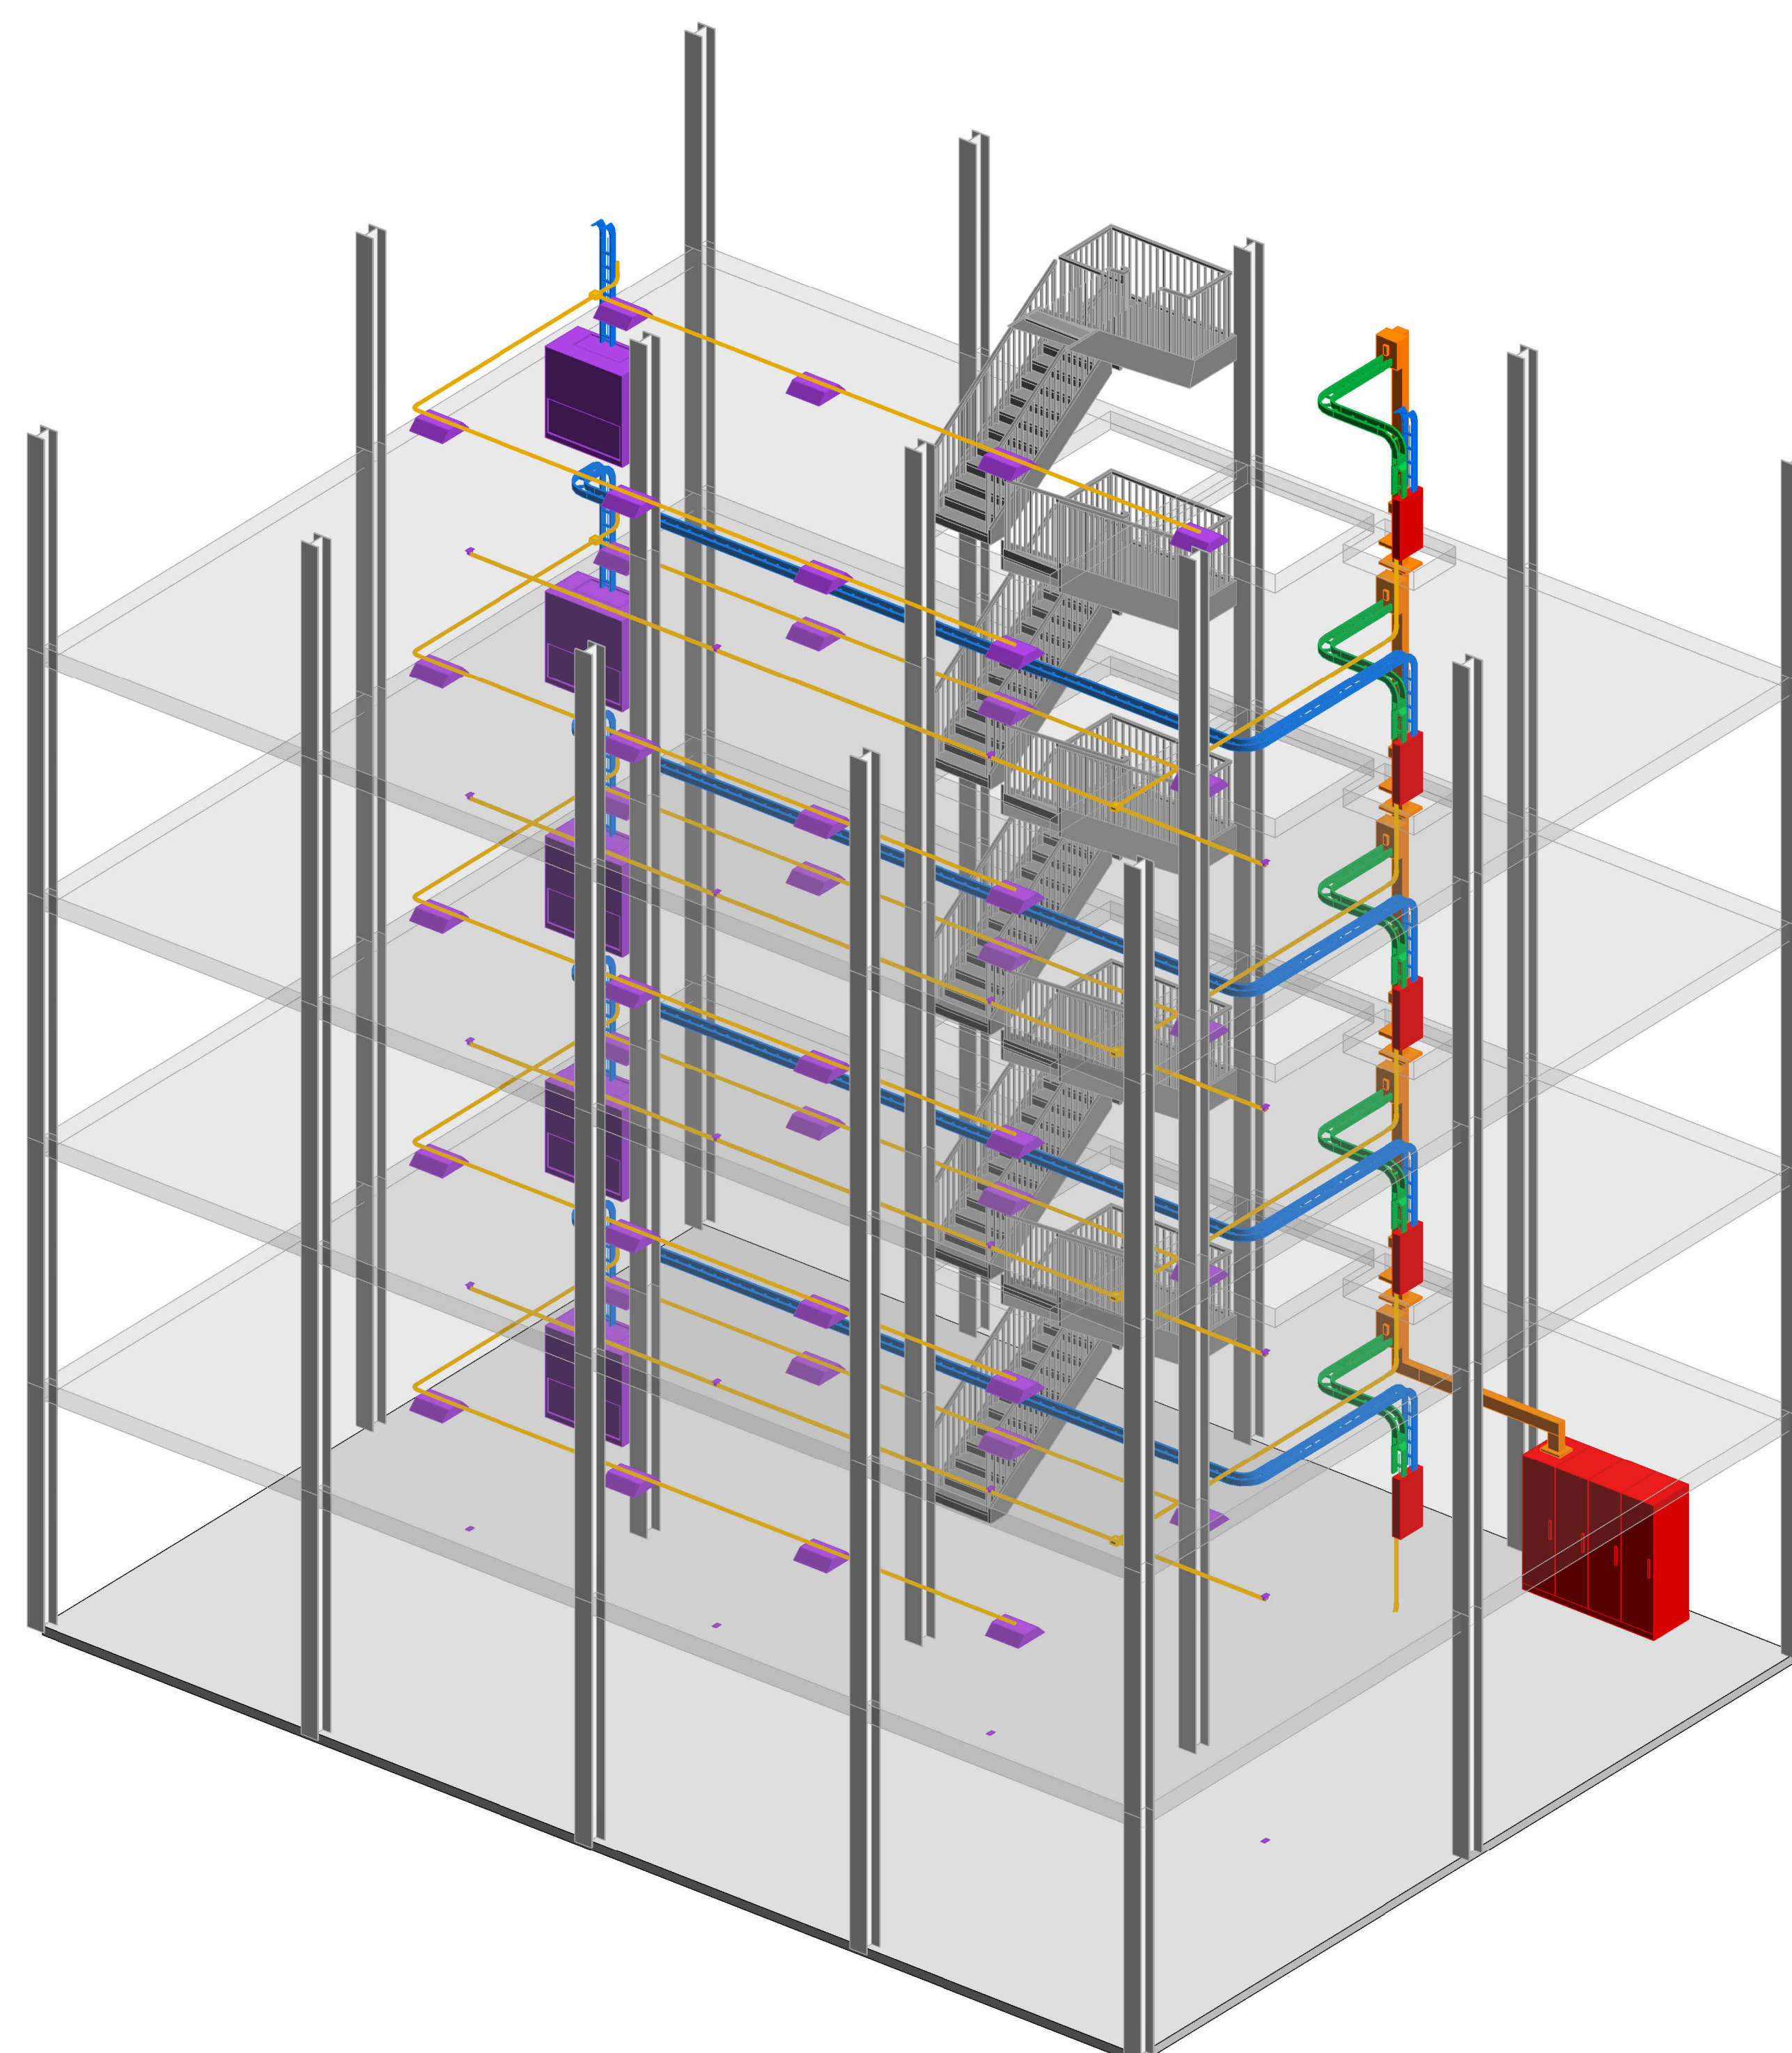

1 3D - Busduct System

[illegible]

**Latihan BIM
Gedung 5 Lantai -
Busduct**

Sistem Busduct - 3D Isometric

Project number	GB-BD-002
----------------	-----------

Date	25-09-2026
------	------------

Muhammad Sabiq Almuttadin

Checked by	Checker
------------	---------

E-001

Scale




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

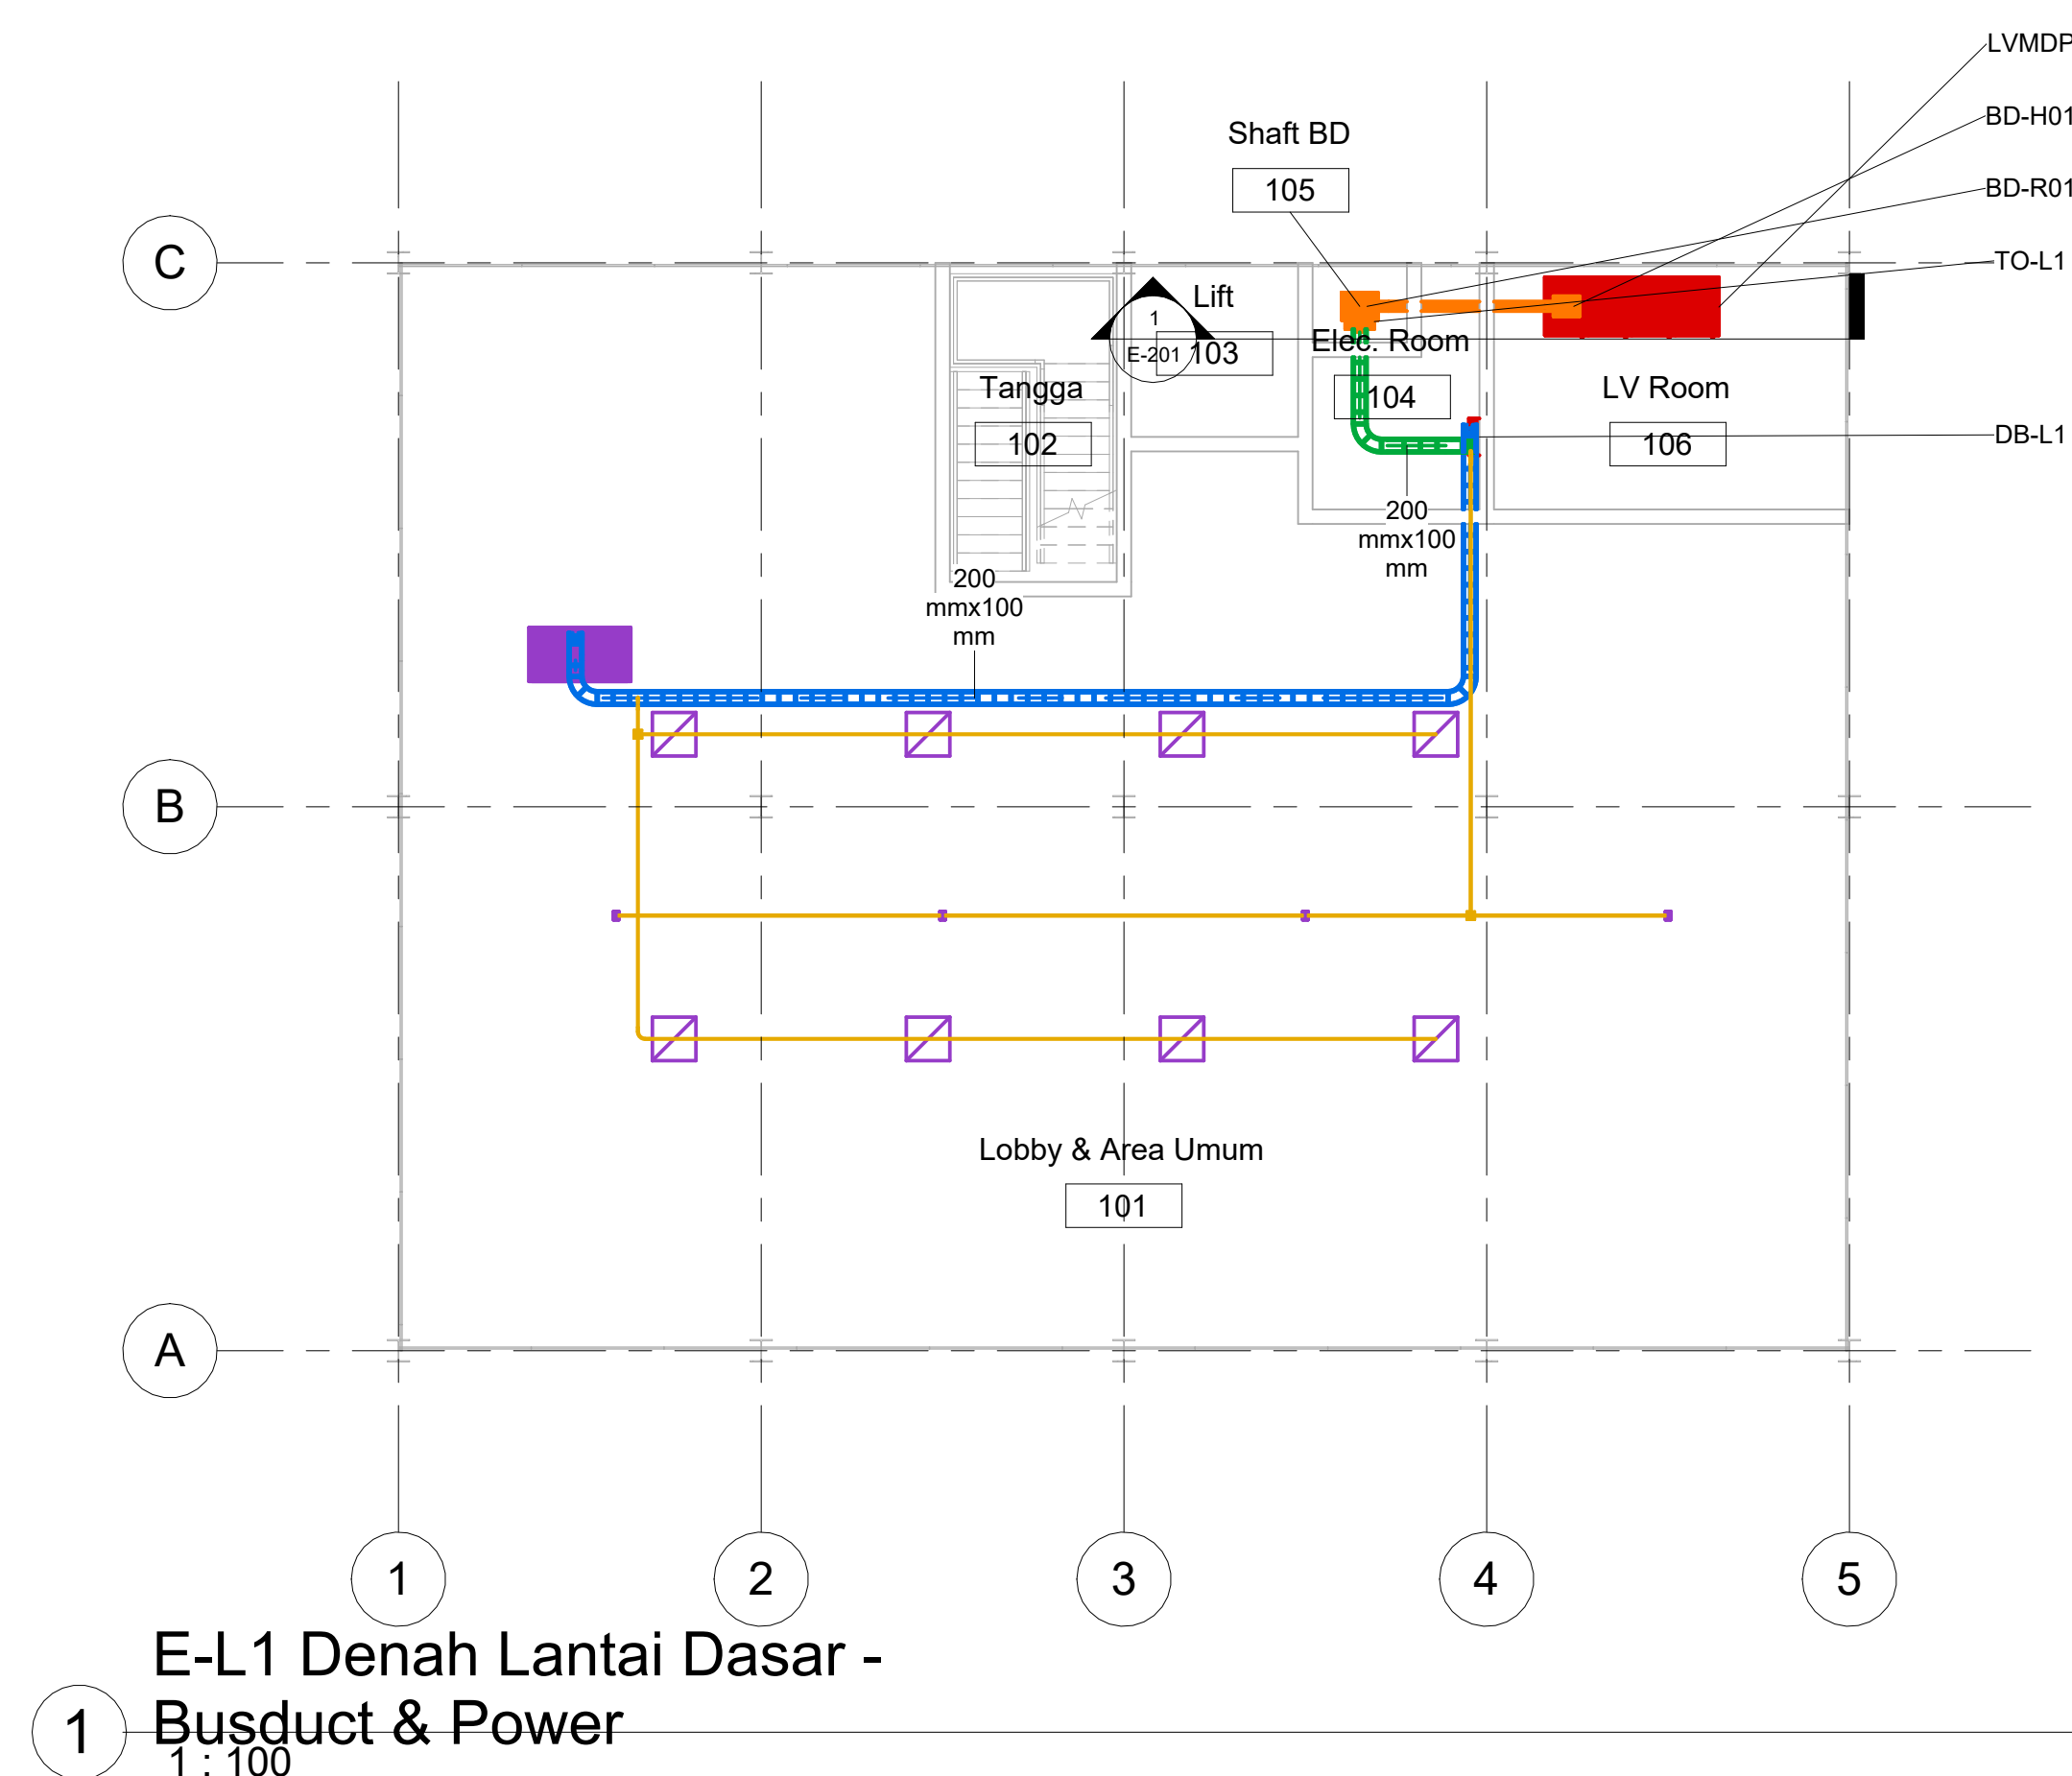[illegible]

**Latihan BIM
Gedung 5 Lantai -
Busduct**

Denah Lantai Dasar - Busduct & Power

Project number	GB-BD-002
----------------	-----------

Date	25-09-2026
------	------------

Muhammad Sabiq Almuttadin

Checked by	Checker
------------	---------

E-101

Scale	1 : 100
-------	---------




www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

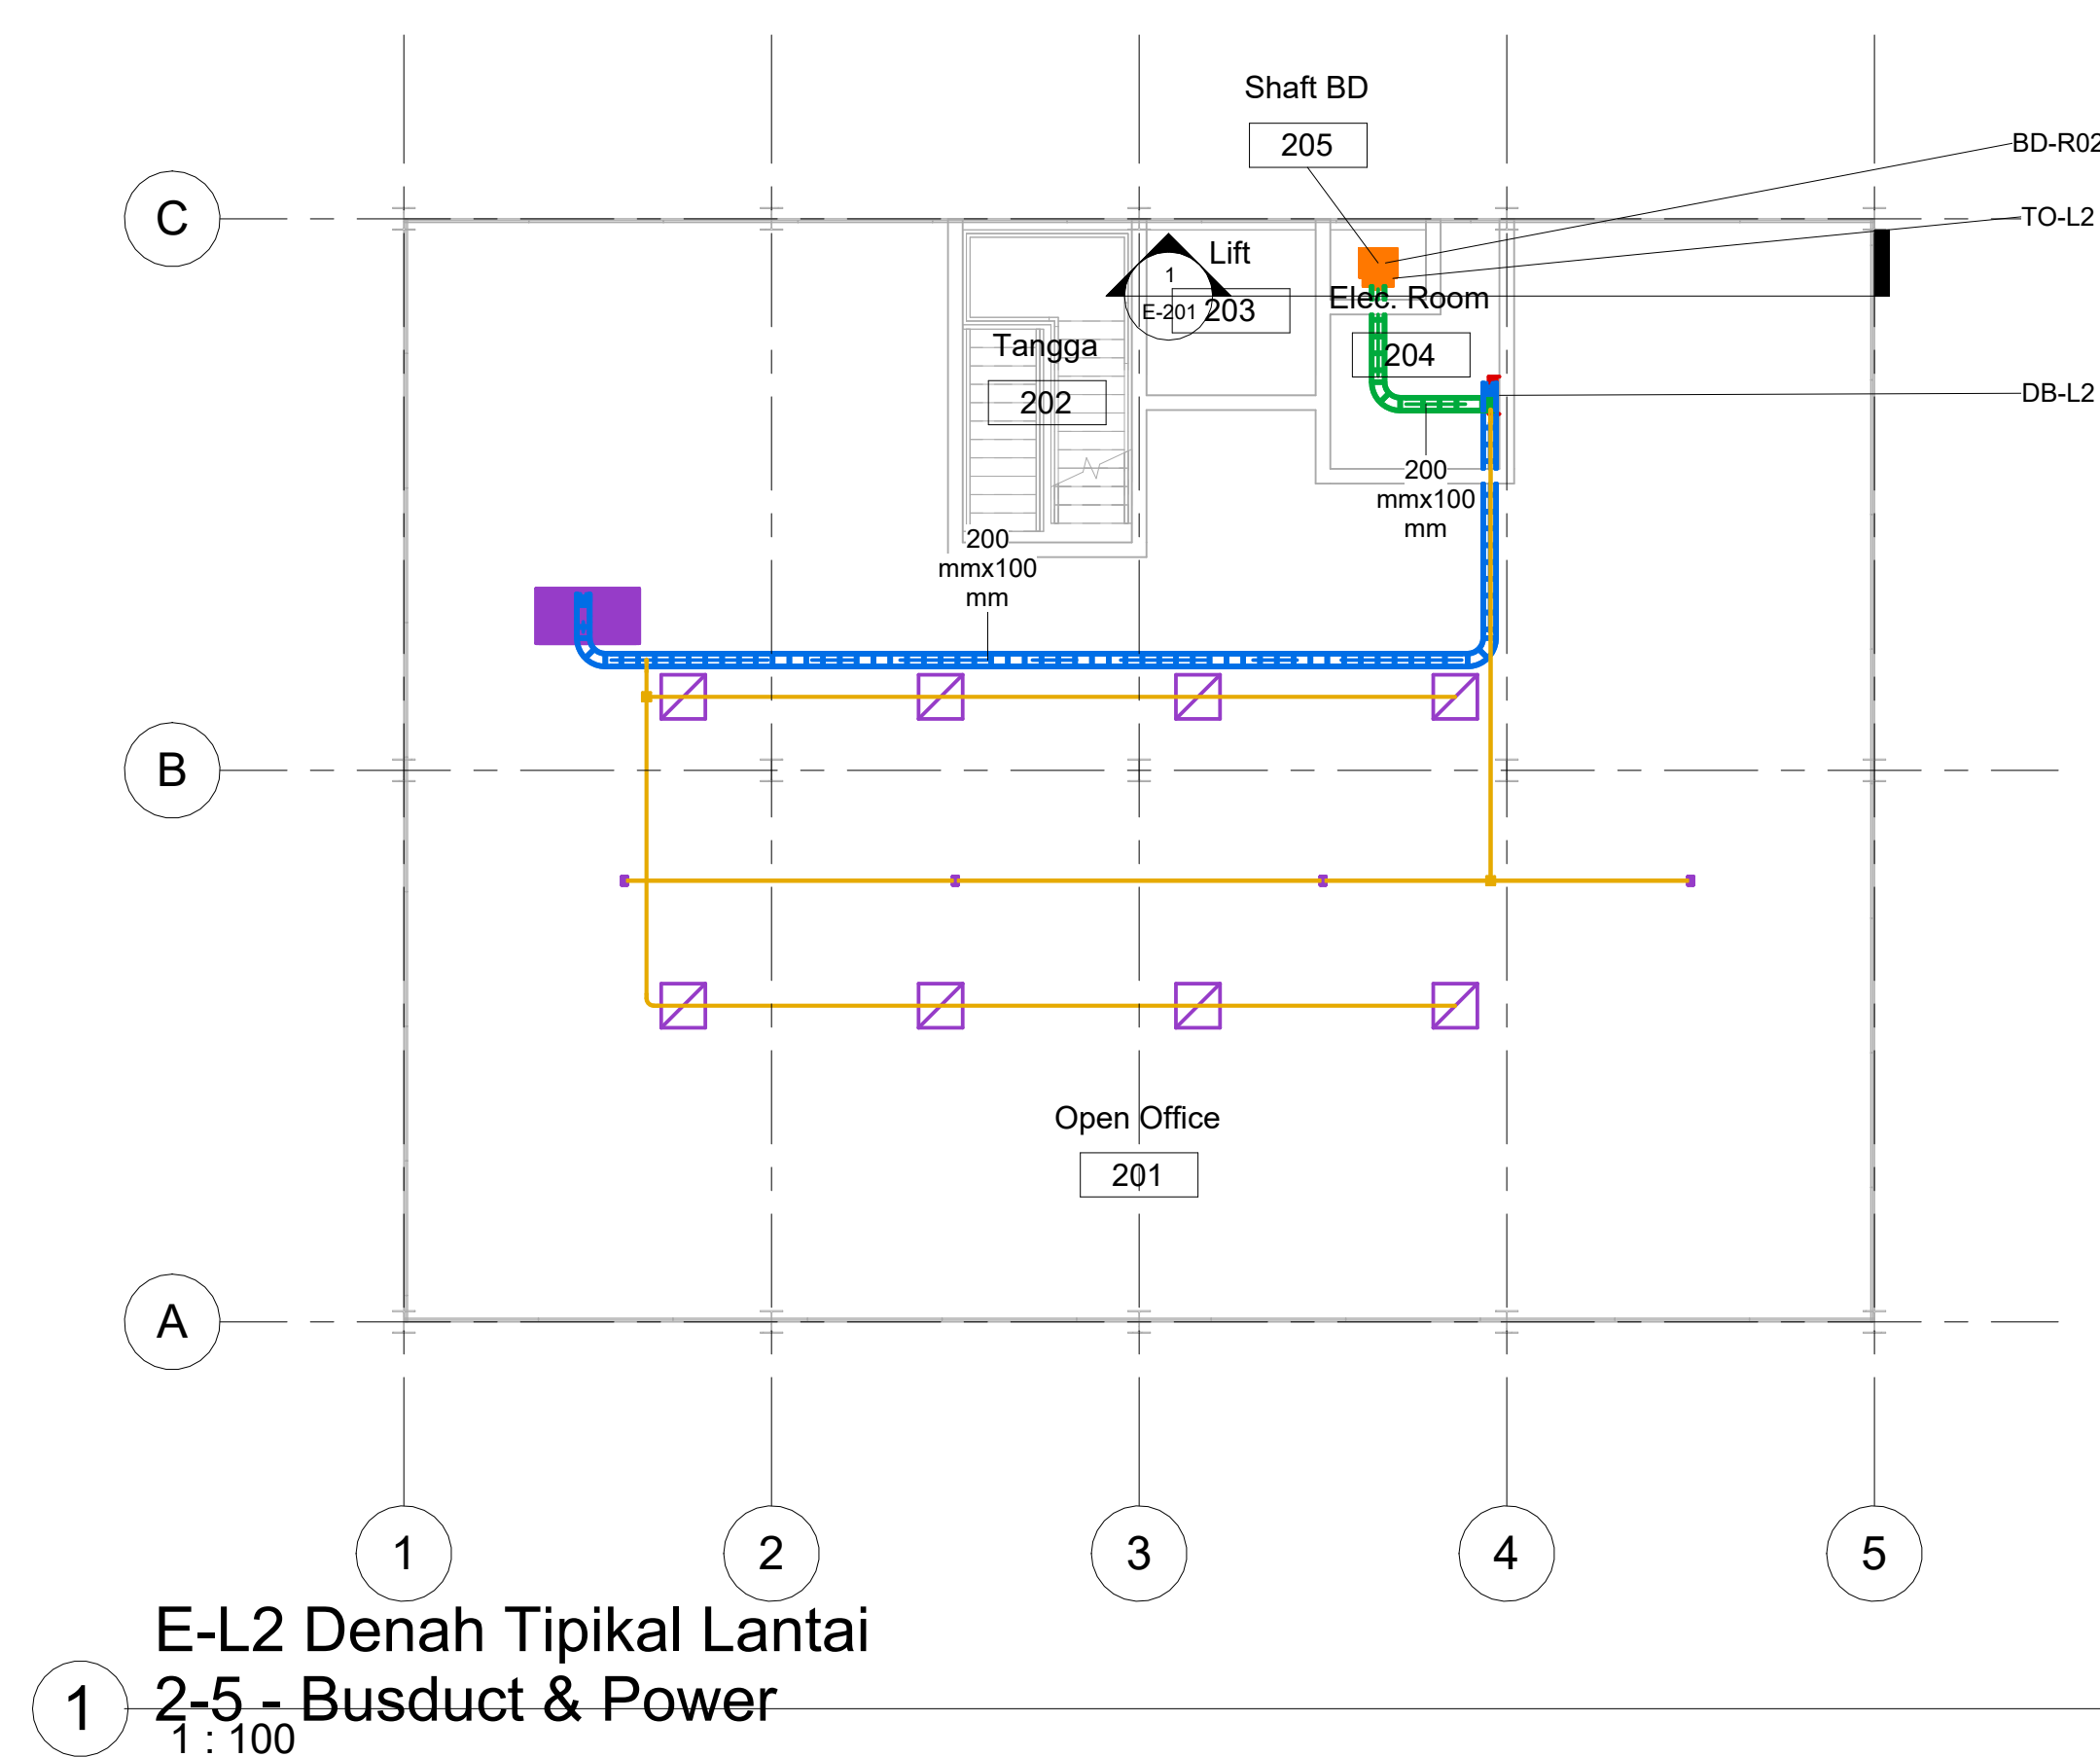[illegible]

**Latihan BIM
Gedung 5 Lantai -
Busduct**

Denah Tipikal Lantai 2-5 - Busduct & Power

Project number	GB-BD-002
Date	25-09-2026
Muhammad Sabiq Almuttaqin	
Checked by	Checker
E-102	
Scale	1 : 100



www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail



SEC-01 Potongan Vertikal
1 Shaft Busduct
1:75

[illegible]

**Latihan BIM
Gedung 5 Lantai -
Busduct**

Potongan Vertikal Shaft Busduct (Riser)

Project number	GB-BD-002
----------------	-----------

Date	25-09-2026
------	------------

Muhammad Sabiq Almuttaqin

Checked by	Checker
------------	---------

E-201

Scale 1 : 75

Electrical Distribution Schedule								
Component Name	Type	Floor	Rating	Busduct Rating	Voltage	Phase	Connected Panel	System
CT-B-L1	Branch Cable Tray (DB-L1 to Loads)	Lantai 1	Branch circuits		230V / 400V	1P & 3P	DB-L1	Branch Cable Tray
CT-F-L1	Feeder Cable Tray (TO-L1 to DB-L1)	Lantai 1	NY Y 4x120mm2 + BC 70mm2		400/230V	3P+N+PE (4P)	TO-L1 / DB-L1	Feeder Cable Tray
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)		230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)		230V	1P+N+PE	DB-L1	Final Circuit Conduit
BD-EL01	Busduct Elbow 90	Lantai 1	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-FE	Busduct Flanged End	Lantai 1	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-H01	Busduct Horizontal Feeder Section	Lantai 1	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-R01	Vertical Busduct Riser Section	Lantai 1	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
TO-L1	Busduct Tap-Off Unit	Lantai 1	MCCB 250A 4P	800A	400/230V	3P+N+PE (4P)	DB-L1	LV Busduct Distribution
LVMDP	Main Switchboard	Lantai 1	1250A ACB 4P		400/230V	3P+N+PE (4P)	Trafo 1000 kVA (PLN)	LV Main Distribution
DB-L1	Sub Distribution Board (DB)	Lantai 1	250A MCCB 4P - 96 kVA		400/230V	3P+N+PE (4P)	TO-L1 / LVMDP	Sub Distribution
CT-B-L2	Branch Cable Tray (DB-L2 to Loads)	Lantai 2	Branch circuits		230V / 400V	1P & 3P	DB-L2	Branch Cable Tray
CT-F-L2	Feeder Cable Tray (TO-L2 to DB-L2)	Lantai 2	NY Y 4x120mm2 + BC 70mm2		400/230V	3P+N+PE (4P)	TO-L2 / DB-L2	Feeder Cable Tray
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)		230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)		230V	1P+N+PE	DB-L2	Final Circuit Conduit
BD-FB02	Busduct Floor Support & Fire Barrier	Lantai 2	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-JP02	Busduct Joint Pack	Lantai 2	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-R02	Vertical Busduct Riser Section	Lantai 2	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
TO-L2	Busduct Tap-Off Unit	Lantai 2	MCCB 250A 4P	800A	400/230V	3P+N+PE (4P)	DB-L2	LV Busduct Distribution
DB-L2	Sub Distribution Board (DB)	Lantai 2	250A MCCB 4P - 85 kVA		400/230V	3P+N+PE (4P)	TO-L2 / LVMDP	Sub Distribution
CT-B-L3	Branch Cable Tray (DB-L3 to Loads)	Lantai 3	Branch circuits		230V / 400V	1P & 3P	DB-L3	Branch Cable Tray
CT-F-L3	Feeder Cable Tray (TO-L3 to DB-L3)	Lantai 3	NY Y 4x120mm2 + BC 70mm2		400/230V	3P+N+PE (4P)	TO-L3 / DB-L3	Feeder Cable Tray
CD-LT-L3	Lighting Conduit EMT 20mm	Lantai 3	NYM 3x2.5mm2 lighting circuit (contoh)		230V	1P+N+PE	DB-L3	Final Circuit Conduit
CD-SO-L3	Socket Conduit RNC 25mm (cast-in slab)	Lantai 3	NYM 3x4mm2 socket circuit (contoh)		230V	1P+N+PE	DB-L3	Final Circuit Conduit

Electrical Distribution Schedule								
Component Name	Type	Floor	Rating	Busduct Rating	Voltage	Phase	Connected Panel	System
BD-FB03	Busduct Floor Support & Fire Barrier	Lantai 3	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-JP03	Busduct Joint Pack	Lantai 3	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-R03	Vertical Busduct Riser Section	Lantai 3	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
TO-L3	Busduct Tap-Off Unit	Lantai 3	MCCB 250A 4P	800A	400/230V	3P+N+PE (4P)	DB-L3	LV Busduct Distribution
DB-L3	Sub Distribution Board (DB)	Lantai 3	250A MCCB 4P - 85 kVA		400/230V	3P+N+PE (4P)	TO-L3 / LVMDP	Sub Distribution
CT-B-L4	Branch Cable Tray (DB-L4 to Loads)	Lantai 4	Branch circuits		230V / 400V	1P & 3P	DB-L4	Branch Cable Tray
CT-F-L4	Feeder Cable Tray (TO-L4 to DB-L4)	Lantai 4	NY Y 4x120mm2 + BC 70mm2		400/230V	3P+N+PE (4P)	TO-L4 / DB-L4	Feeder Cable Tray
CD-LT-L4	Lighting Conduit EMT 20mm	Lantai 4	NYM 3x2.5mm2 lighting circuit (contoh)		230V	1P+N+PE	DB-L4	Final Circuit Conduit
CD-SO-L4	Socket Conduit RNC 25mm (cast-in slab)	Lantai 4	NYM 3x4mm2 socket circuit (contoh)		230V	1P+N+PE	DB-L4	Final Circuit Conduit
BD-FB04	Busduct Floor Support & Fire Barrier	Lantai 4	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-JP04	Busduct Joint Pack	Lantai 4	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-R04	Vertical Busduct Riser Section	Lantai 4	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
TO-L4	Busduct Tap-Off Unit	Lantai 4	MCCB 250A 4P	800A	400/230V	3P+N+PE (4P)	DB-L4	LV Busduct Distribution
DB-L4	Sub Distribution Board (DB)	Lantai 4	250A MCCB 4P - 85 kVA		400/230V	3P+N+PE (4P)	TO-L4 / LVMDP	Sub Distribution
CT-B-L5	Branch Cable Tray (DB-L5 to Loads)	Lantai 5	Branch circuits		230V / 400V	1P & 3P	DB-L5	Branch Cable Tray
CT-F-L5	Feeder Cable Tray (TO-L5 to DB-L5)	Lantai 5	NY Y 4x120mm2 + BC 70mm2		400/230V	3P+N+PE (4P)	TO-L5 / DB-L5	Feeder Cable Tray
CD-LT-L5	Lighting Conduit EMT 20mm	Lantai 5	NYM 3x2.5mm2 lighting circuit (contoh)		230V	1P+N+PE	DB-L5	Final Circuit Conduit
CD-SO-L5	Socket Conduit RNC 25mm (cast-in slab)	Lantai 5	NYM 3x4mm2 socket circuit (contoh)		230V	1P+N+PE	DB-L5	Final Circuit Conduit
BD-EC	Busduct End Cap	Lantai 5	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-FB05	Busduct Floor Support & Fire Barrier	Lantai 5	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-JP05	Busduct Joint Pack	Lantai 5	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
BD-R05	Vertical Busduct Riser Section	Lantai 5	800A	800A	400/230V	3P+N+PE (4P)	LVMDP	LV Busduct Distribution
TO-L5	Busduct Tap-Off Unit	Lantai 5	MCCB 250A 4P	800A	400/230V	3P+N+PE (4P)	DB-L5	LV Busduct Distribution
DB-L5	Sub Distribution Board (DB)	Lantai 5	250A MCCB 4P - 85 kVA		400/230V	3P+N+PE (4P)	TO-L5 / LVMDP	Sub Distribution



www.autodesk.com/revit

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

[illegible]

Latihan BIM Gedung 5 Lantai - Busduct

Electrical Distribution Schedule

Project number GB-BD-002

Date 25-09-2026

Muhammad Sabiq Almuttadin

Checked by _____ Checker _____

E-202

Scale

Electrical Load Schedule							
Component Name	Type	Floor	Rating	Voltage	Phase	Connected Panel	System
AHU-L1	HVAC / Mechanical Load	Lantai 1	11 kW	400V	3P+N+PE	DB-L1	HVAC
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-LT-L1	Lighting Conduit EMT 20mm	Lantai 1	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit

Electrical Load Schedule							
Component Name	Type	Floor	Rating	Voltage	Phase	Connected Panel	System
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
CD-SO-L1	Socket Conduit RNC 25mm (cast-in slab)	Lantai 1	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L1	Final Circuit Conduit
LT-L1-01	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-02	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-03	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-04	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-05	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-06	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-07	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
LT-L1-08	Lighting Load (LED Panel)	Lantai 1	40 W	230V	1P+N+PE	DB-L1	Lighting
SO-L1-01	Socket Outlet Load (Floor Box)	Lantai 1	16A / 1000 VA	230V	1P+N+PE	DB-L1	Power - Socket Outlet
SO-L1-02	Socket Outlet Load (Floor Box)	Lantai 1	16A / 1000 VA	230V	1P+N+PE	DB-L1	Power - Socket Outlet
SO-L1-03	Socket Outlet Load (Floor Box)	Lantai 1	16A / 1000 VA	230V	1P+N+PE	DB-L1	Power - Socket Outlet
SO-L1-04	Socket Outlet Load (Floor Box)	Lantai 1	16A / 1000 VA	230V	1P+N+PE	DB-L1	Power - Socket Outlet
AHU-L2	HVAC / Mechanical Load	Lantai 2	11 kW	400V	3P+N+PE	DB-L2	HVAC
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-LT-L2	Lighting Conduit EMT 20mm	Lantai 2	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
CD-SO-L2	Socket Conduit RNC 25mm (cast-in slab)	Lantai 2	NYM 3x4mm2 socket circuit (contoh)	230V	1P+N+PE	DB-L2	Final Circuit Conduit
LT-L2-01	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-02	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-03	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-04	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-05	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-06	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-07	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
LT-L2-08	Lighting Load (LED Panel)	Lantai 2	40 W	230V	1P+N+PE	DB-L2	Lighting
SO-L2-01	Socket Outlet Load (Floor Box)	Lantai 2	16A / 1000 VA	230V	1P+N+PE	DB-L2	Power - Socket Outlet
SO-L2-02	Socket Outlet Load (Floor Box)	Lantai 2	16A / 1000 VA	230V	1P+N+PE	DB-L2	Power - Socket Outlet
SO-L2-03	Socket Outlet Load (Floor Box)	Lantai 2	16A / 1000 VA	230V	1P+N+PE	DB-L2	Power - Socket Outlet
SO-L2-04	Socket Outlet Load (Floor Box)	Lantai 2	16A / 1000 VA	230V	1P+N+PE	DB-L2	Power - Socket Outlet
AHU-L3	HVAC / Mechanical Load	Lantai 3	11 kW	400V	3P+N+PE	DB-L3	HVAC
CD-LT-L3	Lighting Conduit EMT 20mm	Lantai 3	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L3	Final Circuit Conduit
CD-LT-L3	Lighting Conduit EMT 20mm	Lantai 3	NYM 3x2.5mm2 lighting circuit (contoh)	230V	1P+N+PE	DB-L3	Final Circuit Conduit



AUTODESK

www.autodesk.com/revit

Consultant	Consultant
Address	Address
Address	Address
Phone	Phone
Fax	Fax
e-mail	e-mail
Consultant	Consultant
Address	Address
Address	Address
Phone	Phone
Fax	Fax
e-mail	e-mail

[illegible]

Latihan BIM	
Gedung 5 Lantai - Busduct	
Electrical Load Schedule	
Project number	GB-BD-002
Date	25-09-2026
Muhammad Sabiq Almuttaqin	
Checked by	Checker
E-301	
Scale	