

05/10/2004

INTERLEAF

COMMON FOR MILL, MECHANICAL, PROCESS AND AUTOMATION

Valmet Standard for SHOTTONPM3-Project, Common part for Mill, Mechanical, Process and Automation

	PROJECT INFORMATION
PROJECT NAME	Shotton Mill Ltd.
PROJECT CODE *)	SHOTTONPM3
FILLED IN BY	Hannu Mölsä
DATE	January 21, 2022
NOTE	

	CONTACT PERSONS & DISTRIBUTION
CUSTOMER	Mike Piper
Valmet	Petri Aspholm, MC Project Manager
	Hannu Mölsä, Automation Manager

*) Max. 16 characters (ProjKey-Common Keywords)

REVISIONS

0 Description of 1st revision

TABLE OF CONTENTS

1 PROJECT SPECIFIC INFORMATION

Content	Responsible	Rev.
1.1 Customer information and document titles	Supplier and Purchaser	0
1.2 Mill conditions	Purchaser	4
1.3 Safety standards	Supplier and Purchaser	0
1.4 Pressure vessel standard	Purchaser	1

2 Valmet STANDARD FOR ENGINEERING AND MANUFACTURING

Content	Rev.
2.1 Positioning, mill area and sub process numbering structure	2
2.2 Positioning, room numbering	1
2.3 Name plates, safety and mechanical	0
2.4 Name plates, automation	1
2.5 File naming	1
2.6 Color codes for demolition	0

1.1 Customer information and document titles

1.1.1 Customer information

The documentation will be performed according to Valmet's standard document models. However, in some special applications and in the deliveries of some Valmet's subsuppliers, the documentation style may be different.

Customer fields in title block:

Name of customer (length max 30 characters)

Shotton Mill Ltd

Name of factory / department (length max 30 characters)

Shotton Paper Mill, UK

1.1.2 Drawing format and title

Mill, mechanical and process Acad drawings

Acad (Automation)



ZZD31EH_12345_CODE_16EN MODEL.pdf

Excel (Automation)



A03L02EH_RAU4Exxxxx_0100EN (Autosaved).pdf

Acad (Automation)



ZZD31EH_12345_CODE_16EN.dwg

Excel (Automation)



A03L02EH_RAU4Exxxxx_0100EN (Autosaved).xlsx

1.2 Mill conditions

It is end-user's responsibility to make sure that all the conditions specified in this chapter correspond to the requirements specified in the contract.

Ambient temperature outside building	Summer (max)	+35 °C
	Winter (min)	- 20 °C
Minimum and maximum temperatures inside building	MCC room (min/max)	+5 ... +40 °C
	Electrical drives room (min/max)	+5 ... +40 °C
	Rack room (MCS and DCS) (min/max)	+5 ... +40 °C
	Machine floor temperature (min/max)	0 ... +40°C
	Basement temperature (min/max)	°C/ °C
Maximum humidity inside building	MCC room (max)	20 ... 80 %
	Electrical drives room (max)	100 %
	Rack room (MCS and DCS) (max)	100 %
Cooling water	Temperature (min/max)	2 - 30 25-30 °C Changed back to 30 deg on August 2, 2022
	Pressure (at ground floor)	0.3 MPa (gauge)
	Cooling water quality (See technical spec.)	- pH 7.0 + 0.3 - conductivity micro mhos 300 + 100 - total hardness mg/1 80 + 20 - chlorides mg/1 40 + 10 - seal water purity microns 40 + 10 - free chlorine ppm 1 + 0.5

Air	Mill air pressure (min/max)	0.5 - 0.7 MPa (gauge)
	Instrument air pressure (min/max)	The instrument air supply pressure is 0.6 MPa (gauge). The actuators shall be dimensioned for 0.5 MPa (gauge). 0.5 - 0.7 MPa (gauge)
	Instrument air quality (See technical spec.)	According to Technical Specification M4 05.11: Requirements for Compressed Air
MCS cabinets and cables	Direction of incoming cables (through roof or floor)	Through floor
Chemical aggressiveness	Chemical aggressiveness of mill environment	Plan to use carbon filters for incoming air if necessary
Height over sea		m
Seismic information		N/A

1.3 Safety standards

Product safety is according to technical specification

1.4 Pressure vessel standard

Following pressure vessel standard will be used in project execution phase.

- | | |
|--|-------------------------------------|
| UKCA | ☒ |
| - UK pressure vessel standard | |
| PED | ☐ |
| - European pressure vessel standard | |
| ASME | ☐ |
| - The American Society of Mechanical engineering standard | |
| CHINA | ☐ |
| - Manufacture licence of special equipment, pressure vessel | |
| OTHER | ☐ |
| - Local pressure vessel standard, based on local legislation | |
| - Description of local pressure vessel standard is, | |
-

2.1 Positioning, mill area and sub process numbering structure

2.1.1 General

The purpose of these instructions is to describe the expandable numbering procedure for machinery, equipment, pipelines, shut-off valves or similar fixtures in pipelines, instrumentation loops and main electrical equipment of respective production line. The detailed numbering procedure for electrical and instrumentation device has been described in the respective documents.

Positioning system based following standards,

- IEC81346-1, Industrial systems, installations and equipment and industrial products. Structuring principles and reference designations. Part 1: Basic rules
- IEC81346-2, Industrial systems, installations and equipment and industrial products. Structuring principles and reference designations. Part 2: Classification of objects and codes for classes

2.1.2 Mill area and sub process numbering structure

2.1.2.1 Plant Area Codes (**bolded to be used in SHOTTONPM3 project by Valmet and FIMPEC**)

Plant Area	Description
10	Wood Handling
20	TMP Plant
30	Paper Mill PM1
35	Paper Mill PM3
36	Chemical Building
40	Boiler Plant
42	Boiler Plant 2
46	Boiler Plant 6 New position
47	Low Pressure Condensing Turbine including

	Pump House and Dual Media Filter
50	RCF 1 (Recycled Fibre Plant 1)
52	RCF 1 (Recycled Fibre Plant 2)
53	RCF 3 (Recycled Fibre Plant 3)
55	OCC Building
56	RCF 4 (Recycled Fibre Plant 4)
59	M.R.F. (Municipal Recycling Facility)
60	Fresh and Effluent Water Treatment
65	Bio Gas Plant
70	Services and Auxiliary Departments
75	Site Services
80	Paper Mill PM2
85	Corrugator
91	Tissue machine TM1
92	Tissue machine TM2
93	Tissue Machine TM3

2.1.2.2 Sub-Process Codes

Sub-Process codes are specified for each Plant Area
See below and attached



SHOTTONPM3 Sub-Process Areas REV1.xlsx

OCC Building Plant Area Code 55		Paper Mill PM3 Plant Area Code 35		Chemical Building Plant Area Code 36	
Sub-Process Code	Name	Sub-Process Code	Name	Sub-Process Code	Name
0	General	0	General	0	General
1	Rooms	1	Rooms	1	Rooms
2	Cranes, lifts and hoists	2	Cranes, lifts and hoists	2	Cranes, lifts and hoists
3	Compressed air	3	Compressed air system	3	Compressed air
4	Instrument Air System	4	Instrument Air System	4	Instrument Air System
5	Safety showers	5	Safety showers	5	Safety showers
6	Fire and sprinkler water systems	6	Fire and sprinkler water systems	6	Fire and sprinkler water systems
7	CCTV	7	CCTV	7	CCTV
8	Building electrification	8	Building electrification	8	Building electrification
9		9		9	
10	Hall ventilation	10	Hall ventilation	10	Hall ventilation
11	Special room ventilation	11	Special room ventilation	11	Special room ventilation
12	Office building ventilation	12	Office building ventilation	12	Office building ventilation
13	Process ventilation	13	Machine ventilation	13	Process ventilation
14	Steam and condensate	14		14	
15	Heating water system (AHR)	15	Heating water system (AHR)	15	Heating water system (AHR)
16	Chilled water system	16	Chilled water system	16	Chilled water system
17	Sealing water system	17	Sealing water system	17	Sealing water system
18	Cooling water system	18	Cooling water system	18	Cooling water system
19	Potable water system	19	Potable water system	19	Potable water system
20		20		20	
21		21	Stock Preparation and Mixing	21	
22		22	Approach Flow System	22	
23		23	Vacuum system	23	
24		24	Broke System	24	
25		25	White water system	25	
26		26	Warm- and shower water system	26	
27		27	Steam and condensate system	27	
28		28	Gas	28	
29		29		29	
30	OCC pulping line 1	30		30	
31	OCC pulping line 2	31		31	
32	OCC cleaning and fractionation	32		32	
33	OCC thickening	33		33	
34	OCC reject handling	34		34	
35		35		35	
36		36		36	Chemicals for stock preparation (OCC)
37		37		37	Surface size preparation
38		38		38	Sizing agent
39		39		39	PAC
40		40		40	Defoamer and Biocide
41		41		41	OptiSizer Hard with Spray supply systems
42		42		42	Retention aid PAM
43		43		43	Bentonite
44		44		44	Dye brown
45		45		45	Defoamer
46		46		46	Biocide and hypochloride
47		47		47	Biocide and hypochloride dosing
48		48		48	Micropolymer and wire conditioning
49		49		49	Wire and felt cleaning agents

50			50		50	
51			51	Surface size	51	
52			52	Coating colour	52	
53			53	Machine supply system (Machine circulation)	53	
54			54		54	
55			55	Headbox	55	
56			56	Forming section	56	
57			57	Press section	57	
58			58	Pre dryer section	58	
59			59		59	
60			60	Sizing section	60	
61			61	After dryer section	61	
62			62	Calander	62	
63			63	Coating section	63	
64			64	Reel	64	
65			65		65	
66			66	Hydraulics	66	
67			67	Oil lubrication	67	
68			68	Grease lubrication	68	
69	MCS/DCS		69	MCS/DCS	69	
70	Condition monitoring		70	Condition monitoring	70	
71			71	QCS	71	
72			72	Basis weight headbox	72	
73			73	Steambox	73	
74			74	Scanner 1	74	
75			75	Scanner 2	75	
76			76		76	
77			77	Moisturizer 1	77	
78			78	Air Dryers	78	
79			79	Infra Dryers	79	
80			80		80	
81			81	WIS	81	
82			82	Web break cameras	82	
83			83		83	
84			84	Parent reel cart	84	
85			85	Winder 1	85	
86			86	Winder 2	86	
87	Control system, separate PLC systems		87		87	
88			88	Roll handling system	88	
89			89	Core handling system	89	
90			90	Roll transport	90	
91			91	Roll splitter	91	
92			92	PM drives	92	
93			93	Winder 1 drives	93	
94			94	Winder 2 drives	94	
95			95		95	
96			96		96	Chemicals for PM microflotation (bentonite + polymer)
97			97		97	Chemicals for effluent microflotation (bentonite + polymer)
98			98		98	Chemicals for biological treatment (flockulant, pH, nutrient, defoaming)
99			99		99	

2.1.3 Numbering structure for mechanical/process equipment

MMSSACCC

M	Plant Area Code
SS	Sub-Process Code
A	basic equipment identification code
CCC	Number for equipment from designated number area

2.1.3.1 Basic equipment identification code and consecutive number

Basic equipment identification code	Description
L	Agitators (401 ... 499)
L	Conveyers (nnn ... nnn)
L	Main process equipment (001 ... 299)
V K	Ventilation (fans, compressors) (801 ... 899)
P	Pumps (501 ... 599)
T	Tanks (chests, silos) (601 ... 699)
	Hand valves
L	Rolls and cylinders (nnn ... nnn)
L	Gears (nnn ... nnn)
L	Hydraulics (301 ... 399)


The unique equipment component numbering starts from 001 in every subarea and in every component code.

35-23P501, 35-23P502 ...

35-23T601, 35-23T602 ...

Numbering examples of mechanical equipment

Example 1: according to equipment number

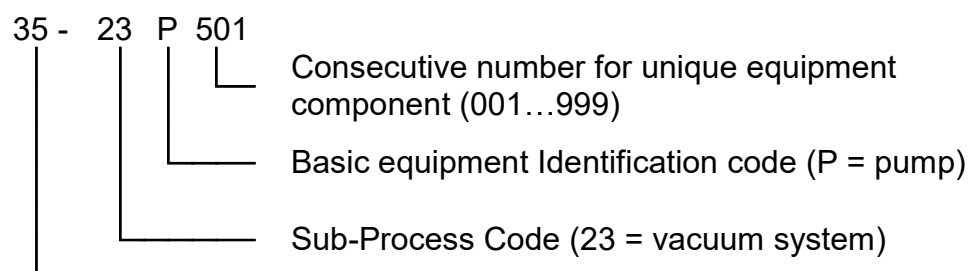

_____ Plant Area Code (35 = PM3)

Example 2: Roll, gear and motor numbering in drive system

35-57Lnnn Press section, 1st roll

35-57LnnnG Press section, 1st roll gear


35-57-nnn.1 Press section, drive motor for 1st roll

2.2 Positioning, room numbering

MMTTCC

MM	Plant Area code
TT	room type
CC	consecutive number for unique room (2 characters)

Example: 35RR01

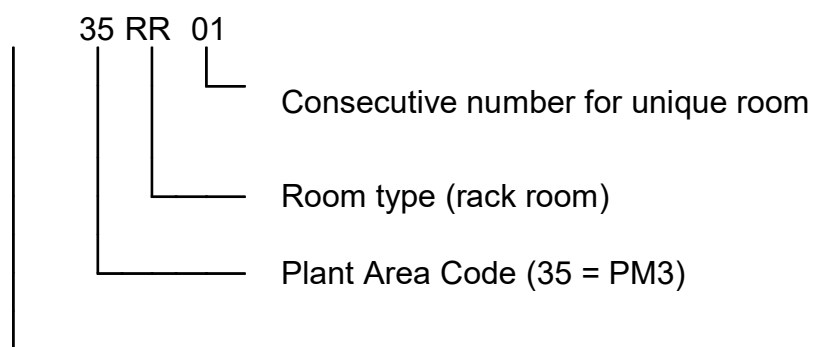

Room types:

CR = Control room


RR = Rack room

MCC = MCC room

2.3 Automation Name Plates Standard

NOTE ! THE POSITION NUMBERS IN THE NAME PLATES BELOW ARE NOT ACCORDING TO THIS PROJECT STANDARD BUT OTHERWISE THE STANDARD IS OK

PAP0000594#1.1A CONTROL DESKS/BOXES, TERMINAL BOXES, VALVE PANELS, HYDRAULIC UNITS

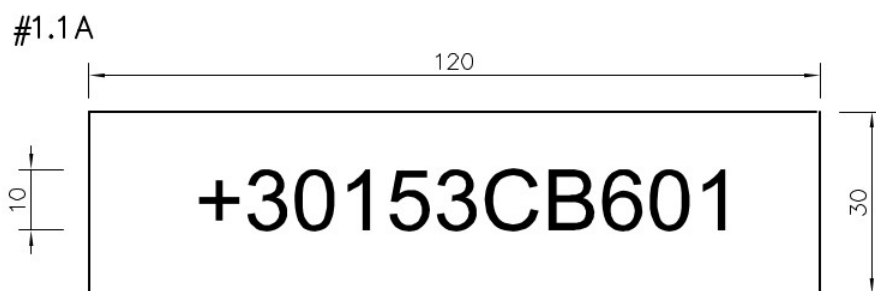


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry Areas and Control Boxes with Protective Covers in Wet Areas
- Max 11 characters

PAP0000594#1.1B CONTROL DESKS/BOXES, TERMINAL BOXES, VALVE PANELS, HYDRAULIC UNITS

#1.1B

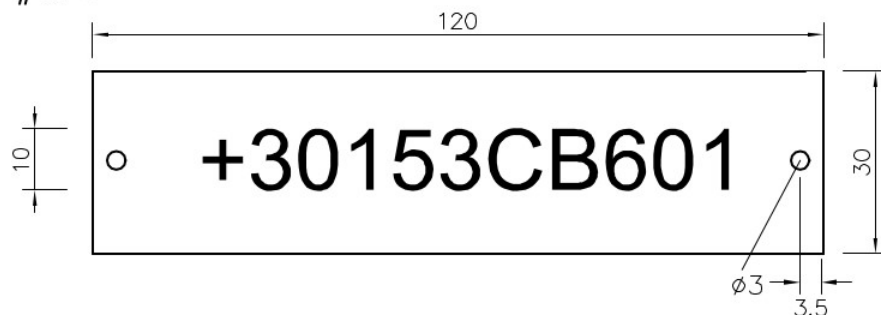


- White plastic, engraving on the back side, black text
- Fastening with thin double-sided tape

Usage:

- Dry Areas and Control Boxes with Protective Covers in Wet Areas
- Max 11 characters

PAP0000594#1.2 CONTROL DESKS/BOXES, TERMINAL BOXES, VALVE PANELS, HYDRAULIC UNITS

#1.2

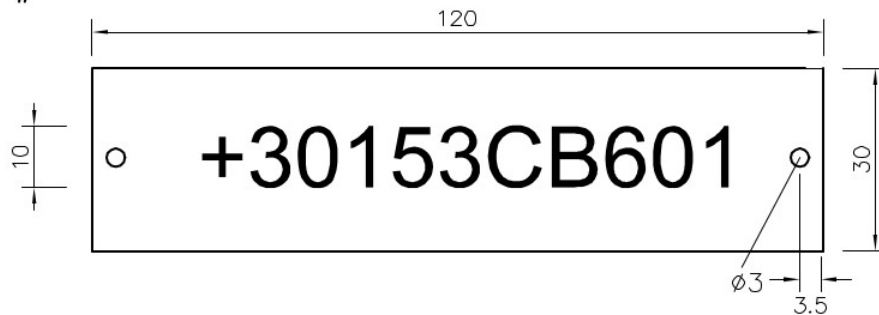


- Acid-proof steel, laser printing, black text
- Acid-proof screw fastening

Usage:

- Hot or Wet Areas
- Max 11 characters

PAP0000594#2.1A ADDITIONAL PLATES: VALVE PANELS AND HYDRAULIC UNITS

#2.1A

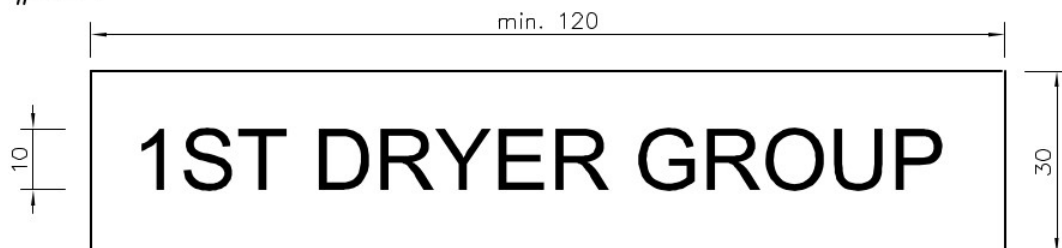


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape
- Plate min width 120mm, otherwise according to characters

Usage:

- Dry Areas. Install above plate #1.1A

PAP0000594#2.1B ADDITIONAL PLATES: VALVE PANELS AND HYDRAULIC UNITS

#2.1B

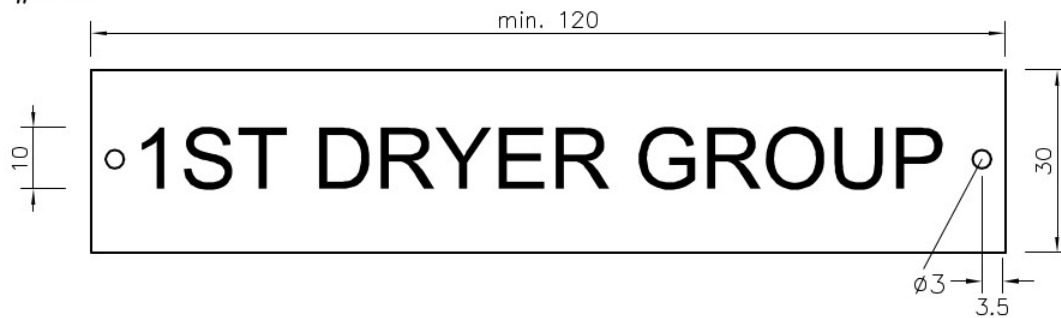

- White plastic, engraving on the back side, black text
- Fastening with thin double-sided tape
- Plate min width 120mm, otherwise according to characters

Usage:

- Dry Areas. Install above plate #1.1B

PAP0000594#2.2 ADDITIONAL PLATES: VALVE PANELS AND HYDRAULIC UNITS

#2.2




- Acid-proof steel, laser printing, black text
- Acid-proof screw fastening
- Plate min width 120mm, otherwise according to characters

Usage:

- Hot or Wet Areas. Install above plate #1.2

PAP0000594#3.1 FOR DNA CABINETS IP 20 FRAME ONLY

#3.1

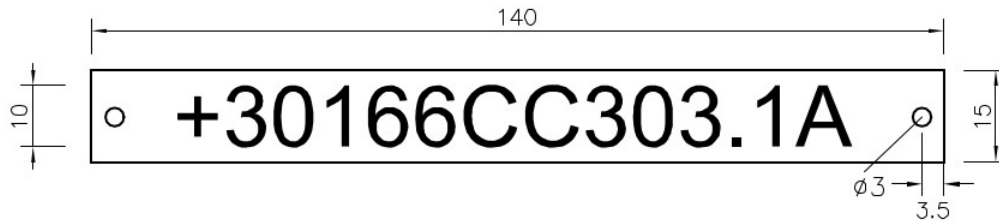


- White plastic, engraving on the back side, black text
- Screw fastening on the top doorframe
- Fastening with thin double-sided tape

Usage:

- Used for old model DNA-cabinets only
- Max 14 characters

PAP0000594#3.2 FOR ALL OTHER PLC- AND DNA-CABINETS

#3.2

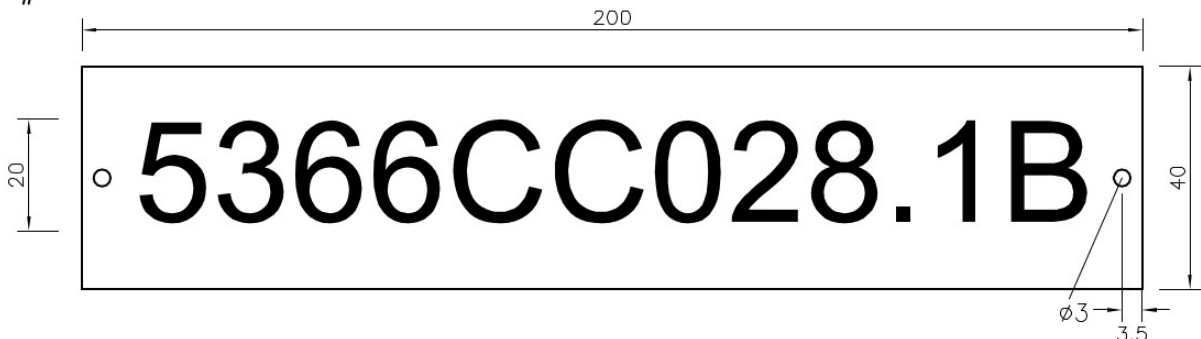

- White plastic, engraving on the back side, black text
- Fastening with thin double-sided tape

Usage:

- Used for Rittal cabinets etc.
- Max 14 characters

PAP0000594#4.1 CONTROL EQUIPMENT IN DESKS AND CONTROL BOXES




- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry and Wet Areas
- Max 23 characters each row

PAP0000594#4.2 CONTROL EQUIPMENT IN DESKS AND CONTROL BOXES

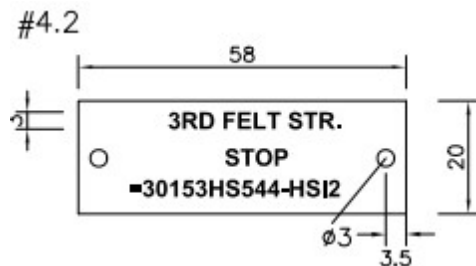


- Acid-proof steel, laser printing, black text
- Acid-proof screw or drive rivet fastening

Usage:

- Hot Areas
- Max 23 characters each row

PAP0000594#4.3 CONTROL EQUIPMENT IN DESKS AND CONTROL BOXES

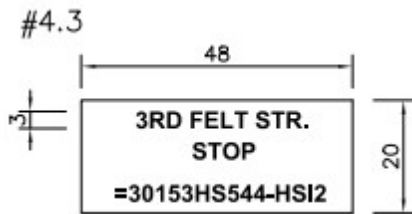


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry and Wet Areas
- Max 18 characters each row

PAP0000594#5.1 EMERGENCY STOP PUSHBUTTON

#5.1

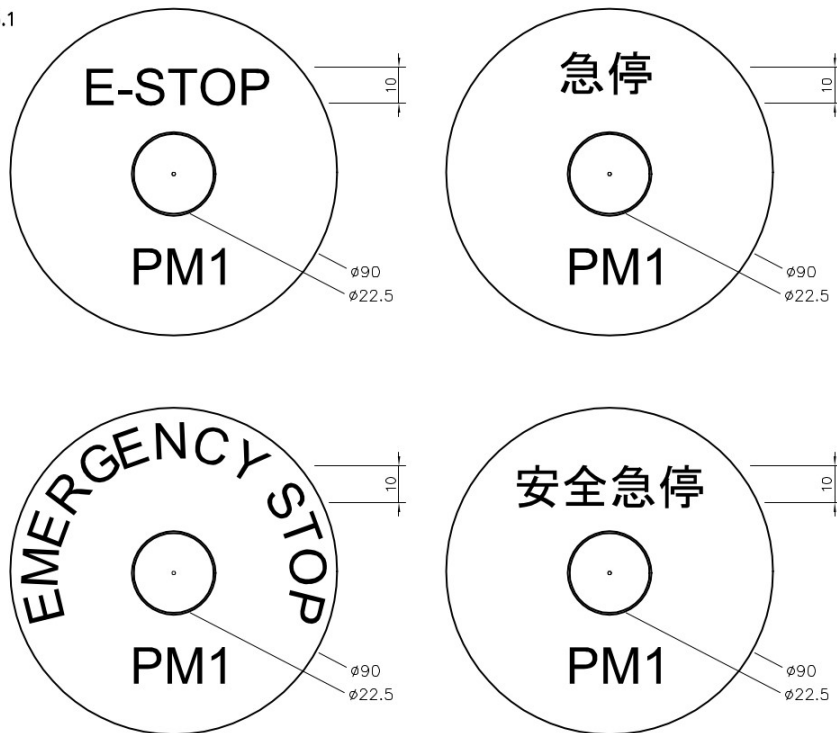


- Yellow plastic, engraving on the top side, black text
- Text in English: E-STOP / EMERGENCY STOP
- Text in Chinese: 急停 / 安全急停

Usage:

- Max 14 characters top row
- Max 6 characters bottom row

PAP0000594#5.2 ADDITIONAL PLATES

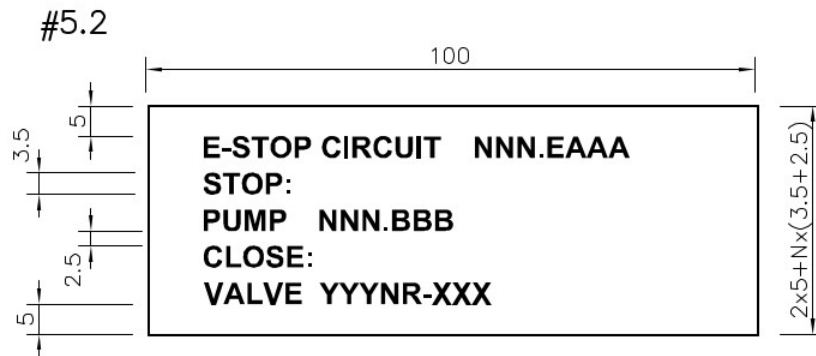


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape
- Text in English: E-STOP CIRCUIT
- Text in English: STOP:
- Text in English: CLOSE:

Usage:

- An additional plate is required only in special cases where the process has been divided into emergency stop zones and the emergency stop area cannot be indicated in any other way
- Max 30 characters each row

PAP0000594#6.1A ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

#6.1A

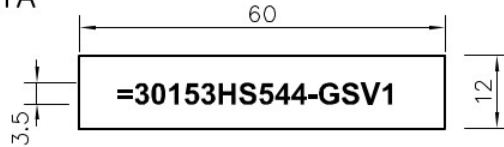


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry Areas
- Max 22 characters

PAP0000594#6.1B ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

#6.1B

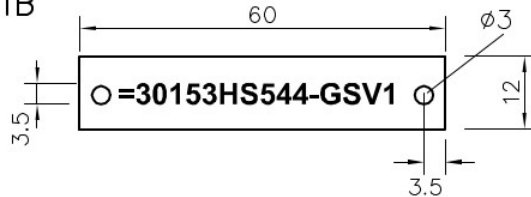


- White plastic, engraving on the back side, black text
- Fastening with thin double-sided tape

Usage:

- Dry Areas
- Max 19 characters

PAP0000594#6.2 ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

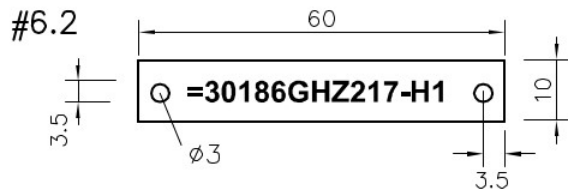


- Acid-proof steel, laser printing, black text
- Acid-proof screw or drive rivet fastening

Usage:

- Hot or Wet Areas
- Max 19 characters

PAP0000594#6.3 ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

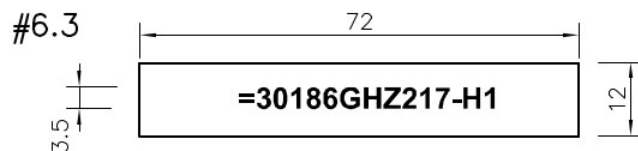


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Valve Cabinets and Boxes
- Max 25 characters

PAP0000594#6.4A ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

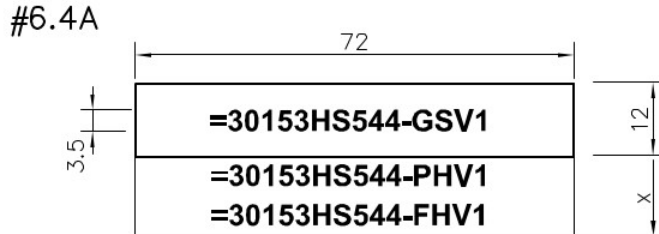


- White plastic, engraving on the back side, black text
- The number of device position rows equals to the number of valves
- Height according to the number of rows
- Fastening with acrylic foam tape

Usage:

- Valve Cabinets and Boxes, Sandwich Valve Blocks
- Max 25 characters each row

PAP0000594#6.4B ELECTRICAL, HYDRAULIC AND PNEUMATIC EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS AND ON MACHINE FRAMES

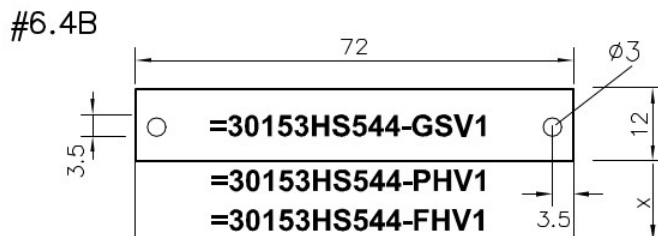


- White plastic, engraving on the back side, black text
- The number of device position rows equals to the number of valves
- Height according to the number of rows
- Fastening with thin double-sided tape and screw or drive rivet fastening

Usage:

- Valve Cabinets and Boxes, Sandwich Valve Blocks
- Max 25 characters each row

**PAP0000594#6.5 ELECTRICAL, HYDRAULIC AND PNEUMATIC
EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC
UNITS AND ON MACHINE FRAMES**

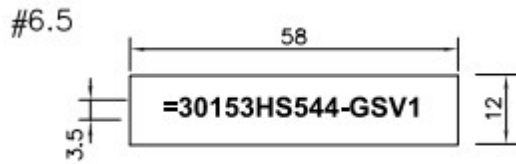


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry Areas
- Max 20 characters

PAP0000594#7.1A METERS AND INDICATOR EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS

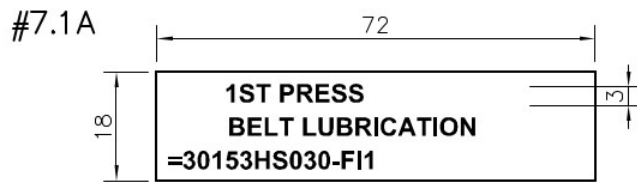


- White plastic, engraving on the back side, black text
- Fastening with acrylic foam tape

Usage:

- Dry Areas
- Max 30 characters

PAP0000594#7.1B METERS AND INDICATOR EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS

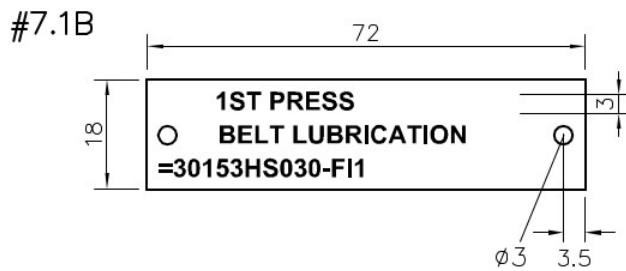


- White plastic, engraving on the back side, black text
- Fastening with thin double-sided tape

Usage:

- Dry Areas
- Max 30 characters

PAP0000594#7.2 METERS AND INDICATOR EQUIPMENT INSIDE BOXES AND VALVE PANELS AND IN HYDRAULIC UNITS

#7.2

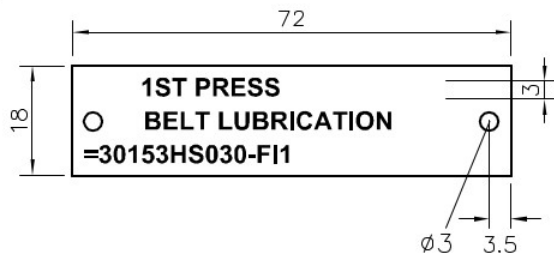


- Acid-proof steel, laser printing, black text
- Acid-proof screw fastening.

Usage:

- Hot or Wet Areas
- Max 30 characters

PAP0000594#8.1 FIELD EQUIPMENT, ON PROCESS PIPING AND MACHINE FRAME

#8.1

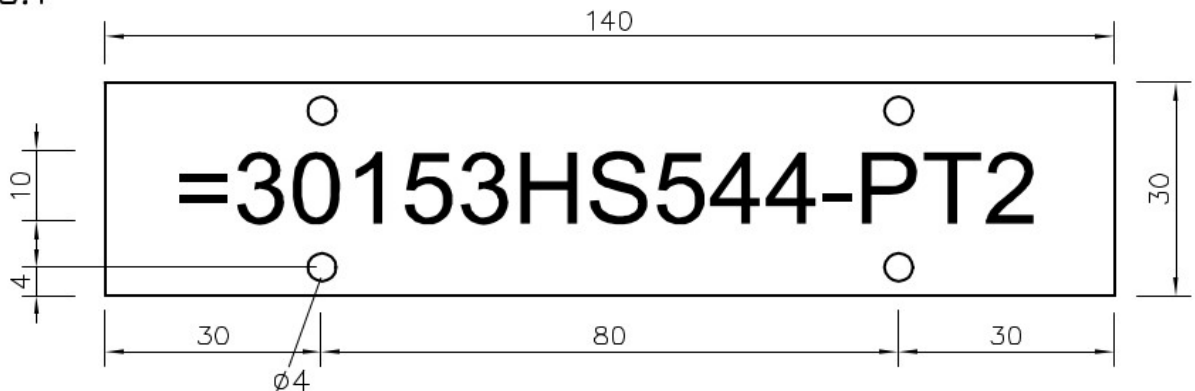


- White plastic, engraving on the back side, black text
- Acid-proof steel wire or cable tie (EN 1.4404 / AISI 316 L)

Usage:

- Dry Areas
- Max 15 characters

PAP0000594#8.2 FIELD EQUIPMENT, ON PROCESS PIPING AND MACHINE FRAME

#8.2

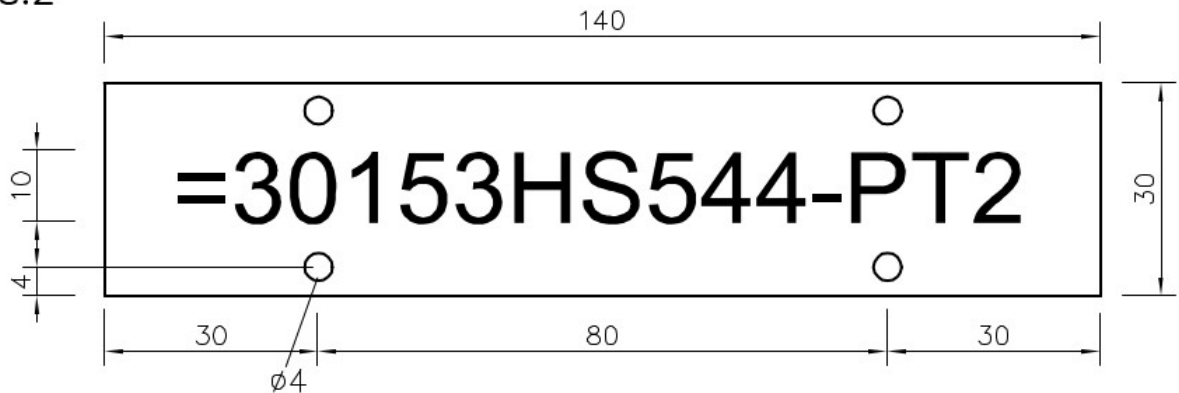

- Acid-proof steel, laser printing, black text
- Acid-proof steel wire or cable tie (EN 1.4404 / AISI 316 L)

Usage:

- Hot or Wet Areas
- Max 15 characters

PAP0000594#9.1 CABLE MARKINGS



- Phoenix Contact Cable Markers **KMK2** (or **KMK4** for extralong text) are used instead of cable plates: **VAL0134728 KMK2** and **VAL0255656 KMK4**


- White paper inside KMK2 or KMK4 pocket, black text
- Fastening with plastic cable tie

Usage:

- Dry Areas

PAP0000594#9.3 CABLE PLATES

#9.3

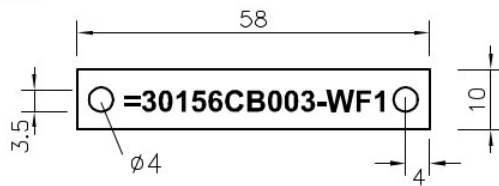


- Acid-proof steel, laser printing
- Steel plate, black text
- Acid-proof steel wire or cable tie (EN 1.4404 / AISI 316 L)

Usage:

- Hot or Wet Areas
- Max 18 characters

PAP0000594#10.1 PIPE PLATES

#10.1

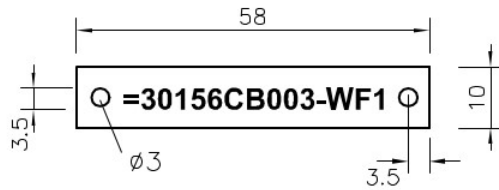


- Acid-proof steel, laser printing, black text
- Fastening with acid-proof steel wire or cable tie (EN 1.4404 / AISI 316 L) or
- Acid-proof screw or drive rivet fastening.

Usage:

- All pipes
- Max 18 characters

PAP0000594#10.2 PIPE PLATES

#10.2

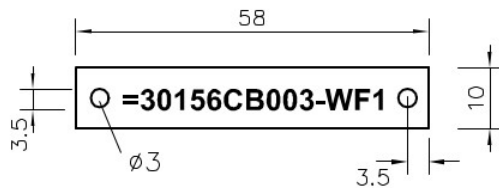

- Paper printout protected with plastic. (Partex PM cable marking)
- White background, black text
- Fastening with cable tie


Usage:

- Inside valve panels
- Max 18 characters

PAP0000594#10.3 PIPE PLATES

Aluminum sheet with stamps, e.g. pipelines of circuits =30186GHZ217 and =30186GHZ217

#10.3

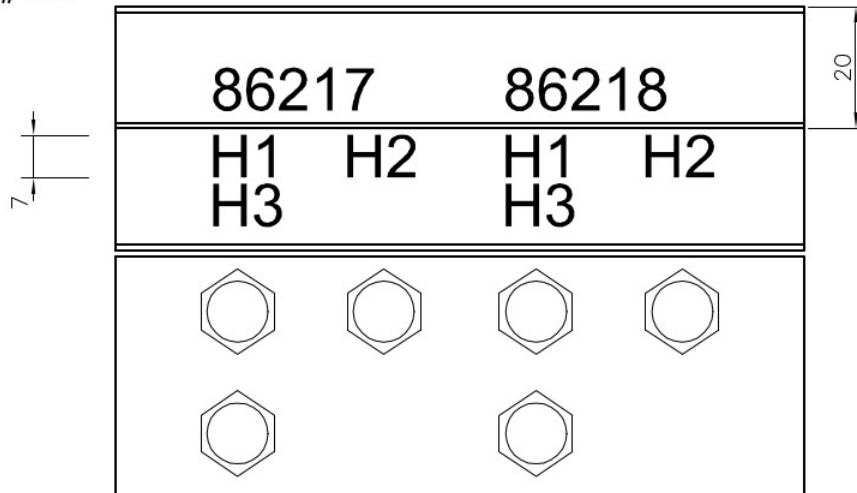


- Aluminum sheet. Height 20 mm.
- Stamped, height of text 7 mm.

Usage:

- Hydraulic Units, Pipes at Valve Panels

PAP0000594#10.4 PIPE PLATES

#10.4

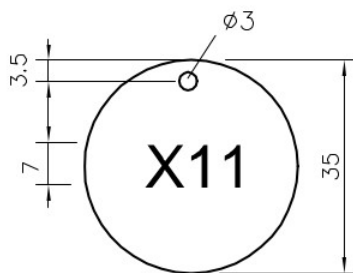


- Acid-proof steel, laser printing, black text
- Coupling code marked on the plate.
- Fastening with acid-proof steel wire (EN 1.4404 / AISI 316 L)

Usage:

- Hydraulic Units, Markings of Hoses Equipped with Quick Couplings

GROUNDING LABEL FOR MACHINE FRAMES AND HYDRAULIC UNITS:

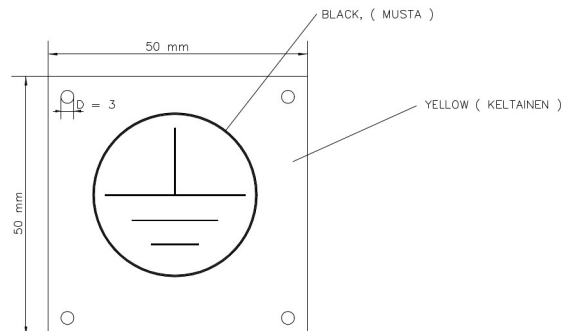


- Acid-proof steel, laser printing, black text, yellow background
- Acid-proof screw fastening

Usage:

- The grounding label is used to indicate the right point for field grounding cable on machine frames and hydraulic units

VALMET STICKER FOR ALL AUTOMATION CABINETS AND -BOXES:

Cabinet id marking plate is located on the left corner of the door (or in the middle of the door on the wider cabinets).

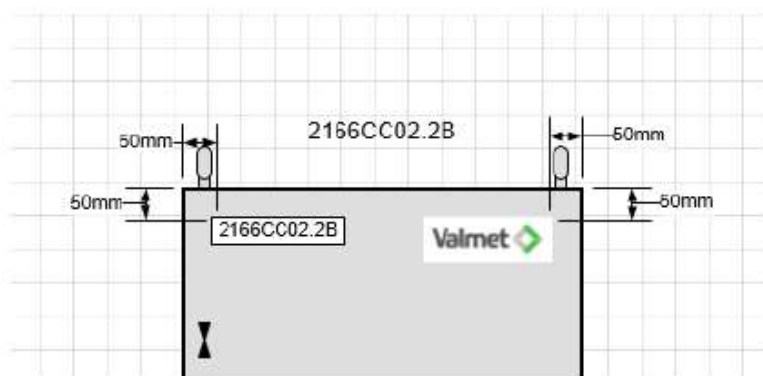

The default brand label is **GDI0004330 : VALMET Sticker 195x70 PVC Separate letters** in IP54 cabinets. Is located in the right corner of the door.

For small boxes/panels default brand label is **GDI0006293** 120x43 mm

PAP0000594 NAME PLATES:

See attached files.

VALMET GLOBAL NAME PLATES IN CADMATIC:

See attached files.

CONTROL EQUIPMENT IN DESKS AND CONTROL BOXES:

See attached files.

2.4 Name plates, Safety and mechanical

2.3.1 Device Position and Device Number Plates

Link Message: Device Position and Device Number Plates (Mechanical Engineering) 

2.3.2 Safety signs

Link Message: Safety Signs / Turvallisuuskilvet 

2.5 File naming

File naming according to Valmet standard

2.6 Color codes for demolition

Tämä siirtomuutosväri-taulukko valitaan, kun on kyseessä osittainen rakenneryhmän uusinta.
This relocation modification color table is selected for partial machine section rebuilds.

Painting on-site	3D-models	Drawings	Color	Description
			Blue	- Modifications
			Green	- No modifications - Relocation
			Red	- Removal
no painting			Orange	- New part
no painting			Grey/ White	- Existing part - No changes

Tämä siirtomuutosväri-taulukko valitaan, kun koko rakenneryhmä puretaan peruslaatalle asti ja rakennetaan uudestaan.

This relocation modification color table is selected when the entire machine section is disassembled down to the base plate and reconstructed.

Painting on-site	3D-models	Drawings	Color	Description
			Blue	- Modifications
			Green	- No modifications - Relocation
			Red	- Removal
no painting			Grey/ White	- New part

Original instruction, see following link -> [📄 \(PAP Engineering Instructions-database\)](#)