



F4 — Per-correction contribution: the corrections act in opposing directions

A net figure conceals this. The internal-gains correction raises heating by +2,031.04 kWh and the conditioned-zone correction lowers it by −4,018.18 kWh; the two infiltration defect fixes take off a further −56.33 and −39.08 kWh, and the Australian q_{50} recalibration returns +8.87 kWh. Derived from consecutive states of results/paper/trajectory_v2/comparison.md.

A — Sensible heating: baseline 1,779.36 kWh → canonical 122.88 kWh

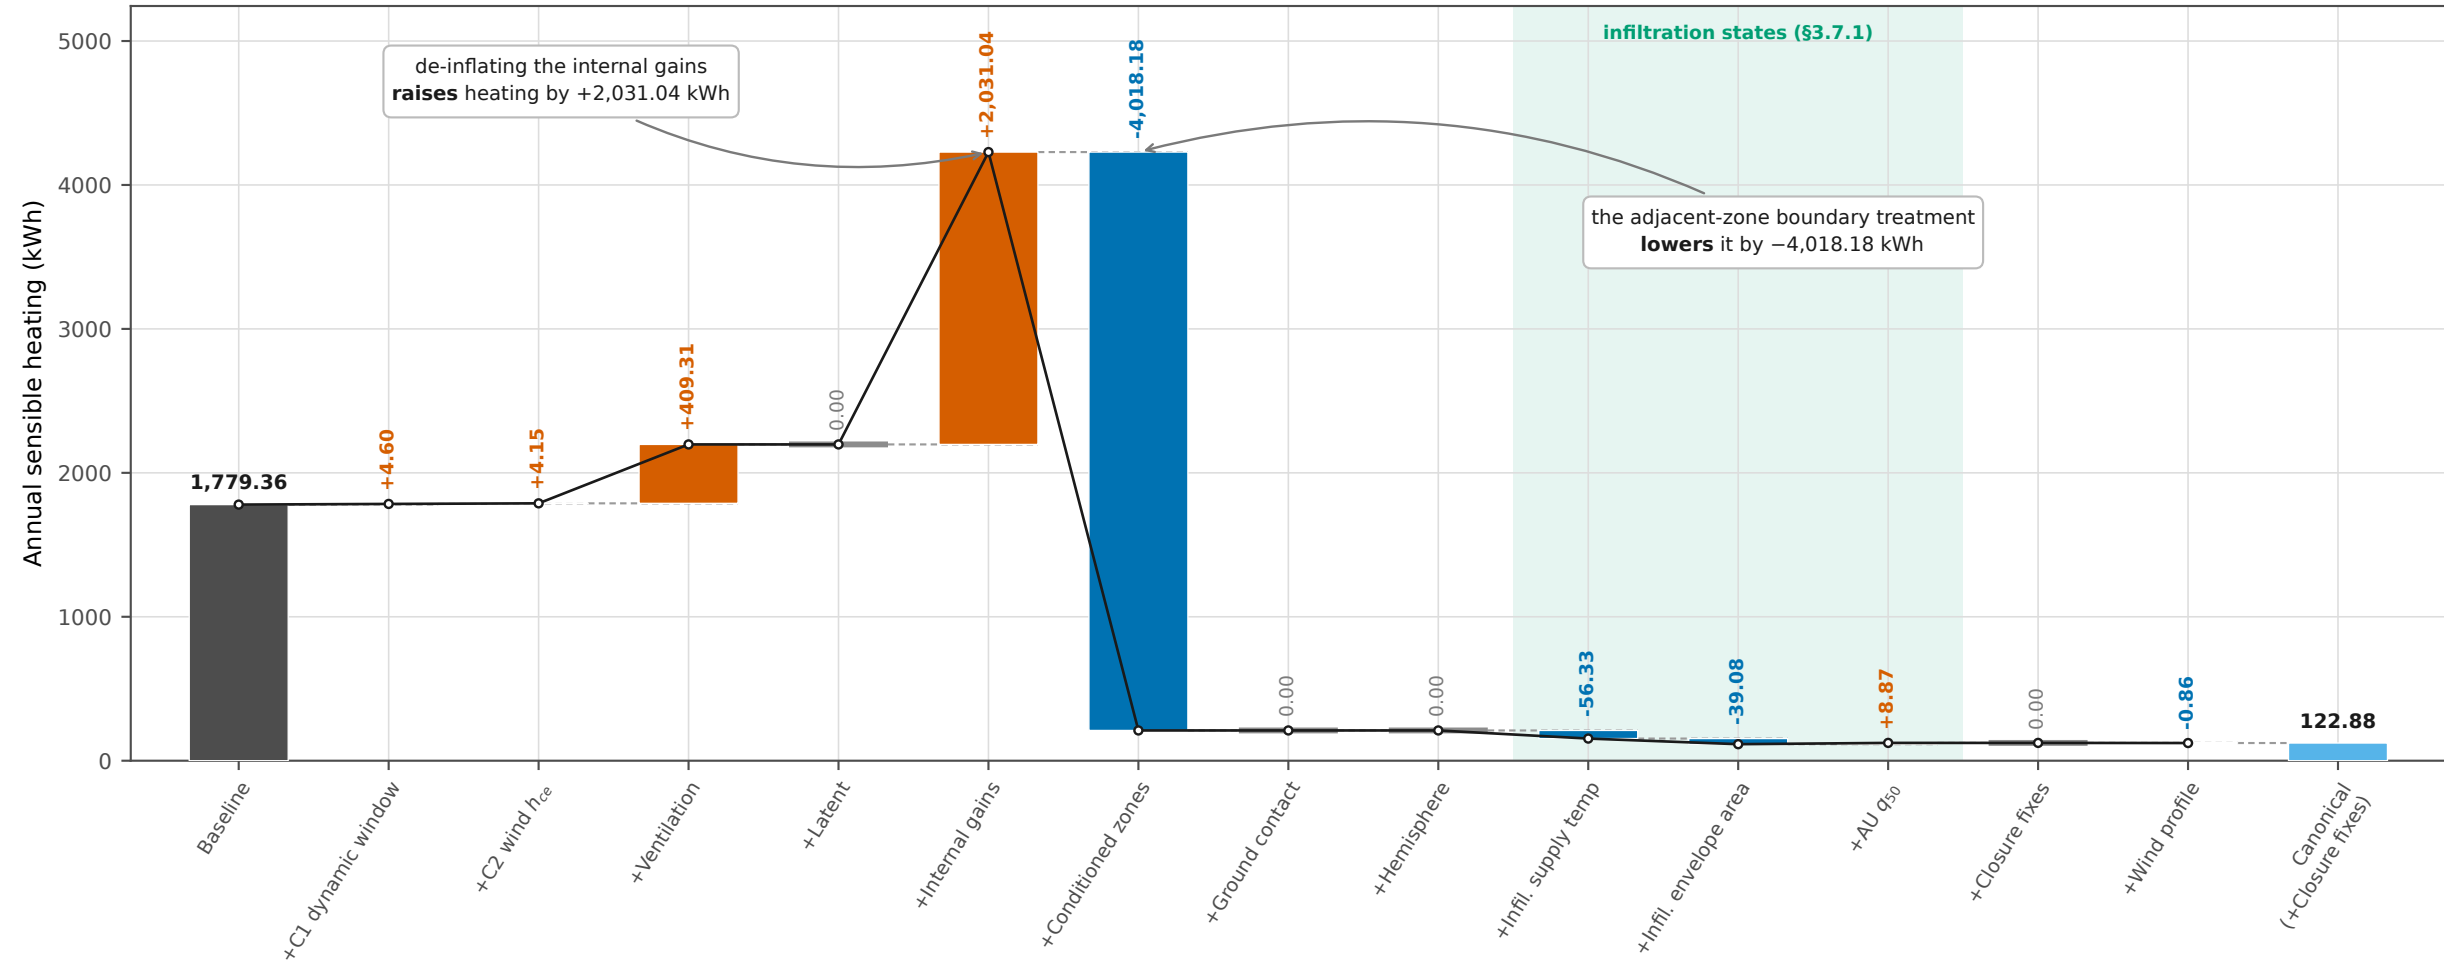

B — Sensible cooling: baseline 640.84 kWh → canonical 19.90 kWh

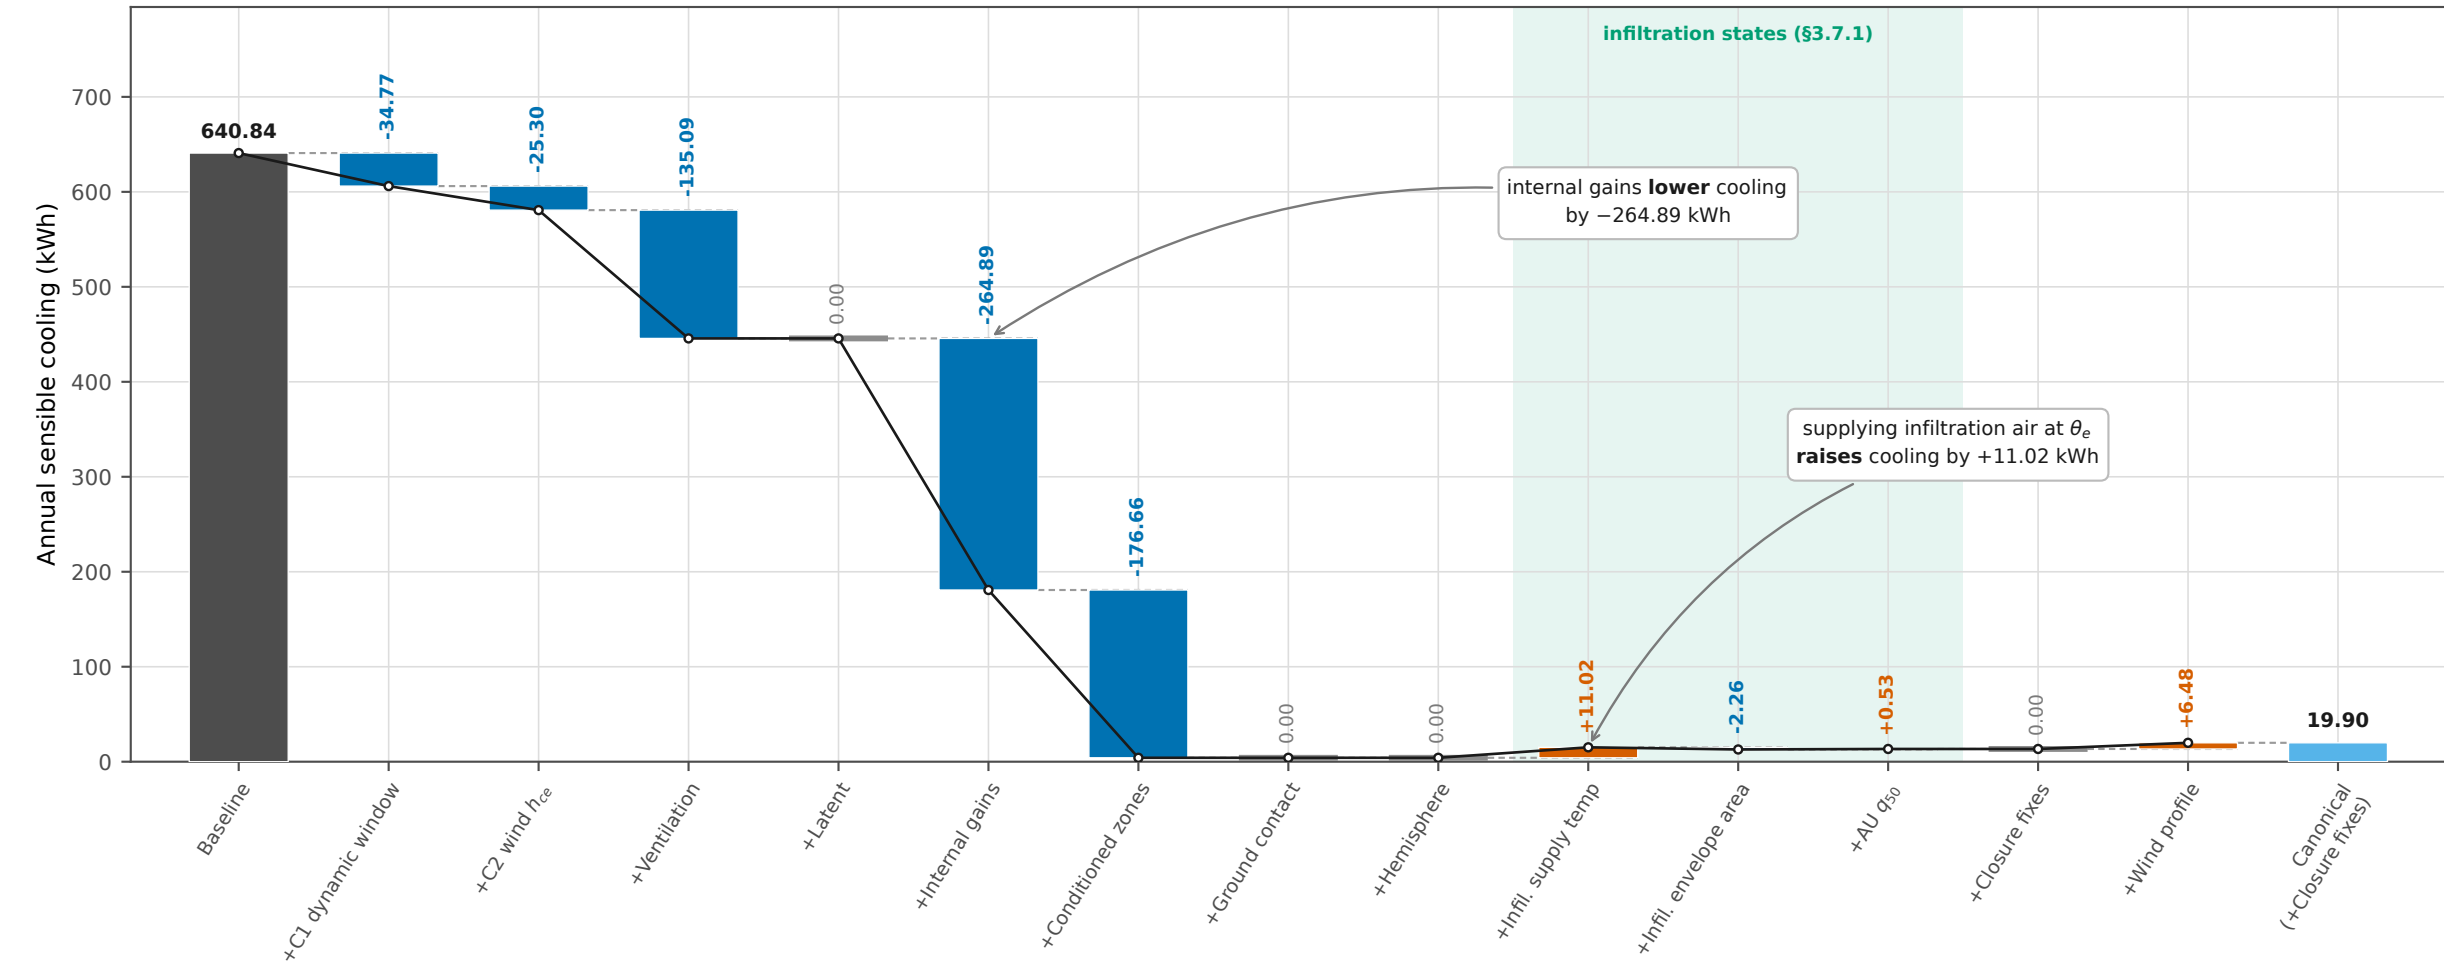

Correction raises the need Correction lowers the need No change ($|\Delta| < 0.005$ kWh) Baseline level Canonical level Cumulative running total