


F12 — Where the remaining ISO-against-EnergyPlus disagreement sits, by loss path
The totals agree to 0.0 kWh; the agreement rests on two large opposing differences, not on uniform agreement

Net heat gain to the zone, kWh/yr, positive into the zone. Corrected ISO 52016-1 against the matched EnergyPlus 24.1.0 case, Melbourne-Essendon Fields TMYx 2011-2025. Paths are ordered by absolute difference, so the two that carry the disagreement appear together.

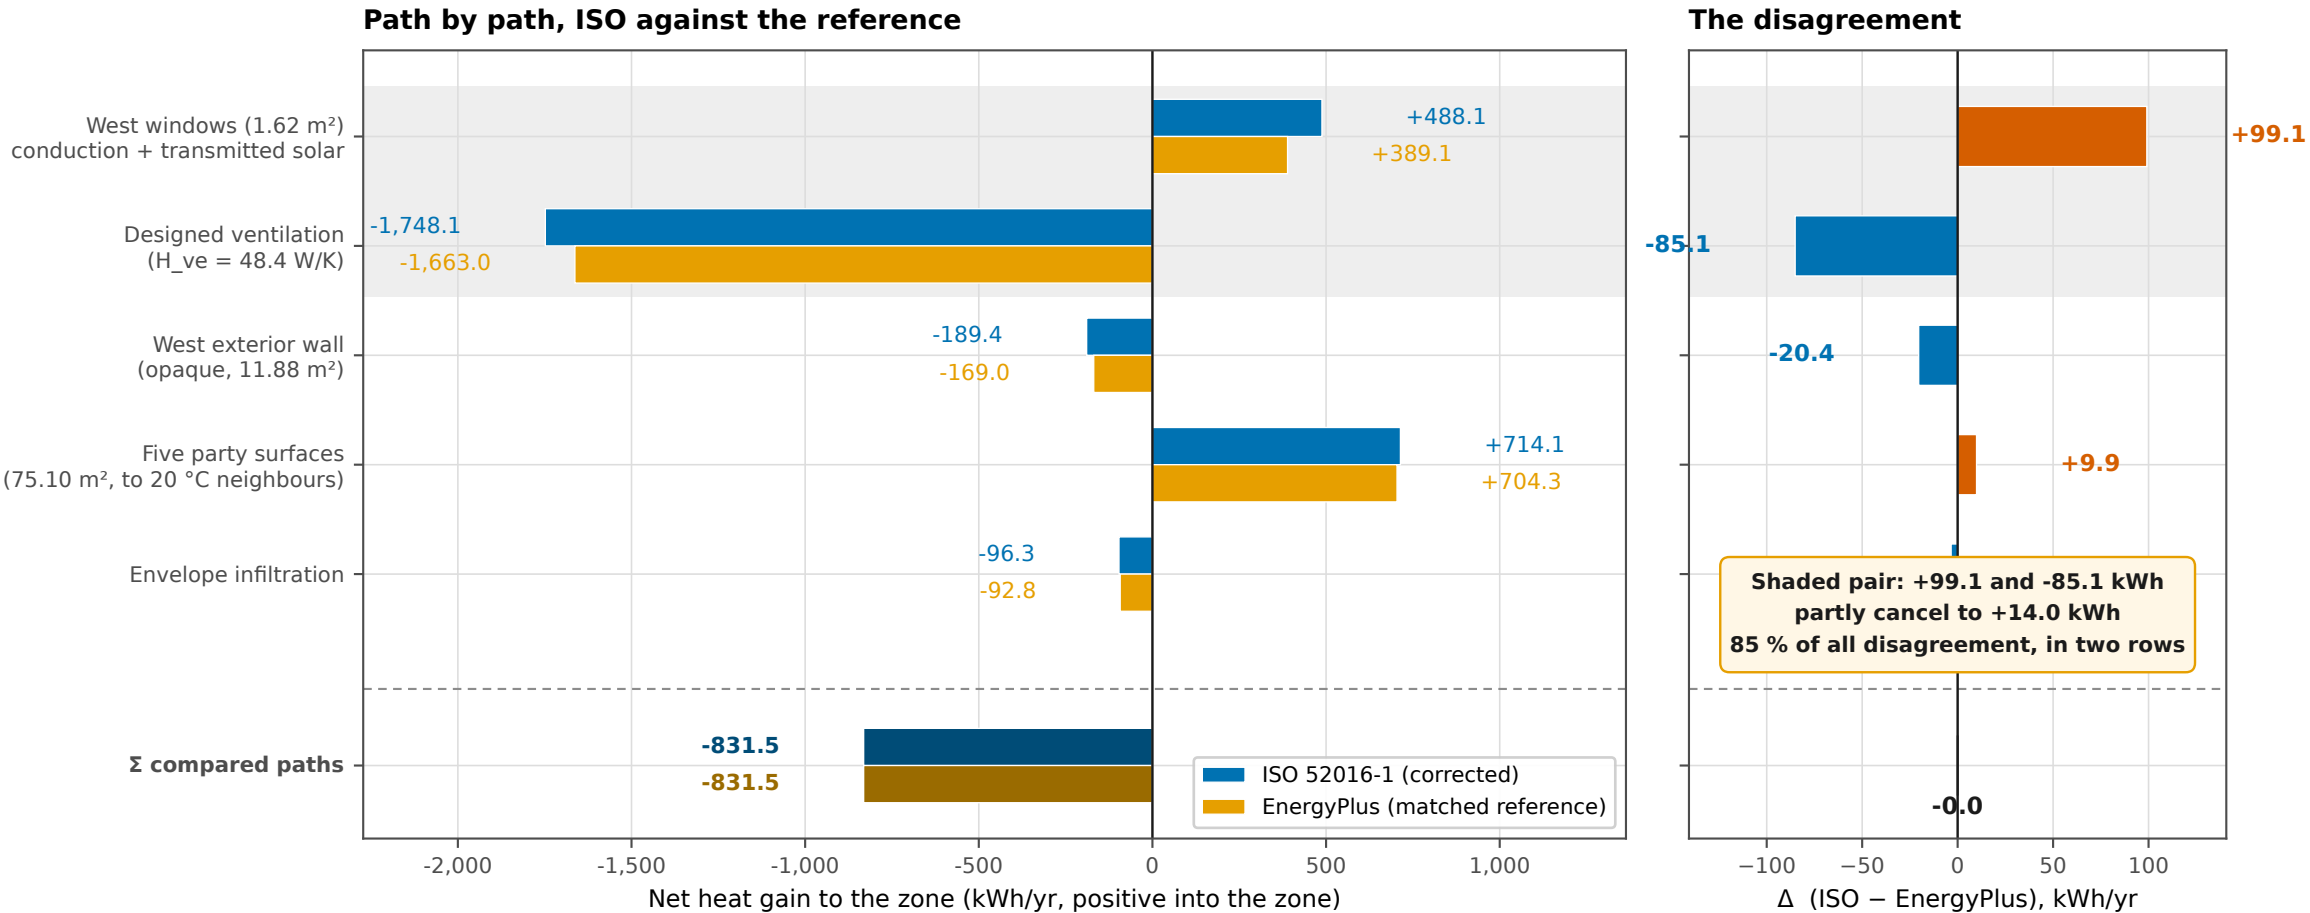

A total that agrees is not evidence that the paths agree. The compared paths sum to -831.5 kWh on the ISO side and -831.5 kWh on the reference — a difference of 0.0 kWh — while individual paths differ by up to 99 kWh. This is the same pattern as the false validation the work set out to detect: a plausible aggregate standing on offsetting errors. The Σ row is a like-for-like comparison of each path, not a closed balance — the two engines partition the zone balance differently, and internal gains (730.29 kWh) are identical by construction and not listed.