


F13 — Apt 305: one exposed facade, five conditioned neighbours

88.6 % of the envelope conductance faces conditioned space, which is why the adjacent-zone treatment is the largest single correction


Areas, U-values and adjacencies are read from `examples/apt305\_building.py`, the same building dictionary the engine is run on. No simulation data.

A The envelope: one exposed facade, five party surfaces

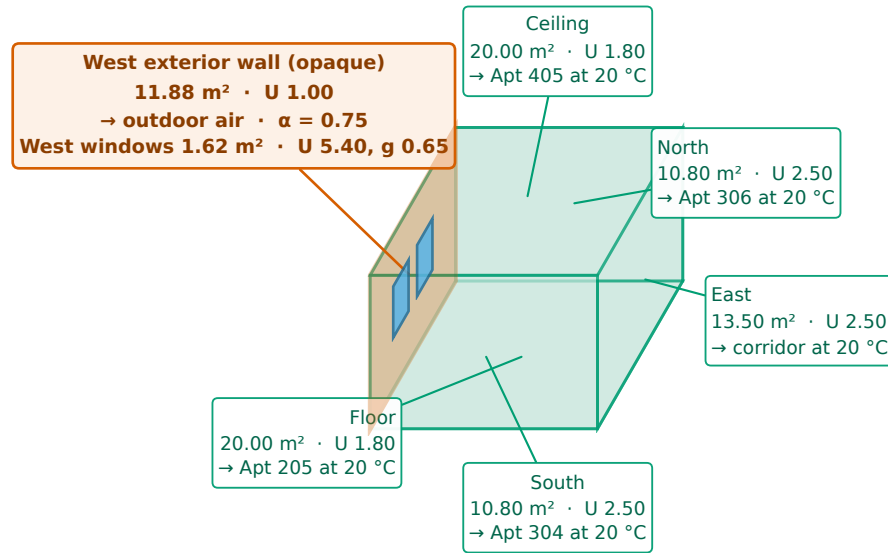

Level 3 of a mid-rise apartment block; 5 × 4 × 2.7 m, 20 m² net floor area. The exposed facade faces 270° (west).
Axonometric, schematic in depth.

B Where the envelope conductance is

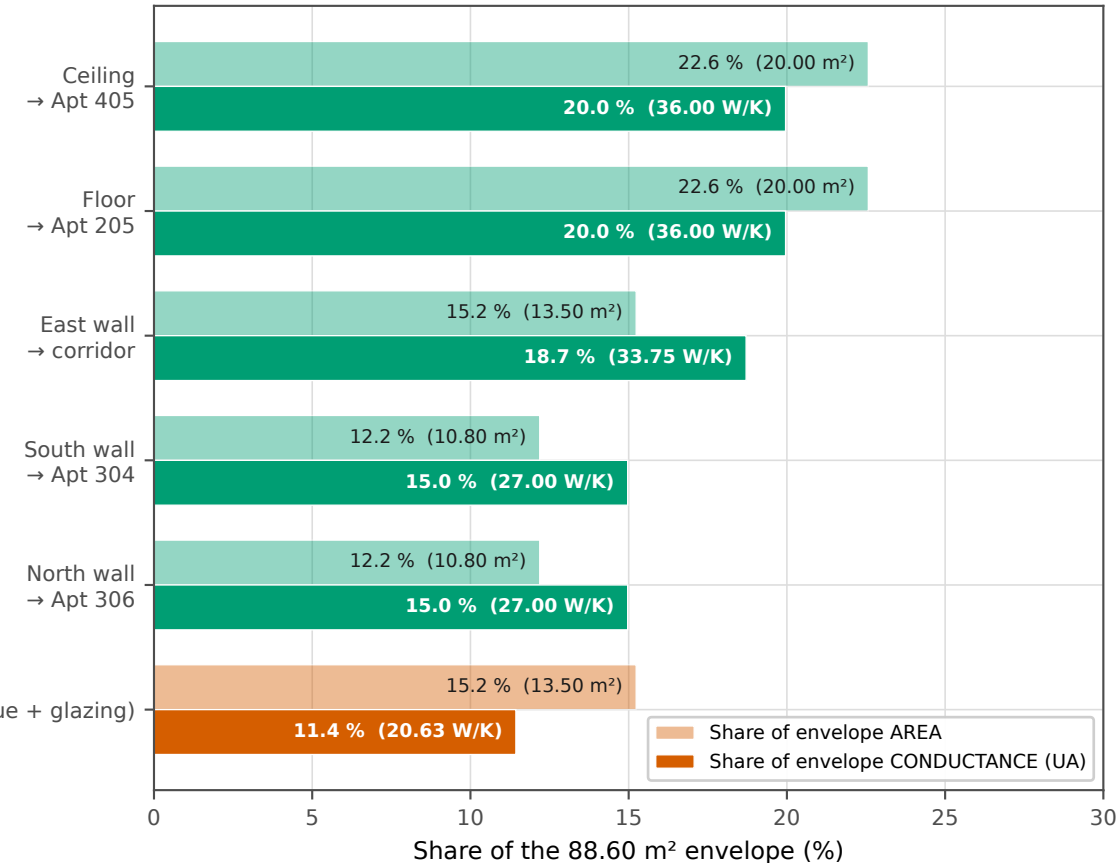

Why this geometry decides the result. Typed as unconditioned buffers, the five party surfaces are driven through the ISO 13789 buffer expression and track outdoor air. Held at 20 °C instead, they see a 20 °C boundary across 88.6 % of the envelope conductance. That single change moves annual sensible heating by -4,018.18 kWh — larger than every other correction in the paper combined, and a consequence of the geometry rather than of the method. **Area is not the measure.** The five party surfaces are 84.8 % of the envelope by area but 88.6 % of it by conductance; the west facade is 15.2 % by area and only 11.4 % by UA.