


F2 — Baseline annual energy balance, ISO 52016-1 as vendored

Apt 305, 50 Barry St Carlton · AUS_VIC_Melbourne-Essendon.Fields.958660_TMYx.2011-2025 · all seven transmission line items resolved

Inputs 8,305.6 kWh · outputs 8,402.3 kWh · residual -96.7 kWh (-1.16 % of inputs) — drawn as an unmatched gap, not as a flow

INPUTS 8,305.6 kWh

OUTPUTS 8,402.3 kWh

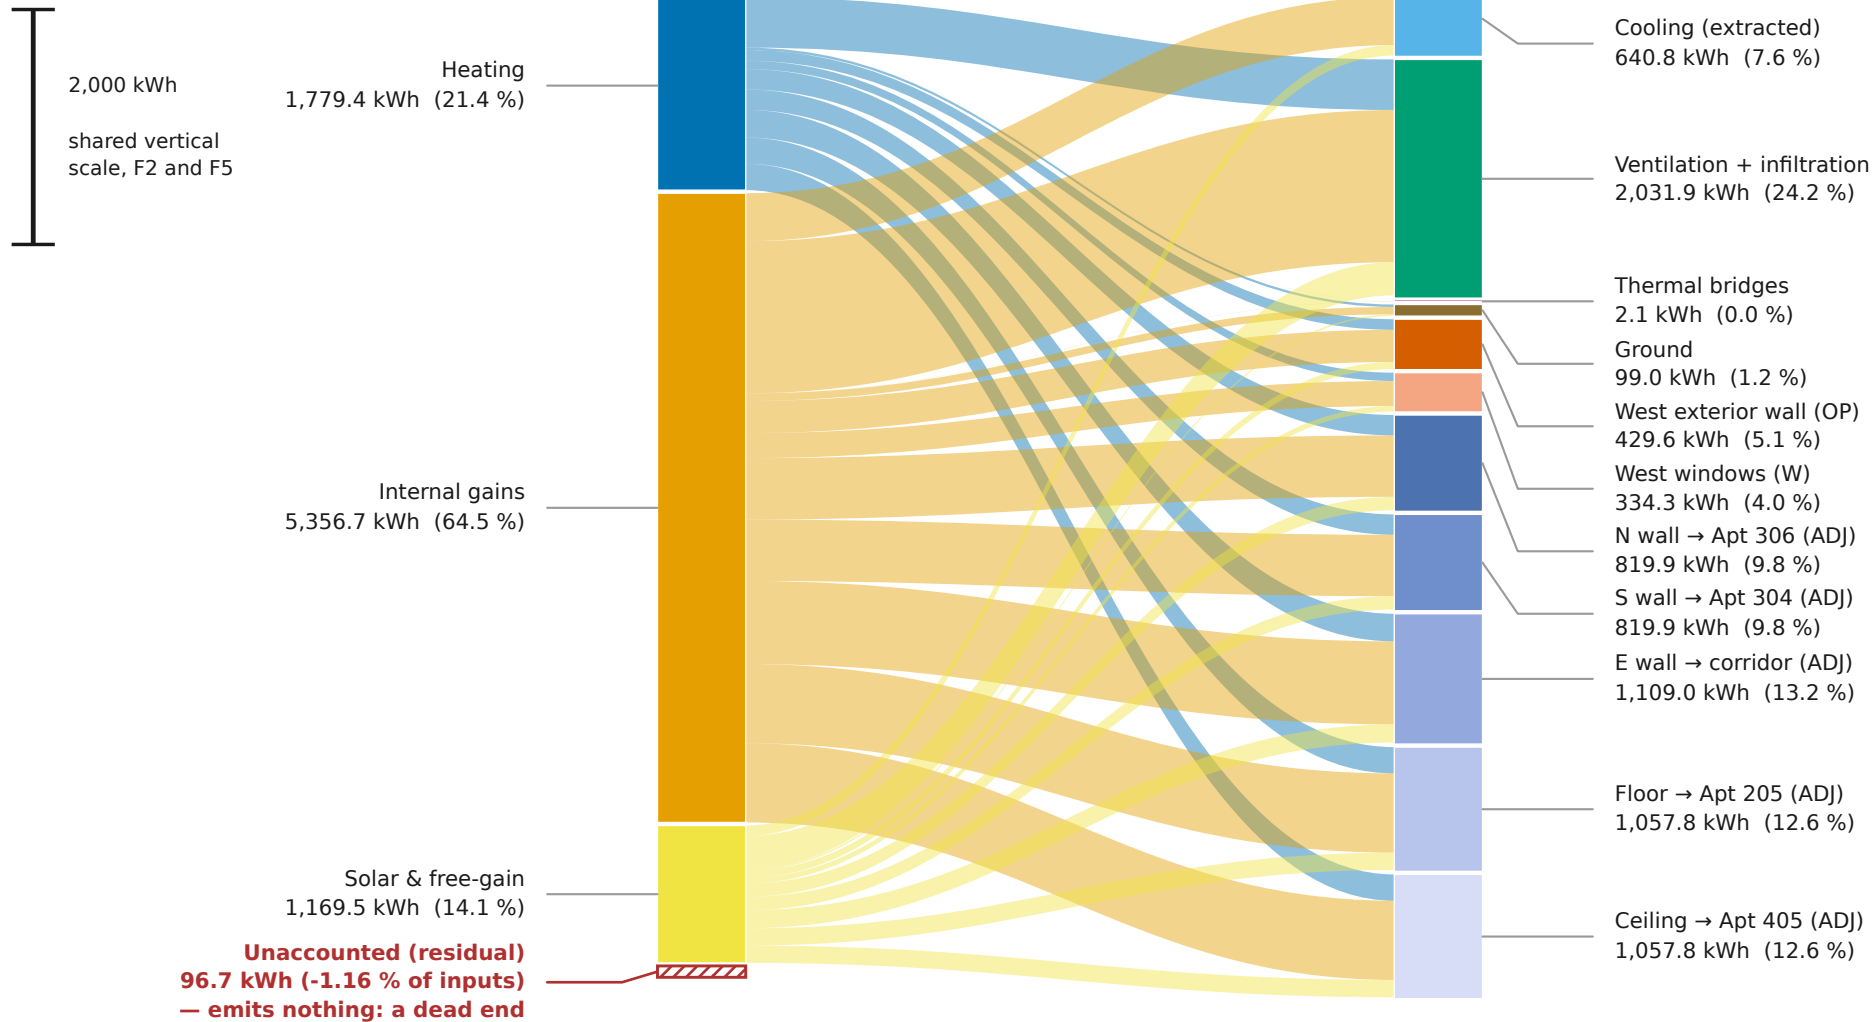

Internal gains dominate the input
5,357 kWh of 8,306 kWh = **64.5 %** of everything
entering the balance — more than heating
and solar together.

The **five party surfaces** dominate the loss
4,865 kWh, 57.9 % of all output. They are
75.10 m² and 88.6 % of the envelope UA, and
they face conditioned neighbours, not outdoors.

The unmatched gap
Outputs exceed inputs by 96.7 kWh
(-1.16 % of inputs). Nothing supplies it,
so it is drawn hatched and emits no ribbon —
never absorbed into a transmission item.

Ribbon pairings are *proportional*, not traced: ISO 52016-1 is a node network and does not attribute a given gain to a given loss.
The vertical scale is shared with F5, so the two balances can be compared directly. Source: results/paper/trajectory_v2/trajectory_raw.json → Baseline → config_B → sankey.