
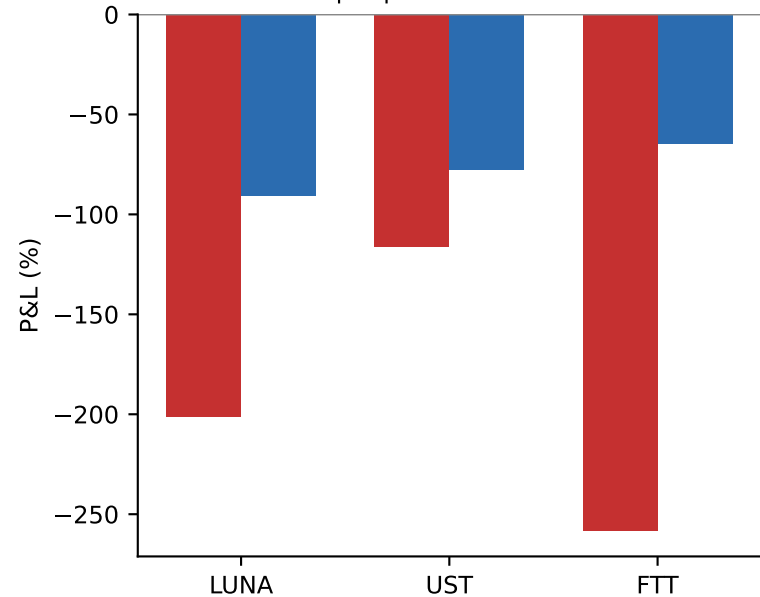


forced-hold P&L per pair

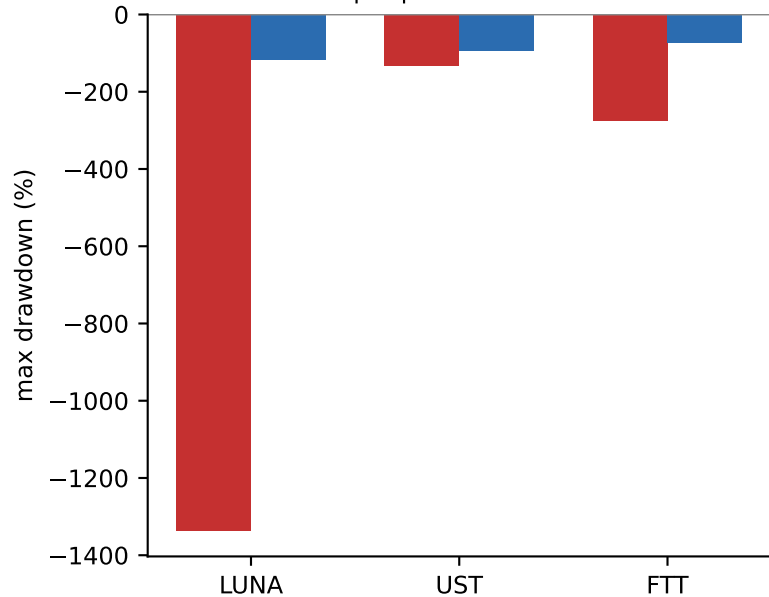

worst drawdown per pair

 no breaker with breaker