


Pre-intervention:
micro-hydro grid only

Intervention date
(May 16, 2024)

Post-intervention: stacked system

Protected PV circuit in use for critical loads;
micro-hydro remains available for other uses

Monitoring of existing micro-hydro system

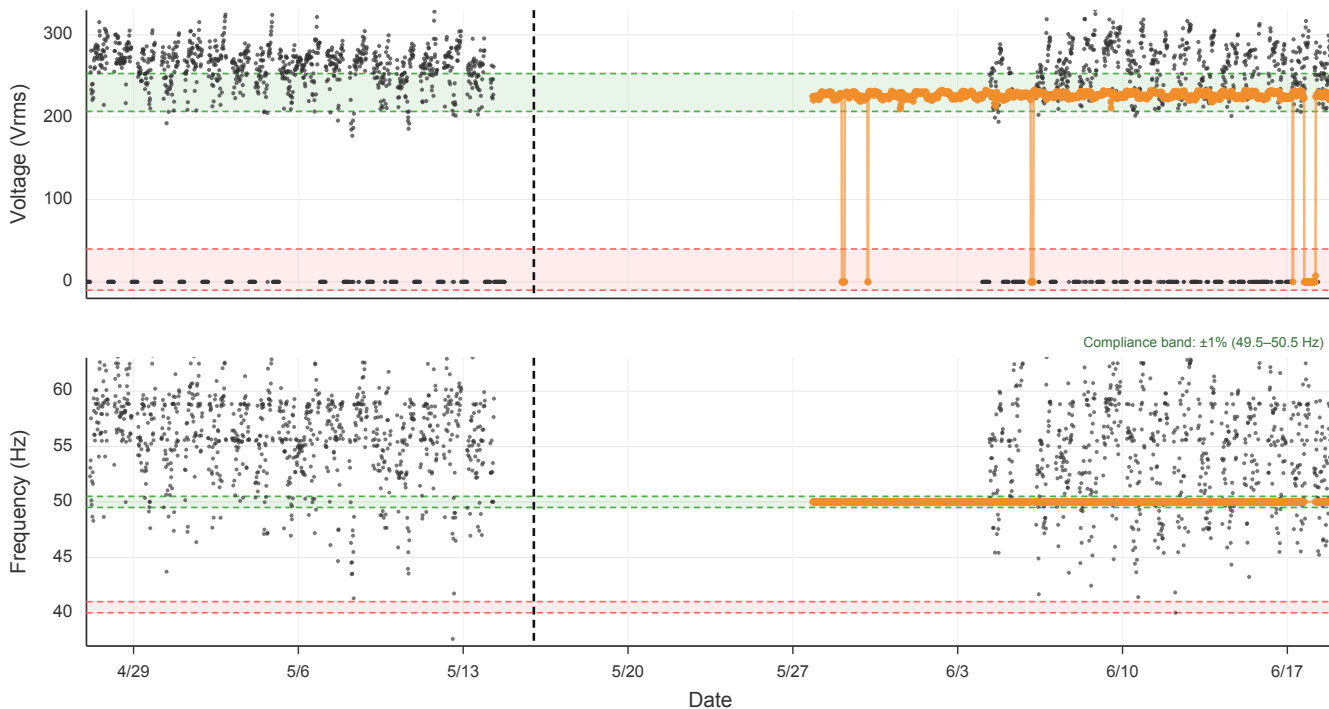

● Existing micro-hydro grid (pre- and post-intervention)

— Protected PV circuit (post-intervention, CSR1)