

High-T case evidence: oxygen-bearing loads reorganize electricity practice over time


A. Lighthouse monitoring and observation window

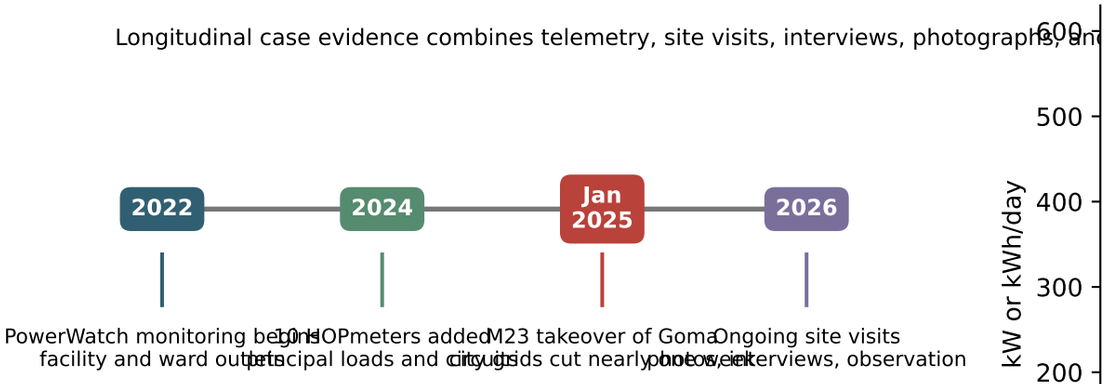


B. Oxygen as an electrical load at the lighthouse facility

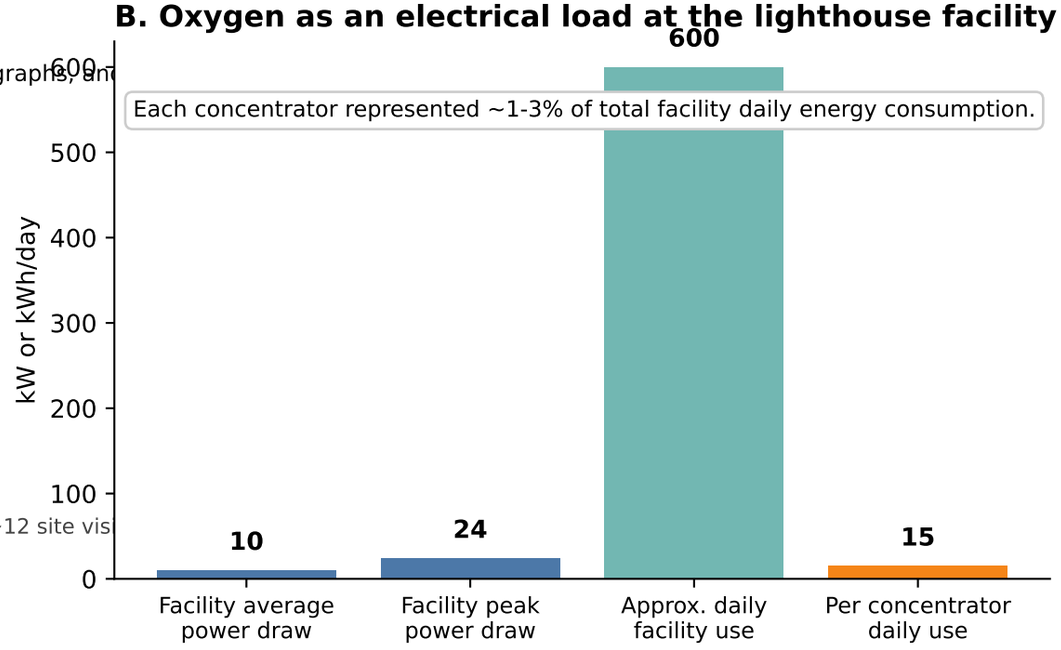

C. Chronic switching under routine grid-quality stress

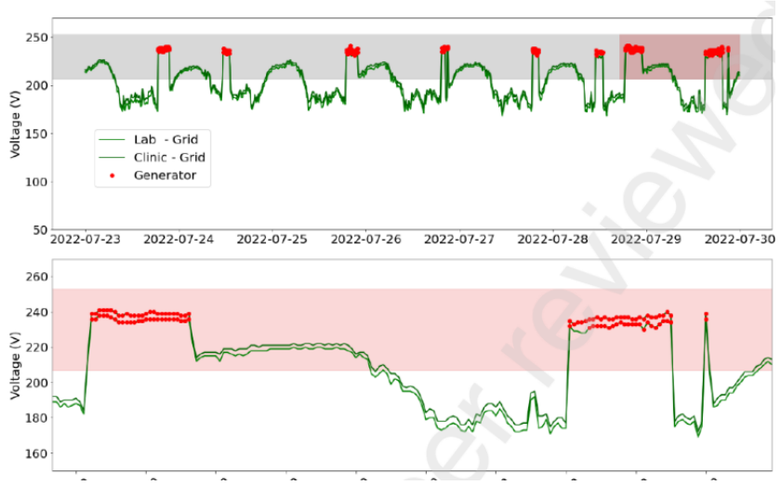

D. Conflict shock: secured circuit continuity during Goma grid interruption

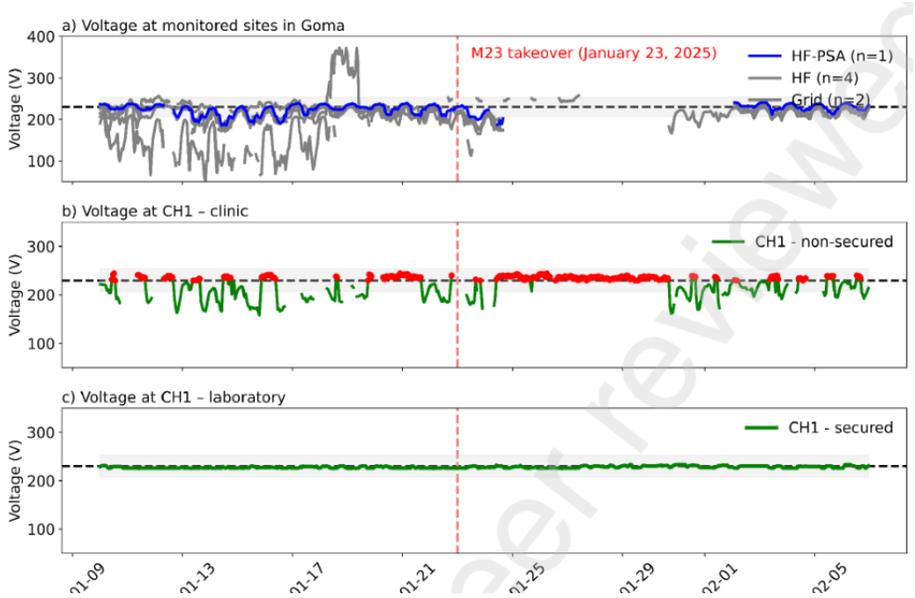

Sources: DRC3 LGH preprint figure traces and text; Valentin formative survey synthesis. Crops retain original trace scales.