

Electricity during the January 2025 Goma event

Ndosho paired series within the nine requested Goma sites · 14 January–8 February · CAT (UTC+2)

A Ndosho

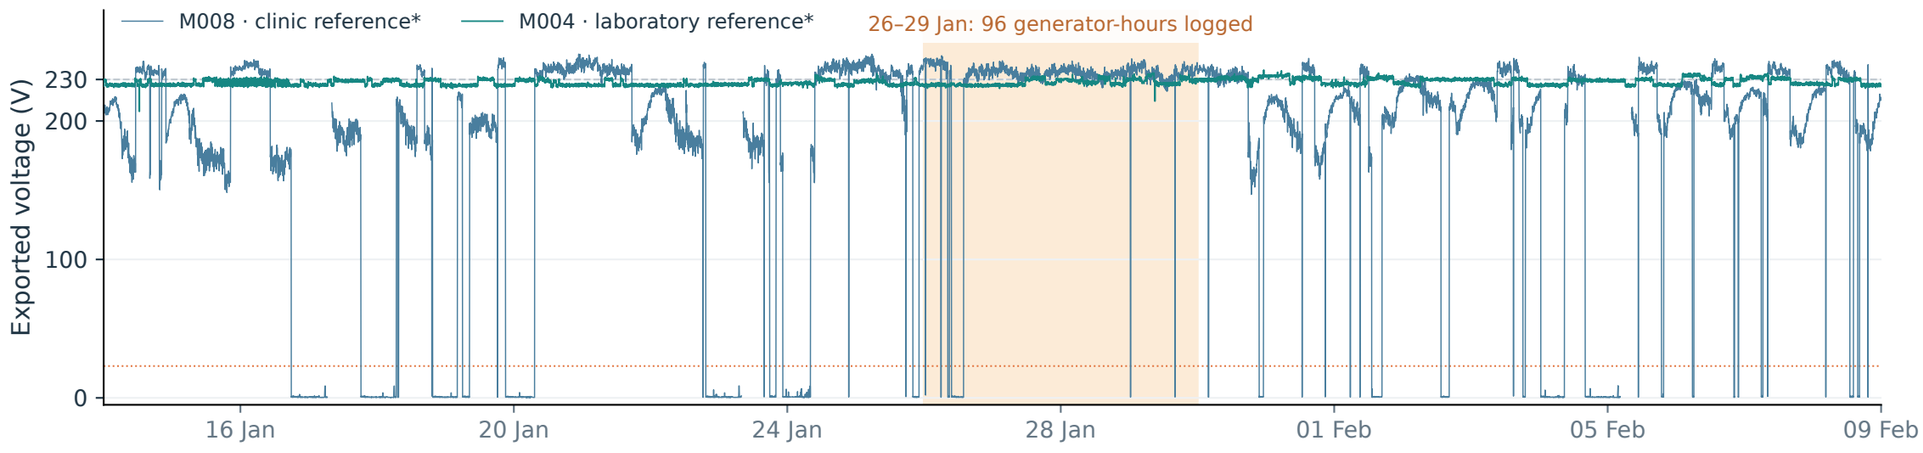

B Measurement states across returned Goma series

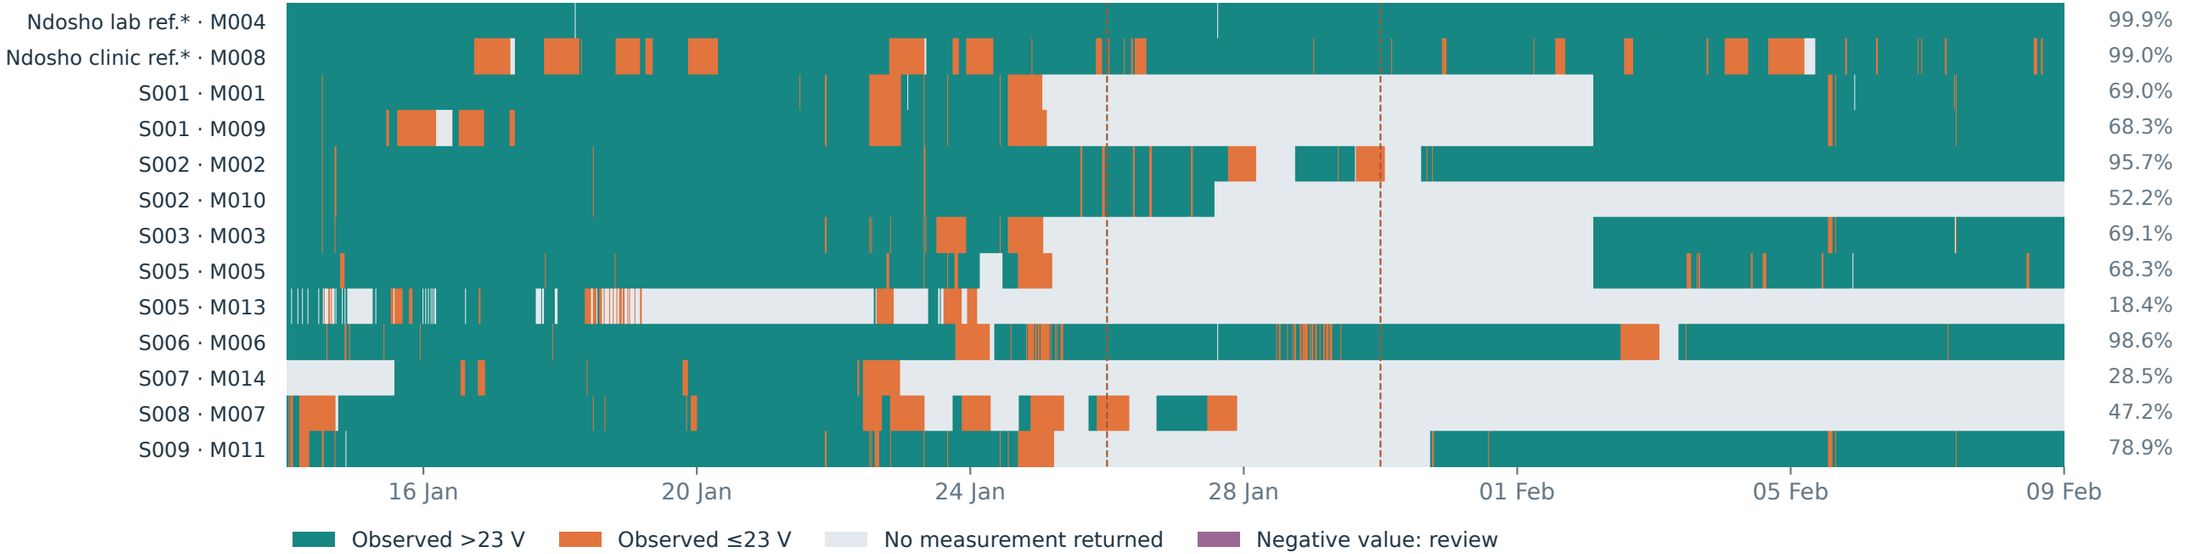

The register records four calendar days of generator operation and 600 L in fuel columns; fuel burn was not independently metered.

*Circuit labels follow a placement reference; January 2025 placement and oxygen-serving connections still need confirmation.

Each pixel is a 120-second dashboard bucket. Mixed buckets prefer energized readings; gaps remain gaps. >23 V is a display screen, not a concentrator operating threshold. Electrical measurements do not establish oxygen flow, PSA operation, or clinical outcomes.

Sources: nLine PowerWatch exports E003–E007; Ndosho register, ChCbNdosho 2025!A50:L54. Kyeshero source identity is unresolved.