

Keep the gym; compare what happens to the laundry

Both options 1:60 at A3 | South up / north down / east left / west right | Amber = maintenance floor reservation

A / REWORK THE EXISTING LAUNDRY



A: no added footprint; laundry functions reduced; P3 unresolved.


B / EXTEND THE EXISTING GYM BLOCK



B: +12.22 m2 footprint; full laundry and gym retained.

The laundry fit comes with a real loss of working space

Option A plan 1:25 at A3 | Side-by-side machines retained | A fit test, not a complete services solution

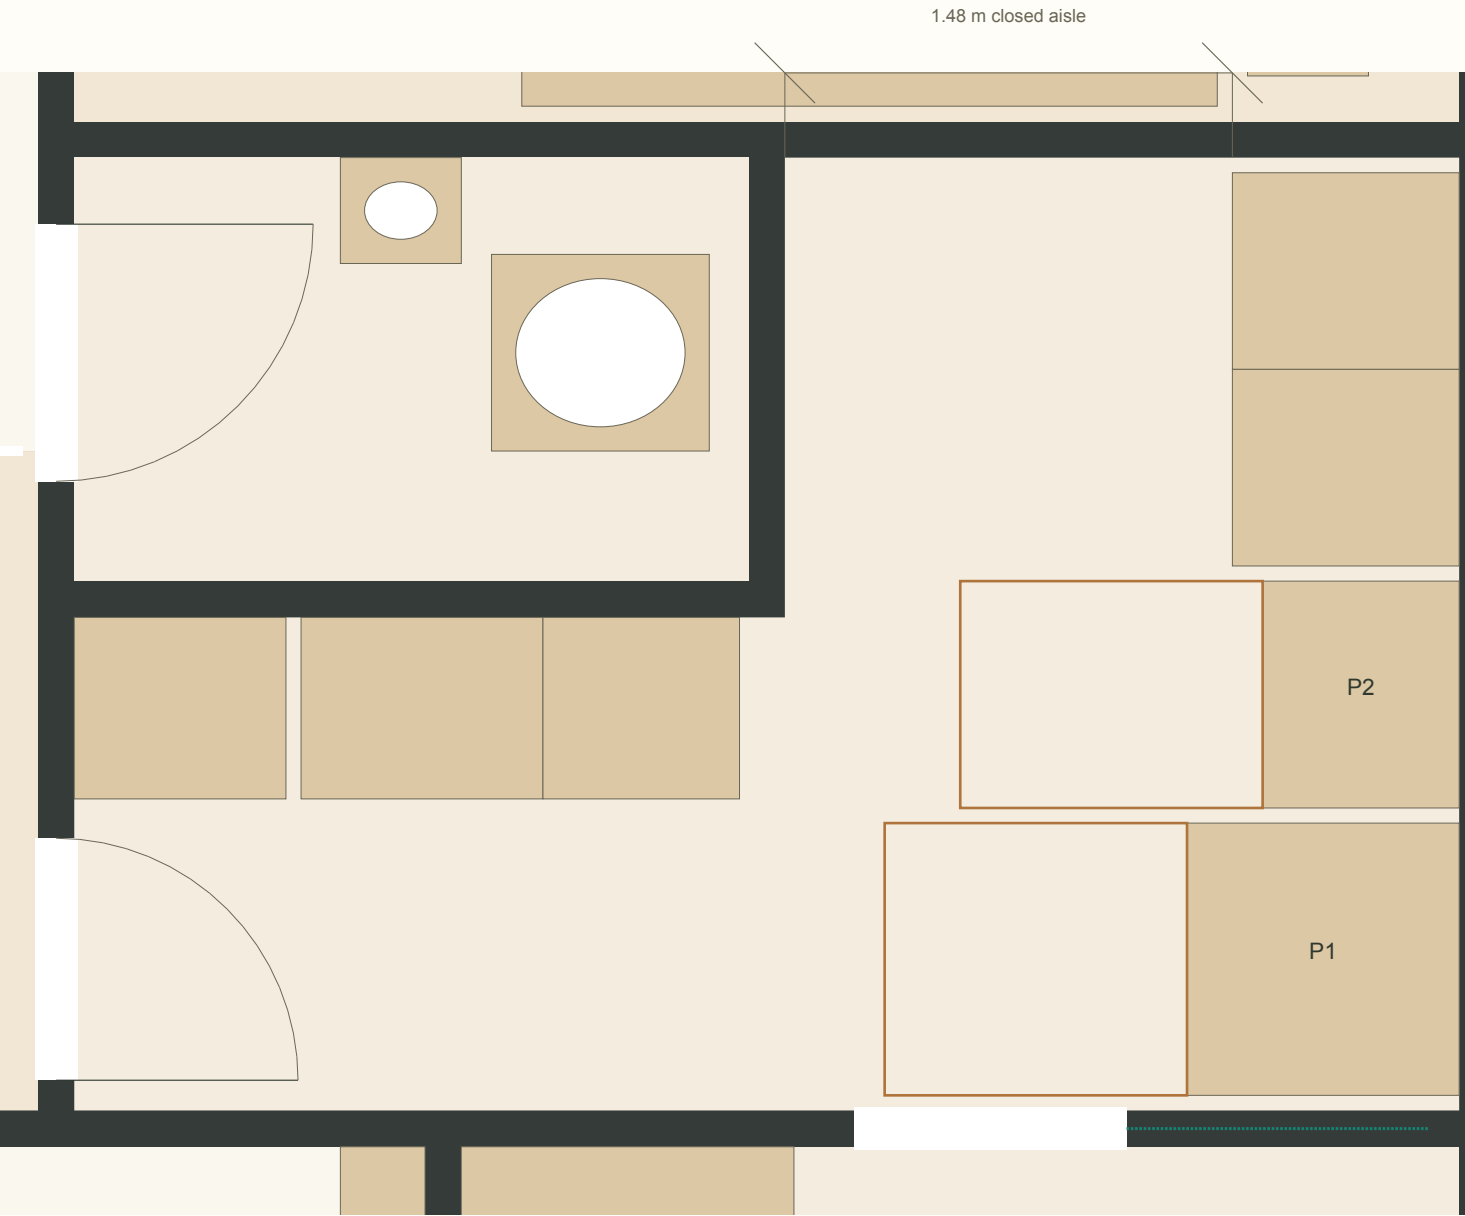

WHAT STILL FITS

- Two 0.65 m appliance bays, side-by-side.
- Existing 0.70 m air-drying cupboard.
- 0.80 m sink relocated to the folding run.
- D19 and boot-room pocket access retained.
- Existing house routes and door sweeps pass.

WHAT IS LOST OR UNRESOLVED

- Folding run falls from 1.45 m to 0.65 m.
- The 0.95 m sorting / detergent drawers disappear.
- P1 and P2 maintenance occupies the working aisle.
- No equivalent P3 wall / service zone is resolved.
- Plant enclosure, ducts and separation add space.

ASSESSMENT / DOES NOT MEET THE FULL BRIEF YET

The plant bodies can be drawn in; the same laundry function and full plant package cannot yet be retained.
Stacking might recover a bay, but is a fallback and has not been used to make this option appear equivalent.
A shared utility still requires acoustic treatment toward the snug, moisture control and replacement planning.
The 0.90 m cylinder reservation is not a selected capacity. Keep the family-wing plant placeholder for now.

A separate compartment preserves both working rooms

Option B plant plan 1:25 at A3 | External access | Existing gym wall and all gym equipment retained



TESTED RESERVATIONS

P1: 0.90 x 0.90 m cylinder / connections bay.
P2: 0.85 x 0.65 m wall ventilation bay.
P3: 0.65 x 0.45 m hydraulics / controls bay.
Each has a 1.00 m front floor reservation.
Internal 0.70 m approach envelopes pass.

ADDED VOLUME

4.70 x 2.60 m extension; 12.22 m2 footprint.
4.00 x 2.25 m clear; 9.00 m2 plant floor.
Extends the block north (down on the plan).
1.00 m door opening on the west outer wall.
No new passage through the gym is assumed.

SECTION INTENT / CONTINUE THE LOWER GYM ROOF

Reserve 2.60 m clear below a provisional 3.20 m external roof top, matching the existing lower-block direction.
Reserve P1 height up to 2.10 m; P2 base 1.00 m / top 1.95 m, leaving 0.65 m above for coordination.
These heights do not establish a duct / silencer fit or roof build-up. Falls, outlets, structure and loads need design.
The door-side external landing, boundaries and complete removal route depend on the actual site.

Develop B first; retain the existing plant reservation meanwhile

Recommendation for design development | Neither option adopted | Same household and services brief for both

WHY B IS THE STRONGER START

- Preserves the fitted laundry, side-by-side machines and full 4 x 6 m gym.
- Gives equipment an external service door without taking it through the house.
- Keeps plant toward the service end as requested.
- Costs additional footprint and a coordinated extension of the roof.

LINEN GAIN IS CONDITIONAL

- Current concept 15: 0.90 x 0.45 m shelving plus retained plant.
- After successful relocation: test 2.00 x 0.55 m linen shelving.
- The old annexe location stays declined.
- Do not count that larger linen run in the current storage total.

DESIGN THE COMPLETE PACKAGE

- Heating / hot water, MVHR and active cooling are separate duties.
- No selected cylinder capacity, heat-pump output or airflow is implied.
- Allow for valves, expansion, silencers, pipe insulation and local manifolds.
- Outdoor units, battery / inverter and cooling units remain unpositioned.
- Compare hot-water routes to the distant family bathrooms and service noise.

WHAT THE SPATIAL CHECKS ESTABLISH

- 40 retained house routes pass in A and B.
- Both retain the full gym and existing house doors / windows.
- B has three clear internal approaches and equipment service zones.
- No occupied laundry or complete equipment-removal test is claimed.
- No heat loss, cooling load, acoustics or site compliance is calculated.

DIMENSION REFERENCES / CHECKED 13 SEPTEMBER 2026

- Vaillant 2024 heat-pump cylinder brochure: 300 L reference body 595 mm diameter / 1745 mm high.
- Our larger allowance includes provisional connection space; 300 L is not selected or sized for the household.
- Zehnder ComfoAir Q450 product page is a ventilation reference only; no Q450 capacity selection is made.
- All front access and enclosure dimensions on these drawings are our planning allowances, not supplier approval.

Vaillant cylinder dimensional reference

Zehnder ventilation reference

Next decision: select a location direction after reviewing the added volume and laundry compromise.