© GRIMM AND PARKER, P.C. 2014

GENERAL MECHANICAL ENLARGED PLAN NOTES	
A	REFER TO WATER SOURCE HEAT PUMP SCHEDULE ON SHEET M10.0 FOR ALL HPS/HPR PIPING RUNOUT SIZES.
B	REFER TO WATER SOURCE HEAT PUMP SCHEDULE ON SHEET M10.0 FOR ALL CONDENSATE PIPING RUNOUT SIZES.
C	SEAL ALL FLOOR SLAB AND WALL PENETRATIONS AIR AND WATER TIGHT. ALL PENETRATIONS ARE TO BE SEALED TO MINIMIZE SOUND TRANSMITTANCE.
D	REFER TO VERTICAL HEAT PUMP INSTALLATION DETAIL ON SHEET M7.0 FOR ALL PIPING REQUIREMENTS FOR VERTICAL UP FLOW AND DOWN FLOW UNITS. PROVIDE ALL PIPING COMPONENTS IN DETAIL WHETHER SHOWN OR NOT IN PLANS, ENLARGED PLANS, SECTIONS, AND ISOMETRICS.
E	PROVIDE SA AND RA DUCT TRANSITIONS AS REQUIRED FOR INLET AND OUTLET OF ALL WATER SOURCE HEAT PUMPS.
F	REFER TO PIPING SHCEMATICS, M6.0 & M6.1, FOR FURTHER DETAIL/INFORMATION.

TAGGED NOTES	
H3	FOR PIPE CONTINUATION REFER TO FIRST FLOOR HYDRONIC DESIGN PLAN - AREA A, SHEET M2.1.
H38	PROVIDE AUTOMATIC AIR VENT IN HIGHEST POINT OF 4" LINE IN MECHANICAL ROOM - GYM 2501. REFER TO DETAIL ON M7.0.

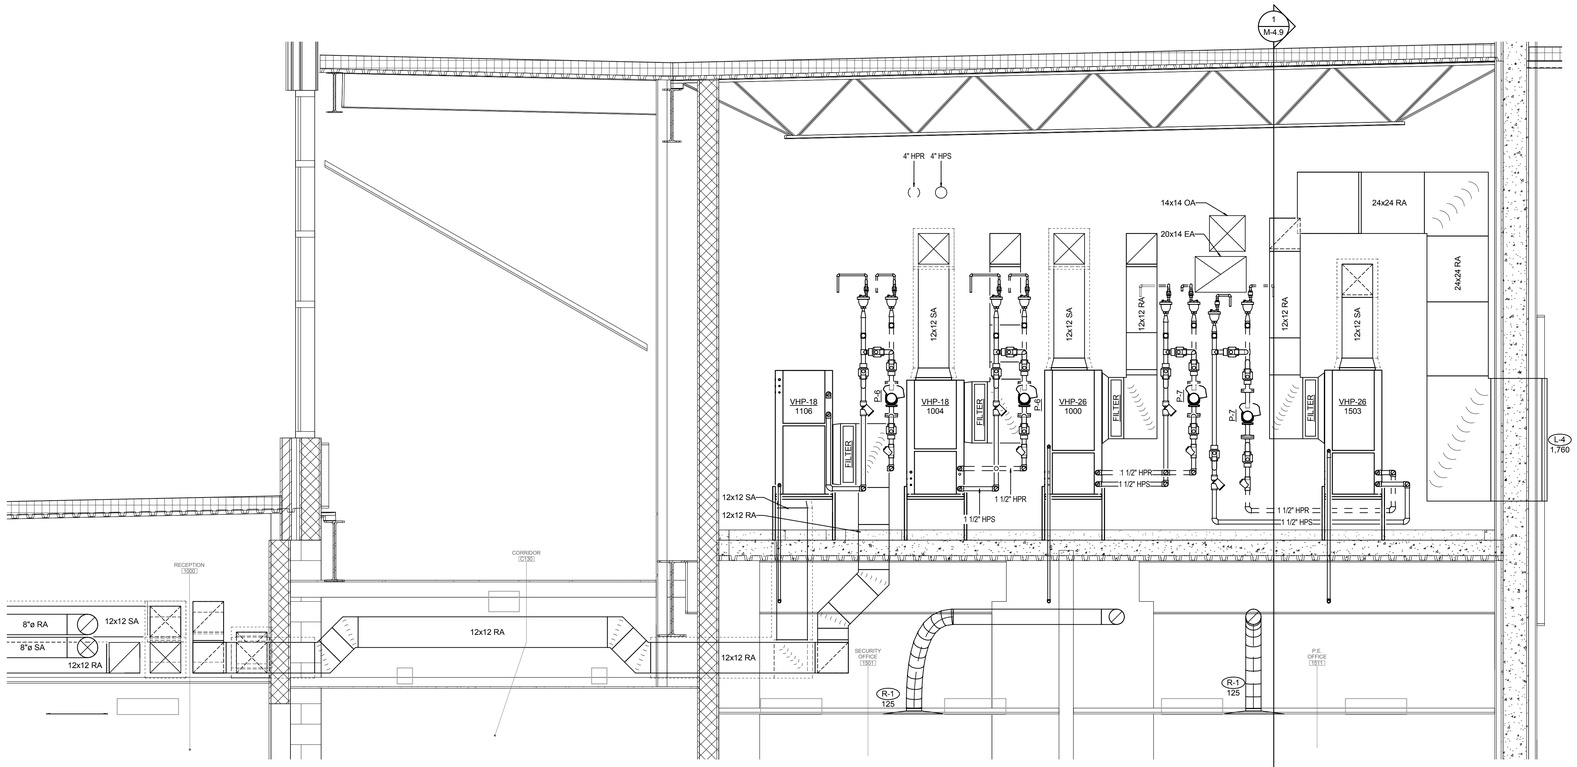

4 GYM MECHANICAL SECTION 1
1 M-1.1
SCALE: 1/2" = 1'-0"
0 0.5' 1' 2' 4' 6' 8'

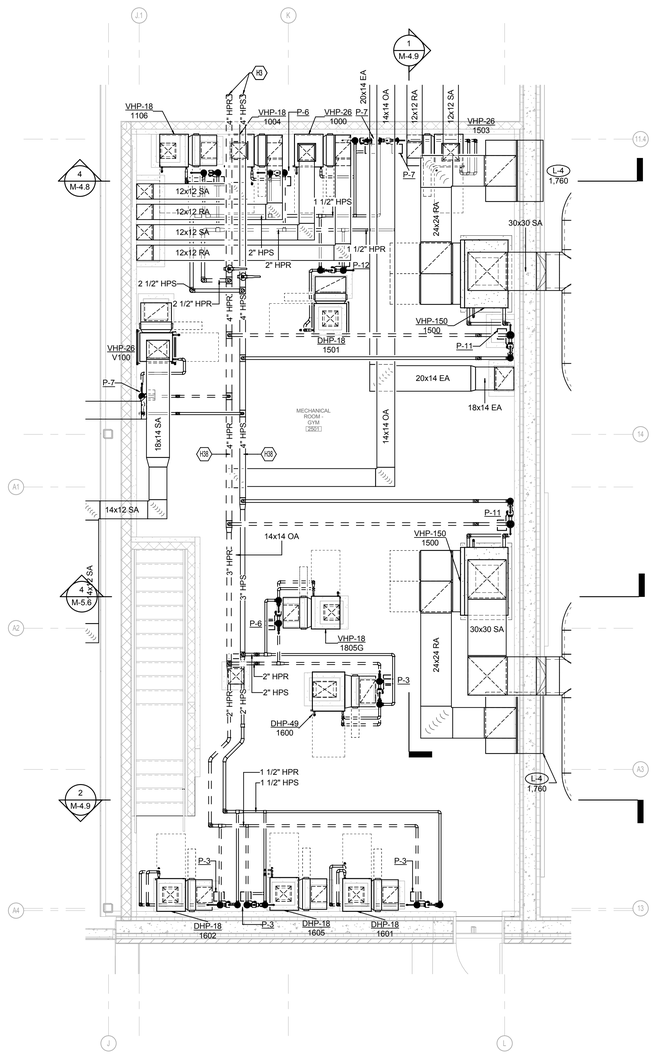

1 GYM MECHANICAL ROOM
SCALE: 1/4" = 1'-0"
0 1' 2' 4' 8' 12' 16'

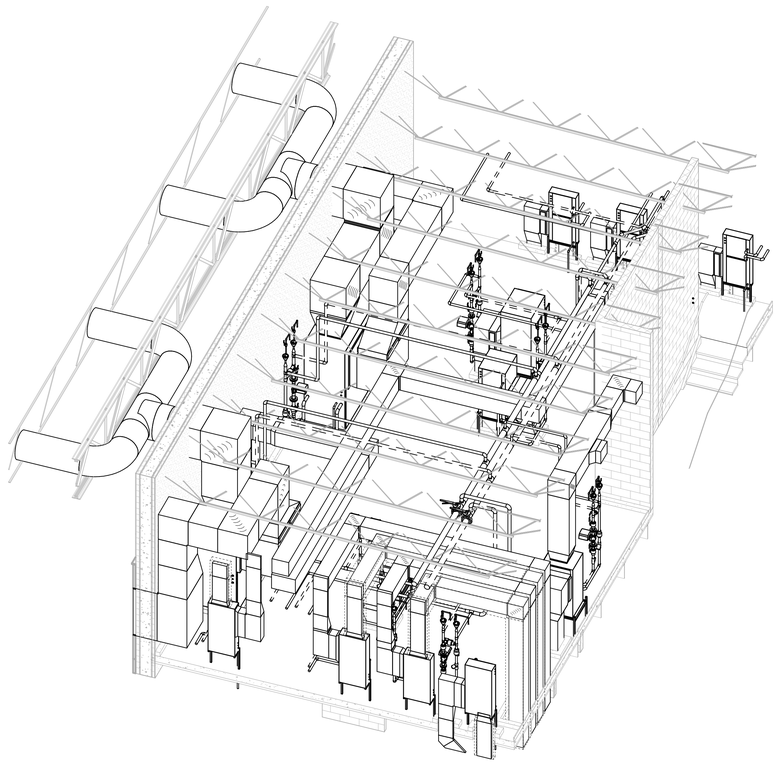

2 GYM MECHANICAL ROOM
SCALE: NONE



KEYPLAN

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegs.com/

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GP# 21553

ENLARGED PLANS

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

M-4.8
03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014