© GRIMM AND PARKER, P.C. 2014

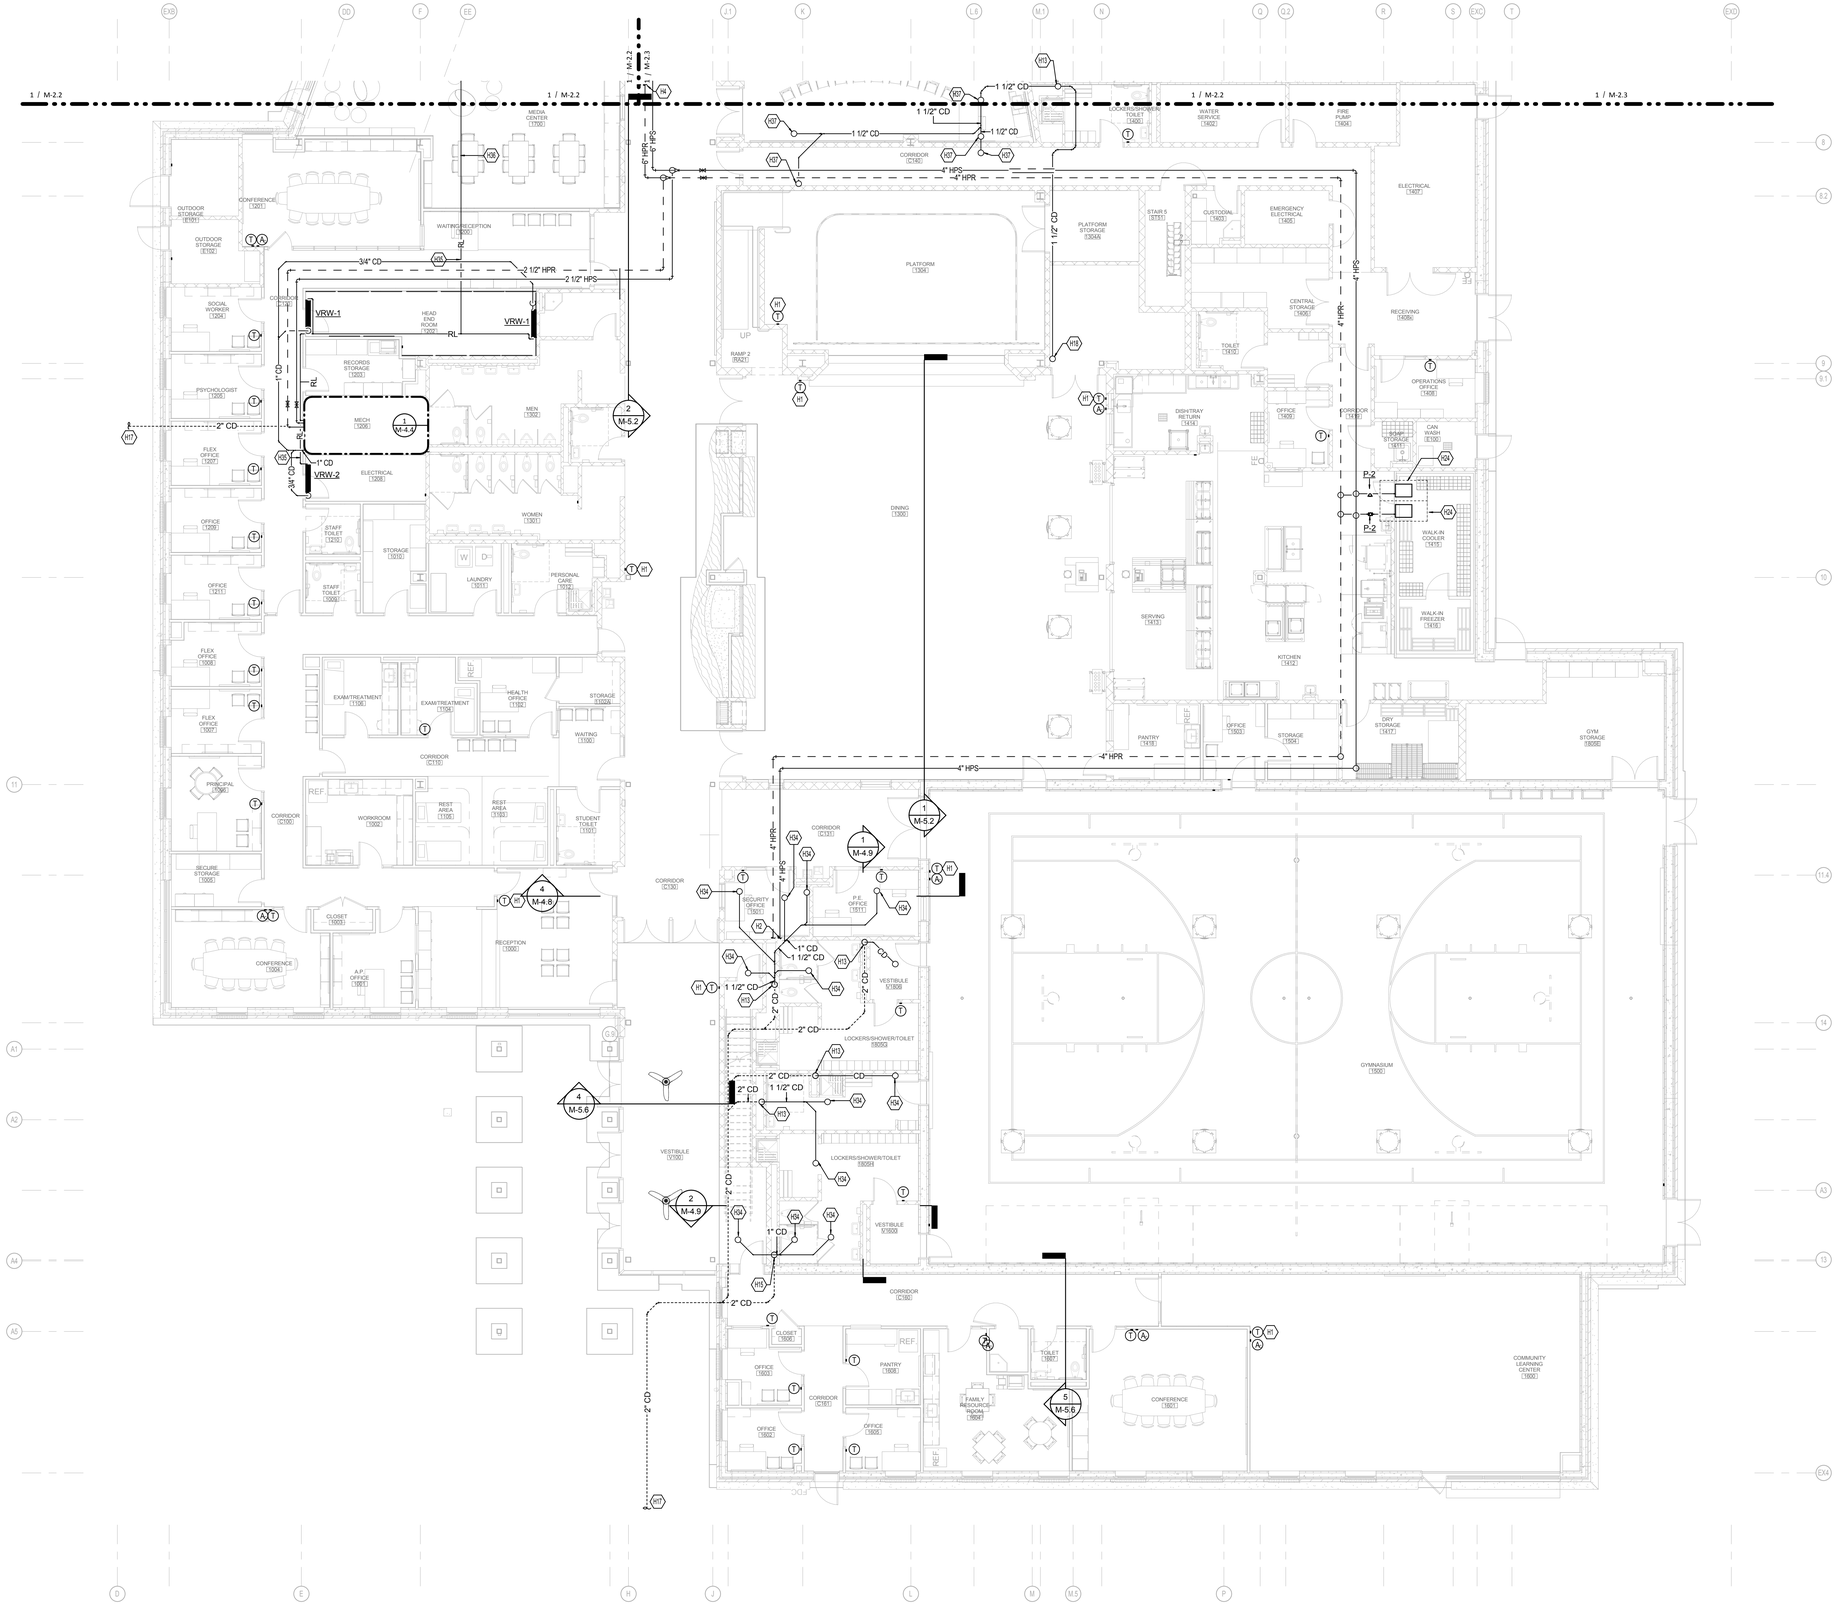

1 First Floor - Hydronics - Area A

SCALE: 1/8" = 1'-0"

0 2' 4' 8' 16' 24' 32'

GENERAL HYDRONIC DESIGN NOTES	
A	REFER TO WATER SOURCE HEAT PUMP SCHEDULE ON SHEET M10.0 FOR CONDENSATE RUNOUT SIZES.
B	REFER TO HVAC CONTROLS SHEETS FOR ADDITIONALS INFORMATION ON THERMOSTATS AND CO2 SENSORS ON SHEETS M9.1-M9.5.
C	REFER TO TYPICAL WALL DEVICE MOUNTING DETAIL ON M7.0.

TAGGED NOTES	
H1	PROVIDE THERMOSTAT WITH TRANSLUCENT LOCKABLE COVER WITH AIR SENSING PERFERATIONS.
H2	FOR PIPE CONTINUATION REFER TO GYM MECHANICAL ROOM PLAN, SHEET M4.8.
H4	FOR PIPE CONTINUATION REFER TO FIRST FLOOR HYDRONIC DESIGN PLAN - AREA B, SHEET M2.2.
H13	2" CD PIPE DOWN TO BELOW SLAB.
H15	NOT USED
H17	2" CD TO SPILL TO STORM INLET GRATE. REFER TO SITE PLAN ON SHEET C2.00G FOR EXACT LOCATION. REFER TO SHEET UM1.0 FOR CONTINUATION.
H18	1.5" CD PIPE UP TO MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0.
H24	REFER TO FREEZER/COOLER PIPING SCHEMATIC ON M6.1 FOR ALL PIPING REQUIREMENTS.
H34	CONDENSATE UP TO MECHANICAL ROOM - GYM 2501. REFER TO SHEET M4.8 FOR CONTINUATION.
H35	RL REPRESENTS REFRIGERANT LINE SETS FOR WATER SOURCE VRF SYSTEM. REFER TO WATER SOURCE VRF HEAT PUMP REFRIGERANT PIPING SCHEMATIC ON SHEET M7.0 FOR QUANTITY AND SIZING OF REFRIGERANT LINES.
H36	REFER TO REFLECTED CEILING PLANS. REFRIGERANT LINE IS EXPOSED IN PORTIONS OF MEDIA CENTER. ROUTE LINE IN STRUCTURE WHERE EXPOSED AND PAINT IN ACCORDANCE WITH ARCHITECTURAL REQUIREMENTS.
H37	CONDENSATE UP TO MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION.



KEYPLAN

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegrs.com/

11720 Baltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GRIMM AND PARKER

GP# 21553

HYDRONIC DESIGN - FIRST FLOOR AREA A

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

M-2.1

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014