© GRIMM AND PARKER, P.C. 2014

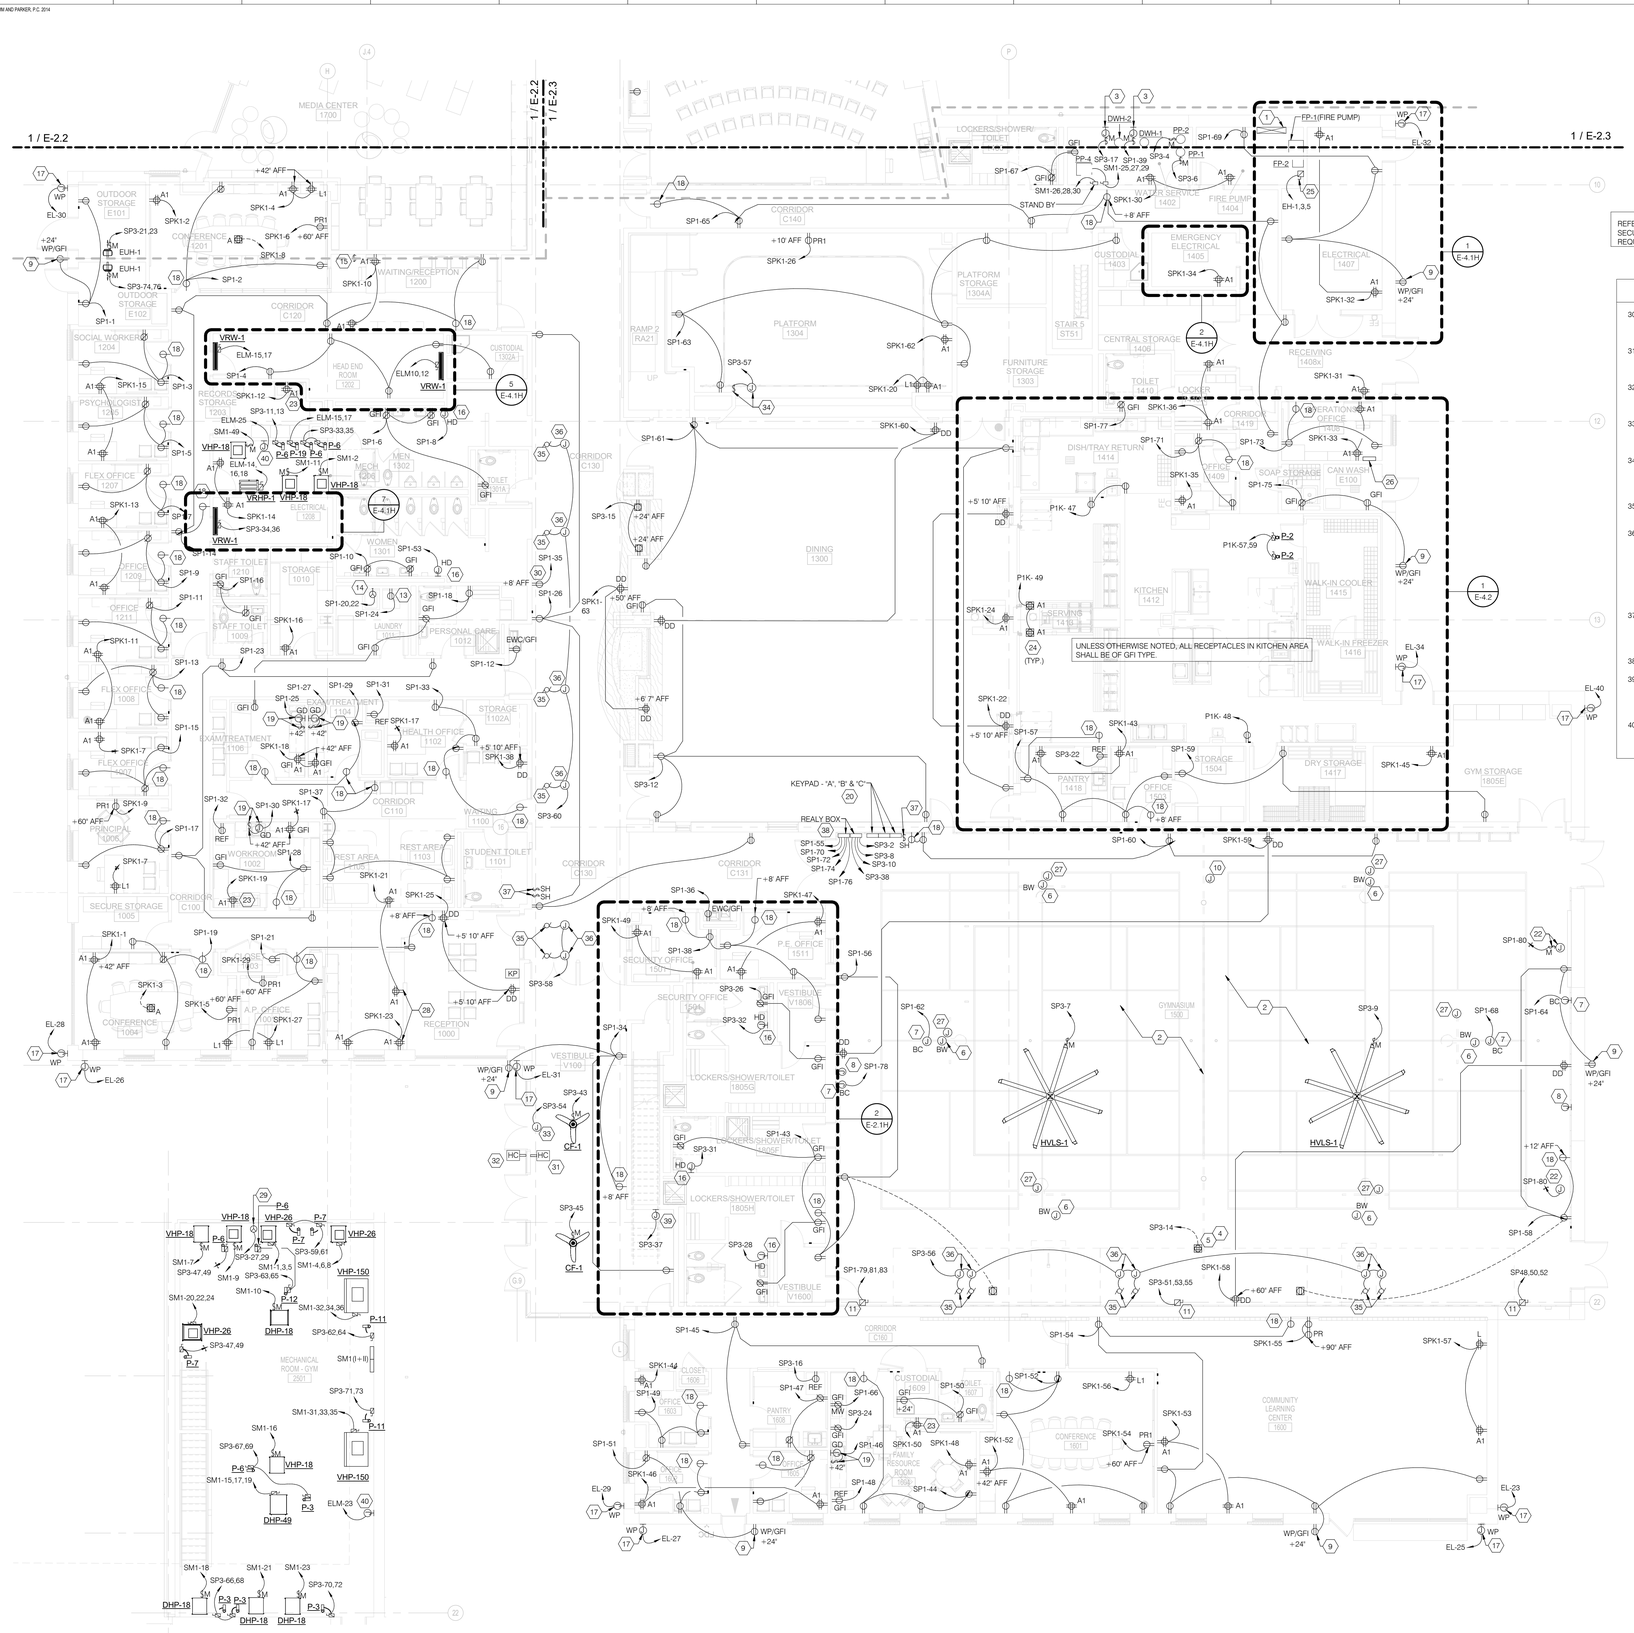

REFER TO TECHNOLOGY CONSULTANT DRAWINGS FOR ALL IT, AV, TELEPHONE, DATA AND SECURITY SYSTEM LOCATION AND REQUIREMENTS VENDOR FOR CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.

GENERAL NOTES

1. REFER TO DRAWING E-0.1H/G FOR ELECTRICAL GENERAL NOTES, LEGEND AND ABBREVIATIONS. REFER TO DRAWING E-5.1 FOR POWER RISER DIAGRAM, E-6.1H/G FOR MECHANICAL/PLUMBING SCHEDULE AND E-6.2H/G THROUGH E-6.5H/G FOR PANEL SCHEDULES.
2. REFER TO ARCHITECTURAL DRAWINGS, ELEVATION & DETAILS FOR EXACT LOCATION OF ELECTRICAL DEVICES.
3. REFER TO MECHANICAL AND PLUMBING DRAWINGS FOR EXACT MECHANICAL AND PLUMBING EQUIPMENT LOCATIONS.
4. ALL OUTLETS ON EMERGENCY CIRCUITS SHALL BE RED IN COLOR.
5. ALL NEW RECEPTACLES, TELECOMMUNICATION OUTLETS WITH ASSOCIATED WIRING SHALL BE FLUSH MOUNTED. SURFACE MOUNTED OUTLETS, CONDUIT, RACEWAYS, ETC TO BE APPROVED BY ARCHITECT PRIOR TO INSTALLATION.
6. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION, MOUNTING HEIGHTS AND ADDITIONAL INFORMATION FOR POWER/DATA OUTLETS PRIOR TO ROUGH-IN WORK.
7. ALL TODDLER, INFANT, PRE-K AND KINDERGARTEN AND ALL CHILD CARE FACILITIES ROOM RECEPTACLES SHALL BE OF TAMPER-RESISTANT TYPE.

SHEET KEYNOTES

30. DUPLEX RECEPTACLE FOR DOUBLE FACE SLAVE CLOCK. COORDINATE WITH TECHNOLOGY CONSULTANT FOR EXACT LOCATION. MOUNTING HEIGHT AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
31. "INTERIOR" WALL MOUNTED HANDICAP PUSH PLATE SWITCH FOR MOTORIZED DOOR OPENER. COORDINATE WITH ARCHITECT FOR EXACT LOCATION AND MOUNTING REQUIREMENTS PRIOR TO INSTALLATION.
32. "EXTERIOR" WALL MOUNTED HANDICAP PUSH PLATE SWITCH FOR MOTORIZED DOOR OPENER. COORDINATE WITH ARCHITECT FOR EXACT LOCATION AND MOUNTING REQUIREMENTS PRIOR TO INSTALLATION.
33. PROVIDE A JUNCTION BOX FOR MOTORIZED DOOR OPENER. CONTRACTOR SHALL VERIFY MOUNTING HEIGHT AND ALL REQUIREMENTS WITH DOOR HARDWARE SPECIFICATIONS.
34. JUNCTION BOX FOR PROJECTION SCREEN. PROVIDE WITH THREE POSITION (UP ,DOWN, STOP) SWITCH . COORDINATE WITH ARCHITECT FOR EXACT LOCATION AND SPECIFICATION AND MANUFACTURER FOR EXACT CONNECTION REQUIREMENTS PRIOR TO ROUGH-IN.
35. MOTORIZED WINDOW SHADES. MOTORS SHALL NOT BE PARALLEL WIRED. INSTALLATION SHALL BE PER MANUFACTURER INSTRUCTIONS.
36. JUNCTION BOX IN ACCESSIBLE CEILING FOR MOTORIZED SHADE CONTROL SYSTEM. COORDINATE WITH ARCHITECT AND EQUIPMENT VENDOR FOR EXACT LOCATION. SYSTEM SPECIFICATIONS AND TO PROVIDE WITH ALL NECESSARY ACCESSORIES TO ENSURE A COMPLETE AND OPERATIONAL SYSTEM. FINAL ELECTRICAL CONNECTION TO BE COORDINATED WITH ARCHITECT AND WINDOW SHADES SELECTION PRODUCT. COORDINATE WIRING SIZE WITH VOLTAGE DROP PER TABLE SHOWN ON E-0.1H.
37. KEYPAD TO CONTROL MOTORIZED SHADES WITHIN IN THIS AREA. COORDINATE WITH OWNER AND EQUIPMENT VENDOR FOR EXACT LOCATION, SPECIFICATIONS AND TO PROVIDE WITH ALL NECESSARY ACCESSORIES TO ENSURE A COMPLETE AND OPERATIONAL SYSTEM.
38. RUN 2 #10 AWG + 1 #10 AWG G IN 3/4" CONDUIT TO THE PANEL INDICATED.
39. JUNCTION BOX FOR EPO SWITCH WITH INTEGRAL ALARM & RESET (PILLA MODEL # WP25G OR EQUAL). COORDINATE WITH ARCHITECT/ EQUIPMENT VENDOR FOR EXACT LOCATION , MOUNTING HEIGHT AND CONNECTION REQUIREMENTS FOR PRIOR TO INSTALLATION.
40 JUNCTION BOX FOR CONNECTION TO ATC CONTROL PANELS. FIELD COORDINATE WITH CONTROL AND MECHANICAL CONTRACTOR THE EXACT LOCATION.

SHEET KEYNOTES

1. FIRE PUMP CONTROLLER. COORDINATE WITH FIRE PROTECTION DRAWINGS FOR EXACT LOCATION. REFER TO POWER RISER DIAGRAM ON DWG E-5.1H FOR POWER CONNECTION. INSTALL PER MANUFACTURER'S REQUIREMENTS AND RECOMMENDATIONS.
2. ALL DEVICES NEEDS TO BE PROVIDED WITH WIRE GUARD.
3. JUNCTION BOX FOR IGNITION OF GAS FIRED DOMESTIC WATER HEATER.
4. QUADRUPLEX OUTLET FOR SCORERS TABLE. REFER TO TECHNOLOGY DRAWINGS FOR TELECOM OUTLET REQUIREMENTS. COORDINATE WITH ARCHITECT AND EQUIPMENT SUPPLIER FOR EXACT LOCATION AND REQUIREMENTS PRIOR TO INSTALLATION.
5. ADA COMPLAINT FLOOR BOXES. CONTRACTOR TO PROVIDE WITH RECESSED CONDUIT IN THE SLAB TO NEAREST PARTITION WALL ANDSTUB UP TO THE CEILING AS REQUIRED.
6. JUNCTION BOX, 20A-1P-120V FOR BASKETBALL WINCH.
7. JUNCTION BOX, 20A-1P-120V, FOR BASKETBALL SHOT CLOCK. COORDINATE WITH ARCHITECT FOR EXACT LOCATION PRIOR TO INSTALLATION.
8. JUNCTION BOX FOR SCOREBOARD. COORDINATE WITH ARCHITECT AND EQUIPMENT VENDOR FOR EXACT LOCATION. MOUNTING HEIGHT AND CONNECTION REQUIREMENTS.
9. SWITCHED RECEPTACLES. SWITCH LOCATION TO BE COORDINATED WITH THE ARCHITECT AND THE SCHOOL AUTHORITY.
10. JUNCTION BOX, 3/4HP, 25A-1P-120V, FOR MOTORIZED DIVIDER CURTAIN IN GYMNASIUM COORDINATE WITH ARCHITECT AND EQUIPMENT SUPPLIER FOR EXACT LOCATION AND POWER REQUIREMENTS PRIOR TO ROUGH-IN.
11. DISCONNECT SWITCH, 30A-3P, 208V FOR MOTORIZED BLEACHER POWER CONNECTION (1/2 HP, 208V, 3 PHASE). RUN 3#10 + 1#10 IN 3/4"C TO PANEL INDICATED COORDINATE FINAL ELECTRICAL REQUIREMENTS AND EXACT LOCATION WITH EQUIPMENT SUPPLIER PRIOR TO INSTALLATION.
12. JUNCTION BOX POWER CONNECTION TO MOTORIZED SMOKE DAMPER. SMOKE DAMPER SHALL BE INTERLOCKED WITH DUCT SMOKE DETECTOR. REFER TO DRAWING E-3.1 FOR FIRE ALARM SMOKE DETECTOR LOCATION. COORDINATE WITH MECHANICAL CONTRACTOR FOR EXACT MOTORIZED SMOKE DAMPER PRIOR MAKING ALL POWER AND FIRE ALARM CONNECTION.
13. RECEPTACLE FOR WASHER. COORDINATE WITH ARCHITECT/EQUIPMENT VENDOR FOR EXACT LOCATION, NEMA CONFIGURATION AND MOUNTING REQUIREMENTS PRIOR TO INSTALLATION.
14. NEMA 14-30R RECEPTACLE FOR ELECTRICAL DRYER. COORDINATE WITH ARCHITECT/EQUIPMENT VENDOR FOR EXACT LOCATION, MOUNTING REQUIREMENTS AND NEMA CONFIGURATION PRIOR TO INSTALLATION. PROVIDE 2 #10 AWG + 1 #10 AWG G IN 3/4" CONDUIT.
15. TYPICAL SWITCH FOR EXTERIOR SWITCHED RECEPTACLES.COORDINATE WITH ARCHITECT AND SCHOOL AUTHORITY FOR EXACT LOCATION.
16. JUNCTION BOX FOR AUTOMATIC HAND DRYER. COORDINATE WITH EQUIPMENT VENDOR FOR CONNECTION REQUIREMENTS AND WITH ARCHITECT FOR EXACT MOUNTING HEIGHT AND LOCATION.
17. JUNCTION BOX FOR CAMERA HEATERS. PROVIDE 3/4" EMPTY CONDUIT AND PULL STRING FOR SECURITY DEVICES. COORDINATE WITH ARCHITECT AND TECHNOLOGY CONSULTANT FOR EXACT LOCATION, MOUNTING HEIGHT AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
18. SIMPLEX RECEPTACLE FOR SLAVE CLOCK. COORDINATE WITH TECHNOLOGY CONSULTANT FOR EXACT LOCATION, MOUNTING HEIGHT AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
19. JUNCTION BOX UNDER COUNTER FOR GARBAGE DISPOSAL. (1PH,3/4HP-120V) AND MANUAL CONTROL SWITCH, MOUNTING @ 42" AFF.
20. WALL MOUNTED TOUCHPAD CONTROL SYSTEM TO OPERATE BACKSTOPS, DIVIDER CURTAIN, SCOREBOARD AND BASKETBALL WINCH. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL CONDUIT, WIRING, JUNCTION BOXES, RELAY PANEL,DIP SWITCH SETTINGS AND RELAY SET PROGRAMMING PER THE FACILITIES REQUIREMENTS. MOTOR WIRES TO BE CONNECTED TO THE RELAY BOXES. COORDINATE EXACT POWER AND INSTALLATION REQUIREMENTS WITH TSC1500 SYSTEM MANUFACTURER PRIOR INSTALLATION.
21. PROVIDE VFD CONTROLLER. REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATION AND ADDITIONAL REQUIREMENTS. PRIOR TO INSTALLATION.
22. JUNCTION BOX AND CONTROL FOR MOTORIZED SHADES. COORDINATE WITH ARCHITECT AND EQUIPMENT VENDOR FOR EXACT LOCATION, SPECIFICATIONS, SEQUENCE OF OPERATIONS AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
23. RECEPTACLE FOR COPIER. COORDINATE WITH EQUIPMENT SUPPLIER FOR EXACT NEMA CONFIGURATION OF COPIER PRIOR TO ROUGH-IN.
24. ADA COMPLAINT FLOOR BOXES. CONTRACTOR TO PROVIDE WITH RECESSED CONDUIT IN THE SLAB TO NEAREST PARTITION WALL AND STUB UP TO THE CEILING AS REQUIRED.
25. JOCKEY PUMP(FP-2). REFER TO PLUMBING DRAWINGS FOR EXACT LOCATION. INSTALL PER MANUFACTURER'S REQUIREMENTS AND RECOMMENDATIONS.
26. REMOTE GENERATOR ANNUNCIATOR PANEL.
27. JUNCTION BOX, 20A-1P-120V, FOR BASKETBALL BACKSTOP HEIGHT ADJUSTER. TO BE OPERATED WITH FLUSH MOUNTED KEYED SWITCH. COORDINATE WITH ARCHITECT FOR EXACT LOCATION, MOUNTING HEIGHT PRIOR TO INSTALLATION.
28. REFER ARCHITECTURAL PLANS FOR EXACT LOCATION OF POWER OUTLETS IN MILLWORK DESKS.
29. NEMA L5-30R TWIST-LOCK RECEPTACLE WITH 2#10 AWG + 1 #10G IN 3/4" CONDUIT FOR EQUIPMENT CABINET. COORDINATE WITH TECHNOLOGY CONSULTANT FOR EXACT OUTLET LOCATIONS PRIOR TO INSTALLATION.

KEY PLAN



2 / E-2.1H — PARTIAL SECOND FLOOR POWER PLAN – AREA A
SCALE: 1/8" = 1'-0"

1 / E-2.1H — PARTIAL FIRST FLOOR POWER PLAN – AREA A
SCALE: 1/8" = 1'-0"

SETTY
ONE SOUTH STREET, SUITE 2110
BALTIMORE, MARYLAND 21202
TEL 667-329-5035
MAYOR'S OFFICE OF CAPITAL MANAGEMENT
ENERGY MANAGEMENT SERVICES - OFFICE BUILDINGS
DEPARTMENT OF GENERAL SERVICES
CITY OF COLUMBIA, MARYLAND
www.SETTY.com
SA2017117 # # # #
PROJECT NUMBER

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GRIMM AND PARKER
GP# 21553

PARTIAL FIRST FLOOR POWER PLAN – AREA A

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

E-2.1H

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014