© GRIMM AND PARKER, P.C. 2014

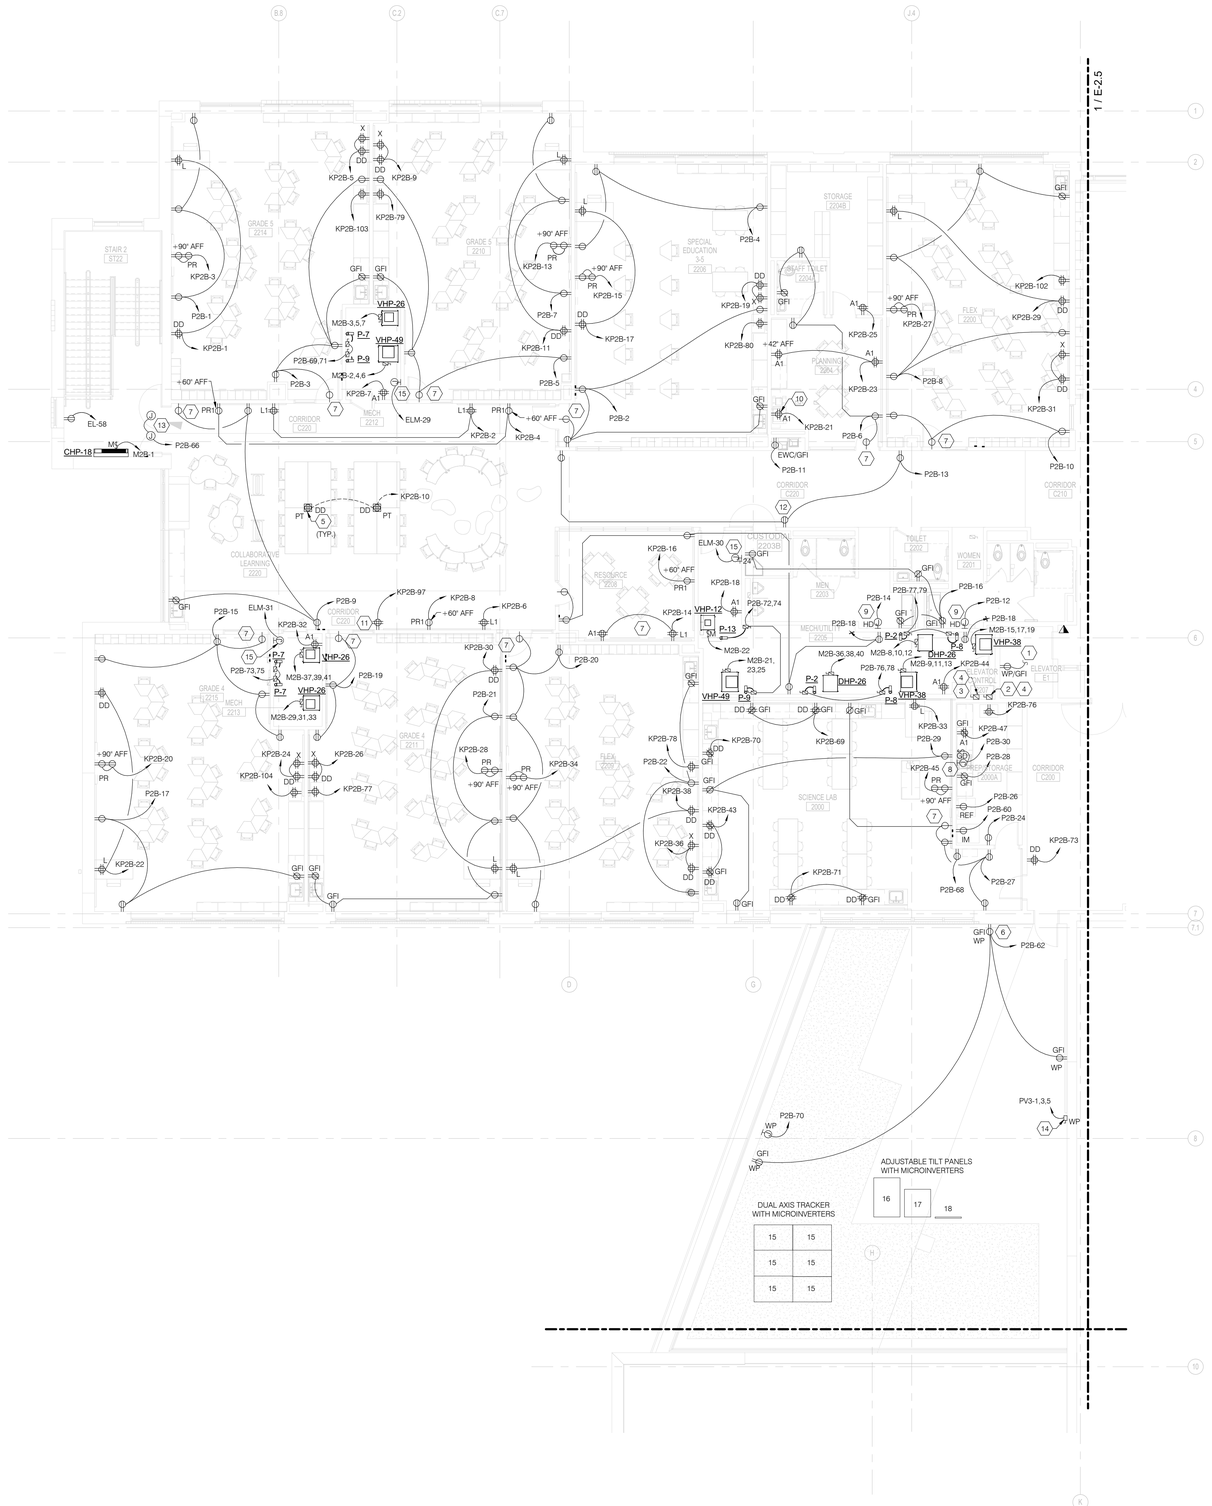

1 E-2.4 PARTIAL SECOND FLOOR POWER PLAN – AREA B

SCALE: 1/8" = 1'-0"

GENERAL NOTES

1. REFER TO DRAWING E-0.1H/G FOR ELECTRICAL GENERAL NOTES, LEGEND AND ABBREVIATIONS. REFER TO DRAWING E-5.1 FOR POWER RISER DIAGRAM, E-6.1H/G FOR MECHANICAL/PLUMBING SCHEDULE AND E-6.2H/G THROUGH E-6.5H/G FOR PANEL SCHEDULES.
2. REFER TO ARCHITECTURAL DRAWINGS, ELEVATION & DETAILS FOR EXACT LOCATION OF ELECTRICAL DEVICES.
3. REFER TO MECHANICAL AND PLUMBING DRAWINGS FOR EXACT MECHANICAL AND PLUMBING EQUIPMENT LOCATIONS.
4. ALL OUTLETS ON EMERGENCY CIRCUITS SHALL BE RED IN COLOR.
5. ALL NEW RECEPTACLES, TELECOMMUNICATION OUTLETS WITH ASSOCIATED WIRING SHALL BE FLUSH MOUNTED. SURFACE MOUNTED OUTLETS, CONDUIT, RACEWAYS, ETC TO BE APPROVED BY ARCHITECT PRIOR TO INSTALLATION.
6. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION, MOUNTING HEIGHTS AND ADDITIONAL INFORMATION FOR POWER/DATA OUTLETS PRIOR TO ROUGH-IN WORK.
7. ALL TODDLER, INFANT, PRE-K AND KINDERGARTEN AND ALL CHILD CARE FACILITIES ROOM RECEPTACLES SHALL BE OF TAMPER-RESISTANT TYPE.

SHEET KEYNOTES

1. COORDINATE WITH ELEVATOR CONTRACTOR FOR EXACT OUTLET LOCATION IN PIT ROOM PRIOR TO INSTALLATION. CONNECT TO THE LIGHT FIXTURE IN PIT AS SHOWN ON DRAWING ON ELECTRICAL LIGHTING PLAN EL1.2.
2. ELEVATORS SHUNT TRIP FUSED DISCONNECT SWITCH. MANUFACTURER "FERRAZ SHAWMUT" 60A-3P-600V WITH AUXILIARY AND ALARM CONTACTS, FUSED AT 60A FUSES OR APPROVED EQUAL. FINAL COORDINATION WITH ELEVATOR CONTRACTOR FOR FINAL ELEVATOR MOTOR SIZE APPROVAL PRIOR TO INSTALLATION OF POWER CONNECTION. COORDINATE WITH ELEVATOR CONTRACTOR FOR FINAL POWER CONNECTION REQUIREMENT PRIOR TO INSTALLATION. SEE POWER RISER DIAGRAM E5.1 FOR POWER CONNECTION.
3. ELEVATOR FAN & CAB LIGHT FUSED DISCONNECT SWITCH 30A-1P+S/N, 250V, FUSED AT 20A FUSES.
4. COORDINATE WITH ELEVATOR MANUFACTURER/ARCHITECT FOR EXACT LOCATION AND MOUNTING HEIGHT PRIOR TO INSTALLATION.
5. FLUSH MOUNTED ADA COMPLAINT POKE THRU FOR POWER AND OUTLETS. CONTRACTOR TO PROVIDE LEGRAND WIREMOLD 6AT EVOLUTION SERIES POKE-THRU DEVICE AND COORDINATE WITH ARCHITECT FOR EXACT LOCATIONS AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
6. SWITCHED RECEPTACLE. SWITCH LOCATION TO BE COORDINATED WITH THE ARCHITECT AND THE SCHOOL AUTHORITY.
7. SIMPLEX RECEPTACLE FOR SLAVE CLOCK. COORDINATE WITH TECHNOLOGY CONSULTANT FOR EXACT LOCATION, MOUNTING HEIGHT AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
8. JUNCTION BOX UNDER COUNTER FOR GARBAGE DISPOSAL (1PH,3/4HP-120V) AND MANUAL CONTROL SWITCH, MOUNTING @ 42" AFF.
9. JUNCTION BOX FOR AUTOMATIC HAND DRYER. COORDINATE WITH EQUIPMENT VENDOR FOR CONNECTION REQUIREMENTS AND WITH ARCHITECT FOR EXACT MOUNTING HEIGHT AND LOCATION.
10. RECEPTACLE FOR COPIER. COORDINATE WITH EQUIPMENT SUPPLIER FOR EXACT NEMA CONFIGURATION OF COPIER PRIOR TO ROUGH-IN.
11. QUAD RECEPTACLE FOR CHARGING CART. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS.
12. QUAD RECEPTACLE FOR DOUBLE FACE SLAVE CLOCK. COORDINATE WITH TECHNOLOGY CONSULTANT FOR EXACT LOCATION, MOUNTING HEIGHT AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.
13. PROVIDE JUNCTION BOX AT WALL (FOR EACH DOOR LEAF) FOR MAGNETIC DOOR HOLD OPEN TO TIE INTO FIRE ALARM SYSTEM. CONTRACTOR TO COORDINATE MOUNTING HEIGHT, AND LOCATION WITH DOOR HARDWARE SPECIFICATIONS.
14. PROVIDE NEMA 3R 30A/3P DISCONNECT FOR ADJUSTABLE TILT PANEL CIRCUIT. CONTRACTOR TO COORDINATE MOUNTING HEIGHT, LOCATION AND CONNECTION REQUIREMENTS PRIOR TO INSTALLATION. EXTEND ENPHASE CONDUCTOR SYSTEM TO PANELS FROM DISCONNECT AS REQUIRED.
15. JUNCTION BOX FOR CONNECTION TO ATC CONTROL PANELS. FIELD COORDINATE WITH CONTROL AND MECHANICAL CONTRACTOR THE EXACT LOCATION.

REFER TO TECHNOLOGY CONSULTANT DRAWINGS FOR ALL IT, AV, TELEPHONE, DATA AND SECURITY SYSTEM LOCATION AND REQUIREMENTS,VENDOR FOR CONNECTION REQUIREMENTS PRIOR TO INSTALLATION.

KEY PLAN



SETTY
ONE SOUTH STREET, SUITE 1110
BALTIMORE, MARYLAND 21202
TEL 667-309-8035
WATER FOOD SANITATION ENVIRONMENT
ENERGY MANAGEMENT SERVICES • DESIGN BUILD SERVICES
CONSULTING • ENGINEERING • CONSTRUCTION
DISTRICT OF COLUMBIA • MARYLAND
www.SETTY.com
SA2017-17 # # # #
PROJECT NUMBER

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com
GRIMM AND PARKER

GP# 21553

PARTIAL SECOND FLOOR POWER PLAN – AREA B

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

E-2.4

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014