© GRIMM AND PARKER, P.C. 2014

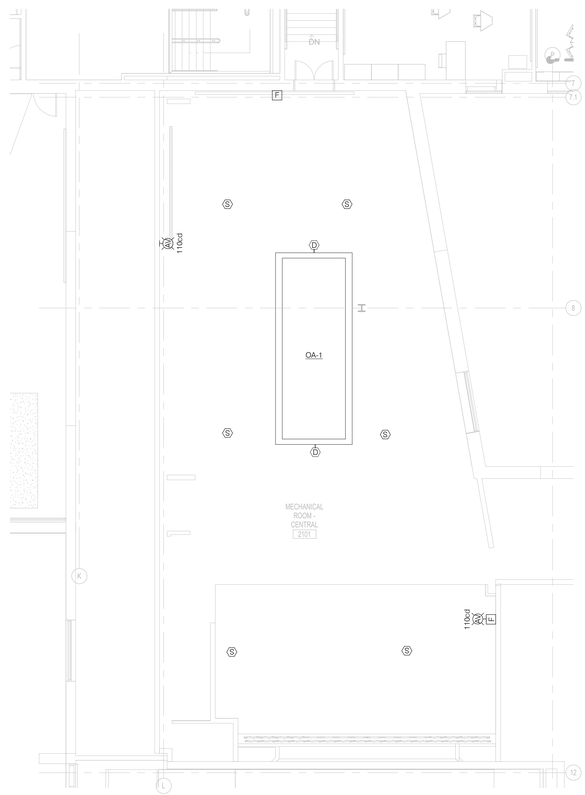

2 E-3.5 PARTIAL SECOND FLOOR FIRE ALARM PLAN – MECHANICAL ROOM

SCALE: 1/8" = 1'-0"

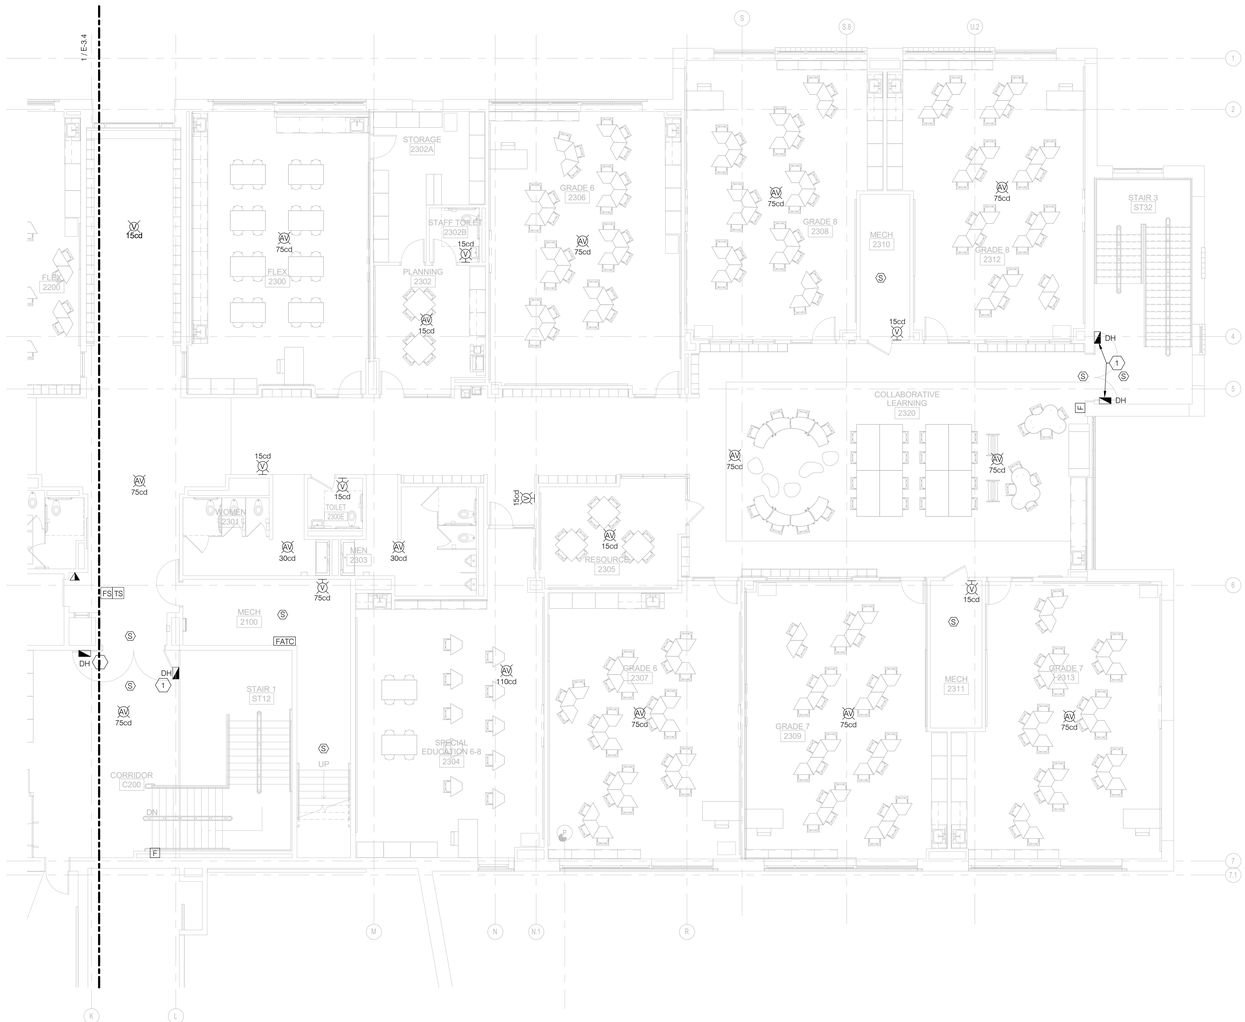

1 E-3.5 PARTIAL SECOND FLOOR FIRE ALARM PLAN – AREA C

SCALE: 1/8" = 1'-0"

GENERAL NOTES

1. REFER TO DRAWING E-0.1H/G FOR ELECTRICAL GENERAL NOTES AND ABBREVIATIONS.
2. SEE DRAWING E-5.2 FOR FIRE ALARM RISER DIAGRAM AND E5.3H/G FOR FIRE ALARM GRAPHIC ANNUNCIATOR DIAGRAM.
3. REFER TO MECHANICAL DRAWINGS FOR EXACT LOCATIONS OF DUCT SMOKE DETECTORS AND FIRE DAMPERS AND FIRE PROTECTION DRAWINGS FOR EXACT LOCATION OF FLOW AND TAMPER SWITCHES.
4. REFER TO ARCHITECTURAL DRAWINGS, ELEVATIONS AND DETAILS PRIOR TO INSTALLATION OF ALL FIRE ALARM DEVICES. COORDINATE WITH THE ARCHITECT IN CASE OF A CONFLICT.
5. ALL WALL MOUNTED FIRE ALARM AUDIO/VISUAL DEVICES WITH THE ASSOCIATED WIRING IN CONDUITS SHALL BE FLUSH MOUNTED ONLY IN THE FURRED OUT WALLS AND/OR IN THE DRY WALL PARTITIONS. AT ALL OTHER LOCATIONS, ALL WALL MOUNTED FIRE ALARM DEVICES WITH ASSOCIATED WIRING IN CONDUITS SHALL BE SURFACE MOUNTED. REFER TO ARCHITECT DRAWINGS FOR WALL TYPES AS NEEDED.

SHEET KEYNOTES

1. PROVIDE MAGNETIC DOOR HOLD OPEN. CONTRACTOR TO COORDINATE WITH DOOR HEIGHT FOR MOUNTING HEIGHT OF DOOR HOLD OPEN DEVICE

KEY PLAN



N

SETTY
ONE SOUTH STREET, SUITE 1130
BALTIMORE, MARYLAND 21202
TEL 667-329-6035
MAINTENANCE MANAGEMENT
ENERGY MANAGEMENT SERVICES • DESIGN BUILD SERVICES
CITY OF COLUMBIA • MARYLAND
www.SETTY.com

PROJECT NUMBER SA2017-F-8-F-F

GRIMM AND PARKER
11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GP# 21553

PARTIAL SECOND FLOOR FIRE ALARM PLAN – AREA C

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

E-3.5

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014