© GRIMM AND PARKER, P.C. 2014

TAGGED NOTES	
E1	NUMBER DESIGNATED INSIDE PHOTOVOLTAIC PANEL INDICATES SUB ARRAY PANEL IS ASSOCIATED WITH. REFER TO SCHEDULE ON W-0.2 FOR MORE INFORMATION ABOUT SUB ARRAY.
E2	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #1. CONNECT TO SUBARRAY #1 AND EXTEND TO INVERTER #1 IN PENTHOUSE ACCORDINGLY.
E3	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #2. CONNECT TO SUBARRAY #2 AND EXTEND TO INVERTER #2 IN PENTHOUSE ACCORDINGLY.
E4	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #3. CONNECT TO SUBARRAY #3 AND EXTEND TO INVERTER #3 IN PENTHOUSE ACCORDINGLY.
E5	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #4. CONNECT TO SUBARRAY #4 AND EXTEND TO INVERTER #4 IN PENTHOUSE ACCORDINGLY.
E6	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #5. CONNECT TO SUBARRAY #5 AND EXTEND TO INVERTER #5 IN PENTHOUSE ACCORDINGLY.
E7	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #6. CONNECT TO SUBARRAY #6 AND EXTEND TO INVERTER #6 IN PENTHOUSE ACCORDINGLY.
E8	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #7. CONNECT TO SUBARRAY #7 AND EXTEND TO INVERTER #7 IN PENTHOUSE ACCORDINGLY.
E9	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #8. CONNECT TO SUBARRAY #8 AND EXTEND TO INVERTER #8 IN PENTHOUSE ACCORDINGLY.
E10	PROVIDE COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE FOR SUBARRAY #9. CONNECT TO SUBARRAY #11 AND EXTEND TO INVERTER #9 IN PENTHOUSE ACCORDINGLY. PROVIDE ECOLIBRIUM SOLAR ECOMOUNT FOR COMBINATION COMBINER BOX / RAPID SHUTDOWN DEVICE; PROVIDE UNI-STRUT AS NECESSARY FOR MOUNTING PURPOSES.
E18	PROVIDE NEMA 3R 30A/3P DISCONNECT FOR ADJUSTABLE TILT PANEL CIRCUIT. EXTEND ENPHASE CONDUCTOR SYSTEM TO PANELS FROM DISCONNECT AS REQUIRED.

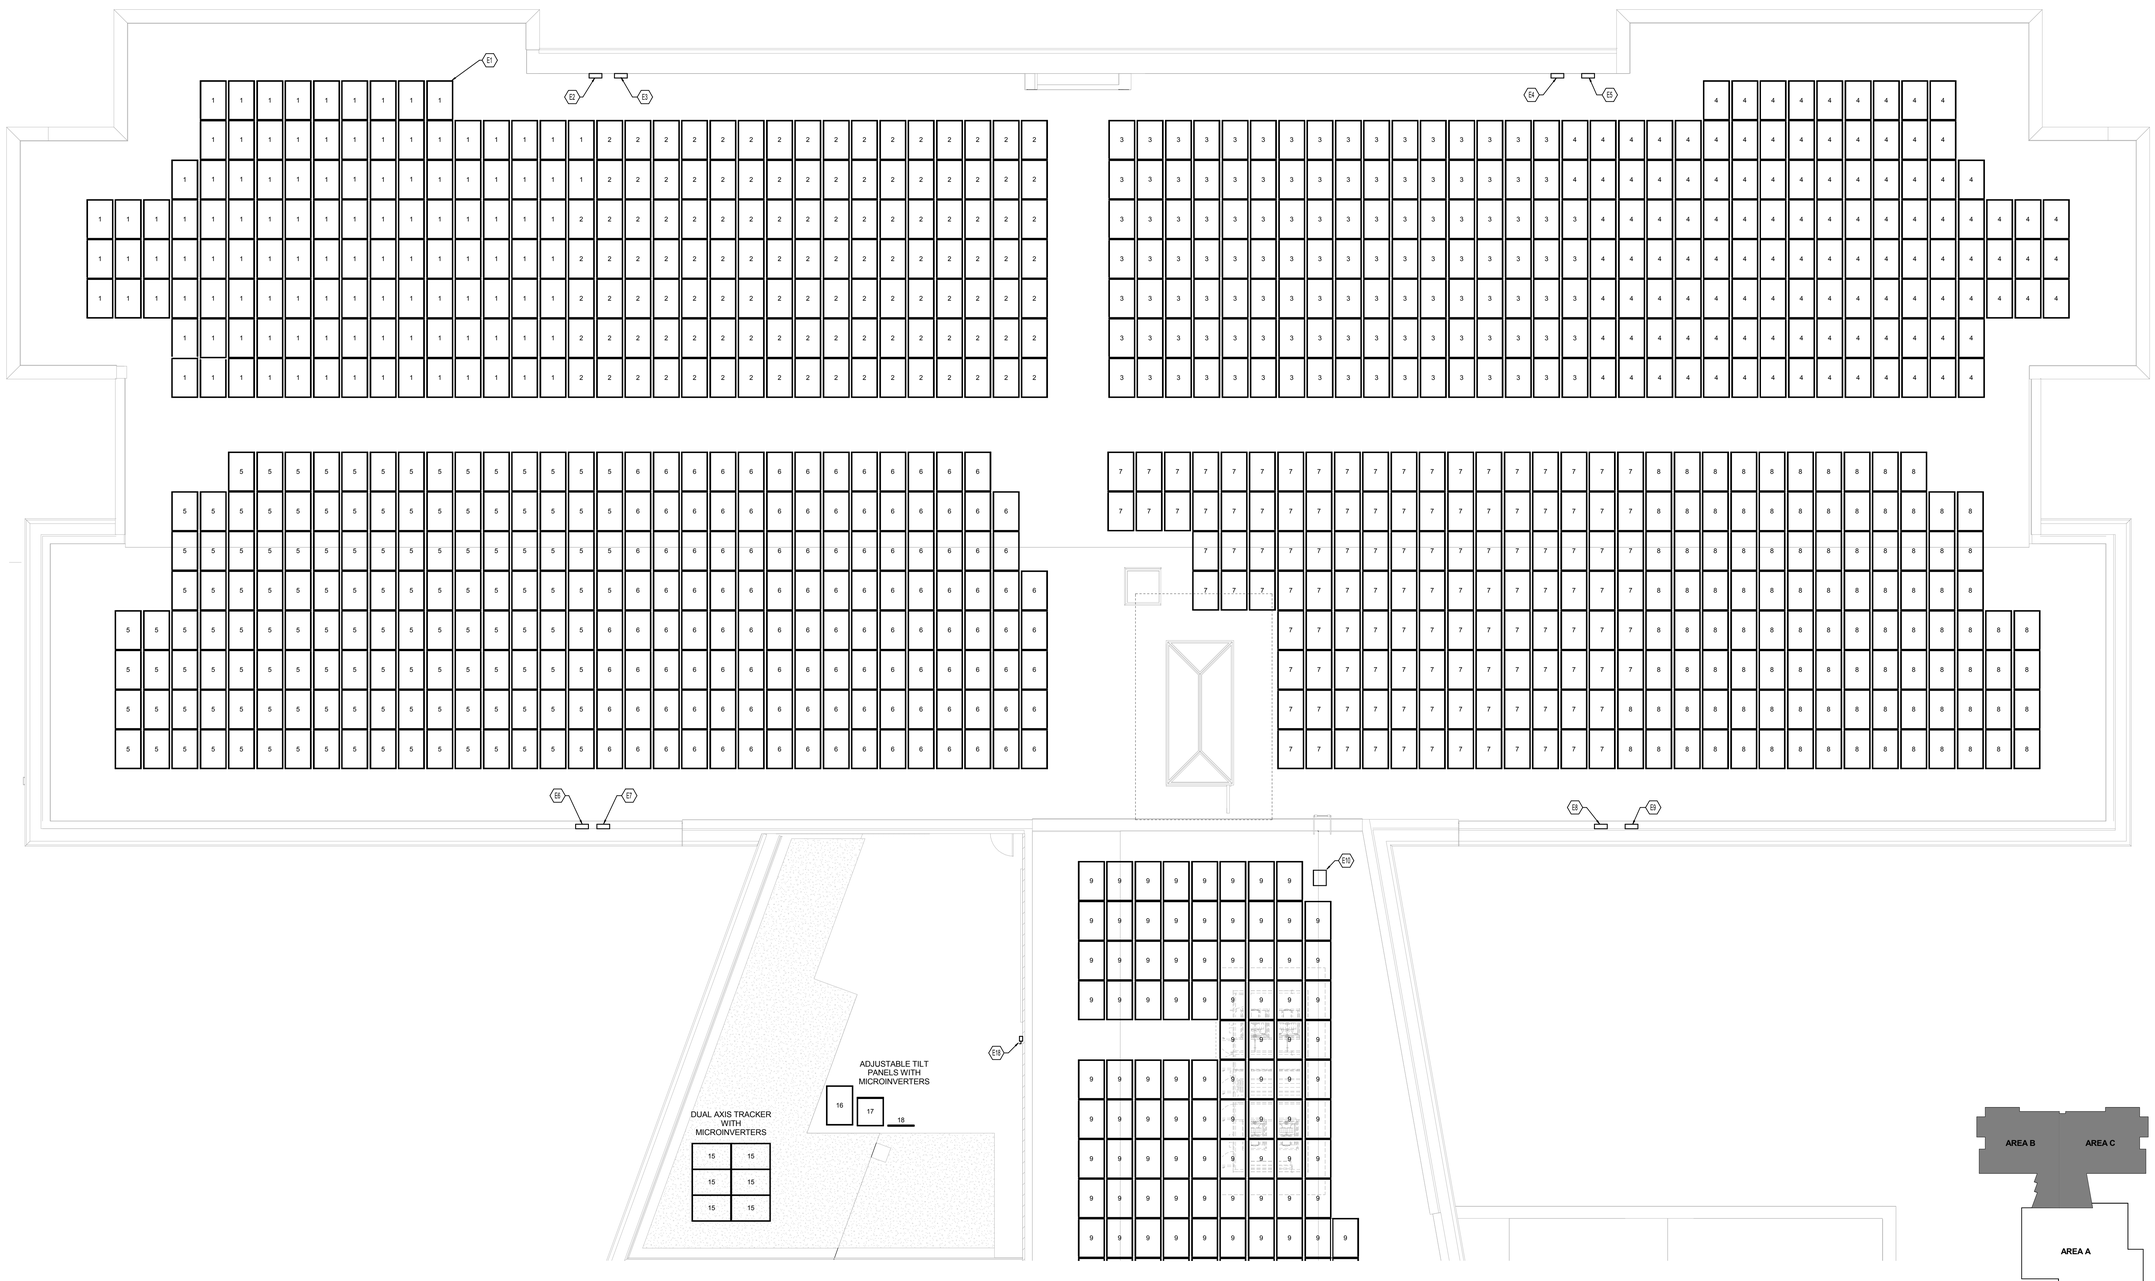

1 ROOF PLAN - AREAS B & C
SCALE: 1/8" = 1'-0"
0 2' 4' 8' 16' 24' 32'



KEYPLAN

N

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegis.com/

11720 Baltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GRIMM AND PARKER

GP# 21553

PHOTOVOLTAICS - ROOF AREA B & C

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

W-1.1BC

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014