© GRIMM AND PARKER, P.C. 2014

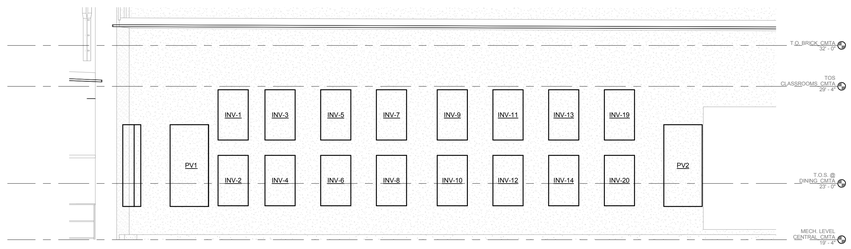

3 / 1 W-2.0 Section 40

SCALE: 1/4" = 1'-0"

0 1' 2' 4' 8' 12' 16'

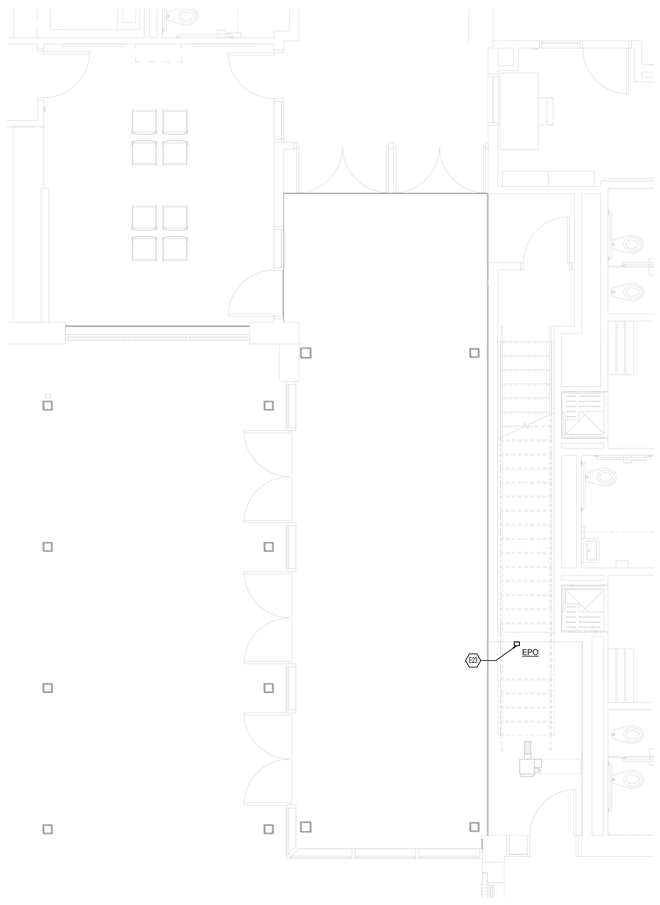

2 FIRST FLOOR_CMTA(1)

SCALE: 1/4" = 1'-0"

0 1' 2' 4' 8' 12' 16'

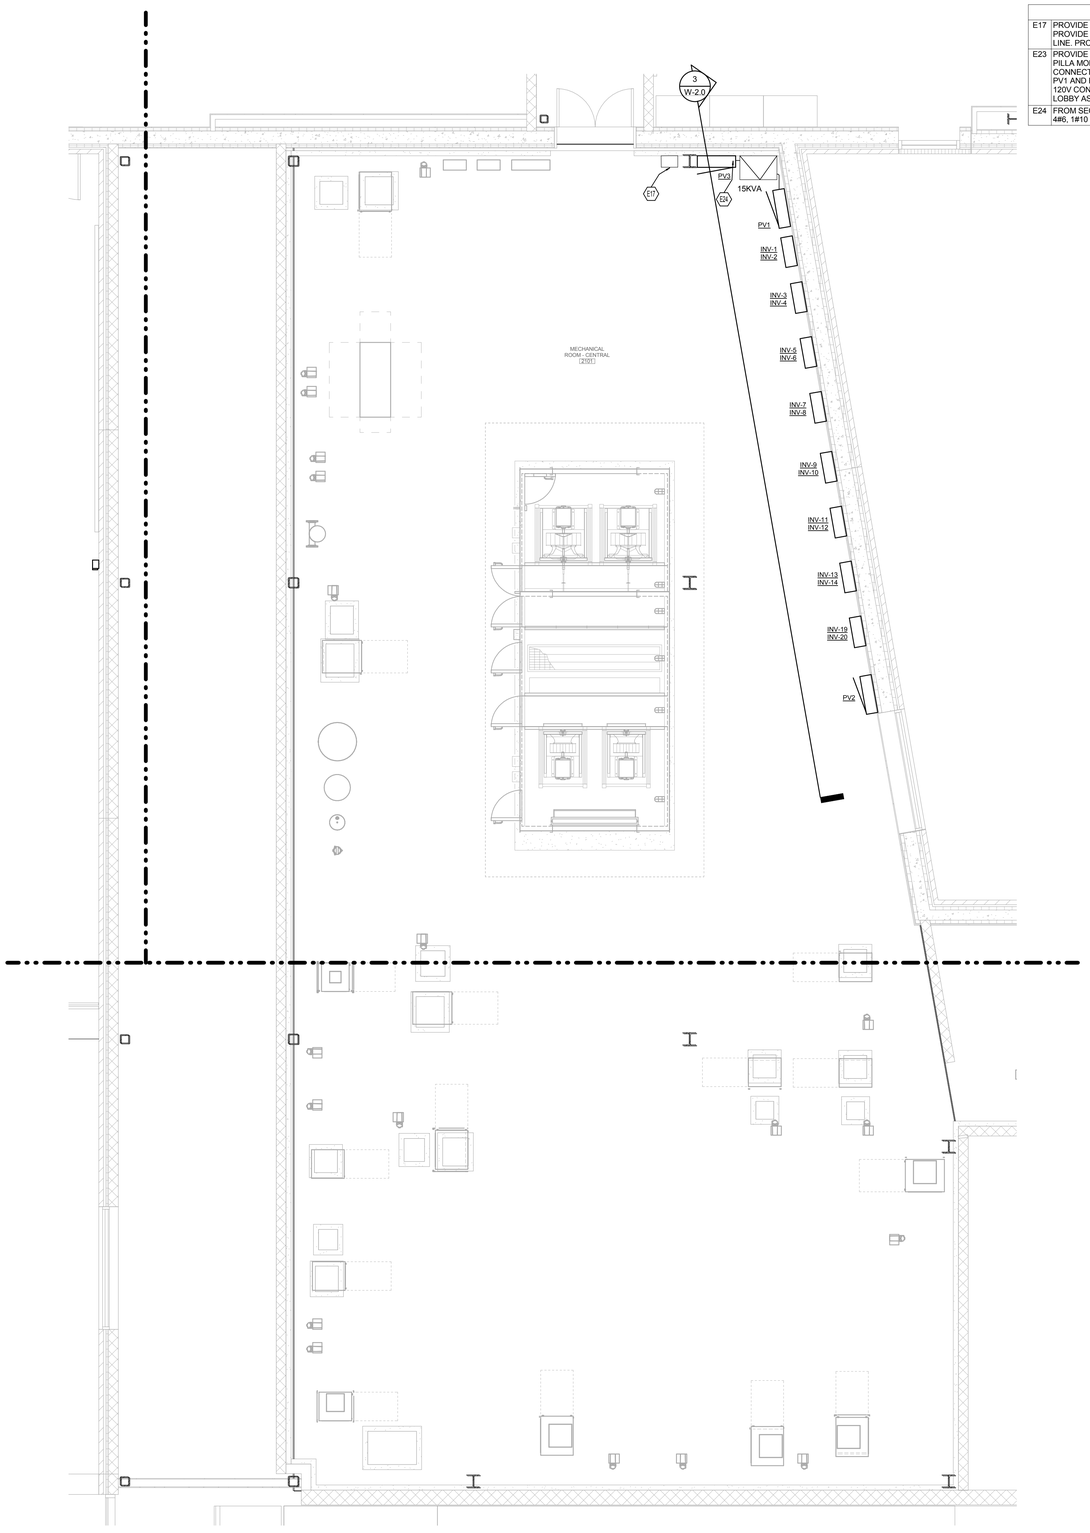

1 MECHANICAL PENTHOUSE

SCALE: 1/4" = 1'-0"

0 2' 4' 8' 16' 24' 32'

TAGGED NOTES	
E17	PROVIDE ENPHASE GATEWAY AT THIS LOCATION. PROVIDE RECEPTACLE AS NOTED IN TRACKER ONE LINE. PROVIDE NETWORK CONNECTION AT GATEWAY.
E23	PROVIDE EPO SWITHC WITH INTEGRAL ALARM & RESET. PILLA MODEL # WP2SG OR EQUAL. EPO SHALL BE CONNECTED TO BOTH SHUNT TRIP BREAKERS SERVING PV1 AND PV2 IN MAIN SWITCH BOARD MS1. PROVIDE 120V CONNECTION FROM RECEPTACLE CIRCUIT IN LOBBY AS REQUIRED.
E24	FROM SECONDARY SIDE OF TRANSFORMER, PROVIDE 4#6, 1#10 GROUND IN 1-1/4" CONDUIT TO PANEL PV3

N

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegs.com/

CMTA CONSULTING ENGINEERS

11720 Baltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

G+P GRIMM AND PARKER

GP# 21553

PHOTOVOLTAICS - FLOOR PLANS

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

W-2.0

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014