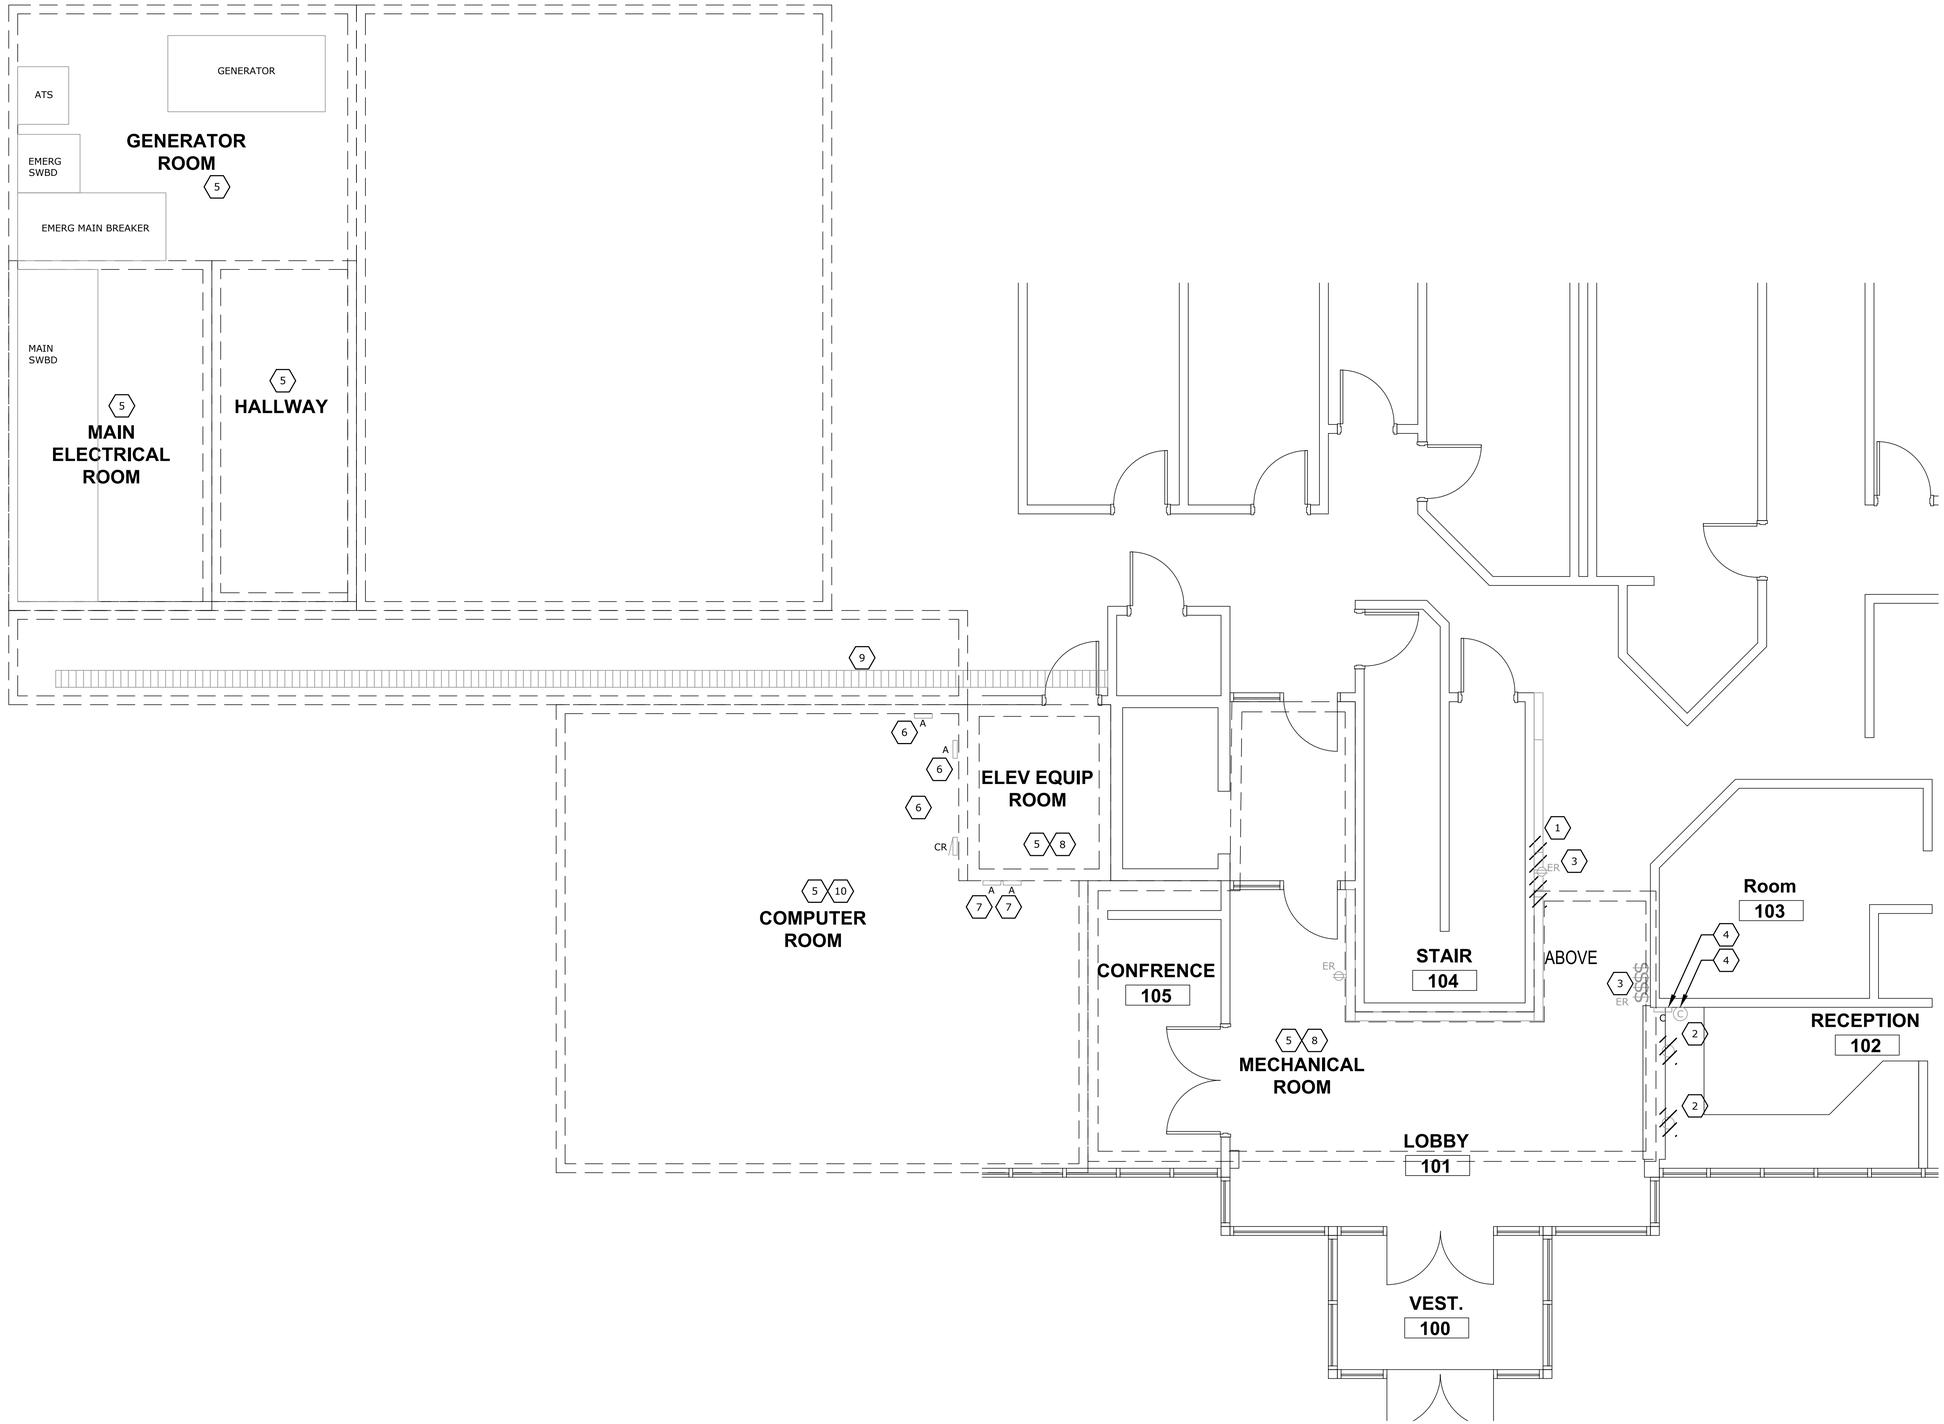

GENERAL NOTES

1. SEE REFLECTED CEILING PLANS FROM ARCHITECT FOR EXACT FIXTURE LOCATIONS.
2. SEE ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS FOR WALL MOUNTED DEVICES.
3. COORDINATE FIXTURE LOCATIONS IN AREAS WITH EXPOSED CEILINGS WITH DUCTWORK AND PIPING. ADJUST LOCATIONS AS REQUIRED FOR ACTUAL FIELD CONDITIONS.
4. SUPPORT LIGHTS IN ACCORDANCE WITH IBC SEISMIC ZONE REQUIREMENTS.
5. PROVIDE CABLE SUPPORTS IN CONJUNCTION WITH MOST CURRENT BICSI STANDARDS AS SUGGESTED PER THE ITS INSTALLATION METHODS MANUAL (ITSIMM). COORDINATE WITH OWNER.
6. PROVIDE AND ALL STRUCTURE CABLING FOR ACCESS CONTROL DEVICES AND MAKE ALL TERMINATIONS. PROVIDE 2-PAIR TWISTED SHIELDED CABLE PER MANUFACTURERS REQUIREMENTS. PROVIDE POWER SUPPLIES FOR ELECTRONIC LOCKS PER MANUFACTURERS RECOMMENDATIONS.

KEY NOTES

1. EXISTING RECESSED CONTINUOUS LUMINAIRE WALL WASHER. SECTION TO BE DEMOLISHED FOR INSTALLATION OF NEW DOOR FRAME. DEMO PER EXISTING LENGTHS OF LUMINAIRE AVAILABLE FOR DOOR FRAME. COORDINATE WITH ARCHITECTURAL FOR EXACT LOCATION OF FRAMING PRIOR TO DEMOLITION. MAINTAIN EXISTING CIRCUIT AND CONTROLS FOR RE-USE. REFERENCE ARCHITECTURAL FOR NEW FRAMEWORK AND DETAIL 1/E-801 FOR EXISTING INFORMATION. EXISTING FIXTURE CONTAINS STAGGERED 4' FLUORESCENT T12 LAMPS.
2. EXISTING LUMINAIRE TO BE DEMOLISHED. RETAIN EXISTING CIRCUIT AND CONTROLS FOR REUSE. REPAIR SOFFIT TO MATCH EXSITING CONDITIONS AND INSTALLATION OF NEW FIXTURES. REFERENCE SHEET E-201 FOR NEW WORK.
3. EXISTING ELECTRICAL DEVICE/CONTROLS TO REMAIN. PROTECT IN PLACE. MAINTAIN EXISTING PATHWAY AND CIRCUITING.
4. REMOVE EXISTING COMMUNICATIONS/SECURITY DEVICE FOR RE-LOCATION. MAINTAIN EXISTING PATHWAY AND CIRCUIT FOR REUSE. REFERENCE SHEET E-201 FOR NEW WORK AND DETAIL 2/E-801 FOR EXISTING INFORMATION.
5. EXISTING ROOM ON LEVEL BELOW
6. EXISTING ACCESS CONTROL PANELS. HIRSCH ELECTRONICS MODEL 8 SYSTEM WITH NET-MUX4 CONTROLLER. PROVIDE ADDITIONAL CONTROLLER AND EXPAND SYSTEM AS REQUIRED FOR NEW DOORS.
7. HIRSCH IDENTIV MX CONTROLLER WITH POWER SUPPLY.
8. CEILING OPEN TO STRUCTURE IN SPACE ON LEVEL BELOW.
9. EXISTING CABLE TRAY ABOVE CEILING OF FLOOR BELOW.
10. DROPPED TILE CEILING ABOVE SPACE ON LEVEL BELOW.

PLAN NORTH

POWER & SYSTEMS PLAN - DEMO/EXISTING

SCALE: 1/4" = 1'-0"

COPYRIGHT 2019
All rights reserved. Reproduction or translation of any part of this work without written permission of ARCHITECTS WEST INC. is unlawful and subject to criminal prosecution.

PROFESSIONAL ENGINEER LICENSED 16750 STATE OF IDAHO GRADY J. WEISZ
9-25-2019

Architects West
210 E Lakeside Ave
Coeur d'Alene, ID 83814
t. 208.667.9402 f. 208.667.6103
www.architectswest.com

- STRUCTURAL
- MECHANICAL
- ELECTRICAL
  TRINDERA
  1130 W HAYDEN AVE, SUITE #101
  HAYDEN, IDAHO 83835
  208.676.8001

ITD SECURITY LOBBY 19-100
ITD - COEUR D ALENE
600 W. PRAIRIE AVE. BUILDING 1002, COEUR D ALENE, IDAHO 83815

POWER & SYSTEMS PLAN - DEMO / EXSITING

PROJECT NO.	1859
DESIGNED BY	MWM
DRAWN BY	MWM
ISSUE DATE	9-24-2019
PHASE	100% BID SET
CHECKED BY	RL
REVISION	
SHEET NO.	E-101