NOTE :

PROVIDE HANGER WHEN PIPE LENGTH IS GREATER THAN 900MM

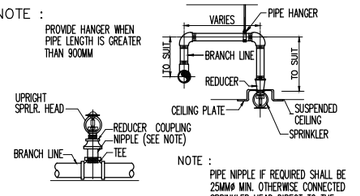

NOTE :

PIPE NIPPLE IF REQUIRED SHALL BE 25MMØ MIN. OTHERWISE CONNECTED SPRINKLER HEAD DIRECT TO THE BRANCHLINE THRU A REDUCER TEE.

A FP-10 BRANCH TO SPRLR. INSTALLATION DTL.
SCALE: NTS



B FP-10 FLUSHING CONNECTION DETAIL
SCALE: NTS



NOTE:

FLOW SWITCH SHALL NOT BE MOUNTED IN A FITTING OR WITHIN 460mm OF ANY FITTING THAT CHANGES DIRECTION OF WATER FLOW

C FP-10 FLOW SWITCH INSTALLATION DETAIL
SCALE: NTS

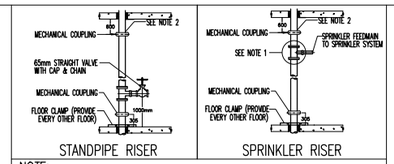

NOTE:
1.ALTERNATIVE CONNECTION IS THRU THE USE OF BOLTED MECHANICAL BRANCH CONNECTION SIMILAR TO "victaulic MECHANICAL TEE"
2.PROVIDE FOUR WAY SWAY BRACINGS ON THE RISER, WITHIN 0.6 m FROM INTERMEDIATE FLOORS & WITHIN 0.6 m FROM THE TOP OF THE RISER
3. 65mmØ HOSE VALVES SUBJECTED TO PRESSURE GREATER THAN 100 PSI SHALL BE PRESSURE REDUCING TYPE.

D FP-10 PIPE RISER DETAIL
SCALE: NTS

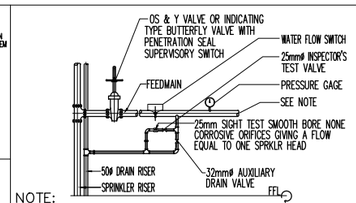

NOTE:

LOCATE ISOLATION VALVE AND FLOW SWITCH WITHIN SIX FEET OF FINISH FLOOR LINE

E FP-10 FEEDMAIN CONNECTION DETAIL
SCALE: NTS

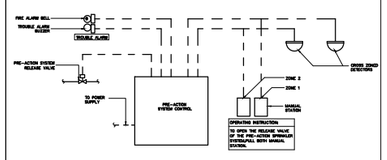

F FP-10 PRE-ACTION CONTROL PANEL SCHEMATIC DIAGRAM
SCALE NTS

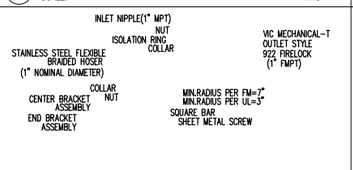

G FP-10 FLEXIBLE PIPE DETAIL
SCALE: NTS

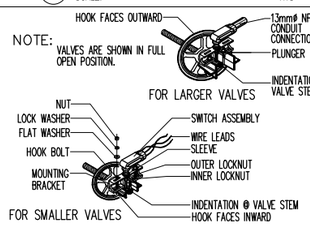

NOTE:
VALVES ARE SHOWN IN FULL OPEN POSITION.

H FP-10 SUPERVISORY SWITCH CONN. DETAIL
SCALE: NTS

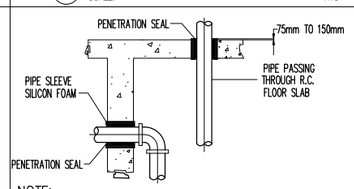

NOTE:

PIPES PASSING THRU BEAMS ARE NOT REQUIRED TO HAVE SILICON FOAM PENETRATION SEAL.

I FP-10 PIPE SLEEVE DETAIL
SCALE: NTS

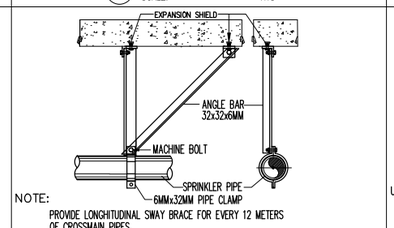

NOTE:

PROVIDE LONGHITUDINAL SWAY BRACE FOR EVERY 12 METERS OF CROSSMAIN PIPES.

J FP-10 SWAY BRACE DETAIL(LONGITUDINAL)
SCALE: NTS

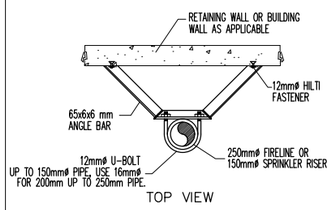

K FP-10 SWAY BRACE DETAIL (A)
SCALE: NTS

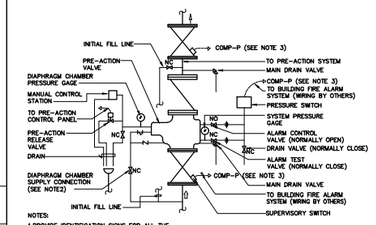

NOTES:
1.PROVIDE IDENTIFICATION SIGNS FOR ALL THE VALVE IDENTIFIED ABOVE & THEIR OPERATING POSITION.
2.VERIFY NORMAL OPERATING POSITION WITH MANUFACTURER.
3.REFER TO ZONING ARRANGEMENT IN FP-2 FOR ZONE & ALARM DESIGNATIONS.

O FP-10 PRE-ACTION VALVE DETAIL
SCALE NTS

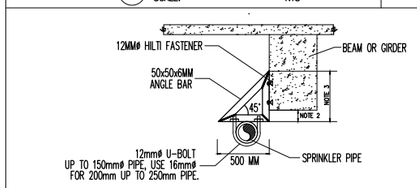

NOTE:

1. ATTACH SWAY BRACES TO BEAMS. DO NOT ATTACH TO FLOOR SLABS.

L FP-10 SWAY BRACE DETAIL (B)
SCALE: NTS

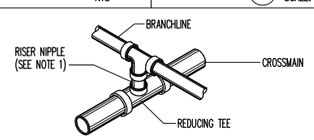

NOTES :

1. ALTERNATIVE CONNECTION IS THRU THE USE OF BOLTED MECHL BRANCH CONNECTION. SIMILAR TO "VICTAULIC" MECHANICAL TEE OR CROSS. IF MECHANICAL CROSSING IS USED, RISER NIPPLE IS NOT REQUIRED.
2. THE USE OF SCREWED CROSS FITTING IS NOT ACCEPTABLE.
3. THE USE OF THREADOLET OR WELDOLET IS ACCEPTABLE PROVIDED THAT HOLE SAW IS USED IN CUTTING HOLE THRU

M FP-10 CROSSMAIN TO BRANCHLINE CONN. DTL.
SCALE: NTS

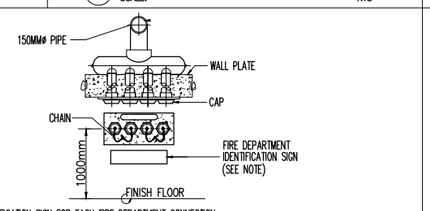

NOTES:

1. PROVIDE IDENTIFICATION SIGN FOR EACH FIRE DEPARTMENT CONNECTION.
2. IDENTIFICATION SIGN SHOULD INDICATE "COMBINED SPRINKLER STANDPIPE SYSTEM", OR "SPRINKLER SYSTEM" AS APPLICABLE.

N FP-10 FIRE DEPARTMENT CONNECTION DETAIL
SCALE: NTS

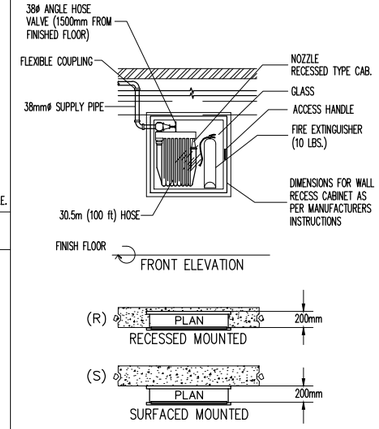

NOTE:

FOR HOSE VALVES SUJECTED TO PRESSURE GREATER THAN 100PSI, PRESSURE RESTRICTING DEVICE SHALL BE PROVIDED TO MAINTAIN PRESSURE TO 100PSI (MAXIMUM)

R FP-10 FIRE HOSE CABINET DETAIL
SCALE: NTS

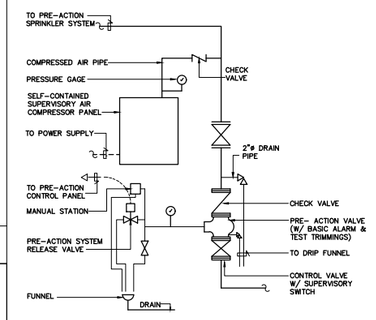

SEQUENCE OF OPERATION :

A. PRE-ACTION CONTROL PANEL
1. UPON ACTUATION OF FIRST ZONE DETECTORS, A TROUBLE ALARM SHALL SOUND.
2. UPON ACTUATION OF THE SOUND ZONE DETECTORS:
a.FIRE ALARM BELL SHALL SOUND IN THE AREA
b.PRE-ACTION SYSTEM RELEASE VALVE SHALL OPERATE (WATER WILL BE ADMITTED TO THE SYSTEM AND THE PRE-ACTION SPRINKLER SYSTEM IS READY TO DIS-CHERGE WATER ONCE THE SPRINKLER HEAD OPERATES,
A. SUPERVISORY AIR COMPRESSOR PANEL
1. SUPERVISORY AIR COMPRESSOR PANEL SHALL MAINTAIN 24oz/IN 2 PRESSURE IN THE PRE-ACTION SPRINKLER PIPING.
2. A TROUBLE ALARM SHALL SOUND ONCE THE SUPERVISORY AIR PRESSURE DROPS BELOW 16oz/IN 2

X FP-10 PRE-ACTION RISER DETAIL
SCALE NTS

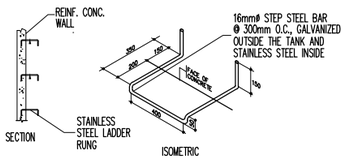

S FP-10 LADDER RUNG DETAIL
SCALE NTS

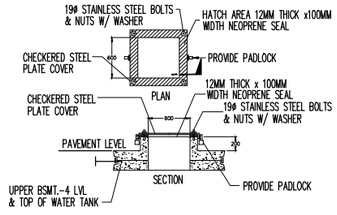

T FP-10 MANHOLE @ WATER TANKS DETAIL
SCALE NTS

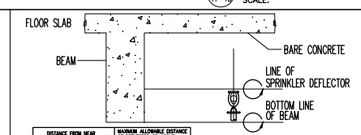

DISTANCE FROM NEAR SIDE OF BEAM(A)	MAXIMUM ALLOWABLE DISTANCE OF DEFLECTOR OR ABOVE BOTTOM LINE OF BEAM (B)
LESS THAN 300	0
300 TO LESS THAN 610	25
610 TO LESS THAN 760	51
760 TO LESS THAN 915	76
915 TO LESS THAN 1070	102
1070 TO LESS THAN 1220	152
1220 TO LESS THAN 1370	178
1370 TO LESS THAN 1525	229
1525 TO LESS THAN 1675	279
1675 TO LESS THAN 1830	356

NOTE: IF DISTANCE B IS EXCEEDED, TREAT THE BEAM AS A WALL.

U FP-10 UPRIGHT SPRINKLER INSTALLATION DETAIL
SCALE NTS

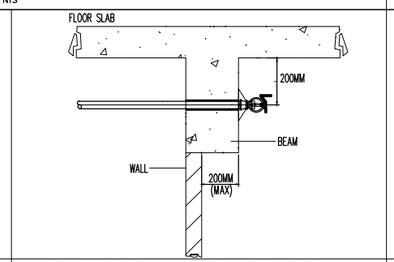

V FP-10 HOR. SIDEWALL INSTALLATION DETAIL
SCALE NTS

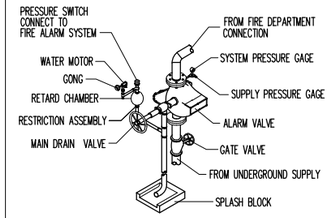

W FP-11 ALARM CHECK VALVE DETAIL
SCALE NTS

CONSULTANT		OWNER	APPROVED BY:	PROJECT TITLE	SHEET CONTENT/S :	ISSUE NO.	REVISIONS	NO.	DATE		DATE	SHEET NO.
E. H. SISON ENGINEERS, CO. ENGINEERS * PLANNERS * CONSULTANTS 3431 GUERNICA ST., PALANAN, MAKATI CITY TEL. Nos. 8317115, 8337030	RAMON D. AGUILOS PROFESSIONAL MECHANICAL ENGINEER PTR NO.: 2464195 D — PRC NO. : 2736 DATE : 01-05-22 — TIN NO. : 137-133-799 PLACE : QUEZON CITY	PHILIPPINE DEPOSIT INSURANCE CORPORATION PDIC	CYRUS T. GALANG VICE PRESIDENT ADMINISTRATIVE SERVICES GROUP	RENOVATION OF PDIC BUILDING IN CHINO ROCES LOCATION: 2228 CHINO ROCES AVENUE, MAKATI CITY	MISCELLANEOUS DETAILS					DESIGNED BY: RDAEC CADD BY: RJA CHECKED BY: APPROVED BY: SCALE:	AS SHOWN	FP-10