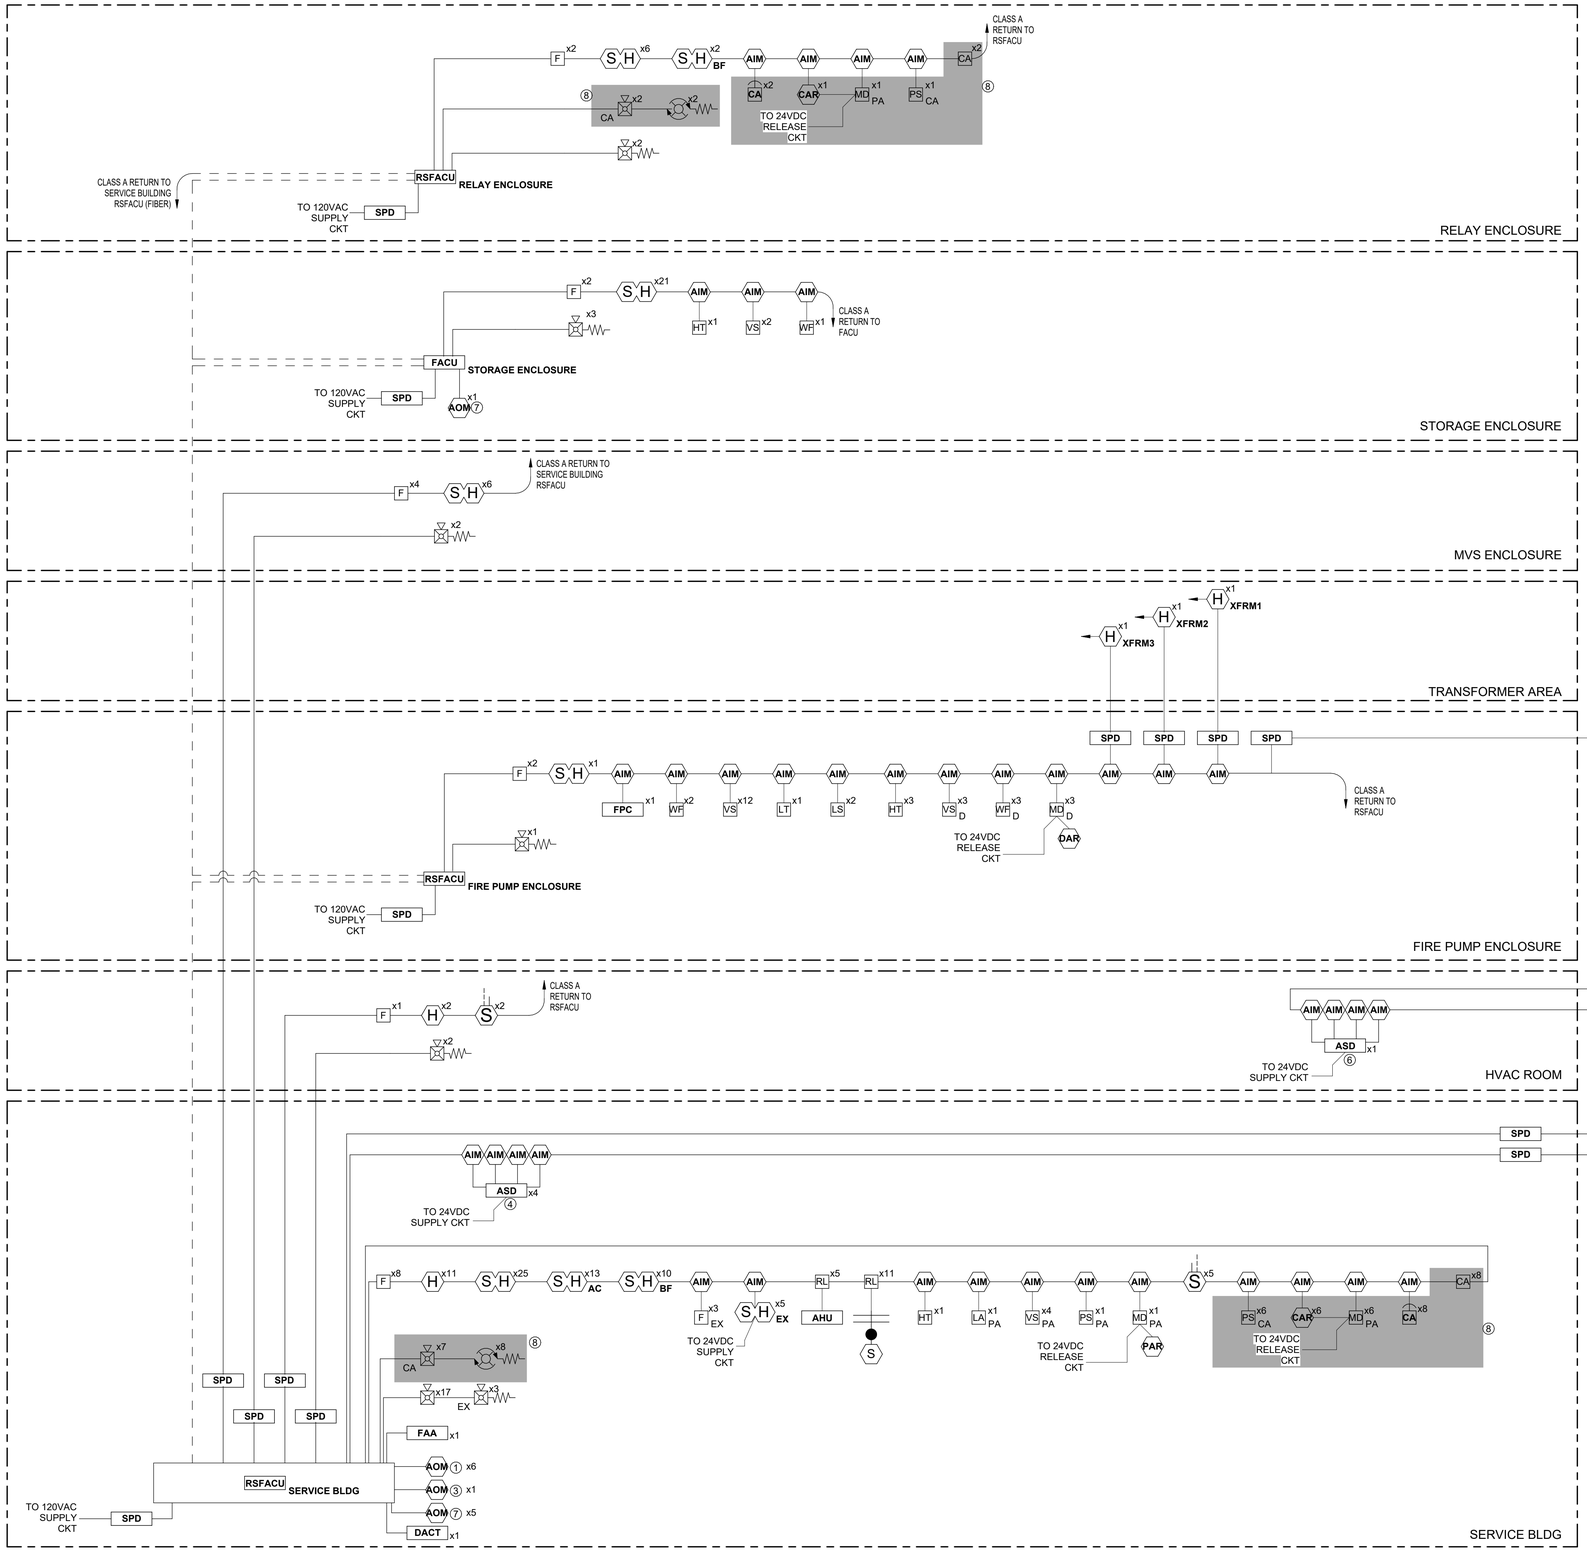

1 SCHEMATIC SINGLE LINE DIAGRAM
FA-013.00 NONE

SHEET NOTES:

1. SINGLE LINE DIAGRAM IS TO SHOW SCHEMATIC LAYOUT OF DEVICES AND EQUIPMENT THROUGHOUT ALL STRUCTURES AND DOES NOT DEPICT ACTUAL QUANTITY OF INDIVIDUAL DEVICES.

KEYNOTES:

1. TRANSMIT SIGNALS TO HITACHI'S ON-SITE MODULAR ADVANCED CONTROL FOR HVDC (MACH) SYSTEM VIA CONTACT RELAYS. SEE INPUT/OUTPUT MATRIX FOR REQUIRED SIGNALS.
2. NOT USED
3. PA SYSTEM OVERRIDE.
4. HEAD END EQUIPMENT IS FOR CONVERTER HALL AIR SAMPLING SMOKE DETECTION WITHIN THE RETURN SIDE OF THE HVAC EQUIPMENT AND AIR SAMPLING REFERENCE DETECTION ON MAKEUP AIR LOUVERS.
5. HEAD END EQUIPMENT IS FOR AIR SAMPLING DETECTION WITHIN THE CONVERTER HALLS. EQUIPMENT IS LOCATED OUTSIDE WITHIN TEMPERATURE CONTROLLED CABINETS ON THE EXTERIOR WALLS OF THE CONVERTER BUILDING HALLS. CABLING **SHALL NOT** BE RUN THROUGH THE CONVERTER HALLS.
6. HEAD END EQUIPMENT IS FOR AIR SAMPLING REFERENCE DETECTION ON MAKEUP AIR LOUVERS. EQUIPMENT IS LOCATED WITHIN TEMPERATURE CONTROLLED CABINETS WITHIN THE CONVERTER BUILDING HVAC ROOM.
7. POST-FIRE SMOKE PURGE EQUIPMENT ACTIVATION. MANUAL CONTROLS SHALL BE INTEGRAL TO RSFACU.
8. INCLUDED IN SEPARATE CLEAN AGENT PERMIT SUBMITTAL.

ISSUED FOR PERMIT

Poole Fire Protection
19910 West 161st Street
Olathe, KS 66062
913.829.8600 office ▲ 913.829.8680 fax

19910 W. 161st STREET
OLATHE, KS. 66062

SOWINSKI SULLIVAN
ARCHITECTURE • ENGINEERING

25 Mohawk Avenue
Sparta, NJ 07871

CONFIDENTIAL

THESE DRAWINGS ARE CONFIDENTIAL IN NATURE. ANY MISUSE OR UNAUTHORIZED DISTRIBUTION OF THE DRAWINGS CONTAINED HEREIN WILL BE A VIOLATION OF THIS CONFIDENTIALITY REQUIREMENT AND SUBJECT THE VIOLATOR TO LIABILITY. REVIEW OF THESE MATERIALS BY RECEIPT SHALL CONSTITUTE ACCEPTANCE OF THESE TERMS AND THE TERMS OF ANY UNDERLYING CONFIDENTIALITY AGREEMENT WE MAY HAVE EXCLUDED IN OBTAINING THIS INFORMATION FROM A THIRD PARTY. IF THE RECIPIENT IS NOT IN AGREEMENT WITH THE OBLIGATION OF CONFIDENTIALITY THEN THE DRAWINGS SHALL BE RETURNED TO THE ORIGINATOR.

REV	DESCRIPTION	DRW BY	CHK BY	DATE
B	FINAL SUBMISSION	SAB	AWP	12/12/2022
A	INTERIM SUBMISSION	SAB	AWP	09/13/2022

Kiewit
470 Chestnut Ridge Rd # 2,
Woodcliff Lake, NJ 07677

Hitachi Energy
901 Main Campus Drive
Raleigh, North Carolina 27606

PROJECT

CHPE
Champlain Hudson Power Express

Astoria HVDC Converter Station

31-45 20th Avenue, Astoria, Queens NY 11105
Block #850 - Lot #310 - BIN #4624437

FIRE ALARM RISER DIAGRAM

STATE OF NEW YORK · 102980 · LICENSED PROFESSIONAL ENGINEER
12/12/22

DATE	12/12/2022
PROJECT NO	105121
DRAWING BY	S. BRINKMEYER
CHECKED BY	A. POOLE
DRAWING NO	FA-006.00
CADD FILE N0	6 of 18

Autodesk Docs://CHPE Astoria/CHA-KIE-111-00-M3-FP-001.rvt

12/20/2022 4:20:12 PM