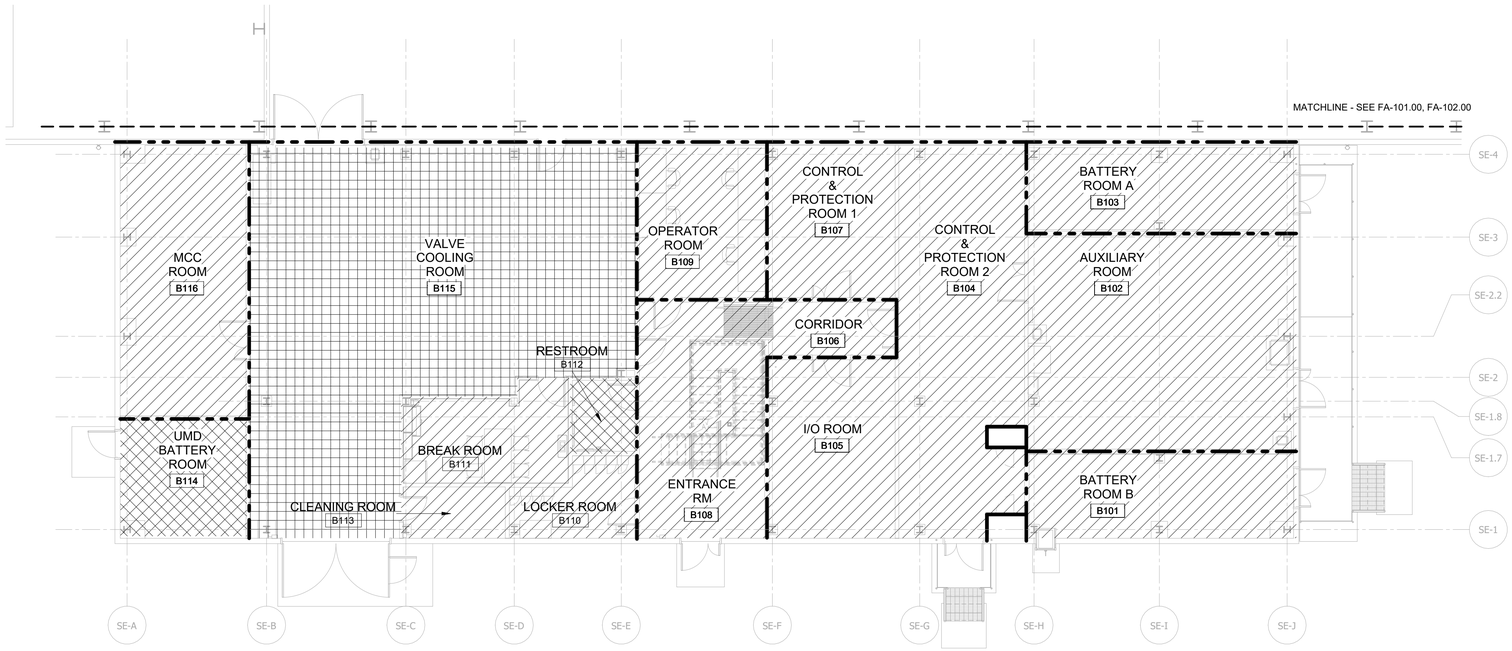

1
FA-103.00
AUDIBILITY PLAN - FIRST FLOOR
1/8" = 1'-0"

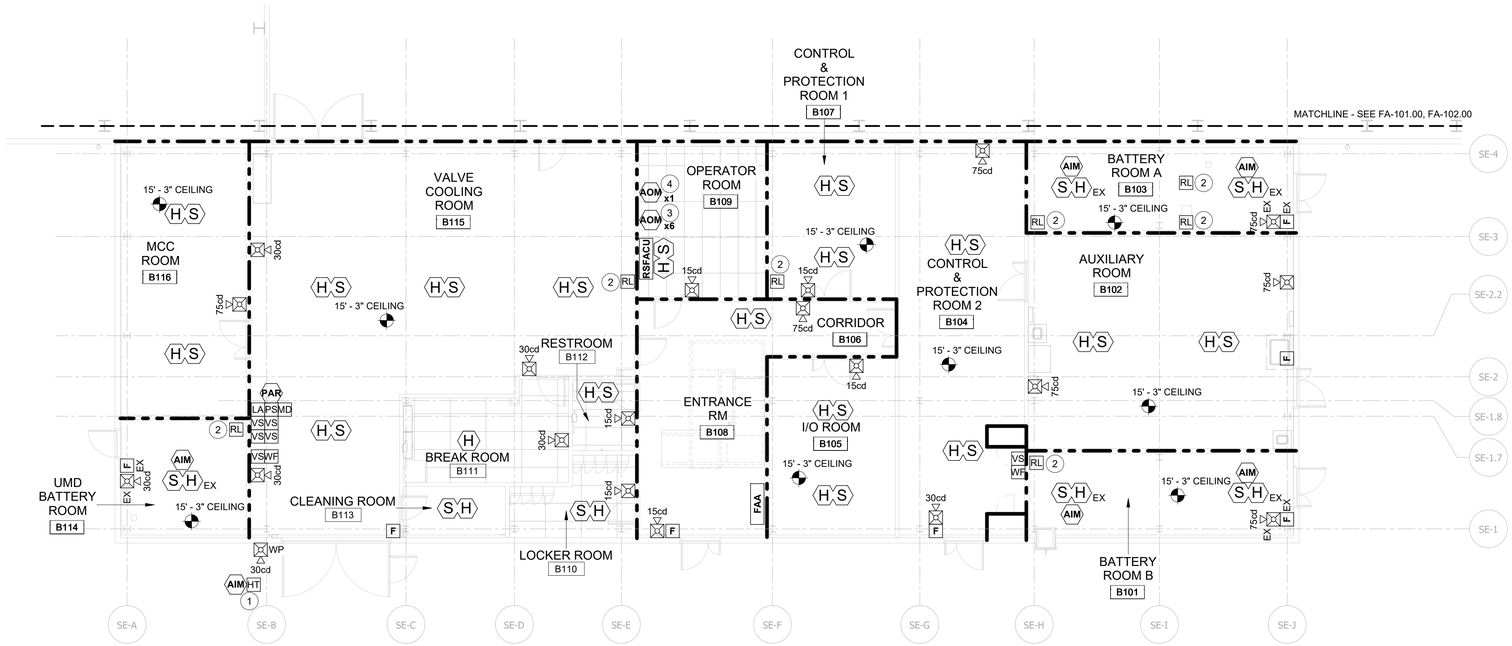

2
FA-103.00
FIRE ALARM PLAN - FIRST FLOOR
1/8" = 1'-0"

AUDIBILITY HATCH LEGEND

	30dB AMBIENT SPL 45dB EXPECTED SPL
	54dB AMBIENT SPL 69dB EXPECTED SPL
	91dB AMBIENT 106dB EXPECTED SPL

RATED WALL LEGEND

	2 HOUR FIRE BARRIER

NOTE: RATED WALLS ARE REFERENCED FROM ARCHITECTURAL PLANS. INCLUDED IN SEPARATE PERMIT SUBMITTAL.

KEYNOTES

1. EACH PIPE SHALL BE ON ITS OWN HEAT TRACING CIRCUIT AND INCLUDE ASSOCIATED TANK VALVE(S). REFER TO MECHANICAL DRAWINGS INCLUDED IN SEPARATE PERMIT SUBMITTAL.
2. RELAY MODULE FOR FIRE/SMOKE DAMPER CLOSURE. COORDINATE LOCATION WITH MECHANICAL DRAWINGS INCLUDED IN SEPARATE PERMIT SUBMITTAL.
3. MACH SYSTEM INTERFACE. SEE INPUT/OUTPUT MATRIX.
4. PA SYSTEM OVERRIDE. SEE INPUT/OUTPUT MATRIX.

ISSUED FOR PERMIT

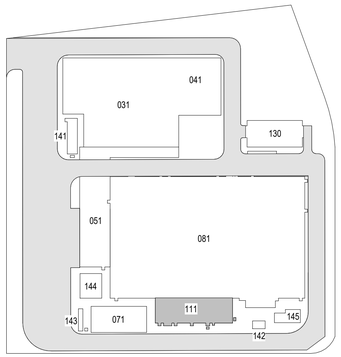

KEY PLAN
N.T.S.

Poole Fire Protection
19910 West 161st Street
Olathe, KS 66062
913.829.8000 office ▲ 913.829.8090 fax

19910 W. 161st STREET
OLATHE, KS. 66062

SOWINSKI SULLIVAN
ARCHITECTURE • ENGINEERING

25 Mohawk Avenue
Sparta, NJ 07871

CONFIDENTIAL

THESE DRAWINGS ARE CONFIDENTIAL IN NATURE. ANY MISUSE OR UNAUTHORIZED DISTRIBUTION OF THE DRAWINGS CONTAINED HEREIN WILL BE A VIOLATION OF THIS CONFIDENTIALITY REQUIREMENT AND SUBJECT THE VIOLATOR TO LIABILITY. REVIEW OF THESE MATERIALS BY RECEIPT SHALL CONSTITUTE ACCEPTANCE OF THESE TERMS AND THE TERMS OF ANY UNDERLYING CONFIDENTIALITY AGREEMENT WE MAY HAVE EXCLUDED IN OBTAINING THIS INFORMATION FROM A THIRD PARTY. IF THE RECIPIENT IS NOT IN AGREEMENT WITH THE OBLIGATION OF CONFIDENTIALITY THEN THE DRAWINGS SHALL BE RETURNED TO THE ORIGINATOR.

REV	DESCRIPTION	DRW BY	CHK BY	DATE
B	FINAL SUBMISSION	SAB	AWP	12/12/2022
A	INTERIM SUBMISSION	SAB	AWP	09/13/2022

Kiewit
470 Chestnut Ridge Rd # 2,
Woodcliff Lake, NJ 07677

Hitachi Energy
901 Main Campus Drive
Raleigh, North Carolina 27606



PROJECT

CHPE
Champlain Hudson Power Express

Astoria HVDC Converter Station

31-45 20th Avenue, Astoria, Queens NY 11105
Block #850 - Lot #310 - BIN #4624437

SERVICE BUILDING - FIRE ALARM PLAN

DATE	12/12/2022
PROJECT NO	105121
DRAWING BY	S. BRINKMEYER
CHECKED BY	A. POOLE
DRAWING NO	FA-103.00
CADD FILE N0 Autodesk Docs://CHPE Astoria/CHA-KIE-111-00-M3-FP-001.rvt	9 of 18

12/20/2022 4:20:20 PM