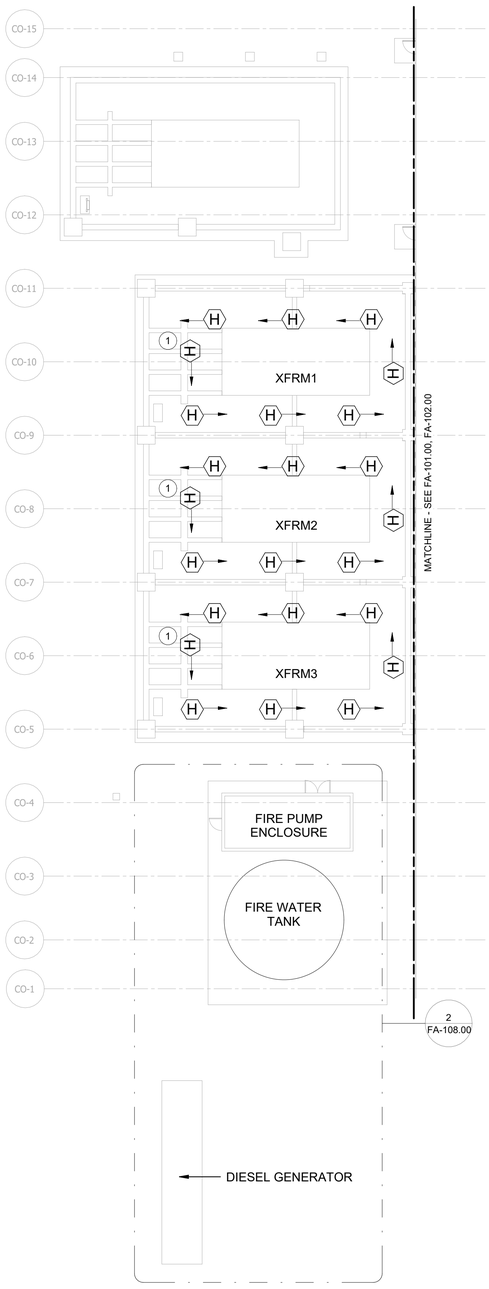

1 FA-108.00 FIRE ALARM PLAN
1/16" = 1'-0"

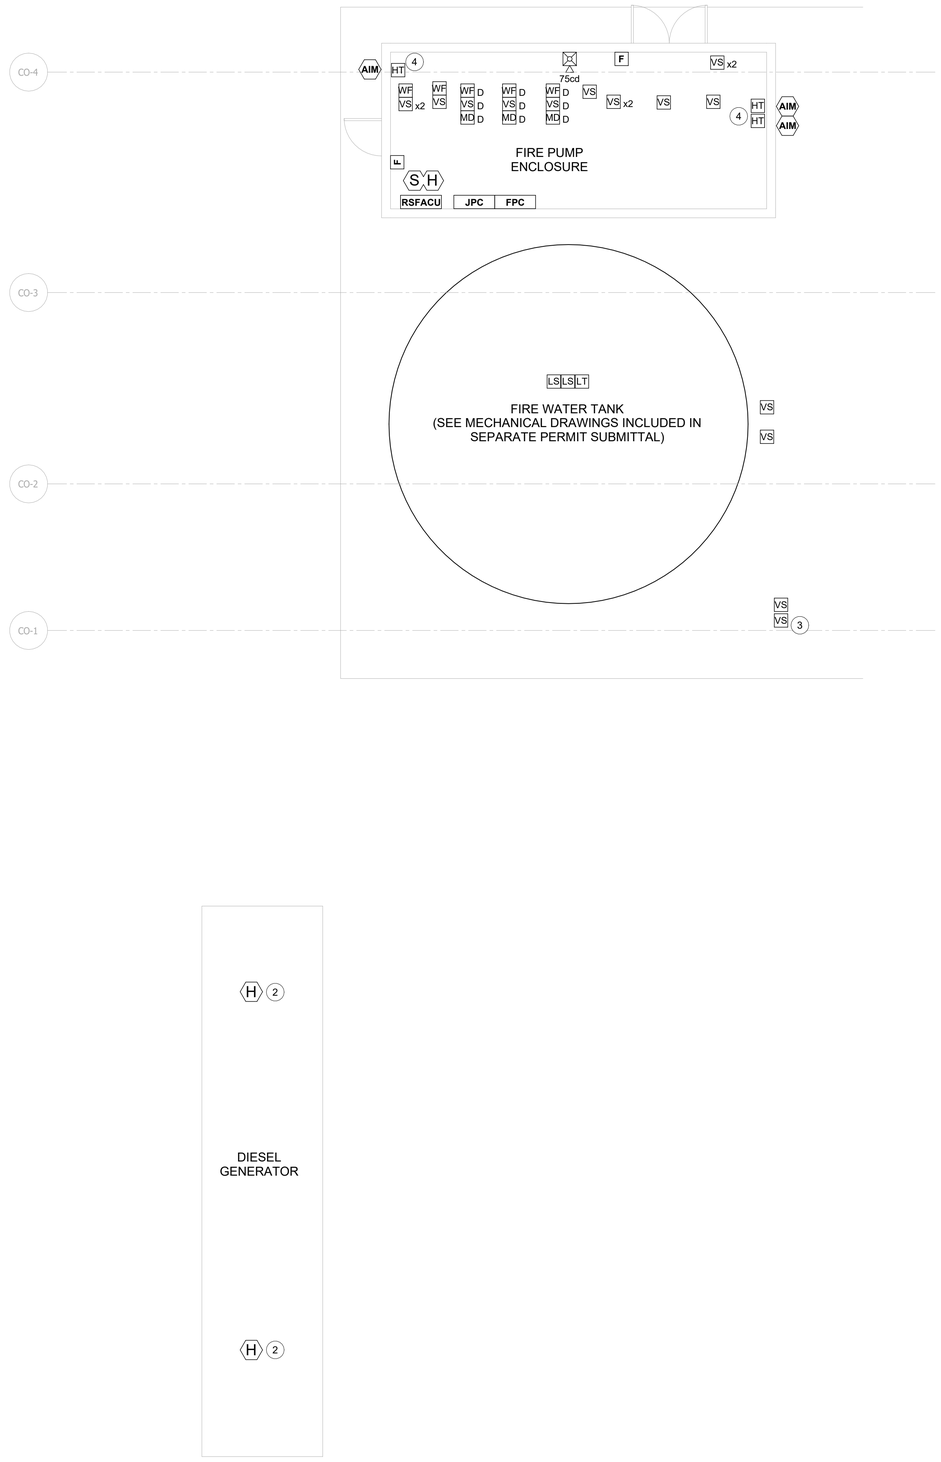

2 FA-108.00 FIRE PUMP ENCLOSURE AND WATER TANK ENLARGED FIRE ALARM PLAN
3/16" = 1'-0"

KEYNOTES

1. LINEAR HEAT DETECTION CIRCUIT SHALL BE MONITORED BY RSFACU LOCATED WITHIN FIRE PUMP ENCLOSURE. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS INCLUDED IN SEPARATE PERMIT APPLICATION.
2. HEAT DETECTORS WITHIN GENERATOR ENCLOSURE SHALL BE CONNECTED TO THE RSFACU LOCATED WITHIN THE FIRE PUMP ENCLOSURE.
3. TAMPER SWTICHES TO MONITOR TANK FILL BOOSTER PUMP VALVES. (SEE MECHANCIAL DRAWINGS INCLUDED IN SEPARATE PERMIT SUBMITTAL)
4. MONITOR ABOVE GROUND FIRE WATER PIPING HEAT TRACING. HEAT TRACING AND INSULATION PROVIDED BY MECHANICAL IN ACCORDANCE WITH NFPA 20 AND NFPA 13. REFER TO MECHANICAL DRAWINGS INCLUDED IN SEPARATE SUBMITTAL.

ISSUED FOR PERMIT

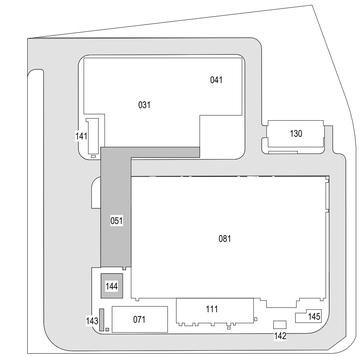

KEY PLAN
N.T.S.

TRUE NORTH
PLAN NORTH

Poole Fire Protection
19910 West 161st Street
Olathe, KS 66062
913.829.8000 office ▲ 913.829.8080 fax

19910 W. 161st STREET
OLATHE, KS. 66062

SOWINSKI SULLIVAN
ARCHITECTURE • ENGINEERING
25 Mohawk Avenue
Sparta, NJ 07871

CONFIDENTIAL

THESE DRAWINGS ARE CONFIDENTIAL IN NATURE. ANY MISUSE OR UNAUTHORIZED DISTRIBUTION OF THE DRAWINGS CONTAINED HEREIN WILL BE A VIOLATION OF THIS CONFIDENTIALITY REQUIREMENT AND SUBJECT THE VIOLATOR TO LIABILITY. REVIEW OF THESE MATERIALS BY RECEIPT SHALL CONSTITUTE ACCEPTANCE OF THESE TERMS AND THE TERMS OF ANY UNDERLYING CONFIDENTIALITY AGREEMENT WE MAY HAVE EXCLUDED IN OBTAINING THIS INFORMATION FROM A THIRD PARTY. IF THE RECIPIENT IS NOT IN AGREEMENT WITH THE OBLIGATION OF CONFIDENTIALITY THEN THE DRAWINGS SHALL BE RETURNED TO THE ORIGINATOR.

REV	DESCRIPTION	DRW BY	CHK BY	DATE
B	FINAL SUBMISSION	AWP	SAB	12/12/2022
A	INTERIM SUBMISSION	AWP	SAB	09/13/2022

Kiewit
470 Chestnut Ridge Rd # 2,
Woodcliff Lake, NJ 07677

Hitachi Energy
901 Main Campus Drive
Raleigh, North Carolina 27606

PROJECT

CHPE
Champlain Hudson Power Express

Astoria HVDC Converter Station

31-45 20th Avenue, Astoria, Queens NY 11105
Block #850 - Lot #310 - BIN #4624437

TRANSFORMER AREA AND PUMP ENCLOSURE FIRE ALARM PLAN



STATE OF NEW YORK
ANTHONY WILLIAM SULLIVAN
102980
LICENSED PROFESSIONAL ENGINEER
12/12/22

DATE	12/12/2022
PROJECT NO	105121
DRAWING BY	S. BRINKMEYER
CHECKED BY	A. POOLE

DRAWING NO
FA-108.00

CADD FILE N0
Autodesk Docs://CHPE Astoria/CHA-KIE-081-00-M3-FP-001.rvt

12/20/2022 4:14:45 PM