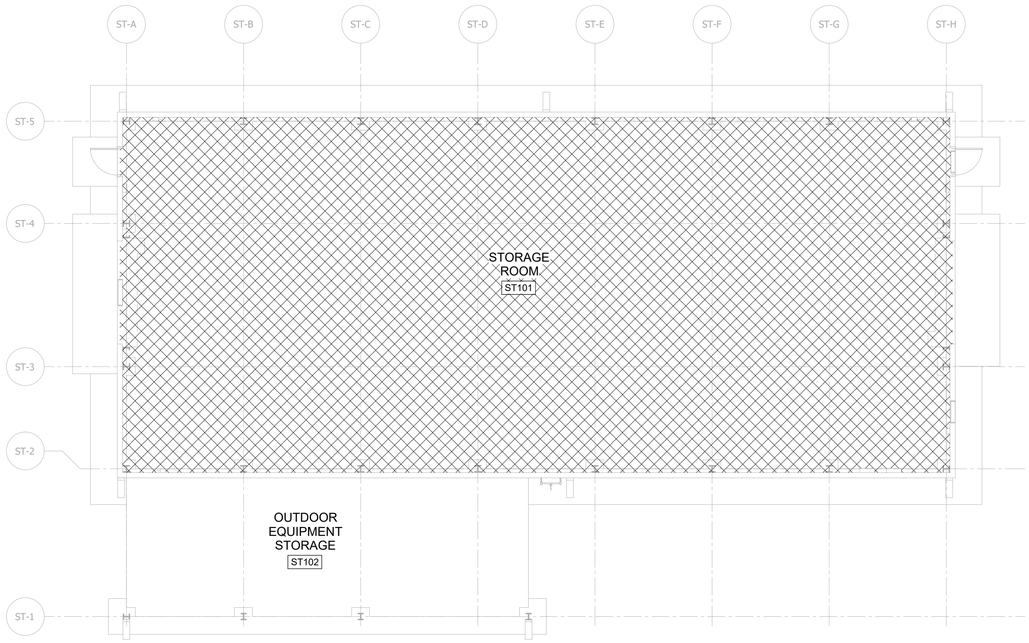

1 / FA-109.00 FIRE ALARM AUDIBILITY PLAN
1/8" = 1'-0"

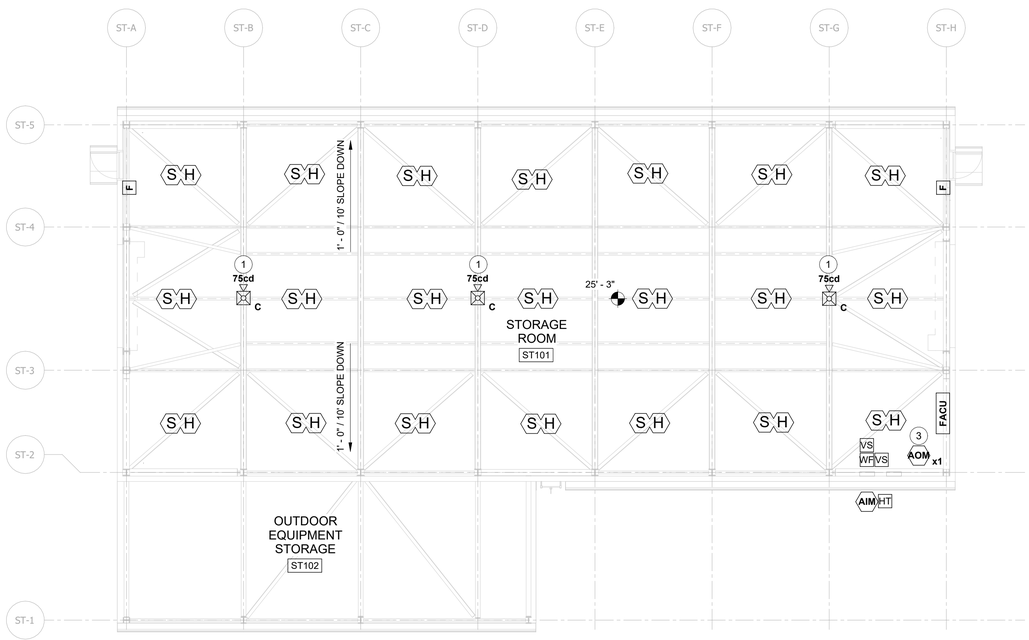

2 / FA-109.00 FIRE ALARM PLAN
1/8" = 1'-0"

KEYNOTES

1. DEVICES MOUNTED ON BOTTOM OF STRUCTURE.
2. MONITOR FIRE WATER LEAD-IN HEAT TRACING. HEAT TRACING AND INSULATION PROVIDED BY MECHANICAL IN ACCORDANCE WITH NFPA 20 AND NFPA 13. REFER TO MECHANICAL DRAWINGS INCLUDED IN SEPARATE SUBMITTAL.
3. POST-FIRE SMOKE PURGE ACTIVATION. SEE INPUT/OUTPUT MATRIX.

AUDIBILITY HATCH LEGEND

	30dB AMBIENT SPL 45dB EXPECTED SPL

ISSUED FOR PERMIT

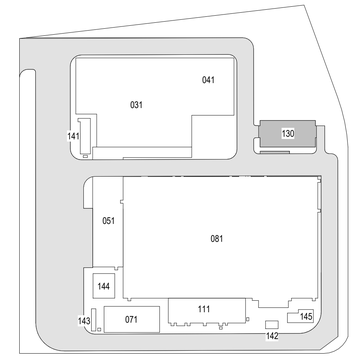

KEY PLAN
N.T.S.

PLAN NORTH

Poole Fire Protection
19910 West 161st Street
Olathe, KS 66062
913.829.8600 office ▲ 913.829.8690 fax

19910 W. 161st STREET
OLATHE, KS. 66062

SOWINSKI SULLIVAN
ARCHITECTURE + ENGINEERING

25 Mohawk Avenue
Sparta, NJ 07871

CONFIDENTIAL

THESE DRAWINGS ARE CONFIDENTIAL IN NATURE. ANY MISUSE OR UNAUTHORIZED DISTRIBUTION OF THE DRAWINGS CONTAINED HEREIN WILL BE A VIOLATION OF THIS CONFIDENTIALITY REQUIREMENT AND SUBJECT THE VIOLATOR TO LIABILITY. REVIEW OF THESE MATERIALS BY RECEIPT SHALL CONSTITUTE ACCEPTANCE OF THESE TERMS AND THE TERMS OF ANY UNDERLYING CONFIDENTIALITY AGREEMENT WE MAY HAVE EXCLUDED IN OBTAINING THIS INFORMATION FROM A THIRD PARTY. IF THE RECIPIENT IS NOT IN AGREEMENT WITH THE OBLIGATION OF CONFIDENTIALITY THEN THE DRAWINGS SHALL BE RETURNED TO THE ORIGINATOR.

REV	DESCRIPTION	DRW BY	CHK BY	DATE
0	FINAL SUBMISSION	AWP	SAB	12/12/2022
A	INTERIM SUBMISSION	AWP	SAB	09/13/2022

Kiewit
470 Chestnut Ridge Rd # 2,
Woodcliff Lake, NJ 07677

Hitachi Energy
901 Main Campus Drive
Raleigh, North Carolina 27606



1' 0 4' 8' 16'

PROJECT

CHPE
Champlain Hudson Power Express

Astoria HVDC Converter Station

31-45 20th Avenue, Astoria, Queens NY 11105
Block #850 - Lot #310 - BIN #4624437

STORAGE ENCLOSURE - FIRE ALARM PLAN

DATE	12/12/2022
PROJECT NO	105121
DRAWING BY	S. BRINKMEYER
CHECKED BY	A. POOLE
DRAWING NO	FA-109.00
CADD FILE N0	Autodesk Docs://CHPE Astoria/CHA-KIE-130-00-M3-FP-001.rvt
	15 of 18

12/20/2022 4:23:14 PM