© GRIMM AND PARKER, P.C. 2014

GENERAL MECHANICAL ENLARGED PLAN NOTES	
A	REFER TO WATER SOURCE HEAT PUMP SCHEDULE ON SHEET M10.0 FOR ALL HPS/HPR PIPING RUNOUT SIZES.
B	REFER TO WATER SOURCE HEAT PUMP SCHEDULE ON SHEET M10.0 FOR ALL CONDENSATE PIPING RUNOUT SIZES.
C	SEAL ALL FLOOR SLAB AND WALL PENETRATIONS AIR AND WATER TIGHT. ALL PENETRATIONS ARE TO BE SEALED TO MINIMIZE SOUND TRANSMITTANCE.
D	REFER TO VERTICAL HEAT PUMP INSTALLATION DETAIL ON SHEET M7.0 FOR ALL PIPING REQUIREMENTS FOR VERTICAL UP FLOW AND DOWN FLOW UNITS. PROVIDE ALL PIPING COMPONENTS IN DETAIL WHETHER SHOWN OR NOT IN PLANS, ENLARGED PLANS, SECTIONS, AND ISOMETRICS.
E	PROVIDE SA AND RA DUCT TRANSITIONS AS REQUIRED FOR INLET AND OUTLET OF ALL WATER SOURCE HEAT PUMPS.
F	REFER TO PIPING SHCEMATICS, M6.0 & M6.1, FOR FURTHER DETAIL/INFORMATION.

TAGGED NOTES	
A28	PROVIDE CONTROLS HEAD END AT INDICATED LOCATION.
A29	PROVIDE AIRCUITY COMPRESSOR AND MAIN CONTROLS AT INDICATED LOCATION.
A30	PROVIDE TOUCH SCREEN COMPUTER AS SPECIFIED IN CONTROLS SPECIFICATIONS 235200.
H7	6" HYDRONIC PIPES DOWN TO FIRST FLOOR, REFER TO SHEET M2.2.
H8	FOR PIPE CONTINUATION REFER TO SECOND FLOOR HYDRONIC DESIGN PLAN - AREA C, SHEET M2.5.
H16	1.5" CD PIPE DOWN TO FIRST FLOOR CEILING, AREA A. REFER TO SHEET M2.1.
H19	FOR PIPE CONTINUATION, SEE DOMESTIC WATER HEAT PUMP PIPING SCHEMATIC, SHEET M6.1.
H20	FOR MORE INFORMATION, SEE DUAL TEMPERATURE SYSTEM HYDRONIC PIPING SCHEMATIC ON SHEET M6.0.
H45	REFER TO UM-1.0G FOR GEOTHERMAL WELL FIELD PIPING.
H46	6" GS/R & HPS/R TO EXTERNAL PURGE AND FLUSH PORT BOX. REFER TO DETAIL 2 ON M-7.2 FOR FURTHER DETAIL.
H47	8" GS/R UP TO FIRST FLOOR. REFER TO M-2.1B FOR CONTINUATION.

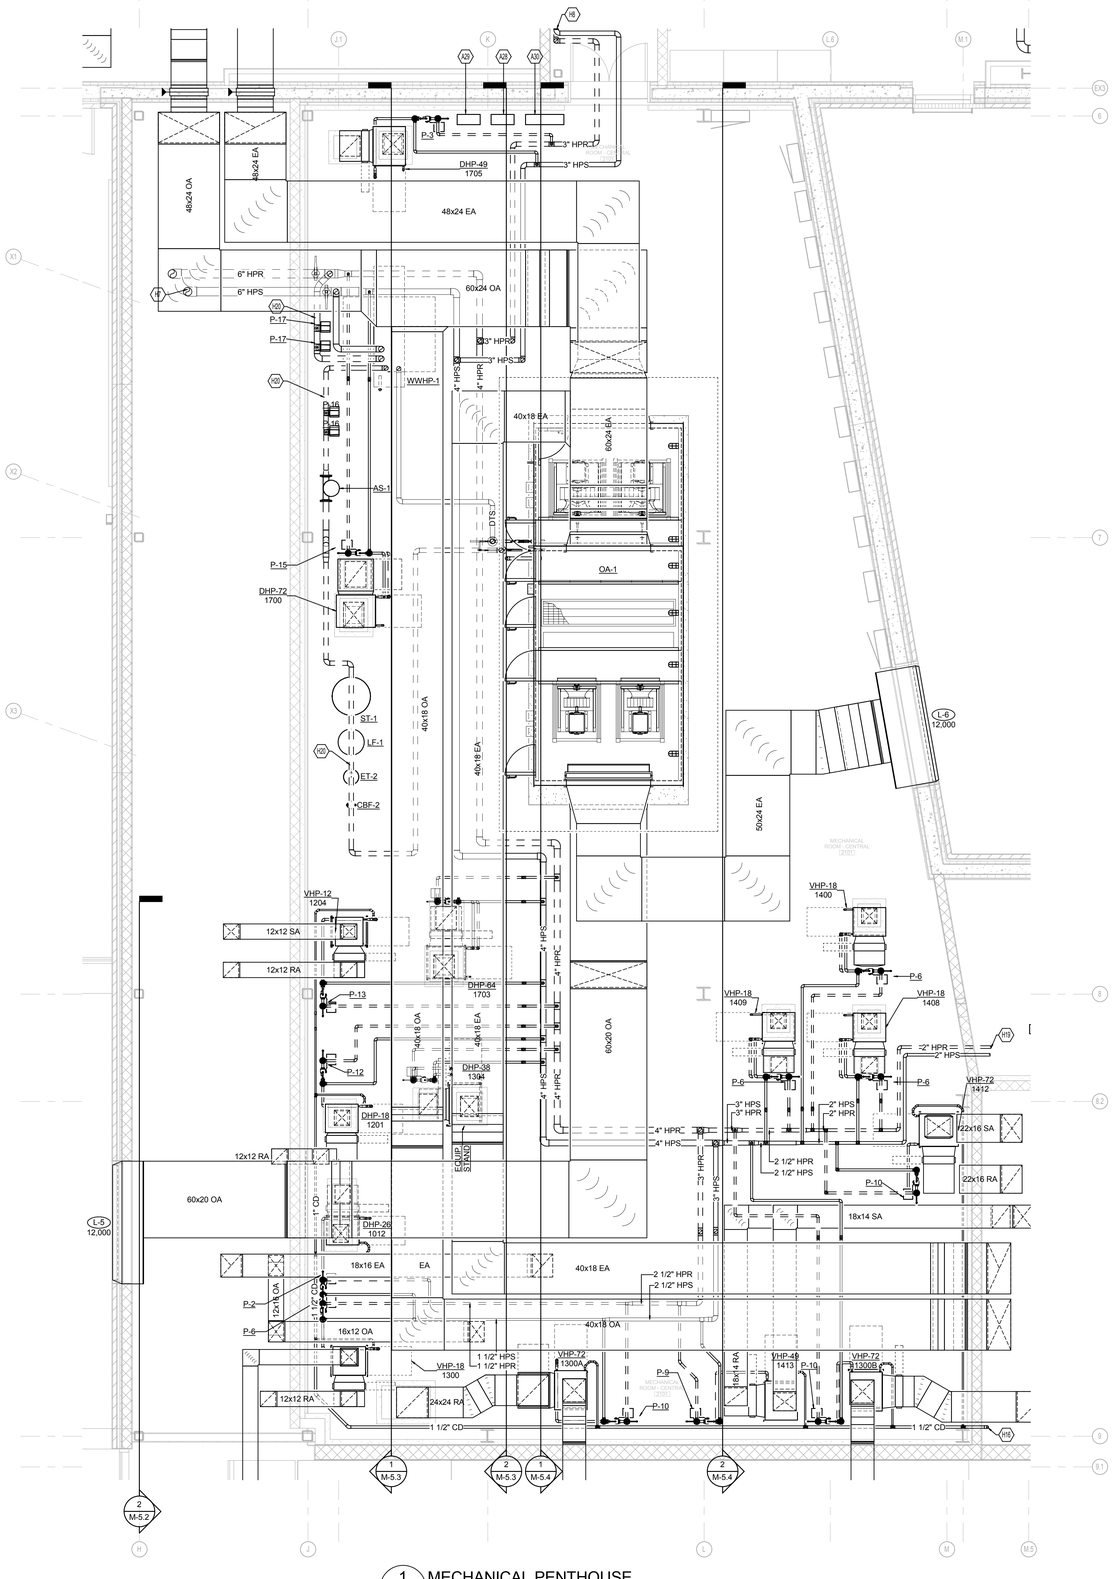

1 MECHANICAL PENTHOUSE
SCALE: 1/4" = 1'-0"

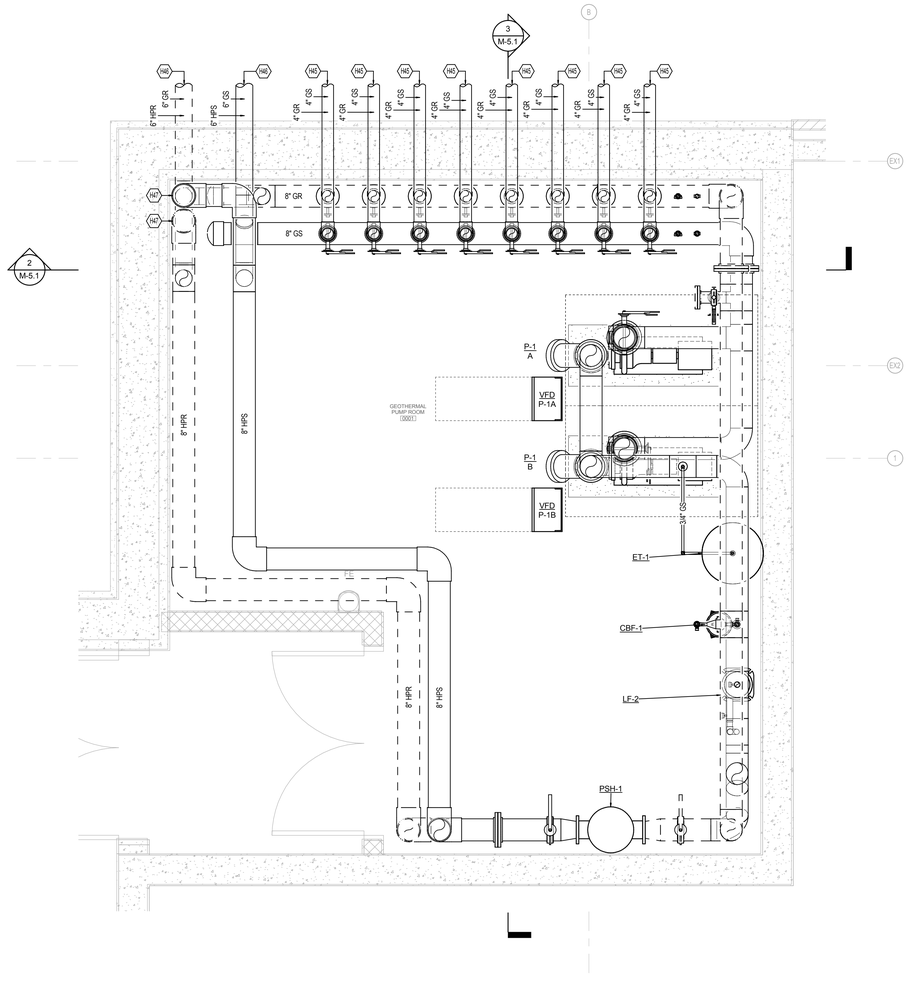

2 GEOTHERMAL PUMP ROOM
SCALE: 1/2" = 1'-0"



KEYPLAN

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegis.com/

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GRIMM AND PARKER

GP# 21553

ENLARGED PLANS

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

M-4.0

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014