© GRIMM AND PARKER, P.C. 2014

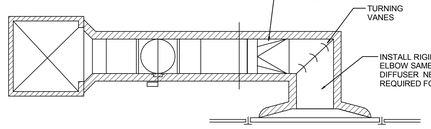

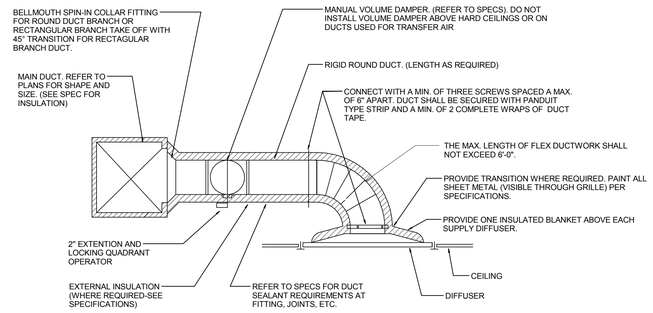

NOTE: INSTALL MANUAL VOLUME DAMPERS ON ALL SUPPLY AIR, EXHAUST AIR, OUTSIDE AIR, AND RETURN AIR DUCT BRANCHES WHETHER INIDCATED ON DRAWINGS OR NOT.

NOTE: NO VOLUME DAMPER IS REQUIRED ON VAV BOX BRANCHES ONLY SERVING ONE DIFFUSER. VAV BOX WILL BALANCE AIR FLOW.



PLAN VIEW REPRESENTATION

NOTE: SUPPORT DUCTWORK, DIFFUSERS, ETC. INDEPENDENTLY OF CEILING SYSTEM.

PLAN VIEW REPRESENTATION

NOTE: INSTALL MANUAL VOLUME DAMPERS ON ALL SUPPLY AIR, EXHAUST AIR, OUTSIDE AIR, AND RETURN AIR DUCT BRANCHES WHETHER INIDCATED ON DRAWINGS OR NOT.

NOTE: NO VOLUME DAMPER IS REQUIRED ON VAV BOX BRANCHES ONLY SERVING ONE DIFFUSER. VAV BOX WILL BALANCE AIR FLOW.

1 TYPICAL BRANCH DUCT SUPPLY/OUTSIDE/RETURN/EXHAUST AIR DETAIL

SCALE: NONE



5 GEOTHERMAL TRENCH DETAIL

SCALE: NONE

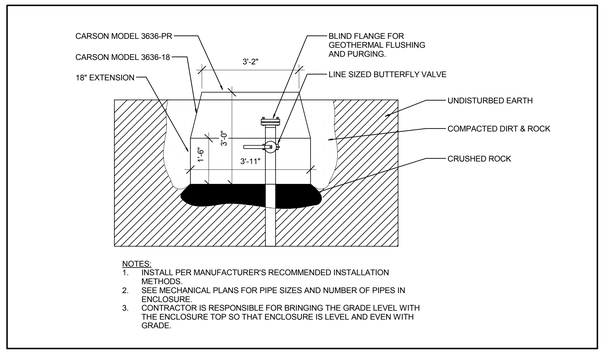

NOTES:
1. INSTALL PER MANUFACTURER'S RECOMMENDED INSTALLATION METHODS.
2. SEE MECHANICAL PLANS FOR PIPE SIZES AND NUMBER OF PIPES IN ENCLOSURE.
3. CONTRACTOR IS RESPONSIBLE FOR BRINGING THE GRADE LEVEL WITH THE ENCLOSURE TOP SO THAT ENCLOSURE IS LEVEL AND EVEN WITH GRADE.

2 GEOTHERMAL EXTERIOR PURGE BOX DETAIL

SCALE: NONE

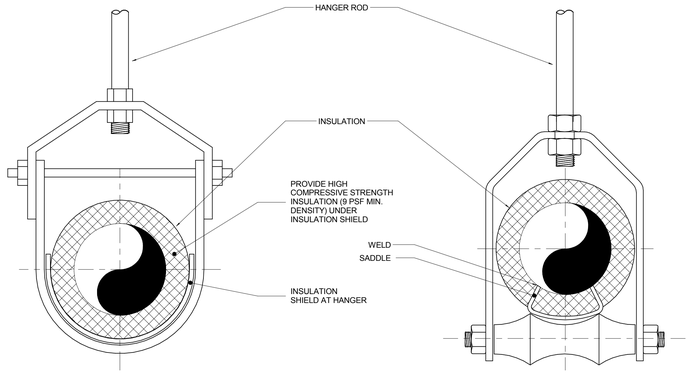

ADJUSTABLE CLEVIS HANGER TYPE # - SEE SPECIFICATIONS

ADJUSTABLE CLEVIS HANGER TYPE # - SEE SPECIFICATIONS

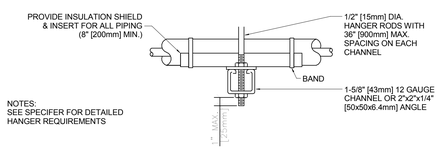

NOTES:
SEE SPECIFER FOR DETAILED HANGER REQUIREMENTS

SIDE VIEW TRAPEZE HANGER FOR UP TO 1000 LB. [4533KG] UNIFORM LOAD

MAXIMUM PIPE/TUBING SUPPORT SPACING																				
NOM. SIZE	IN. [mm]	THRU 3/4 THRU [20]	1 [25]	1 1/4 [32]	1 1/2 [40]	2 [50]	2 1/2 [65]	3 [75]	4 [100]	5 [125]	6 [150]	8 [200]	10 [250]	12 [300]	14 [350]	16 [400]	18 [450]	20 [500]	24 [600]
PIPE	FT. [mm]	7 [2100]	7 [2100]	7 [2100]	9 [2700]	10 [3000]	11 [3400]	12 [3700]	14 [4100]	16 [4900]	17 [5200]	19 [5800]	22 [6700]	23 [7000]	25 [7600]	27 [8200]	28 [8500]	30 [9100]	32 [9600]
TUBING	FT. [mm]	5 FT [1500]	6 [1800]	7 [2100]	8 [2400]	8 [2400]	9 [2700]	10 [3000]	12 [3700]	13 [4000]	14 [4100]	16 [4900]	-	-	-	-	-	-	-
NOTE: FOR TRAPEZE HANGER TAKE SPACING OF SMALLEST SIZE ON TRAPEZE.																			

3 PIPE HANGER DETAIL

SCALE: NONE

1. OPENING, RA
2. FILTER, 2" MERV 8 W/ GAUGE
3. HEAT WHEEL
4. FANMATRIX™ EXHAUST W/ BACKDRAFT DAMPER
5. DAMPER, BYPASS
6. DAMPER, EXHAUST
7. DAMPER OSA
8. FILTER, 2" MERV 8 PLEATED & 12" MERV 13 CARTRIDGE W/ GAUGE
9. DAMPER, FACE
10. COIL, COOLING/ HEATING COMBINATION W/ DRAIN PAN
11. FANMATRIX™ SUPPLY W/ BALANCE STREAM
12. OPENING, DISCHARGE
13. VFD(S)
14. GFI, LIGHT SWITCH

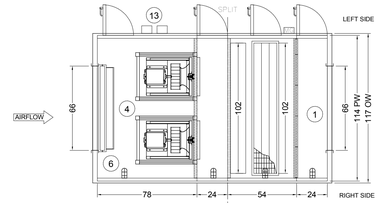

PLAN VIEW - EXHAUST SIDE

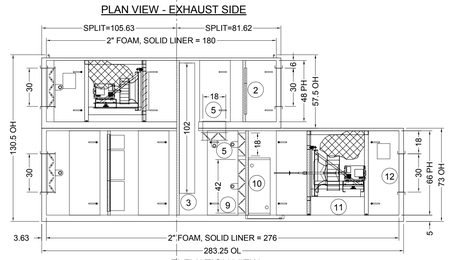

ELEVATION VIEW

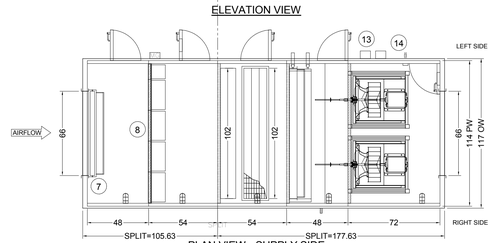

PLAN VIEW - SUPPLY SIDE

NOTES:
1. VOLTAGWE 460/3/60
2. ALL ACCESS DOORS = 24" W UNLESS OTHERWISE SPECIFIED, A VIEW WINDOW SHALL BE PROVIDED AT FAN SECTION.
3. PIEZOMETRIC SENSORS, TRANSDUCER, MOTOR SHAFT GROUNDING, VFD(S) FURNISHED & INSTALLED BY CLIMATECRAFT.
4. NOVELAIRE HEAT WHEEL FURNISHED & INSTALLED BY CLIMATECRAFT.
5. BYPASS CONTROL DAMPER DESIGNED AT COIL AREA:
CWC: 15,000 CFM
FACE & BYPASS DAMPER: 15,000 CFM
SA = 15,000 CFM
6. BYPASS DAMPER BETWEEN EXH:
13,500 CFM
EXH/ RA = 13,500 CFM

4 OUTSIDE AIR UNIT (OA-1) SCHEMATIC

SCALE: 1/8" = 1'-0"

0 2' 4' 8' 16' 24' 32'

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegs.com/
CMTA CONSULTING ENGINEERS

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com
G+P GRIMM AND PARKER
GP# 21553

MECHANICAL DETAILS
HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

DATE	DESCRIPTION

M-7.2

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014