© GRIMM AND PARKER, P.C. 2014

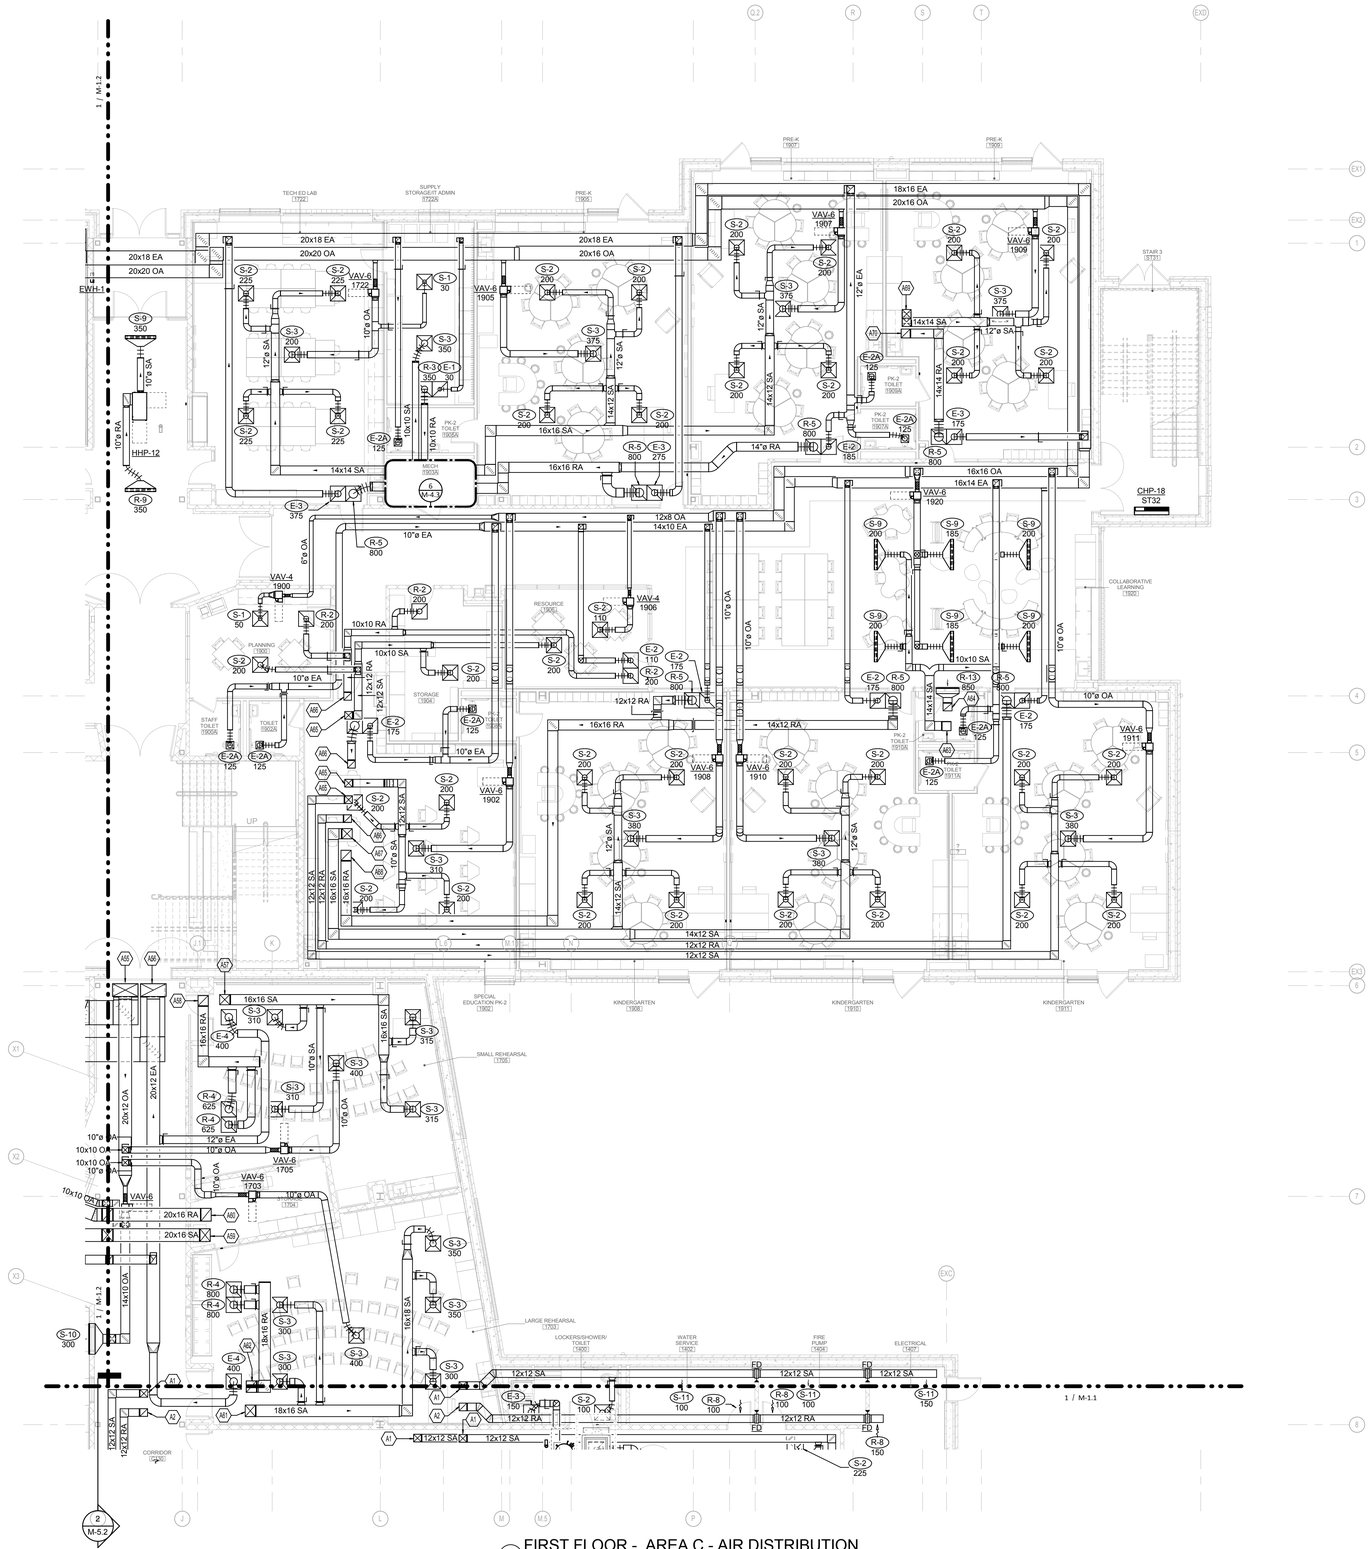


1 FIRST FLOOR - AREA C - AIR DISTRIBUTION

SCALE: 1/8" = 1'-0"

0 2' 4' 8' 16' 24' 32'

| GENERAL AIR DISTRIBUTION NOTES | |
|---|---|
| A | REFER TO R,G,D RUNOUT SCHEDULE FOR R,G,D DUCT SIZE. |
| B | REFER TO TYPICAL BRANCH DUCT SUPPLY/OUTSIDE/RETURN/EXHAUST AIR DETAIL. |
| C | REFER TO TRANSFER AIR GRILLE DETAIL. |
| D | COORDINATE REGISTERS, GRILLES, AND DIFFUSERS WITH REFLECTED CEILING PLANS AND LIGHTING PLANS. |
| E | REFER TO CAV/VAV BOX DETAIL. |
| F | REFER TO AIR TERMINAL UNIT SCHEDULE FOR ALL RUNOUT SIZED OF VAV AND CAV BOXES. |
| G | REFER TO REFLECTED CEILING PLANS. PROVIDE 12"x12" ACCESS PANEL PREPARED FOR PAINTING AND PAINTED IN ACCORDANCE WITH ARCHITECTURAL REQUIREMENTS. PROVIDE ACCESS PANELS FOR DAMPERS WHERE INDICATED ABOVE GYPSUM CEILINGS IN AREAS SUCH AS RESTROOMS, LOCKER ROOMS, CUSTODIAL AREAS, ETC. |

| TAGGED NOTES | |
|---|---|
| A1 | 12"x12" SA UP TO MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M-4.0 MECHANICAL PENTHOUSE. |
| A2 | 12"x12" RA UP TO MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M-4.0 MECHANICAL PENTHOUSE. |
| A37 | ALL EXPOSED RECTANGULAR DUCTWORK SHALL BE INSULATED AND PAINTED IN ACCORDANCE WITH SPECIFICATIONS. COLOR TO BE SELECTED BY ARCHITECT. |
| A55 | 40"x20" OA UP. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A56 | 40"x20" EA UP. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A57 | 16"x16" SA UP TO DHP-49 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A58 | 16"x16" RA UP TO DHP-49 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A59 | 20"x16" SA UP TO DHP-72 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A60 | 20"x16" RA UP TO DHP-72 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A61 | 18"x16" SA UP TO DHP-64 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A62 | 18"x16" RA UP TO DHP-64 IN MECHANICAL ROOM - CENTRAL 2101. REFER TO SHEET M4.0 FOR CONTINUATION. |
| A63 | 14"x14" SA UP TO DHP-26 IN MECH 2311. REFER TO SHEET M4.5 FOR CONTINUATION. |
| A64 | 14"x14" RA UP TO DHP-26 IN MECH 2311. REFER TO SHEET M4.5 FOR CONTINUATION. |
| A65 | 12"x12" SA UP TO DHP-26 IN MECH 2100. REFER TO SHEET M4.7 FOR CONTINUATION. |
| A66 | 12"x12" RA UP TO DHP-26 IN MECH 2100. REFER TO SHEET M4.7 FOR CONTINUATION. |
| A67 | 16"x16" SA UP TO DHP-49 IN MECH 2100. REFER TO SHEET M4.7 FOR CONTINUATION. |
| A68 | 16"x16" RA UP TO DHP-49 IN MECH 2100. REFER TO SHEET M4.7 FOR CONTINUATION. |
| A69 | 14"x14" SA UP TO DHP-26 IN MECH 2310. REFER TO SHEET M4.5 FOR CONTINUATION. |
| A70 | 14"x14" RA UP TO DHP-26 IN MECH 2310. REFER TO SHEET M4.5 FOR CONTINUATION. |

## R, G, D RUNOUT SCHEDULE

| MARK | BRANCH DUCT SIZE |
|---|---|
| E-1 | 6" DIA |
| E-1A | 6" DIA |
| E-2 | 8" DIA |
| E-2A | 10" DIA |
| E-3 | 10" DIA |
| E-4 | 12" DIA |
| E-5 | 14" DIA |
| E-7 | SEE PLANS |
| E-9 | SEE PLANS |
| E-10 | 48"x12" |
| R-1 | 6" DIA |
| R-2 | 8" DIA |
| R-3 | 10" DIA |
| R-4 | 12" DIA |
| R-5 | 14" DIA |
| R-6 | 16" DIA |
| R-7 | SEE PLANS |
| R-8 | 12"x8" |
| R-9 | SEE PLANS |
| R-10 | SEE PLANS |
| R-11 | 18"x12" |
| R-13 | SEE PLANS |
| R-14 | SEE PLANS |
| S-1 | 6" DIA |
| S-1A | 6" DIA |
| S-2 | 8" DIA |
| S-3 | 10" DIA |
| S-4 | 12" DIA |
| S-7 | SEE PLANS |
| S-8 | SEE PLANS |
| S-9 | 48"x5.25" |
| S-10 | SEE PLANS |
| S-11 | - |
| S-12 | - |
| S-13 | - |
| S-14 | SEE PLANS |
| T-1 | SEE PLANS |




KEYPLAN

N

2429 Members Way
Lexington, Ky 40504
Tel: 859.253.0892
http://www.cmtaegrs.com/

11720 Beltsville Drive
Suite 600
Calverton, MD 20705
Tel: 301.595.1000
www.grimmandparker.com

GRIMM AND PARKER

GP# 21553

AIR DISTRIBUTION - FIRST FLOOR AREA C

HOLABIRD ACADEMY PK-8
CITY OF BALTIMORE, MARYLAND

| DATE | DESCRIPTION |
|---|---|

M-1.3

03/13/2017
BID SET

© GRIMM AND PARKER, P.C. 2014