KEYED NOTES	
KEYED NOTES	KEYED NOTE TEXT

1	1" (2 PSI) GAS PIPE VALVED & CAPPED FOR THE ROOF TOP UNITS (RTU). ESTIMATED LOAD IS 800 MBH COORDINATE PIPE ROUTING & LOADS WITH THE MECHANICAL CONTRACTOR.
2	DESIGN OF FIRE SPRINKLER SYSTEM IS BY OTHERS. SHOWN FOR COORDINATION ONLY.
3	BACKFLOW PREVENTER ASSE-1015 OR ASSE-1013 AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION.

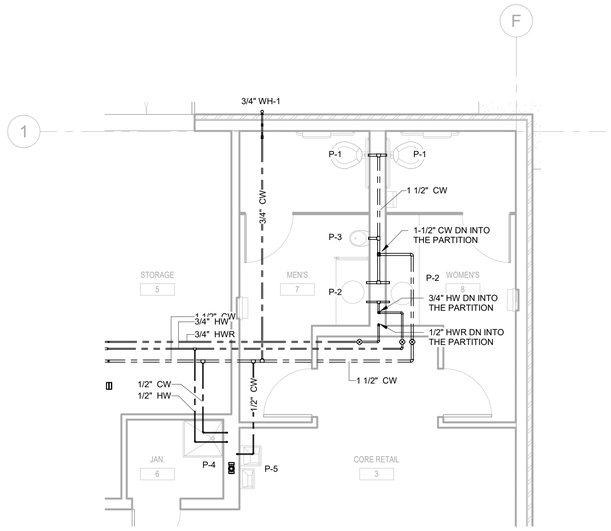

1 RESTROOM LAYOUT - WATER SUPPLY
1/4" = 1'-0"

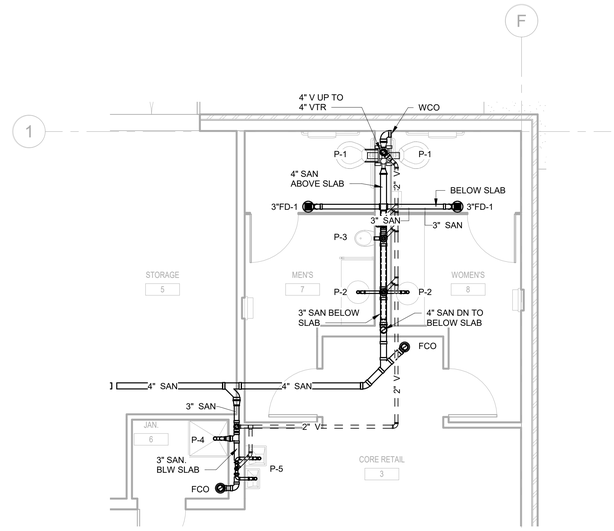

2 RESTROOM LAYOUT - SANITARY
1/4" = 1'-0"

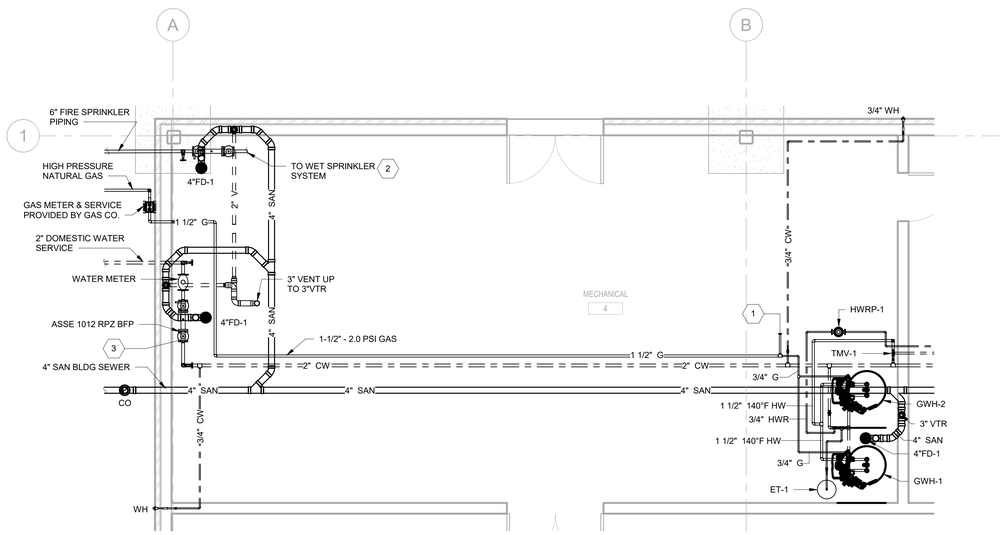

3 MECHANICAL ROOM - PLUMBING FLOOR PLAN
1/4" = 1'-0"

REVISION	DESCRIPTION	BY	DATE

GENERAL NOTES

1. REFER TO P001 FOR GENERAL NOTES, SYMBOL LEGEND AND LIST OF ABBREVIATIONS.

ARCHITECT

MEP. ENG.

NIST

FOR OFFICIAL USE ONLY

U.S. DEPARTMENT OF COMMERCE

OFFICE OF FACILITIES & PROPERTY MANAGEMENT

NIST - STAND ALONE RETAIL

PLUMBING ENLARGED PLANS

P201

APPROVED BY	DATE	SPONSOR	DATE	MAINTENANCE ENG. OFF.	DATE	ENVIRONMENTAL MANAGEMENT	DATE	SAFETY	DATE	SHED - NIST FIRE MARSHAL/AHJ	DATE	FACILITIES ENGR. OFF.	DATE	PROJECT LEADER	DATE	DRAWN BY	DATE	PROJECT/ W.O. #
														VAY		AA	08/15/2022	Project Number

SH. NO. ___ OF ___ DWG. P201