
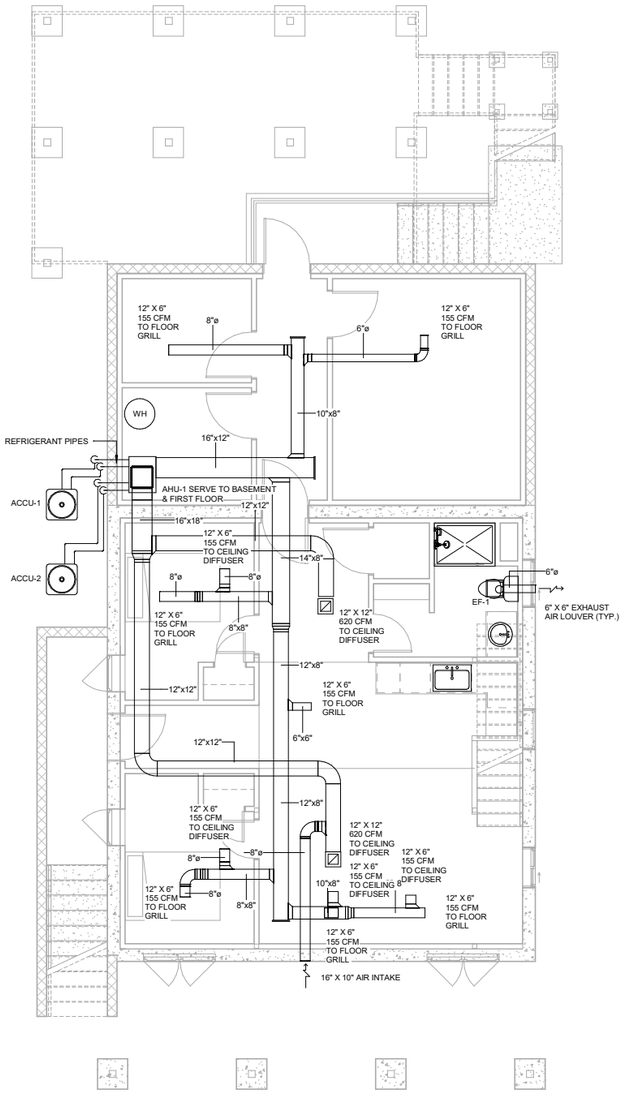



1 MECHANICAL BASEMENT PLAN
1/4" = 1'-0"

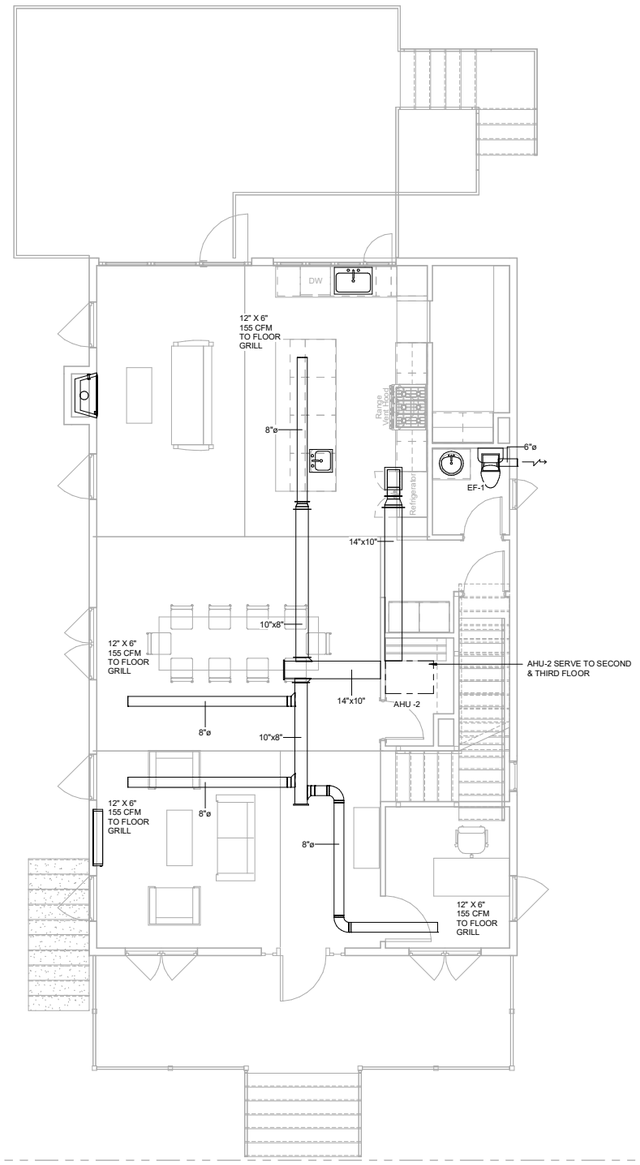


2 MECHANICAL FIRST FLOOR PLAN
1/4" = 1'-0"

ARCOS DESIGN
4500 New Hampshire Avenue NW
Washington, DC 20011
202.780.5599 | 646.678.6348


Project
**4518 9th Street NW Remodel**
4518 9th Street NW
Washington, DC 20011

Issue


| | | | |
|---|---|---|---|
| Drawn by: | KS | Project No. | A2217 |
| Checked by: | KS | Scale: | 1/4" = 1'-0" |

Sheet Name
BASEMENT AND FIRST FLOOR MECHANICAL PLAN

**M101**
Sheet Number

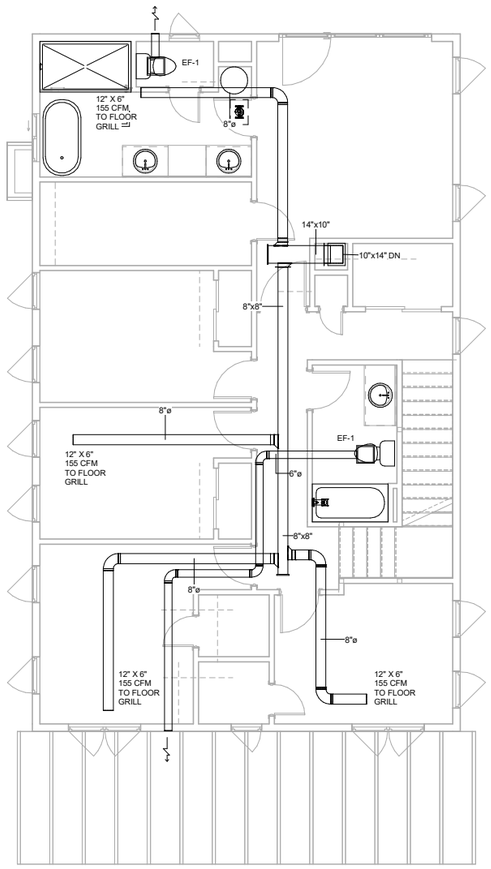


1 MECHANICAL SECOND FLOOR PLAN
1/4" = 1'-0"

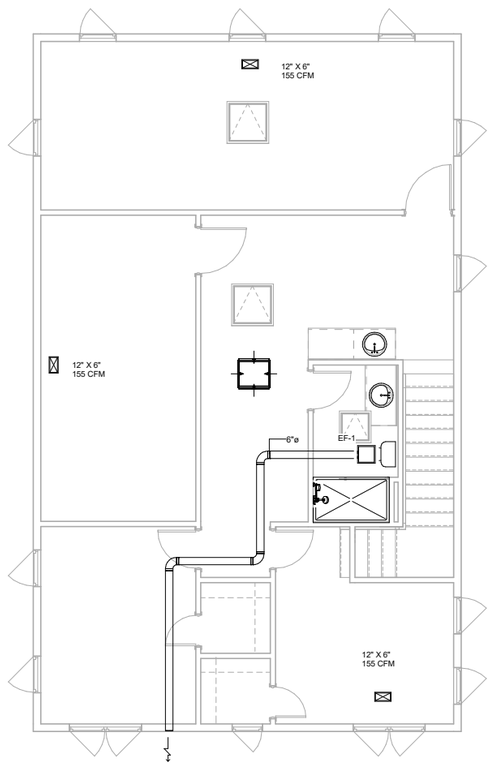


2 MECHANICAL THIRD FLOOR PLAN
1/4" = 1'-0"

ARCOS DESIGN
4500 New Hampshire Avenue NW
Washington, DC 20011
202.780.5599 | 646.678.6348

Project
**4518 9th Street NW Remodel**
4518 9th Street NW
Washington, DC 20011

Issue

| | | | |
|---|---|---|---|
| Drawn by: | KS | Project No. | A2217 |
| Checked by: | KS | Scale: | 1/4" = 1'-0" |

Sheet Name
SECOND AND THIRD FLOOR MECHANICAL PLAN

**M102**
Sheet Number

| FANS | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| MARK | QTY | LOCATION | CFM | ESP (IN W.G) | ELEC (V/Hz/Ph.) | WATTS | FAN SPEED(RPM) | INLET (dBA) | INLET SONES | WEIGHT | DIMENSION | MODEL | BASIS OF DESIGN |
| EF-1 | 5 | TOILET | 50 | 0.3 | 115/60/1 | 11 | 820 | 31 | 0.8 | 27 | 13X13X8 | SP-AP0511W | GREENHECK |
| NOTES FOR FANS | | | | | | | | | | | | | |
| 1) ALL DIRECT DRIVE FANS SHALL BE FURNISHED WITH VARI-GREEN MOTOR CONTROL. | | | | | | | | | | | | | |
| 2) FAN SPEED SHALL BE EASILY FIELD ADJUSTABLE. | | | | | | | | | | | | | |
| 3) REFER TO DETAILS, FAN SHALL BE MOUNTED W/SUPPORT FRAMING BY OTHERS. | | | | | | | | | | | | | |
| 4) PROVIDE MOTOR STARTERS, DISCONNECTS WITH NEMA-3R (IF NOT FACTORY PROVIDED). ALL EQUIPMENT NORMAL POWER WIRING BY ELECTRICAL CONTRACTOR. COORDINATE POWER REQUIREMENTS. | | | | | | | | | | | | | |

| AIR CONDITIONING UNIT WITH ELECTRIC HEAT SCHEDULE | | | | | | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| MARK | AREA SERVED | SUPPLY FAN DATA | | | | | DX COOLING SECTION | | | | HEATING COIL DATA | | | | | | | ELECTRICAL DATA | | | WEIGHT | DIMENSION | MODEL | BASIS OF DESIGN |
| | | TOTAL CFM | OUTSIDE AIR CFM | ESP (IN WC) | DRIVE TYPE | MOTOR TYPE | TOTAL COOLING CAPACITY | UNIT TYPE | LIQUID PIPE (IN) | SUCTION PIPE (IN) | HEATER MODEL | HEAT CAPACITY KW | QTY | HP (EA) | FLA (EA) | MCA | MOCP | V/PH/HZ | MCA | MOCP | | | | |
| AHU-1 | CELLAR & 1ST FLOOR | 1400 | 160 | 0.8 | DRIVE TYPE | ECM | 48 | UP FLOW | 3/8. | 7/8. | HKSX15XC | 14.4 | 1 | 3/4. | 5.7 | 7.1 | 15 | 240/1/60 | 57 | 60 | 125 | 21X21X49 | ASPT49C14 | GOODMAN |
| AHU-2 | 2ND & 3RD FLOOR | 1400 | 322 | 0.8 | DRIVE TYPE | ECM | 48 | UP FLOW | 3/8. | 7/8. | HKSX15XC | 14.4 | 1 | 3/4. | 5.7 | 7.1 | 15 | 240/1/60 | 57 | 60 | 125 | 21X21X49 | ASPT49C14 | GOODMAN |
| NOTES FOR FANS | | | | | | | | | | | | | | | | | | | | | | | |
| 1) ALL DIRECT DRIVE FANS SHALL BE FURNISHED WITH VARI-GREEN MOTOR CONTROL. | | | | | | | | | | | | | | | | | | | | | | | |
| 2) FAN SPEED SHALL BE EASILY FIELD ADJUSTABLE. | | | | | | | | | | | | | | | | | | | | | | | |
| 3) REFER TO DETAILS, FAN SHALL BE MOUNTED W/SUPPORT FRAMING BY OTHERS. | | | | | | | | | | | | | | | | | | | | | | | |
| 4) PROVIDE MOTOR STARTERS, DISCONNECTS WITH NEMA-3R (IF NOT FACTORY PROVIDED). ALL EQUIPMENT NORMAL POWER WIRING BY ELECTRICAL CONTRACTOR. COORDINATE POWER REQUIREMENTS. | | | | | | | | | | | | | | | | | | | | | | | |

| AIR COOLED CONDENSING UNIT SCHEDULE | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| MARK | CONNECTED UNIT | | | | | | | | | ELECTRICAL DATA | | | WEIGHT | DIMENSION | MODEL | BASIS OF DESIGN |
| | | NOMINAL TONS | TOTAL COOLING CAPACITY (MBH) | TOTAL HEATING CAPACITY (MBH) | COMPRESSOR TYPE | REFRIGERANT | SEER | LIQUID PIPE (IN) | SUCTION PIPE (IN) | V/PH/HZ | MCA | MOCP | | | | |
| ACCU-1 | AHU-1 | 4 | 49 | - | SCROLL | R410A | 18 | 3/8. | 1-1/8. | 208-230/1/60 | 28.3 | 45 | 276 | 36X36X40 | GSXC180481 | GOODMAN |
| ACCU-2 | AHU-2 | 4 | 49 | - | SCROLL | R410A | 18 | 3/8. | 1-1/8. | 208-230/1/60 | 28.3 | 45 | 276 | 36X36X40 | GSXC180481 | GOODMAN |
| NOTES FOR FANS | | | | | | | | | | | | | | | | |
| 1) PROVIDE DISCONNECT SWITCH FOR OUTDOOR UNIT. | | | | | | | | | | | | | | | | |
| 2) PROVIDE ROOF CURB WITH SPRING ISOLATOR TYPICAL FOR EACH UNIT | | | | | | | | | | | | | | | | |

| SCHEDULE OF GRILLES | | | | | |
|---|---|---|---|---|---|
| MARK | CFM RANGE | FACE SIZE | MODEL NO. | BASIS OF DESIGN | MAX NC dBA |
| SG-1 | 0-75 | 6X6 | 300FL | TITUS | 20 |
| | 76-130 | 8X6 | | | 23 |
| | 131-185 | 8X8 | | | 20 |
| | 186-300 | 12X6 | | | 23 |
| RG-1 | 0-95 | 6X6 | 300FS | | 23 |
| | 96-170 | 10X6 | | | 22 |
| | 171-220 | 12X6 | | | 20 |
| | 230-900 | 18X12 | | | 20 |
| NOTES | | | | | |
| 1. ALL GRILLES : CONTRACTOR SHALL COORDINATE WITH LATEST ARCHITECTURAL | | | | | |
| 2. COORDINATE COLOR/FINISH WITH ARCHITECT. | | | | | |

ARCOS DESIGN
4500 New Hampshire Avenue NW
Washington, DC 20011
202.780.5599 | 646.678.6348

Project
**4518 9th Street NW Remodel**
4518 9th Street NW
Washington, DC 20011

Issue

Drawn by: KS | Project No. A2217
Checked by: KS | Scale:

Sheet Name
MECHANICAL SCHEDULE

**M103**
Sheet Number