

MECHANICAL SERVICES DRAWING INDEX

610122.000	M01	COVER SHEET AND DRAWING LIST
610122.000	M02	GROUND LEVEL LAYOUT
610122.000	M03	LEVEL 1 LAYOUT
610122.000	M04	ROOF LAYOUT
610122.000	M05	GROUND FLOOR-PENETRATION LAYOUT
610122.000	M06	FIRST FLOOR PENETRATION PLAN
610122.000	M07	GROUND & FIRST FLOOR SECTIONS
610122.000	M08	SECTIONS AND DETAILS SHEET 1
610122.000	M09	SECTIONS AND DETAILS SHEET 2
610122.000	M10	SECTIONS AND DETAILS SHEET 3
610122.000	M11	SECTIONS AND DETAILS SHEET 4
610122.000	M12	SECTIONS AND DETAILS SHEET 5
610122.000	M14	EQUIPMENT SCHEDULES
610122.000	M13	EQUIPMENT SCHEDULES

LEGEND OF SYMBOLS

DUCTWORK LEGEND

- BARE OR EXTERNALLY INSULATED DUCTWORK - REFER SPECIFICATION FOR DETAILS
- INTERNALLY INSULATED DUCTWORK - REFER SPECIFICATION FOR DETAILS
- CIRCULAR DUCTWORK
- OVAL DUCTWORK
- DUCT ACCESS PANEL (A/P)
- FIRE RATED DUCTWORK
- SOUND ATTENUATOR
- FLEXIBLE DUCT CONNECTION
- TURNING VANES
- DUCT SET UP
- DUCT SET DOWN
- S/A DUCT RISER
- R/A DUCT RISER
- S/A DUCT DROPPER
- R/A DUCT DROPPER
- SPIRAL WOUND CIRCULAR OR OVAL DUCTWORK
- FLEXIBLE ACOUSTIC DUCTWORK
- CIRCULAR DUCT TAKEOFF
- CIRCULAR DUCT TAKEOFF WITH BUTTERFLY DAMPER (VCD)
- ROOM TEMPERATURE SENSOR/THERMOSTAT (T)
- AFTER HOURS CONTROLLER/CONTROLLER (AH)
- CARBON MONOXIDE SENSOR ON/OFF SWITCH (CO)
- ROOM HUMIDITY SENSOR (H)
- AIR FILTER - DUCT MOUNTED C/W ACCESS PANEL (AP)
- VOLUME CONTROL DAMPER (VCD)
- OPPOSED BLADE DAMPER (OBD)
- MOTORISED DAMPER (M)
- FIRE DAMPER C/W ACCESS PANEL (FD)
- CEILING ACCESS PANEL - 600 x 600 U.N.O.
- CEILING LOUVRE FACED DIFFUSER (REFER SCHEDULE)
- CEILING AIR SWIRL DIFFUSER (REFER SCHEDULE)
- CEILING SUPPLY AIR DIFFUSER 3 WAY BLOW
- 'THERMAFUSER'
- CIRCULAR CEILING SUPPLY AIR DIFFUSER
- SIDEWALL SUPPLY AIR DIFFUSER
- CEILING RETURN/EXHAUST AIR GRILLE
- GRILLE TYPE (REFER SCHEDULE)
- AIR QUANTITY L/s
- BRANCH DAMPER (PUSH/PULL TYPE)

COLOUR LEGEND

- SUPPLY AIR
- OUTSIDE AIR
- MAKE-UP AIR
- RETURN AIR
- EXHAUST AIR
- TOILET EXHAUST
- KITCHEN EXHAUST

DUCTWORK LEGEND (CONT.)

- SIDEWALL RETURN/EXHAUST AIR GRILLE
- DOOR GRILLE (A)
- CEILING MOUNTED EXHAUST FAN
- LINEAR DIFFUSER C/W PLENUM BOOT
- INLINE RETURN / EXHAUST FAN (MCSB)
- MECHANICAL SERVICES SWITCHBOARD

PIPEWORK LEGEND

- PIPE CONNECTION
- DIRECTION OF FLOW
- PIPE RISER/DROPPER
- PIPE RISE
- PIPE FALL
- TEE DROP
- FLANGED END
- CAPPED END
- REDUCER
- TEE CONNECTION
- PIPE ANCHOR
- PIPE GUIDE
- PIPE BREAK
- TUNDISH (TD)
- FLOOR WASTE (FW)
- REFRIGERANT PIPING (R)
- DRAIN (D)
- TUNDISH

ABBREVIATIONS

S/A	SUPPLY AIR
R/A	RETURN AIR
O/A	OUTSIDE AIR
E/A	EXHAUST AIR
T/E	TOILET EXHAUST
G/E	GENERAL EXHAUST
K/E	KITCHEN EXHAUST
EF	EXHAUST FAN
T/A	TO ABOVE
F/A	FROM ABOVE
T/B	TO BELOW
F/B	FROM BELOW
SD	SET DOWN
SU	SET UP
AFL	ABOVE FLOOR LEVEL
FFFL	FROM FINISHED FLOOR LEVEL
OBD	OPPOSED BLADE DAMPER
FCU	FAN COIL UNIT
UNO	UNLESS NOTED OTHERWISE
C/W	COMPLETE WITH

GENERAL NOTES

1. DRAWINGS SHALL BE READ IN CONJUNCTION WITH RELEVANT SECTIONS OF THE MECHANICAL SPECIFICATION, SERVICES DOCUMENTS AND ALL OTHER DISCIPLINE DOCUMENTS INCLUDING BUT NOT LIMITED TO ACOUSTIC, FIRE ENGINEERING, BUILDING SURVEYOR, ARCHITECTURAL, STRUCTURAL, CIVIL ETC.
2. ALL DUCTWORK DIMENSIONS ARE CLEAR INTERNAL AIRWAY ONLY.
3. ALL DIMENSIONS ARE IN MILLIMETRES.
4. ALL AIR QUANTITIES ARE IN LITRES/SECOND.
5. INSULATION OF ALL SUPPLY AND RETURN AIR DUCTS SHALL BE IN ACCORDANCE WITH NCC/BCA REQUIREMENTS AND ACOUSTIC REQUIREMENTS (REGARDLESS IF SHOWN HATCHED OR NOT). EXHAUST AIR DUCTS DO NOT NEED TO BE INSULATED UNLESS NOTED OTHERWISE.
6. DIFFUSER AND GRILLE SIZES ARE NOMINAL ONLY. FINAL SIZE SHALL BE BASED ON MANUFACTURER'S CERTIFIED TECH DATA WITH RESPECT TO NOISE, PRESSURE DROP, AIR THROW AND VELOCITY.
7. FINAL LOCATIONS OF ALL TEMPERATURE SENSORS & CONTROL PANELS SHALL BE CONFIRMED WITH THE ARCHITECT, SYSTEM MANUFACTURER, COMMISSIONING CONTRACTOR AND CONTROLS CONTRACTOR FOR THE SAFE, PROPER AND EFFICIENT OPERATION OF THE AIR CONDITIONING SYSTEM.
8. PROVIDE TRAFFOLYTE LABEL ADJACENT TO EACH TEMPERATURE SENSOR/CONTROL PANEL TO INDICATE THE NUMBER/TAG OF CORRESPONDING AIR CONDITIONING UNIT ETC.
9. ACCESS PANELS SHALL BE POSITIONED FOR THE PROPER MAINTENANCE OF SERVICES. FINAL DIMENSION AND LOCATION OF ALL ACCESS PANELS SHALL BE CO-ORDINATED WITH THE ARCHITECTURAL RCP BASED ON COMBINED SERVICES SHOP DRAWINGS. ACCESS PANELS SHALL BE SHOWN ON THE SHOP DRAWINGS, SUBMITTED FOR REVIEW.
10. FULL EXTENT OF EXPOSED REFRIGERANT PIPEWORK ON THE ROOF LEVEL SHALL BE PROTECTED WITH REMOVABLE COLORBOND METAL COVERS.
11. PIPEWORK ROUTES ARE SHOWN FOR INFORMATION PURPOSES ONLY AND SHALL NOT BE USED FOR PRICING. FINALISE AND CO-ORDINATE PIPEWORK ROUTES BASED ON CO-ORDINATED SHOP DRAWINGS AND ON-SITE CO-ORDINATION.
12. ALL FACADE INTAKE AND DISCHARGE LOUVRES SHALL BE INSTALLED WITH VERMIN PROOF MESH.
13. ALLOW TO THOROUGHLY CO-ORDINATE ALL WORK WITH OTHER TRADES AND CONTRACTORS PRIOR TO INSTALLATION.
14. ALL BLANKED/TERMINATED SERVICES SHALL BE LABELLED AS "FOR FUTURE USE".
15. DUCTWORK & PIPEWORK CROSSING ANY EXPANSION OR MOVEMENT JOINTS SHALL BE INSTALLED WITH SUITABLE FLEXIBLE CONNECTIONS.
16. SERVICES CROSSING ANY FIRE AND/OR SMOKE RATED BARRIER SHALL BE PROTECTED WITH APPROPRIATE AND APPROVED FIRE AND SMOKE SEALS.
17. ALL DUCTWORK (NOT PART OF SMOKE HAZARD MANAGEMENT SYSTEMS) CROSSING ANY FIRE AND/OR SMOKE RATED BARRIER SHALL BE INSTALLED WITH APPROVED FIRE AND/OR SMOKE DAMPERS.
18. ALL VERTICAL KITCHEN EXHAUST RISER(S) SHALL BE INSTALLED WITH A DRAIN PLUG AT THE BOTTOM OF RISER(S).
19. WHERE THERE IS ANY DISCREPANCY BETWEEN DRAWINGS AND SPECIFICATION, THE LARGER OR GREATER VALUE/CAPACITY SHALL BE CONSIDERED FOR PRICING DURING TENDERING. DURING CONSTRUCTION, WRITTEN CLARIFICATION SHALL BE OBTAINED FROM THE CONSULTANT PRIOR TO CARRYING OUT ANY WORK ON SITE.
20. REFER TO DATE AND REVISION OF ARCHITECTURAL BACKGROUND USED IN THE PREPARATION OF THESE DRAWINGS. ANY DISCREPANCY BETWEEN MECHANICAL DRAWINGS AND TENDER ARCHITECTURAL BACKGROUNDS SHALL BE RAISED WITH THE SUPERINTENDENT FOR CLARIFICATION.
21. CONNECT ALL CONDENSATE DRAINS TO NEAREST TUNDISH PROVIDED BY HYDRAULIC CONTRACTOR. PROVIDE CONDENSATE PUMP (IF REQUIRED) & ASSOCIATED ACCESSORIES.

FLEXIBLE DUCT SCHEDULE

AIR QUANTITY (l/s)	DIAMETER (mm)
0 TO 50	150
51 TO 100	200
101 TO 200	250
201 TO 250	300
251 TO 350	350
351 TO 450	400

DOOR GRILLE SCHEDULE

AIR QUANTITY (l/s)	SIZE (mm)	DESIGNATION
UP TO 100	600x150	A
101 TO 200	600x300	B
201 TO 350	600x450	C
351 TO 500	600x600	D
25mm UNDERCUT DOOR BY PARTITION CONTRACTOR		IC

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 (0 1 2 3 4 5)

1:50 @ A1 (0 0.5 1 1.5 2 2.5)

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.

Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - COVER SHEET AND DRAWING LIST

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M01	T3

A1

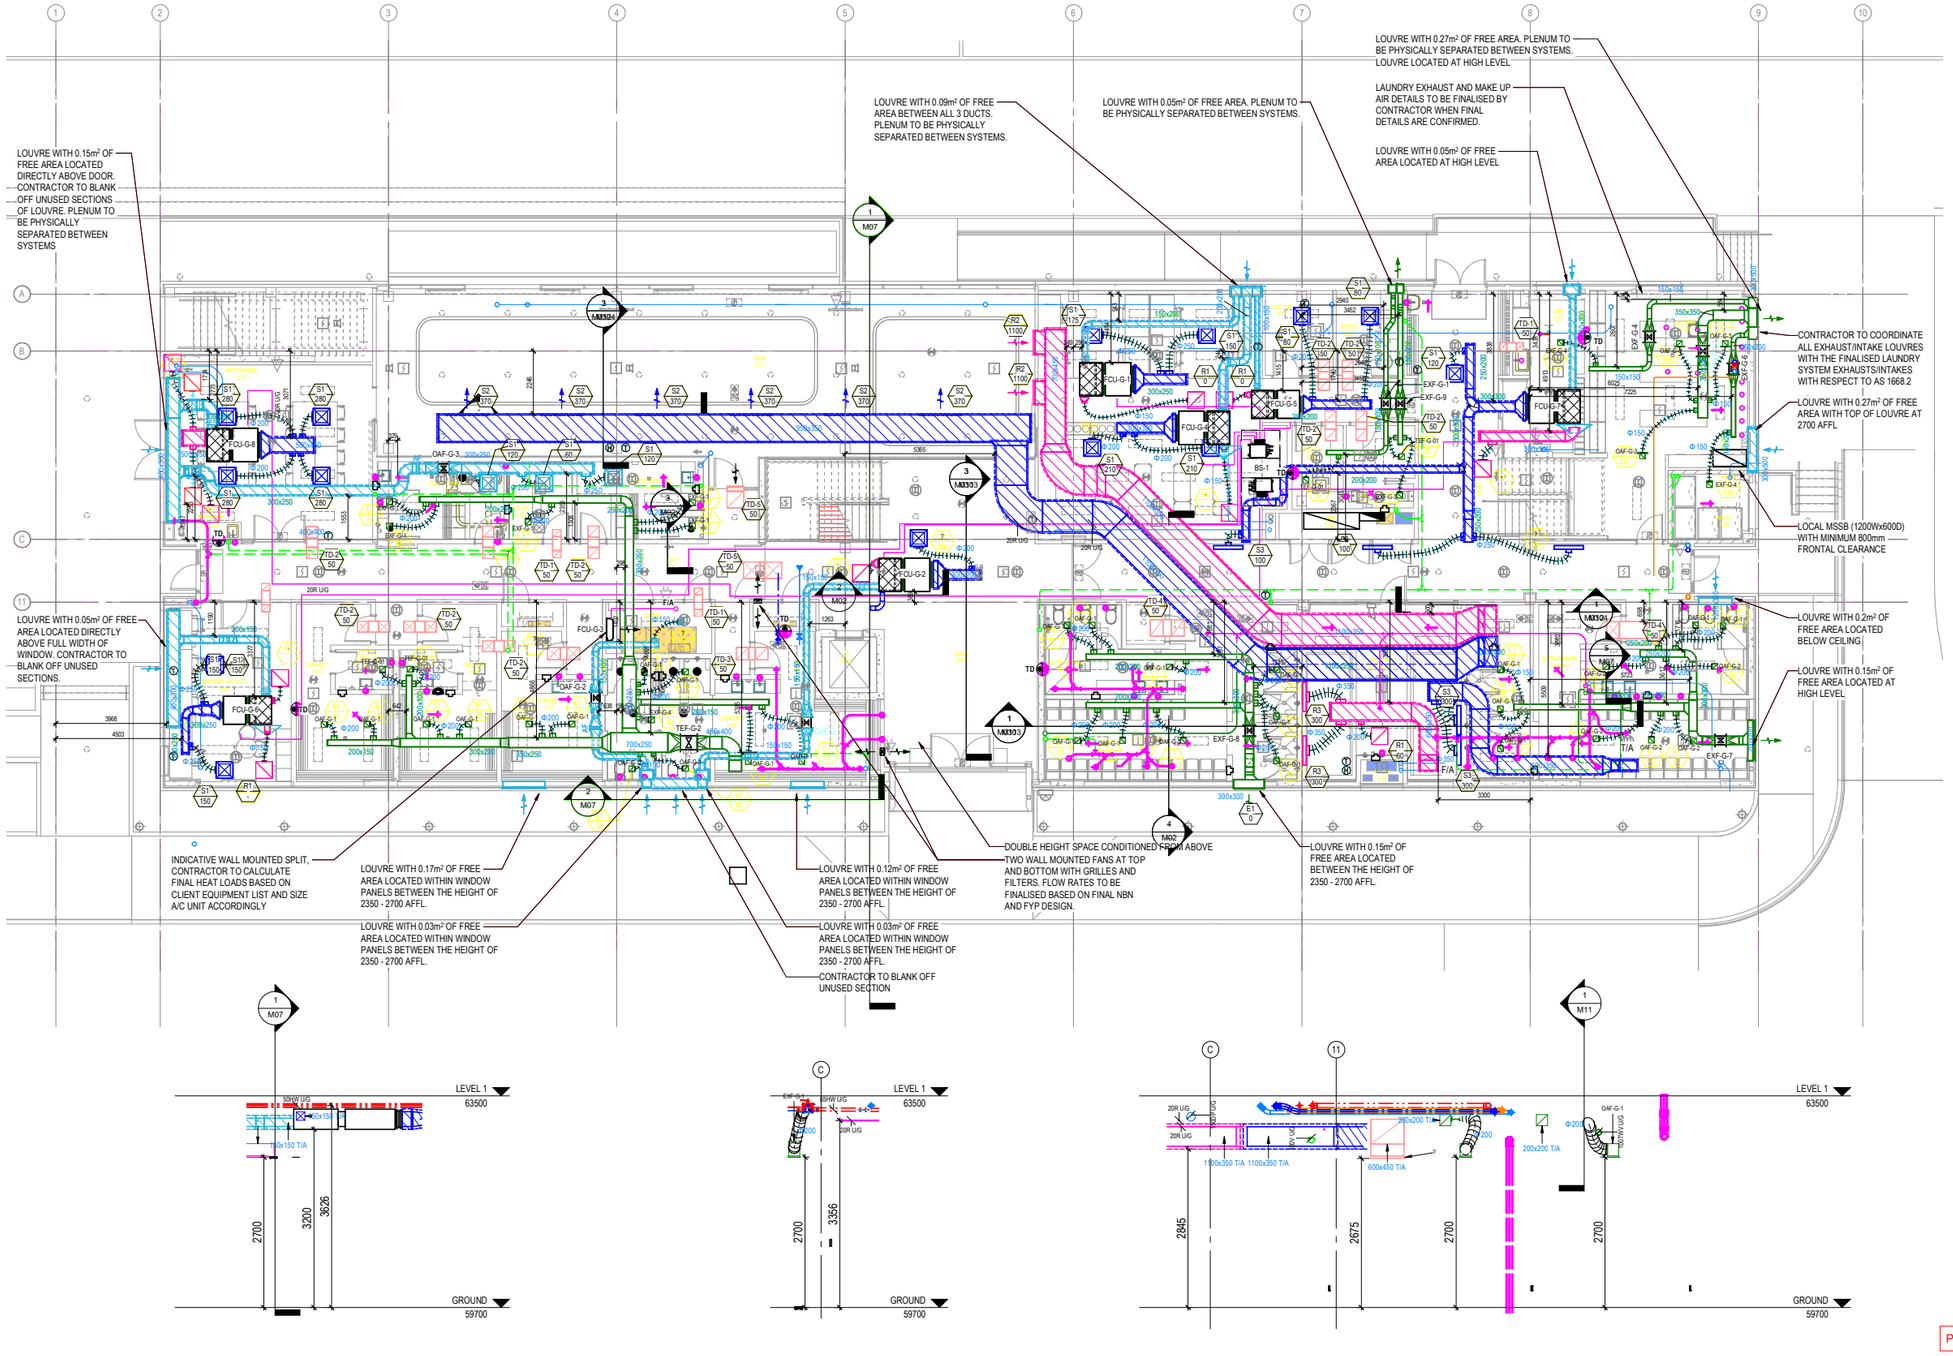

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - GROUND LEVEL LAYOUT

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M02	T3

A1

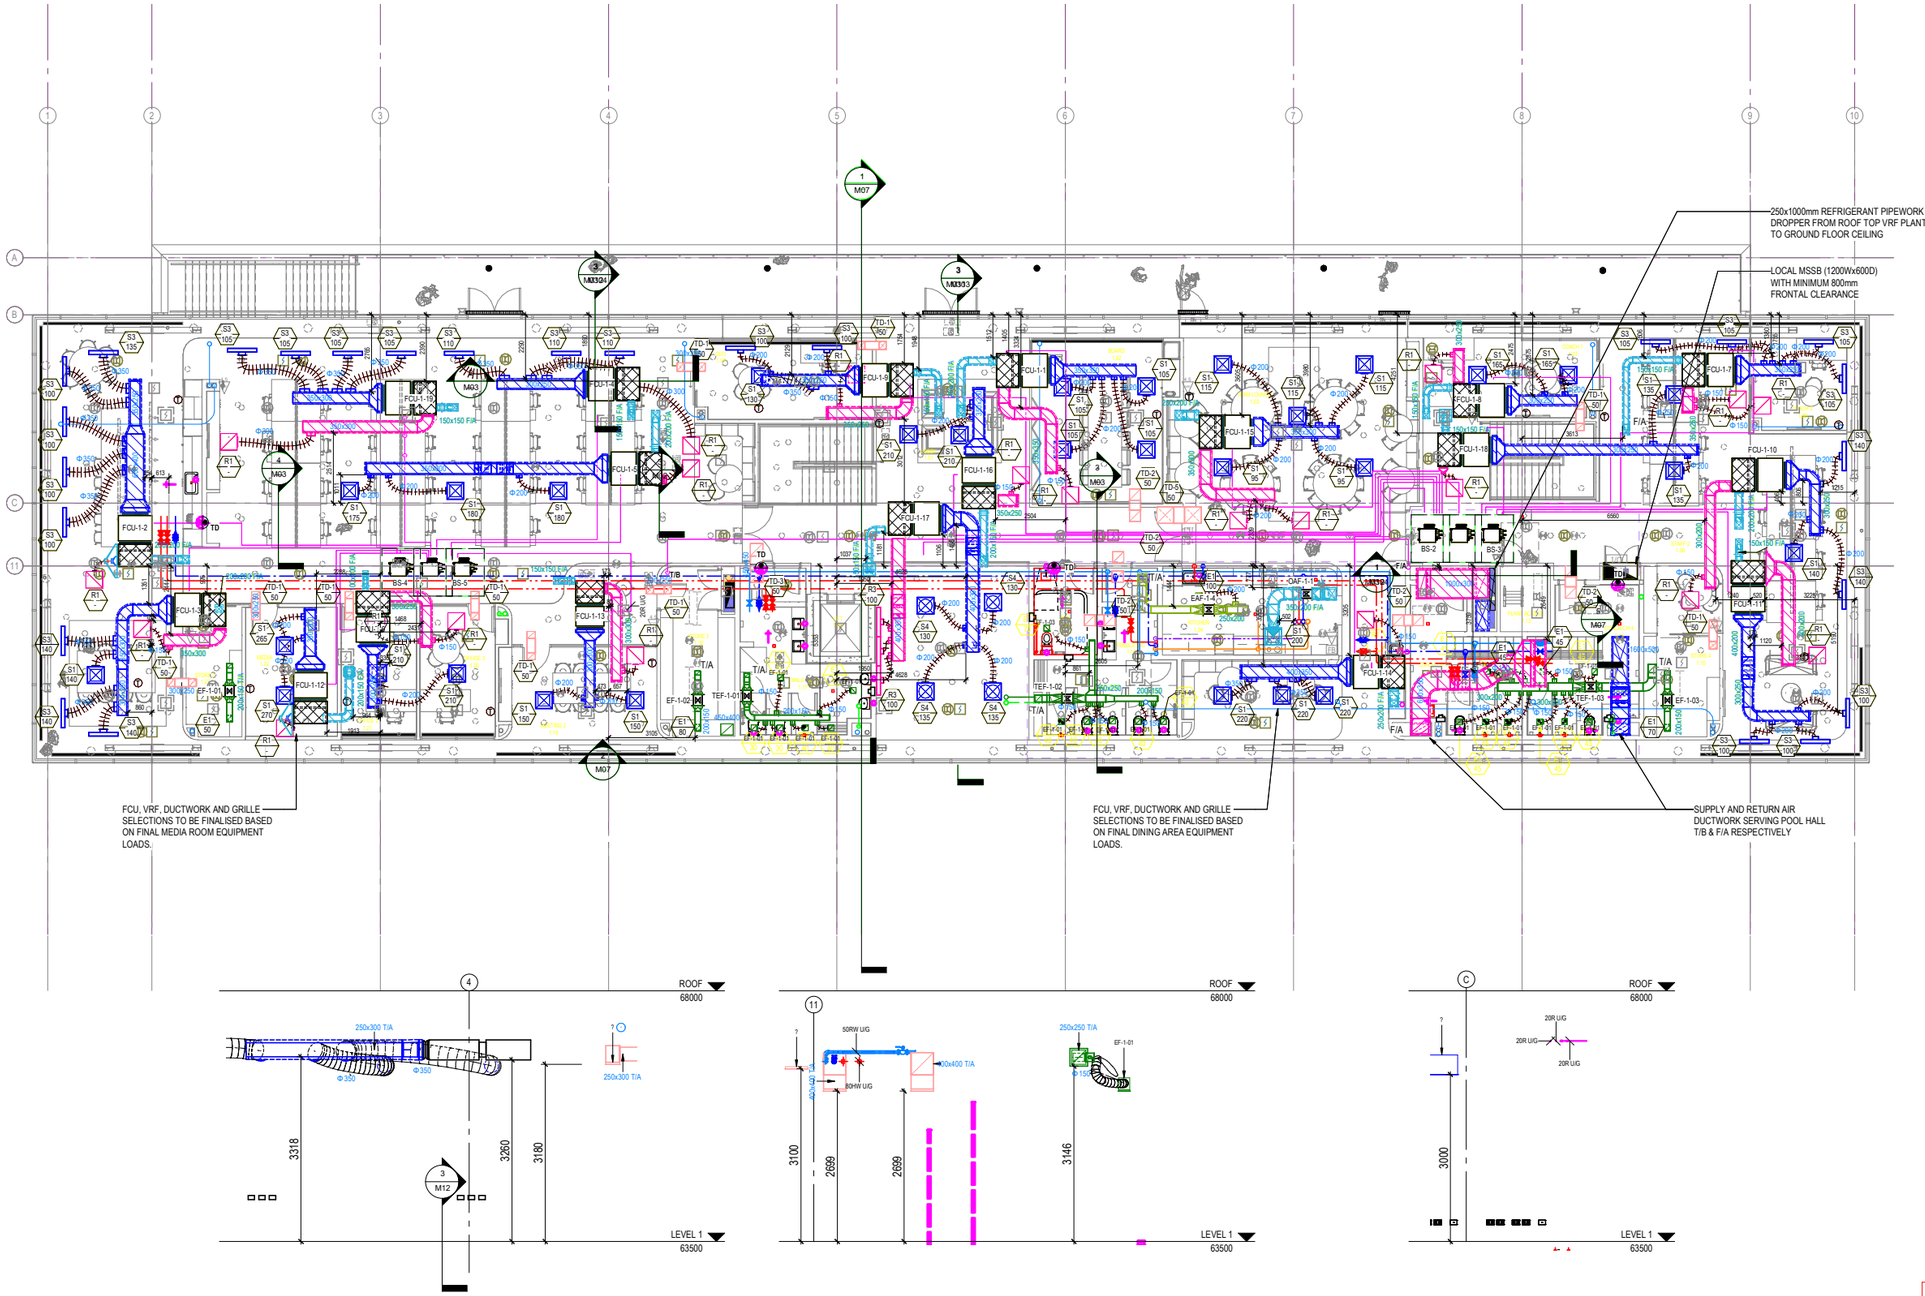

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - LEVEL 1 LAYOUT

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M03	T3

A1

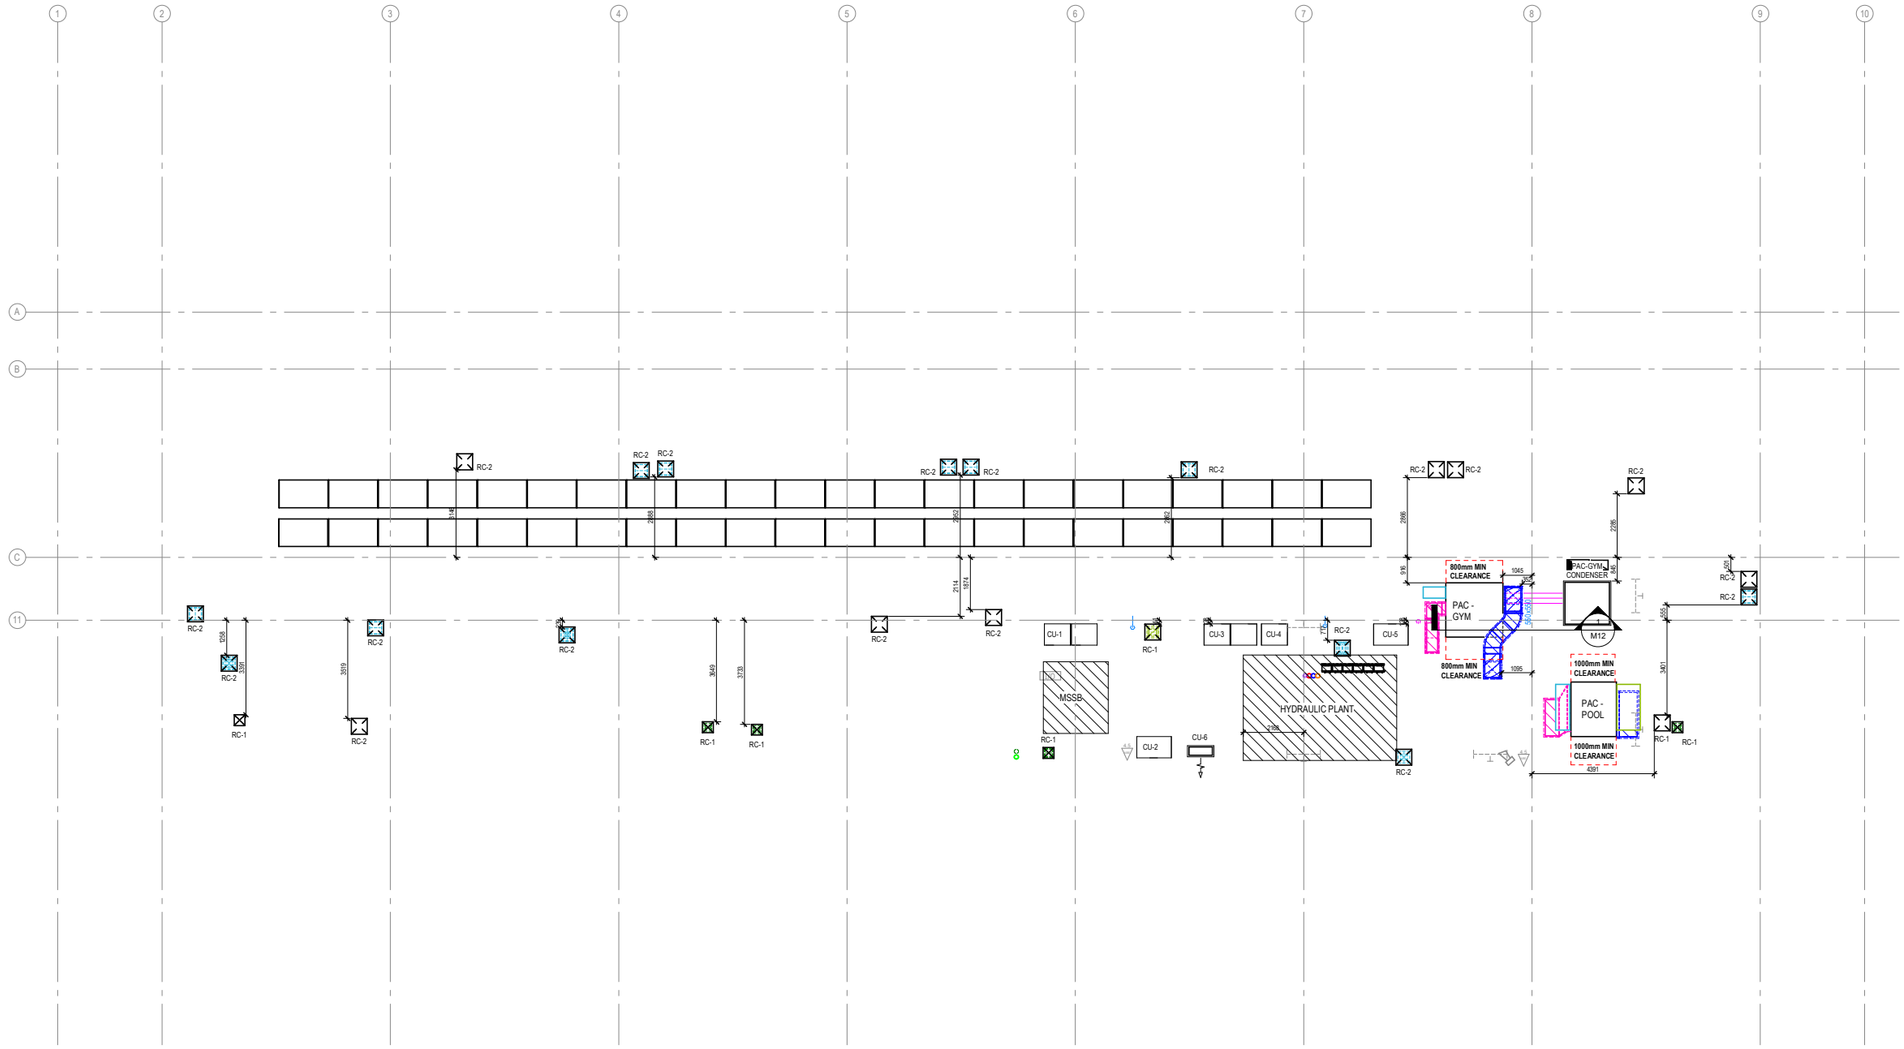

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct


UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 164 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advanceddaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - ROOF LAYOUT

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M04	T3

A1

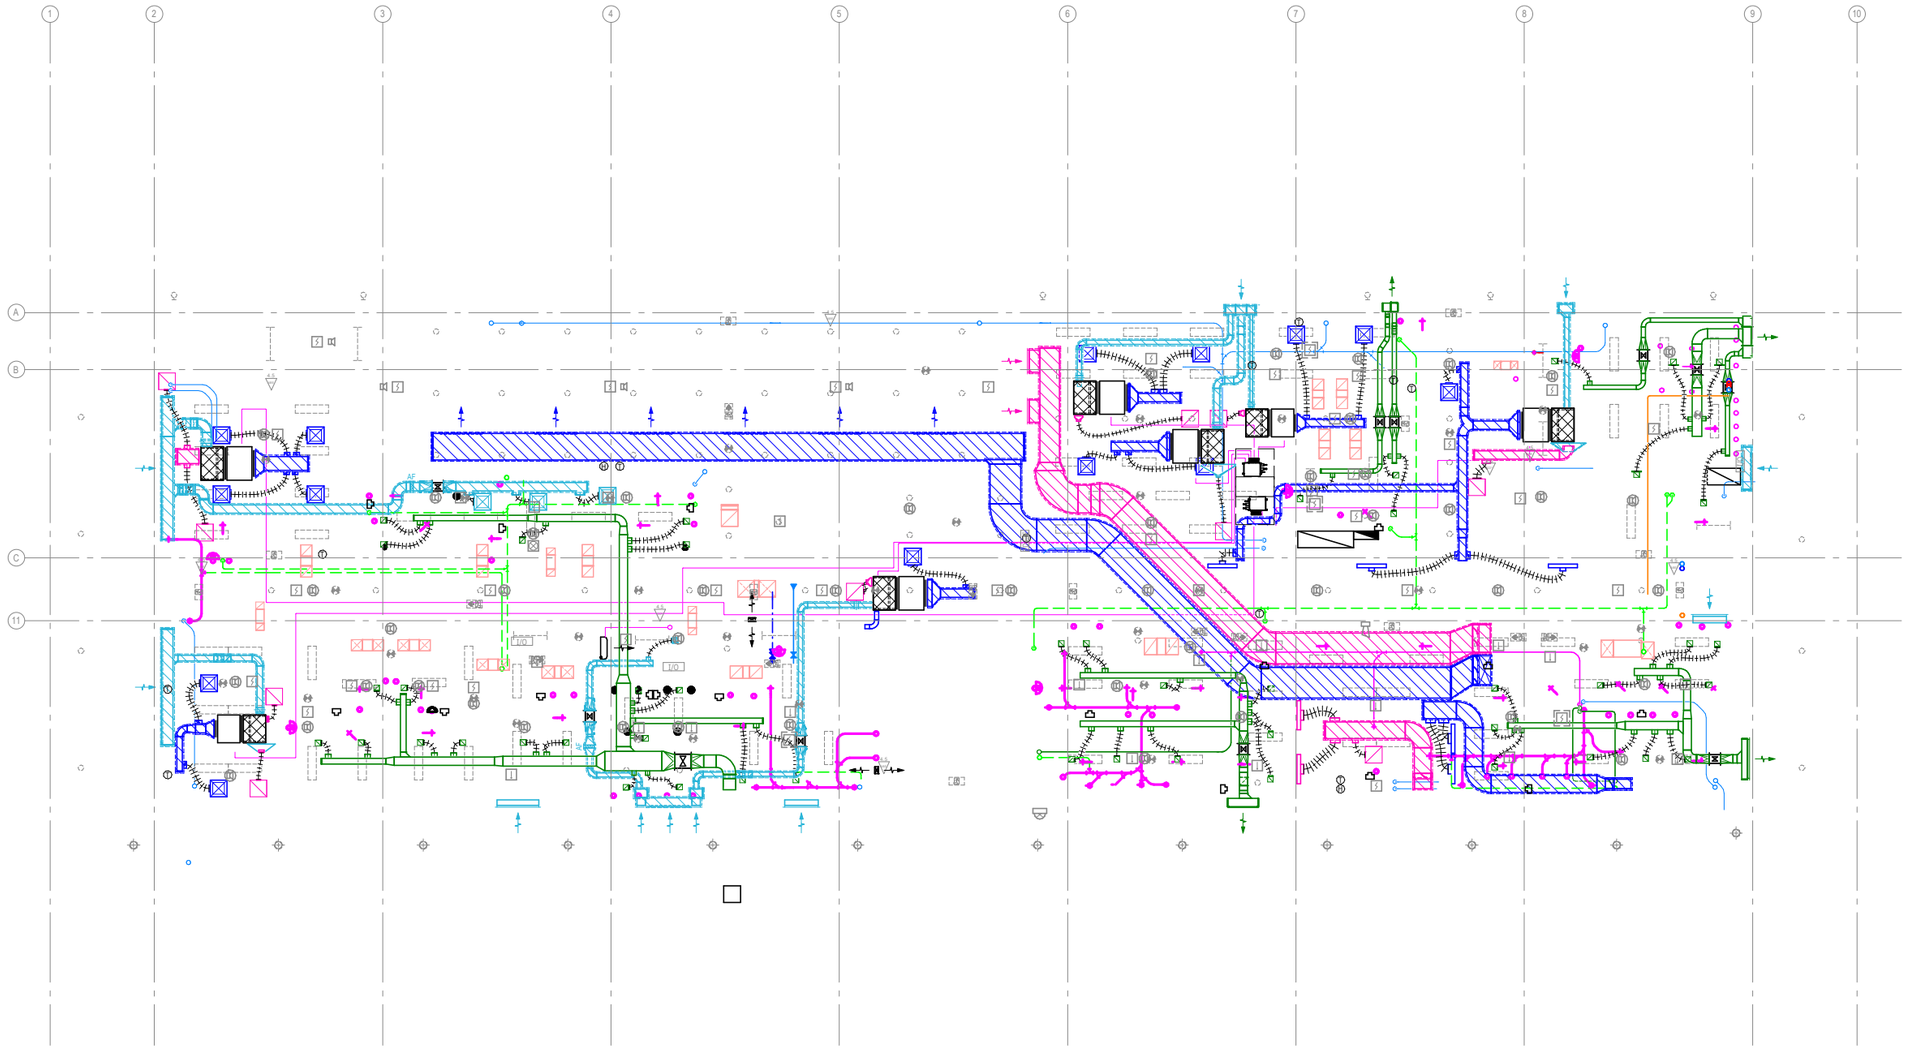

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct


UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 452
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES -
GROUND FLOOR-PENETRATION LAYOUT

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
1 : 100		610122.000	M05	

A1

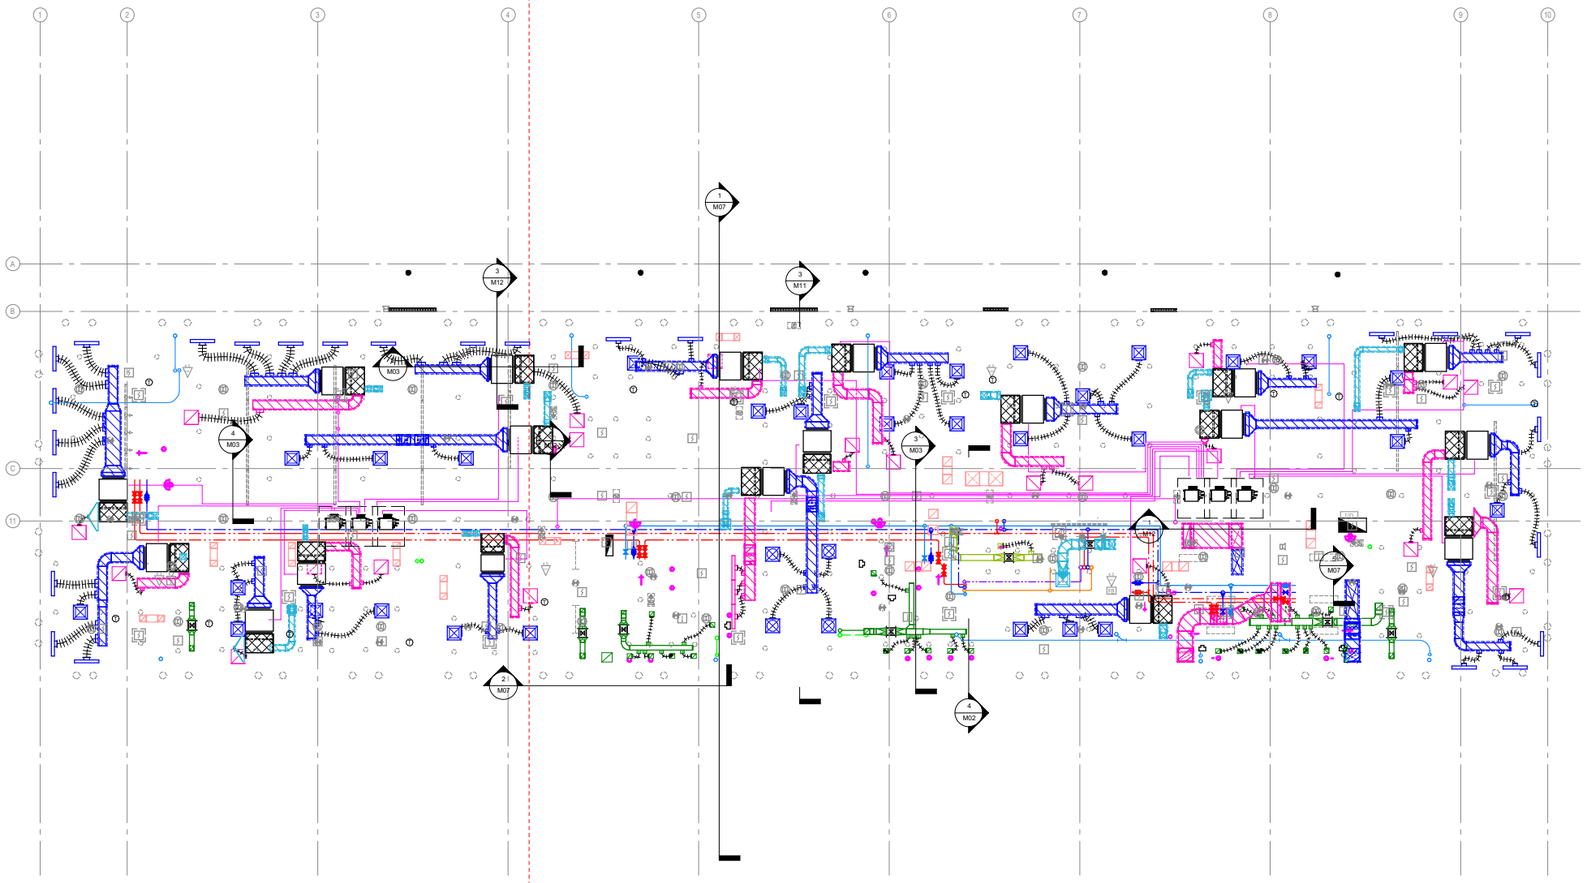

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 872
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES -
FIRST FLOOR PENETRATION PLAN

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M06	

A1

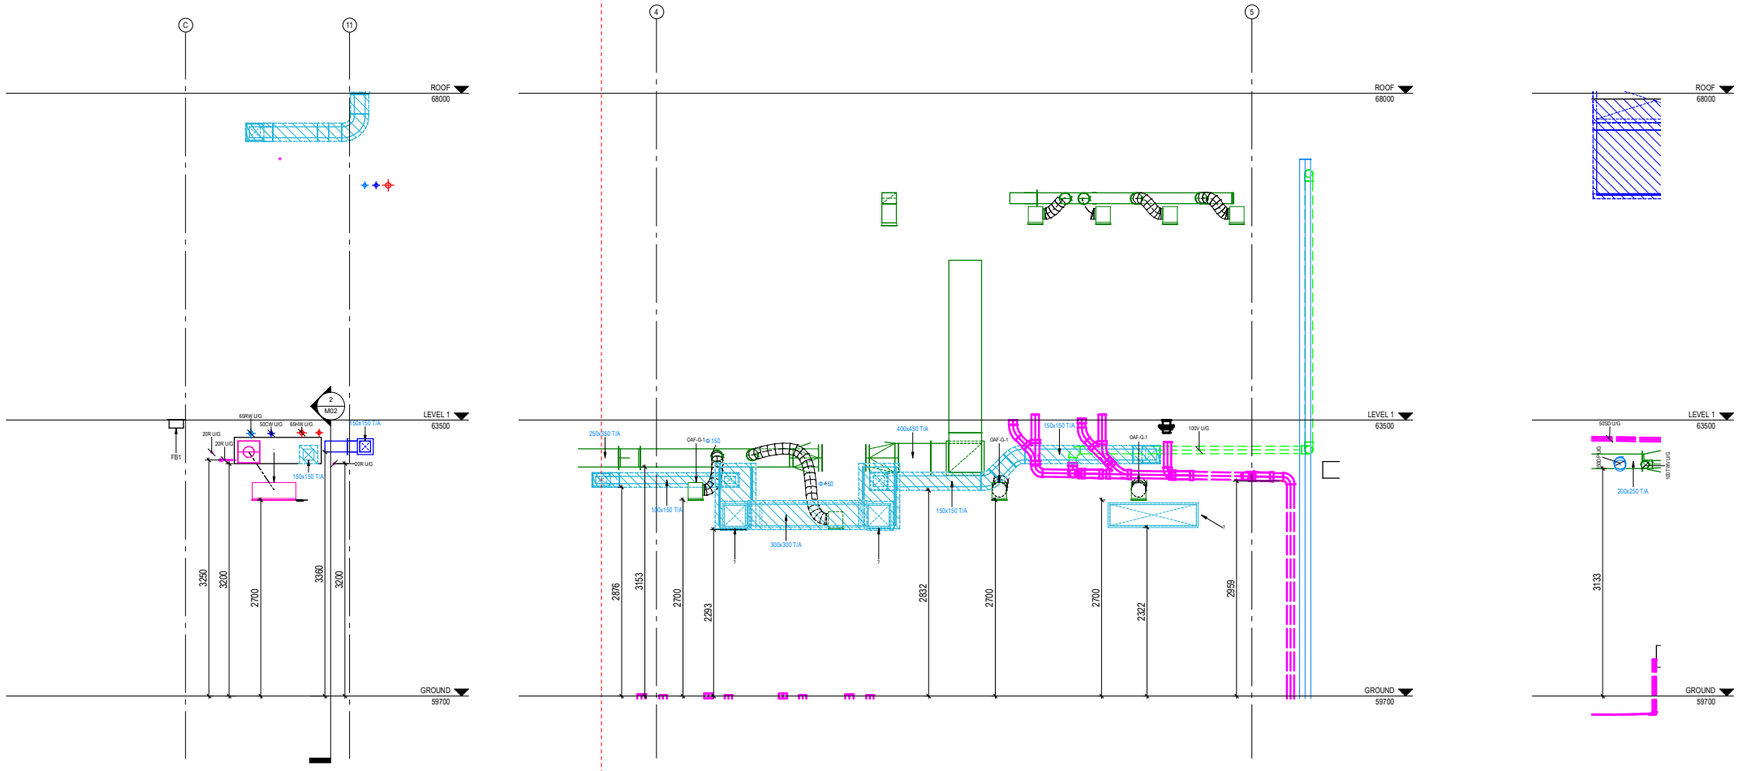

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 837 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1: 0 1 2 3 4 5

1:50 @ A1: 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions. To be read in conjunction with all other Consultant's drawings. Advanced Air to be immediately notified of any discrepancies. Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct


UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 44 104 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW


DRAWING TITLE
MECHANICAL SERVICES -
GROUND & FIRST FLOOR SECTIONS

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M07	


A1

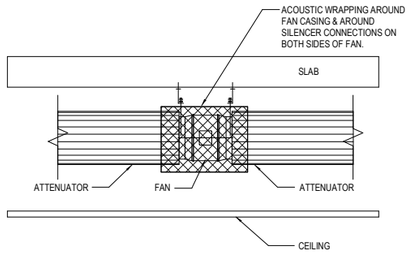


DUCT MOUNTED IN-LINE FAN WITH ACOUSTIC WRAPPING & ATTENUATORS

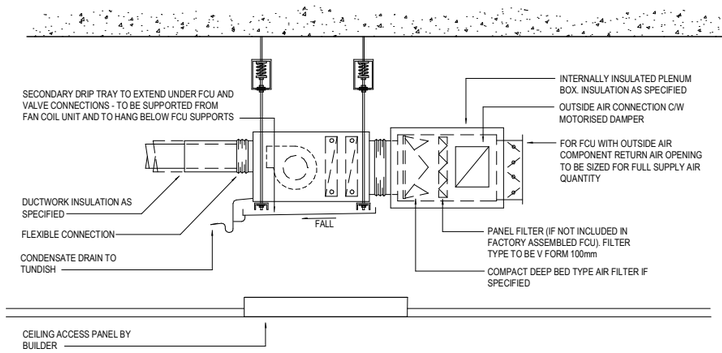


FAN COIL UNIT

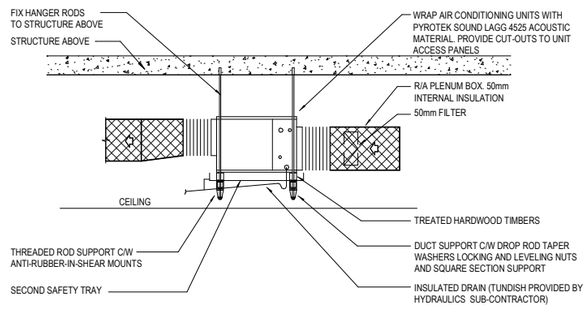


ACOUSTICALLY TREATED DUCTWORK & UNIT SUPPORT

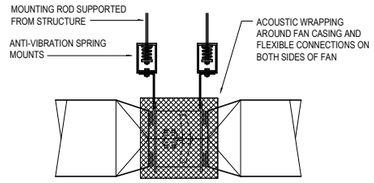


AXIAL FAN MOUNTING WITH ACOUSTIC WRAPPING

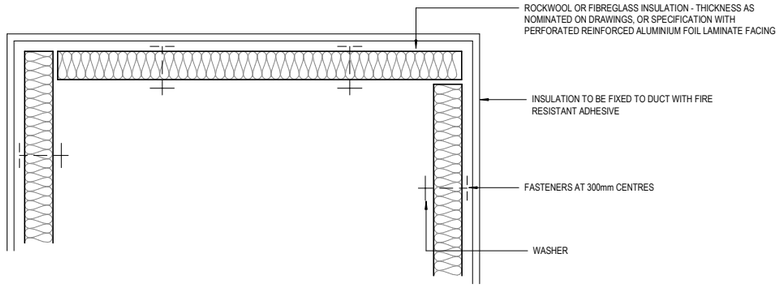


ACOUSTIC INSULATION DETAILS

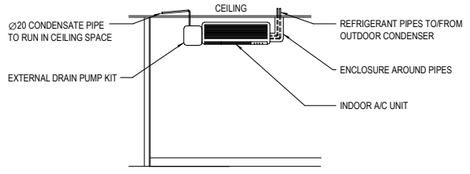


WALL MOUNTED INDOOR A/C UNIT

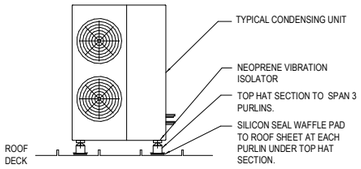


TYPICAL CONDENSING UNIT ROOF MOUNTING DETAIL




TYPICAL PLENUM DETAIL




CIRCULAR DUCT SUPPORT

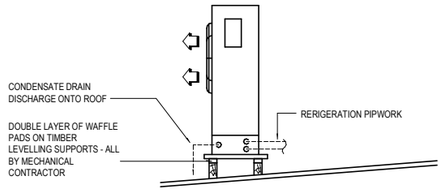


ROOF MOUNTED CONDENSING UNIT

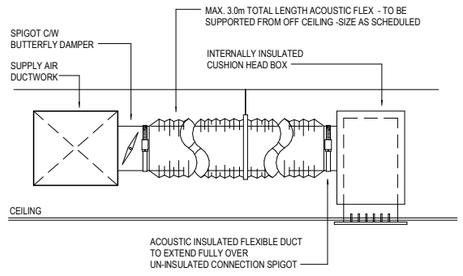


LOW PRESSURE CONNECTION TO SUPPLY DIFFUSER

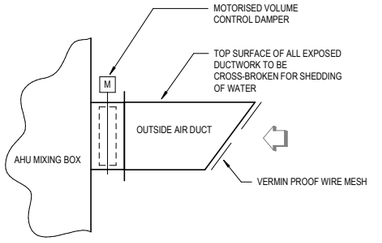


AIR HANDLING UNIT OUTSIDE AIR CONNECTION DETAIL

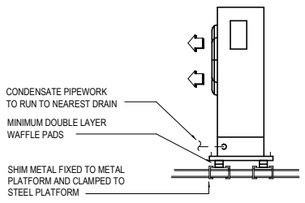



CONDENSING UNIT - STEEL PLATFORM






DUCT HANGER DETAIL

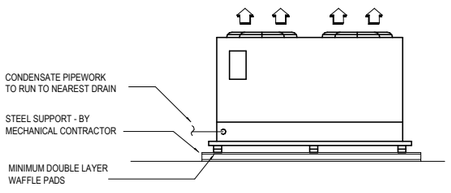

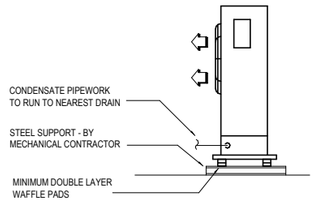

CONDENSING UNIT - STEEL SUPPORT

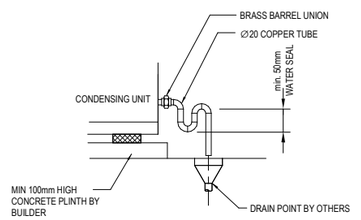

CONDENSATE WASTE DETAIL

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advanceairconcon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW


DRAWING TITLE
MECHANICAL SERVICES - SECTIONS AND DETAILS SHEET 1

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M08	T3


A1

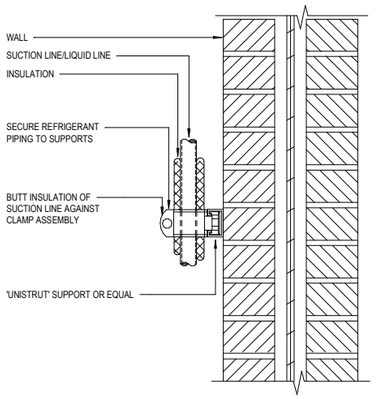


REFRIGERANT PIPE SUPPORT AT WALL

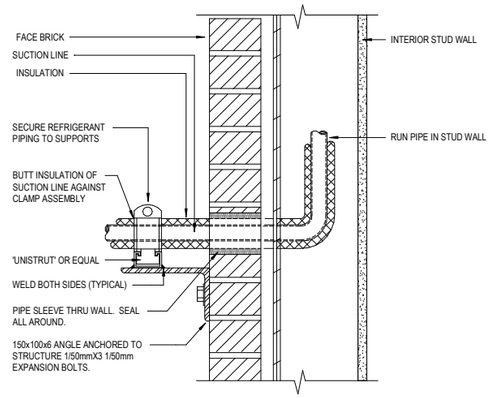


REFRIGERANT PIPE SUPPORT AT WALL




SUPPORT FOR MINOR SERVICES WHERE NO CEILING SHEETING

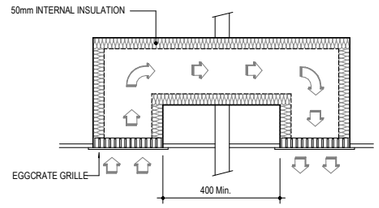


TRANSFER DUCT T2

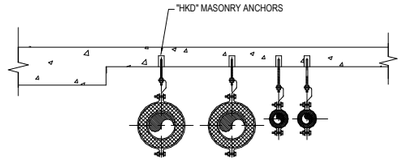


TYPICAL PIPEWORK SUPPORT DETAIL AT CONCRETE SOFFITS

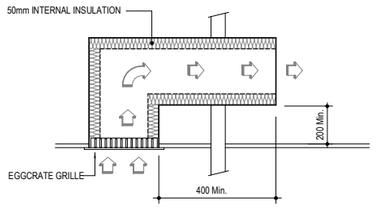


TRANSFER DUCT T4




GROUPED REFRIGERANT PIPES DETAILS

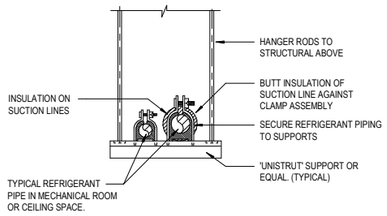


SUSPENDED REFRIGERANT PIPE SUPPORT ABOVE CEILING

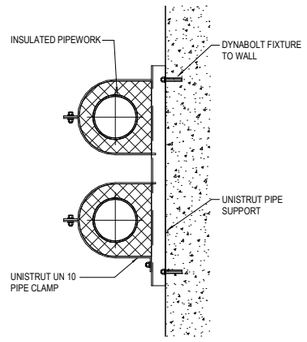


TYPICAL INSULATED PIPEWORK SUPPORT

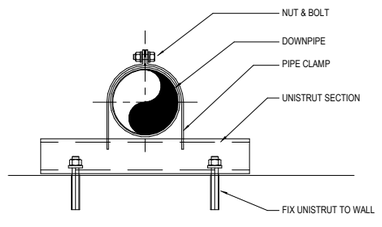


TYPICAL VERTICAL PIPEWORK FIXING

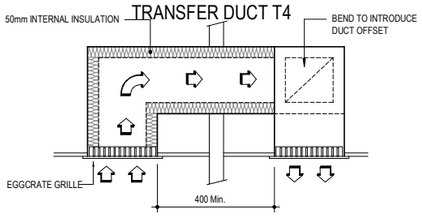


TRANSFER DUCT T5

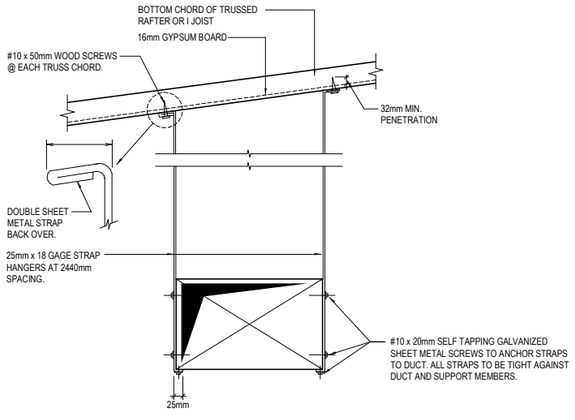


DUCT STRAP HANGER DETAIL

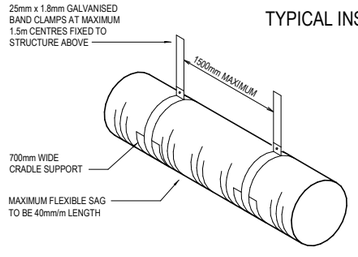


FLEXIBLE DUCT SUPPORT

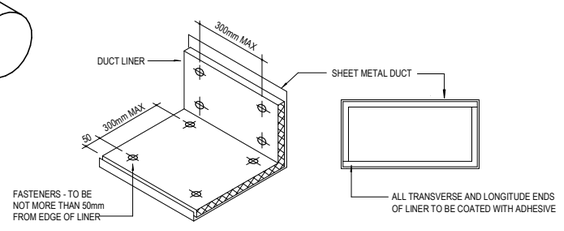

DUCT LINER DETAIL

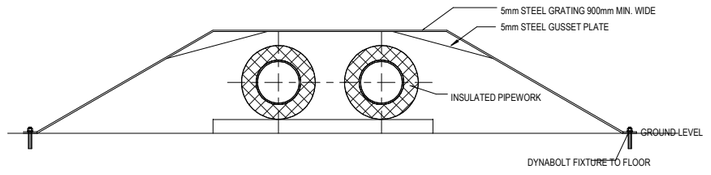

TYPICAL WALK - OVER FOR INSULATED PIPEWORK

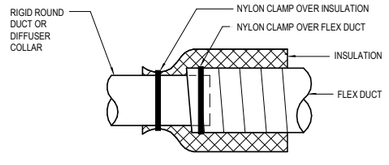

FLEXIBLE DUCT CONNECTING DETAIL

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5


Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 164 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au


PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES -
SECTIONS AND DETAILS SHEET 2


SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M09	T3

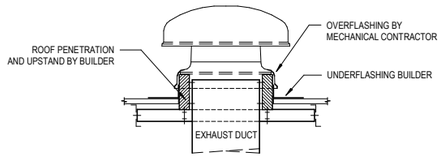


ROOF COWL DETAIL 1

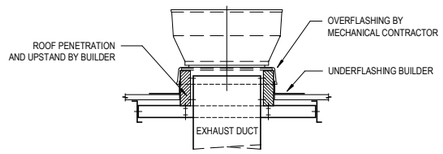


ROOF COWL DETAIL 2

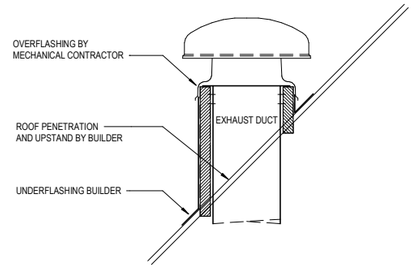


ROOF COWL ON PITCHED ROOF

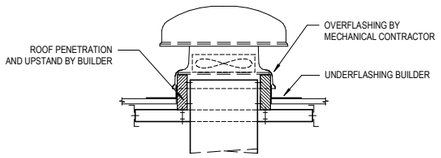


ROOF FAN DETAIL 1

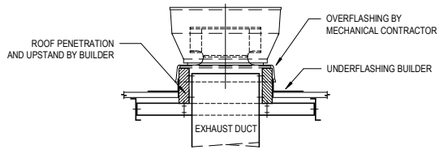

ROOF FAN DETAIL 2

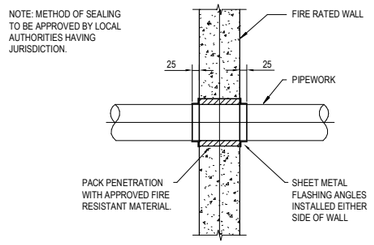

TYPICAL FIRE RATED WALL PIPE PENETRATION DETAIL
(NON-INSULATED)



A/C PUSH BUTTON DETAIL(PB)

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 0 1 2 3 4 5

1:50 @ A1 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon
design& construct Pty. Ltd.

advanced aircon design&construct


UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW


DRAWING TITLE
MECHANICAL SERVICES -
SECTIONS AND DETAILS SHEET 3

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M10	T3

A1

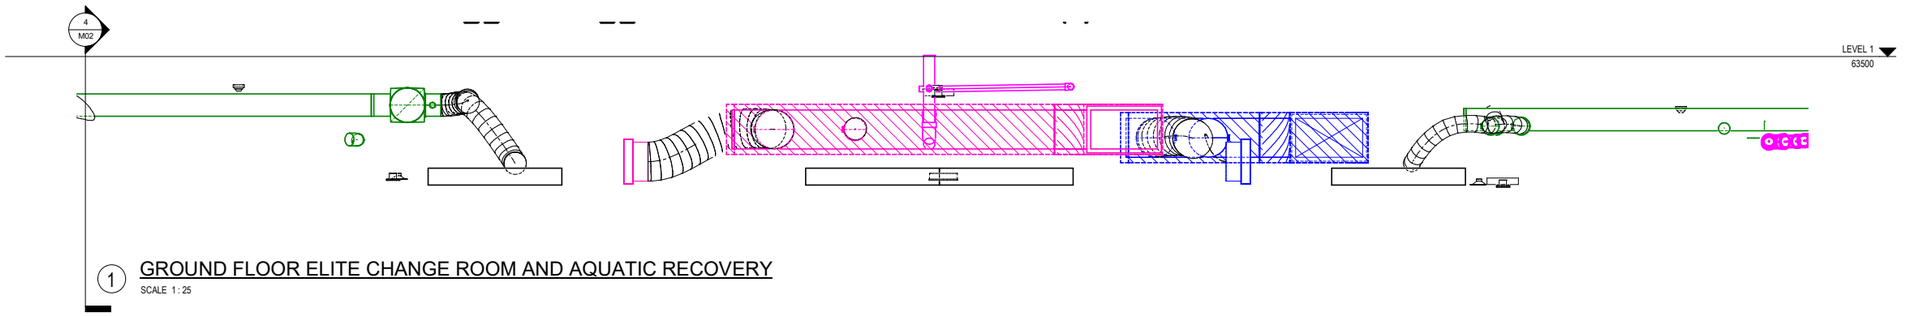

1 GROUND FLOOR ELITE CHANGE ROOM AND AQUATIC RECOVERY
SCALE 1 : 25

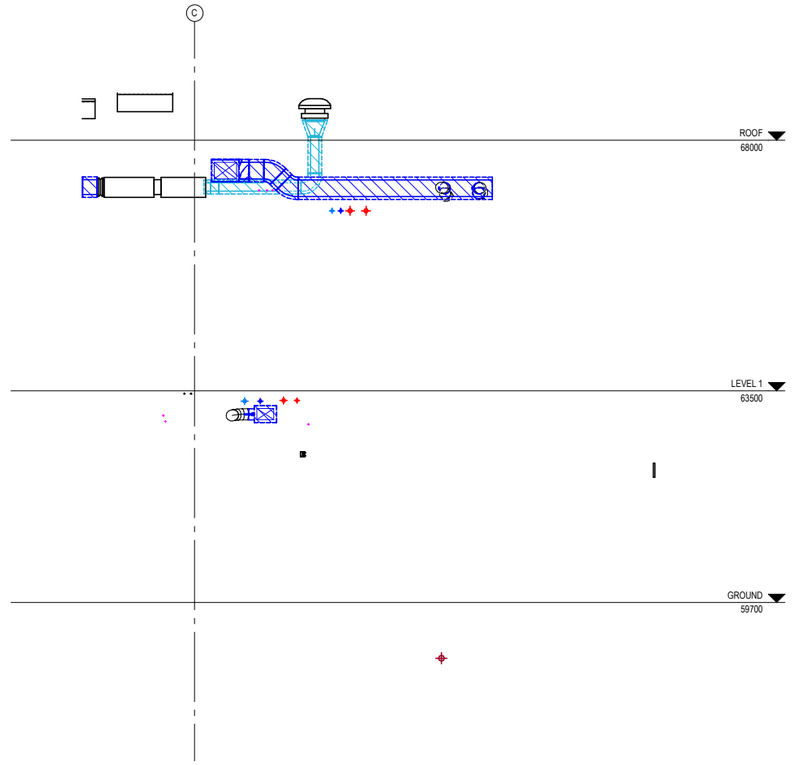

3 LOBBY MECHANICAL SECTION
SCALE 1 : 50

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 0 1 2 3 4 5

1:50 @ A1 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.


advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES -
SECTIONS AND DETAILS SHEET 4


SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M11	T3

A1

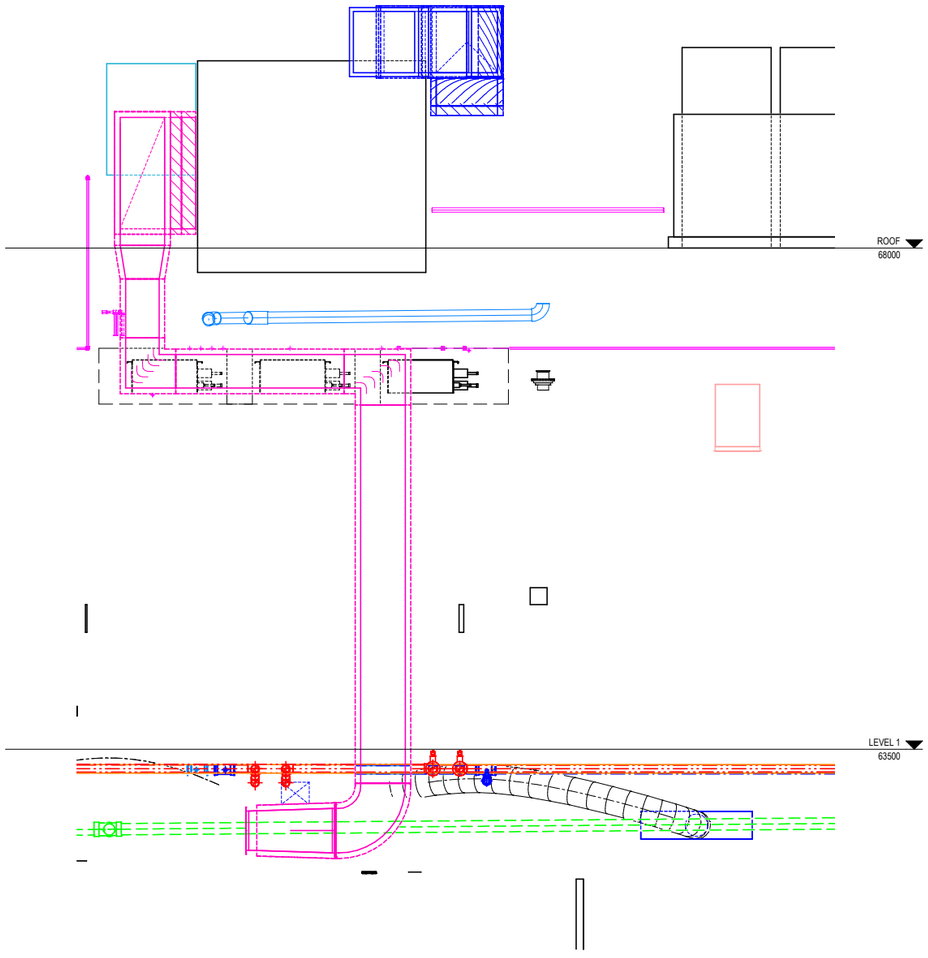

1 PLANTROOM - GYM PAC

SCALE 1 : 25

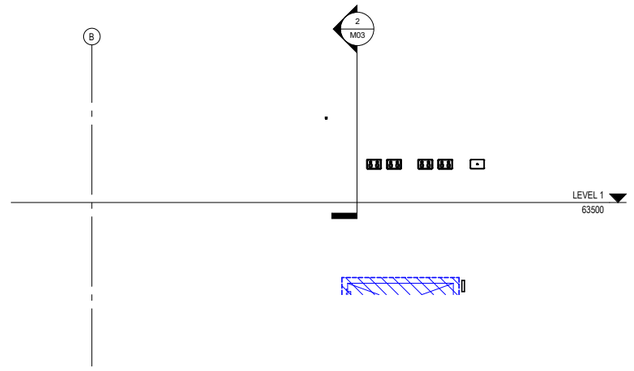

3 GYM SUPPLY AIR ARRANGEMENT

SCALE 1 : 25

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 0 1 2 3 4 5

1:50 @ A1 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct

UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS
FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES -
SECTIONS AND DETAILS SHEET 5

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M12	T3

A1

FCU SCHEDULE

ITEM NO.	TYPE	SERVING	COOLING					HEATING	OUTSIDE AIR FLOW (L/s)	FILTERS	SOUND	POWER (V/Ø/Hz)	SELECTION OR APPROVED EQUIVALENT	POWER SOURCE	OUTDOOR UNIT
			TOTAL LOAD (kW)	SENSIBLE LOAD (kW)	AIR ON COIL DB/WB (°C)	AIR ON COIL DB (°C)	AIR ON COIL WB (°C)	CAPACITY (kW)							
FCU-1-1	VRF DUCT MOUNTED	BOARD	6.8	4.9	26.2/19.4	26.2	19.4	3.3	100	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-2
FCU-1-10	VRF DUCT MOUNTED	STAFF 2	7.1	4.9	28.5/20.5	28.5	20.5	4.0	120	G4	39-44	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-2
FCU-1-11	VRF DUCT MOUNTED	MEETING 4	4.5	3.8	25.3/18.6	25.3	18.6	2.4	40	G4	37-41	220V 1ph	FXMQ50PAVE	MSSB-L1	CU-3
FCU-1-12	VRF DUCT MOUNTED	MEDIA	8.2	6.7	25.5/18.8	25.5	18.8	2.5	80	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-5
FCU-1-13	VRF DUCT MOUNTED	MEETING 2	4.5	3.5	25.8/19	25.8	19	2.0	50	G4	37-41	220V 1ph	FXMQ50PAVE	MSSB-L1	CU-5
FCU-1-14	VRF DUCT MOUNTED	DINING	11.1	8.3	26.5/19.4	26.5	19.4	5.8	150	G4	43-46	220V 1ph	FXMQ125PAVE	MSSB-L1	CU-3
FCU-1-15	VRF DUCT MOUNTED	TEAM LOUNGE	9.6	6.7	26.6/19.6	26.6	19.6	5.2	150	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-3
FCU-1-16	VRF DUCT MOUNTED	L1 LOBBY	6.5	5.1	25.4/18.8	25.4	18.8	3.4	70	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-3
FCU-1-17	VRF DUCT MOUNTED	L0 LOBBY	7.6	6.7	24.8/18.3	24.8	18.3	4.8	40	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-3
FCU-1-18	VRF DUCT MOUNTED	STAFF 2	3.7	2.5	28.7/20.5	28.7	20.5	2.4	60	G4	35-39	220V 1ph	FXMQ40PAVE	MSSB-L1	CU-3
FCU-1-19	VRF DUCT MOUNTED	OPEN PLAN OFFICE	5.8	4.7	25.3/18.7	25.3	18.7	2.6	60	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-5
FCU-1-2	VRF DUCT MOUNTED	KITCHENETTE	9.9	7.7	25.5/18.9	25.5	18.9	5.0	100	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-4
FCU-1-3	VRF DUCT MOUNTED	KITCHENETTE	7.8	5.9	26.6/19.4	26.6	19.4	3.9	100	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-4
FCU-1-4	VRF DUCT MOUNTED	OPEN PLAN OFFICE	5.8	4.7	25.3/18.7	25.3	18.7	2.6	60	G4	38-42	220V 1ph	FXMQ63PAVE	MSSB-L1	CU-4
FCU-1-5	VRF DUCT MOUNTED	OPEN PLAN OFFICE	8.9	6.5	26.8/19.4	26.8	19.4	5.0	110	G4	39-43	220V 1ph	FXMQ100PAVE	MSSB-L1	CU-5
FCU-1-6	VRF DUCT MOUNTED	OFFICE 2/3	5.3	4.9	24.6/18.2	24.6	18.2	2.1	20	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-5
FCU-1-7	VRF DUCT MOUNTED	COACH 2/STAFF 2	7.4	6.2	24.9/18.4	24.9	18.4	3.1	60	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L1	CU-2
FCU-1-8	VRF DUCT MOUNTED	COACH 1	5.3	4.4	24.8/18.4	24.8	18.4	2.0	40	G4	38-42	220V 1ph	FXMQ63PAVE	MSSB-L1	CU-2
FCU-1-9	VRF DUCT MOUNTED	CEO	5.9	4.4	25.9/19.2	25.9	19.2	3.0	80	G4	38-42	220V 1ph	FXMQ63PAVE	MSSB-L1	CU-2
FCU-G-1	VRF DUCT MOUNTED	MEDICAL	5.8	4.2	27.1/19.6	27.1	19.6	3.4	80	G4	38-42	220V 1ph	FXMQ63PAVE	MSSB-L0	CU-1
FCU-G-2	VRF DUCT MOUNTED	CIRC. LOBBY	4.0	3.0	26.7/19.4	26.7	19.4	3.1	50	G4	35-39	220V 1ph	FXMQ40PAVE	MSSB-L0	CU-1
FCU-G-4	VRF DUCT MOUNTED	MASSAGE	8.1	5.1	28.9/20.7	28.9	20.7	4.4	110	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L0	CU-1
FCU-G-5	VRF DUCT MOUNTED	OFFICE/DOCTOR	2.8	2.2	26/19	26	19	2.0	30	G4	30-34	220V 1ph	FXMQ32PAVE	MSSB-L0	CU-1
FCU-G-6	VRF DUCT MOUNTED	ACADEMY OFFICES	5.4	3.9	27.5/19.9	27.5	19.9	3.7	80	G4	37-41	220V 1ph	FXMQ50PAVE	MSSB-L0	CU-1
FCU-G-7	VRF DUCT MOUNTED	BOOTS/CIRC.	6.4	5.2	26.2/19.1	26.2	19.1	6.1	80	G4	39-43	220V 1ph	FXMQ80PAVE	MSSB-L0	CU-1
FCU-G-8	VRF DUCT MOUNTED	MP/THEATRE	17.3	10.0	30.3/21.4	30.3	21.4	8.8	250	G4	38-45	220V 1ph	FXMQ160PV1A	MSSB-L0	CU-1

CU SCHEDULE

ITEM NO.	TYPE	COOLING	HEATING	AMBIENT SELECTION TEMP (DB) (°C)	SOUND POWER LEVEL (DBA) @1m	ELECTRICAL REQUIREMENTS		SELECTION OR APPROVED EQUIVALENT	COMMENTS	POWER SOURCE
		TOTAL COIL LOAD (kW)	TOTAL COIL LOAD (kW)			VOLT	MCA (A)			
CU-1	VRF VERTICAL DISCHARGE	49.6	31.6	31.1	82	400 / 3	42.0	REYQ22TAY1	PROVIDE CORROSION PROTECTION TO COIL	MSSB-RF
CU-2	VRF VERTICAL DISCHARGE	32.4	15.3	31.1	81	400 / 3	28.0	REYQ14TAY1	PROVIDE CORROSION PROTECTION TO COIL	MSSB-RF
CU-3	VRF VERTICAL DISCHARGE	43.1	24.0	31.1	82	400 / 3	42.0	REYQ22TAY1	PROVIDE CORROSION PROTECTION TO COIL	MSSB-RF
CU-4	VRF VERTICAL DISCHARGE	23.5	11.5	31.1	80	400 / 3	21.0	REYQ12TAY1	PROVIDE CORROSION PROTECTION TO COIL	MSSB-RF
CU-5	VRF VERTICAL DISCHARGE	32.6	14.2	31.1	81	400 / 3	28.0	REYQ14TAY1	PROVIDE CORROSION PROTECTION TO COIL	MSSB-RF
CU-6	VRF VERTICAL DISCHARGE	6.7	-	31.1	51	220 / 1	20.0	RKF71TVMA	PROVIDE CORROSION PROTECTION TO COIL	MSSB-L0

FAN SCHEDULE

ITEM NO.	DESCRIPTION	AIR FLOW (L/S)	FAN STATIC PRESSURE (Pa)	FAN SPEED (RPM)	MOTOR POWER (kW)	IMPELLER STYLE	INLET SOUND POWER LEVEL (dB(A)) AT FREQUENCIES (Hz)							SOUND POWER LEVEL (dB(A)) (FULL SPEED)	CAPACITY CONTROL (VSD/EC)	SELECTION OR APPROVED EQUIVALENT		COMMENTS	POWER SOURCE
							63	125	250	500	1k	2k	4k	8k					
Sydney FC																			
TEF-G-1	TOILET EXHAUST FAN	30	50	1850	0.018	Mixed Flow	49	50	52	49	48	38	31	28	31 @ 3m	-	FANTECH	Silent Series TD-250/100SIL		MSSB-L0
TEF-G-2	TOILET EXHAUST FAN	1040	150	1650	0.5	Mixed Flow	73	73	69	64	61	62	61	55	48 @ 3m	-	FANTECH	PowerLine Ultra EC Series PUEEC35		MSSB-L0
EXF-G-1	GENERAL EXHAUST FAN	70	100	1950	0.044	Mixed Flow	51	47	50	53	48	43	36	31	33 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L0
OAF-G-3	TOILET MAKE UP AIR FAN	300	150	1020	0.16	Centrifugal	69	65	65	62	57	53	52	47	43 @ 3m	-	FANTECH	PowerLine Series PCD356ER		MSSB-L0
EXF-G-3	GENERAL EXHAUST FAN	40	30	1260	0.05	Centrifugal	0	0	0	0	0	0	0	0	31 @ 3m	-	FANTECH	Ezfit In-Wall Exhaust Fan EIE150		MSSB-L0
EXF-G-4	GENERAL EXHAUST FAN	100	100	2500	0.05	Mixed Flow	51	49	57	59	55	53	45	43	40 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L0
EXF-G-5	GENERAL EXHAUST FAN	660	150	1380	0.33	Mixed Flow	65	68	61	58	54	56	55	49	42 @ 3m	-	FANTECH	PowerLine Ultra Series PUD354ER		MSSB-L0
EXF-G-6	GENERAL EXHAUST FAN	100	100	2500	0.05	Mixed Flow	51	49	57	59	55	53	45	43	40 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L0
EXF-G-7	GENERAL EXHAUST FAN	450	140	900	0.22	Mixed Flow	60	64	57	57	51	54	53	47	40 @ 3m	-	FANTECH	PowerLine Ultra Series PUD406ER		MSSB-L0
EXF-G-8	GENERAL EXHAUST FAN	450	140	900	0.22	Mixed Flow	60	64	57	57	51	54	53	47	41 @ 3m	-	FANTECH	PowerLine Ultra Series PUD406ER		MSSB-L0
OAF-G-1	OUTSIDE AIR FAN	50	50	2250	0.03	Mixed Flow	48	43	48	54	49	41	36	31	33 @ 3m	-	FANTECH	Silent Series TD-350/125SILT-4PL		MSSB-L0
OAF-G-2	OUTSIDE AIR FAN	40	50	1850	0.018	Mixed Flow	49	50	52	49	48	38	31	28	31 @ 3m	-	FANTECH	Silent Series TD-250/100SIL		MSSB-L0
TEF-1-01	TOILET EXHAUST FAN	190	100	1080	0.1	Centrifugal	74	66	62	58	52	52	46	40	40 @ 3m	-	FANTECH	PowerLine Series PCD316ER		MSSB-L1
TEF-1-02	TOILET EXHAUST FAN	270	150	1020	0.16	Centrifugal	69	65	65	62	57	53	52	47	43 @ 3m	-	FANTECH	PowerLine Series PCD356ER		MSSB-L1
TEF-1-03	TOILET EXHAUST FAN	630	150	1380	0.37	Mixed Flow	65	68	61	58	54	56	55	49	42 @ 3m	-	FANTECH	PowerLine Ultra Series PUD354DD		MSSB-L1
EF-1-01	GENERAL EXHAUST FAN	50	100	1950	0.044	Mixed Flow	51	47	50	53	48	43	36	31	33 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L1
EF-1-02	GENERAL EXHAUST FAN	80	100	2150	0.044	Mixed Flow	48	49	55	56	55	54	48	41	38 @ 3m	-	FANTECH	ProVent Series RIL-150SW		MSSB-L1
EF-1-03	GENERAL EXHAUST FAN	70	100	1950	0.044	Mixed Flow	51	47	50	53	48	43	36	31	33 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L1
EF-1-04	GENERAL EXHAUST FAN	100	100	2500	0.05	Mixed Flow	51	49	57	59	55	53	45	43	40 @ 3m	-	FANTECH	Silent Series TD-500/150SIL		MSSB-L1
OAF-1-01	OUTSIDE AIR FAN	200	150	2300	0.19	Mixed Flow	60	63	68	59	58	55	52	48	44 @ 3m	-	FANTECH	Silent High Capacity Series TD-2000/315SIL		MSSB-L1

NOTES
1. FAN STATICS ARE APPROXIMATE. CONTRACTOR TO CALCULATE STATIC PRIOR TO ORDERING FAN.
2. EXF-G-3 - DELETED
3. Name of FAN - TEF-G-1 IS CHANGED TO EXF-G-9 IN THE SCHEDULES.

ROOF COWLS

ITEM NO.	TYPE	MODEL	MAXIMUM AIRFLOW (L/s)	SYSTEM	MAKE
RC-1	ALPHA RELIEF SERIES	MRV2	190	TEF-1.01	IDEA AIR
RC-2	ALPHA RELIEF SERIES	MRV2	270	TEF-1.02	IDEA AIR
RC-3	ALPHA RELIEF SERIES	RV2	630	TEF-1.03	IDEA AIR
RC-4	ALPHA RELIEF SERIES	MRV1	50	EF-1.01	IDEA AIR
RC-5	ALPHA RELIEF SERIES	MRV2	80	EF-1.02	IDEA AIR
RC-6	ALPHA RELIEF SERIES	MRV1	70	EF-1.03	IDEA AIR
RC-7	ALPHA RELIEF SERIES	MRV2	100	EF-1.04	IDEA AIR
RC-8	ALPHA RELIEF SERIES	MRV2	200	OEF-1.04	IDEA AIR
RC-9	ALPHA RELIEF SERIES	MRV2	100	FCU-1.1	IDEA AIR
RC-10	ALPHA RELIEF SERIES	MRV2	100	FCU-1.2	IDEA AIR
RC-11	ALPHA RELIEF SERIES	MRV2	100	FCU-1.3	IDEA AIR
RC-12	ALPHA RELIEF SERIES	MRV1	60	FCU-1.4	IDEA AIR
RC-13	ALPHA RELIEF SERIES	MRV2	110	FCU-1.5	IDEA AIR
RC-14	ALPHA RELIEF SERIES	MRV1	20	FCU-1.6	IDEA AIR
RC-15	ALPHA RELIEF SERIES	MRV1	60	FCU-1.7	IDEA AIR
RC-16	ALPHA RELIEF SERIES	MRV1	40	FCU-1.8	IDEA AIR
RC-17	ALPHA RELIEF SERIES	MRV2	80	FCU-1.9	IDEA AIR
RC-18	ALPHA RELIEF SERIES	MRV1	60	FCU-1.10	IDEA AIR
RC-19	ALPHA RELIEF SERIES	MRV1	40	FCU-1.11	IDEA AIR
RC-20	ALPHA RELIEF SERIES	MRV2	80	FCU-1.12	IDEA AIR
RC-21	ALPHA RELIEF SERIES	MRV2	80	FCU-1.13	IDEA AIR
RC-22	ALPHA RELIEF SERIES	MRV2	150	FCU-1.14	IDEA AIR
RC-23	ALPHA RELIEF SERIES	MRV2	150	FCU-1.15	IDEA AIR
RC-24	ALPHA RELIEF SERIES	MRV1	70	FCU-1.16	IDEA AIR
RC-25	ALPHA RELIEF SERIES	MRV1	40	FCU-1.17	IDEA AIR
RC-26	ALPHA RELIEF SERIES	MRV1	60	FCU-1.18	IDEA AIR
RC-27	ALPHA RELIEF SERIES	MRV1	60	FCU-1.19	IDEA AIR

GRILLE SCHEDULE

ITEM NO.	DESCRIPTION	NOMINAL SIZE	MAXIMUM AIRFLOW (L/s)	COMMENTS
S1	FIXED HELICAL SWIRL DIFFUSER. SMARTEMP HSC-FD. ROUND FACE PLATE TO ARCHITECTURAL SPECIFICATION	FACE/NECK Ø355/DN250 Ø500/DN355 Ø710/DN500	110 220 500	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AND REDUCER AS REQUIRED
S2	SMARTEMP PERFORATED MULTISTREAM DIFFUSER - LONG THROW	FACE/NECK 1490x212/1455x177	370	DUCT MOUNTED C/W OBD
S3	LINEAR MULTI STREAM CEILING DIFFUSER LMC 1200. SMARTEMP OR APPROVED EQUAL	FACE/NECK 1200x160/DN300 1200x244/DN300	200 300	COMPLETE WITH CUSHION HEAD BOX AND BLACK REDUCERS AS REQUIRED. C/W OBD
S4	FIXED HELICAL SWIRL DIFFUSER. SMARTEMP HSC-AD. ROUND FACE PLATE TO ARCHITECTURAL SPECIFICATION	FACE/NECK Ø375/DN250	135	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AND REDUCER AS REQUIRED INCLUDE MOTOR TO SWITCH BETWEEN WINTER AND SUMMER MODES
R1	FIXED HELICAL SWIRL DIFFUSER. SMARTEMP HSC-FD. ROUND FACE PLATE TO ARCHITECTURAL SPECIFICATION	FACE/NECK Ø355/DN250 Ø500/DN355 Ø710/DN500	110 220 500	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AND REDUCER AS REQUIRED
R2	RETURN AIR EGG CRATE GRILLE. HOLYOAKE EC OR APPROVED EQUAL.	FACE 600x300 / 400x400 600x600 900x600 1200x600	225 435 830 1200	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AS REQUIRED
R3	LINEAR MULTI STREAM CEILING DIFFUSER LMC 1200. SMARTEMP OR APPROVED EQUAL	FACE/NECK 1200x160/DN300 1200x244/DN300 1500x244/DN300	200 300 330	COMPLETE WITH CUSHION HEAD BOX AND BLACK REDUCERS AS REQUIRED. C/W OBD
E1	FIXED HELICAL SWIRL DIFFUSER. SMARTEMP HSC-FD. ROUND FACE PLATE TO ARCHITECTURAL SPECIFICATION	FACE/NECK Ø355/DN250 Ø500/DN355 Ø710/DN500	110 220 500	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AND REDUCER AS REQUIRED
E2	EXHAUST AIR EGG CRATE GRILLE. HOLYOAKE EC OR APPROVED EQUAL.	FACE 600x300 / 400x400 600x600 900x600 1200x600	225 435 830 1200	COMPLETE WITH INTERNALLY LINED CUSHION HEAD BOX (INTERNALLY MATT BLACK) AS REQUIRED

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY
T1	D&C TENDER ISSUE	15-04-2021		LMG
T2	D&C TENDER ADDENDUM	06-05-2021		LMG
T3	ISSUE FOR CDC	14-02-2022		RH

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - EQUIPMENT SCHEDULES

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M13	T3

A1

Equipment Schedule

Family and Type	System Name	System Classification	Type	ULSHE_Current	ULSHM_Air Flow	ULSHM_Outside Air Flow	ULSHM_Outside Air Flow Min
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 4,RA 2,OA 2,RA 2	Supply Air,Return Air,Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	325 L/s	325 L/s	80 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 5,RA 4,OA 3	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	420 L/s	420 L/s	110 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 7,SA 2,OA 5,RA 1	Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	265 L/s	265 L/s	50 L/s
ULM_ME-AS_FCU Generic_: FXDYQ63MAV1	SA 8,MA 2,OA 6,RA 5	Supply Air,Return Air,Undefined	FXDYQ63MAV1	0.0 A	300 L/s	300 L/s	80 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 12,RA 7,OA 7	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	400 L/s	400 L/s	100 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 13,RA 8,OA 8,OA 9	Supply Air,Return Air,Supply Air,Undefined,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	535 L/s	535 L/s	100 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 14,OA 10,OA 11	Supply Air,Undefined,Supply Air,Undefined,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	0 L/s	0 L/s	100 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 15,RA 10,OA 12,RA 10	Supply Air,Return Air,Supply Air,Return Air,Undefined	FXDYQ80MAV1	0.0 A	400 L/s	400 L/s	60 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 15,MA 3,RA 9,RA 11	Supply Air,Undefined,Supply Air,Return Air,Undefined	FXDYQ80MAV1	0.0 A	535 L/s	535 L/s	110 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 16,OA 13,OA 15	Supply Air,Undefined,Supply Air,Undefined,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	165 L/s	165 L/s	20 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 17,RA 13,OA 16	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	420 L/s	420 L/s	60 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 18,RA 14,OA 16	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	300 L/s	300 L/s	40 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 19,RA 15,OA 18	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	330 L/s	330 L/s	80 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 20,RA 16,OA 19,RA 16	Supply Air,Return Air,Supply Air,Return Air,Undefined	FXDYQ80MAV1	0.0 A	280 L/s	280 L/s	120 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 21,RA 12,OA 21	Supply Air,Undefined,Return Air,Undefined,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	300 L/s	300 L/s	40 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 22,OA 22,RA 17	Supply Air,Undefined,Supply Air,Return Air,Undefined	FXDYQ80MAV1	0.0 A	0 L/s	0 L/s	80 L/s
ULM_ME-AS_Fan Axial Fan: 315mm Dia	OA 38	Supply Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_FCU Wall Mount: FXAQ32		Hydronic Supply,Power,Hydronic Return,Sanitary	FXAQ32	0.0 A	0 L/s	0 L/s	35 L/s
ULM_ME-AS_Fan Axial Fan: 500mm Dia	TE 17	Exhaust Air	500mm Dia	0.0 A	740 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 4	Exhaust Air	315mm Dia	0.0 A	30 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 4	Exhaust Air	315mm Dia	0.0 A	40 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 6	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV1	TE 6	Exhaust Air	MRV1		0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 2	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV1	TE 2	Exhaust Air	MRV1		0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 9	Exhaust Air	315mm Dia	0.0 A	270 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV1	TE 9	Exhaust Air	MRV1		0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 8	Exhaust Air	315mm Dia	0.0 A	300 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV1	TE 8	Exhaust Air	MRV1		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 9	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 28	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 20	Supply Air	MRV2		0 L/s		
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: H - Humidity Sensor			H - Humidity Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 29,OA 29,OA 30	Supply Air,Undefined,Supply Air,Undefined,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	535 L/s	535 L/s	80 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 30	Supply Air	MRV2		0 L/s		
ULM_ME-AS_FCU Generic_: FXMQ50PAVE	SA 30,OA 31,OA 32	Supply Air,Undefined,Supply Air,Undefined,Supply Air,Undefined	FXMQ50PAVE	0.0 A	300 L/s	300 L/s	80 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 32	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 34	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 36	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 37	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 39	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 14	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 25	Supply Air	MRV2		0 L/s		
ULM_ME_DB Board: Mechanical Board		Power	Mechanical Board				
ULM_ME_!GenBlock: Rect			Rect				
ULM_ME_!GenBlock: Rect			Rect				
MP6200E-1: HD200e 2 Burner Demand Duo	CW 2	Domestic Cold Water,Hydronic Supply	HD200e 2 Burner Demand Duo				
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 19	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV1	TE 19	Exhaust Air	MRV1		0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	OA 1	Supply Air	315mm Dia	0.0 A	300 L/s		
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 28,RA 29,OA 27	Supply Air,Return Air,Supply Air,Undefined	FXDYQ80MAV1	0.0 A	660 L/s	660 L/s	150 L/s
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 31,RA 31	Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	535 L/s	535 L/s	150 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	EA 4	Exhaust Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 40	Supply Air	MRV2		0 L/s		
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 34,RA 33	Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	420 L/s	420 L/s	70 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 42	Supply Air	MRV2		0 L/s		
Halgan_Modular Grease Trap: MGT_1000		Sanitary	MGT_1000				
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 23,RA 20,OA 1,RA 20	Supply Air,Return Air,Supply Air,Return Air,Undefined	FXDYQ80MAV1	0.0 A	1120 L/s	920 L/s	250 L/s
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				

Equipment Schedule

Family and Type	System Name	System Classification	Type	ULSHE_Current	ULSHM_Air Flow	ULSHM_Outside Air Flow	ULSHM_Outside Air Flow Min
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 15,RA 32	Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	400 L/s	400 L/s	60 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 41	Supply Air	MRV2		0 L/s		
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 1,OA 43,RA 34	Supply Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	0 L/s	0 L/s	40 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 45	Supply Air	MRV2		0 L/s		
ULM_ME-AS_FCU Generic_: FXDYQ80MAV1	SA 36,RA 36	Supply Air,Return Air,Undefined,Return Air,Undefined	FXDYQ80MAV1	0.0 A	270 L/s	270 L/s	60 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 44	Supply Air	MRV2		0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 20	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 20	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 20	Exhaust Air	315mm Dia	0.0 A	100 L/s		
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ	R 17	Undefined,Other,Undefined,Power	BS6Q54TVJ				
Revit -Daikin-VRV IV_MultiPort_Branch_Selector-BS6_8Q54TVJ: BS6Q54TVJ		Undefined,Power	BS6Q54TVJ				
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 46	Supply Air	MRV2		0 L/s		
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: reyq12t7y1b - vrv_daikin_reyq-t		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	reyq12t7y1b - vrv_daikin_reyq-t				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: reyq8t7y1b - vrv_daikin_reyq-t		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	reyq8t7y1b - vrv_daikin_reyq-t				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: CUSTOM		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	CUSTOM				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: reyq12t7y1b - vrv_daikin_reyq-t		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	reyq12t7y1b - vrv_daikin_reyq-t				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: reyq8t7y1b - vrv_daikin_reyq-t		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	reyq8t7y1b - vrv_daikin_reyq-t				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: reyq8tay1 - daikin		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	reyq8tay1 - daikin				
RSen_58_ME_FB_outdoor unit - vrv - air cooled heat recovery_daikin: CUSTOM		Hydronic Supply,Hydronic Return,Power,Undefined,Controls	CUSTOM				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 7	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 12	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Fan In-Wall: Wall Fan			Wall Fan	0.0 A	0 L/s		
ULM_ME-AS_Fan In-Wall: Wall Fan			Wall Fan	0.0 A	0 L/s		
ULM_ME-AS_Fan In-Wall: Wall Fan			Wall Fan	0.0 A	0 L/s		
ULM_ME-AS_Fan In-Wall: Wall Fan			Wall Fan	0.0 A	0 L/s		
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_Fan Axial Fan: 315mm Dia	TE 11	Exhaust Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 52	Supply Air	MRV2		0 L/s		
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				
ULM_ME-AS_Fan Axial Fan: 315mm Dia	OA 5	Supply Air	315mm Dia	0.0 A	0 L/s		
ULM_ME-AS_Fan Axial Fan: 315mm Dia	EA 2	Exhaust Air	315mm Dia	0.0 A	100 L/s		
ULM_ME-WS_Condenser Unit: CU-6			CU-6				
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 4	Supply Air	MRV2		0 L/s		
ULM_ME-AS_FCU Generic_: FXDYQ63MAV1	SA 10,RA 22	Supply Air,Return Air,Undefined,Return Air,Undefined	FXDYQ63MAV1	0.0 A	160 L/s	160 L/s	30 L/s
ULM_ME-AS_Roof Cowl.0001: MRV2	EA 2	Exhaust Air	MRV2		0 L/s		
ULM_ME-AS_Roof Cowl.0001: MRV2	OA 17	Supply Air	MRV2		0 L/s		
Halgan_Modular Grease Trap: MGT_1000		Sanitary	MGT_1000				
ULM_ME-AS_Fan Axial Fan: 315mm Dia	OA 17	Supply Air	315mm Dia	0.0 A	200 L/s		
ULM_ME-WS_Condenser Unit: PAC-CONDENSER			PAC-CONDENSER				
ULM_ME_Sensor: H - Humidity Sensor			H - Humidity Sensor				
ULM_ME_Sensor: T - Temperature Sensor			T - Temperature Sensor				

PRINT IN COLOUR

REV.	DESCRIPTION	DATE	DRAWN BY	APPROVED BY

CLIENT

ARCHITECT

MECHANICAL CONSULTANT

Integral Group Consulting Engineers Pty Ltd
ABN 27 618 557 672
Level 7, 657 Pacific Highway
St Leonards
NSW 2065 AUSTRALIA
T +61 2 9431 9431
sydney@integralgroup.com
integralgroup.com

INTEGRAL

SCALE

1:100 @ A1 — 0 1 2 3 4 5

1:50 @ A1 — 0 0.5 1 1.5 2 2.5

Do not scale from drawing. Use marked dimensions.
To be read in conjunction with all other Consultant's drawings.
Advanced Air to be immediately notified of any discrepancies.
Copyright on this drawing retained by Advanced AirCon design& construct Pty. Ltd.

advanced aircon design&construct
UNIT 20, 7-9 PERCY STREET, AUBURN, NSW 2144
PO BOX 1232 STRATHFIELD, NSW 2135
ABN 46 154 328 462
TEL: (02) 9749 7400
FAX: (02) 9749 7900
www.advancedaircon.com.au

PROJECT
SYDNEY FC CENTRE OF EXCELLENCE
MACQUARIE UNIVERSITY SPORTS FIELD, NORTH RYDE, NSW

DRAWING TITLE
MECHANICAL SERVICES - EQUIPMENT SCHEDULES

SCALE @ A1	STATUS	JOB No.	DWG No.	REV.
NTS		610122.000	M14	

A1