



Smart Load




Backup Load



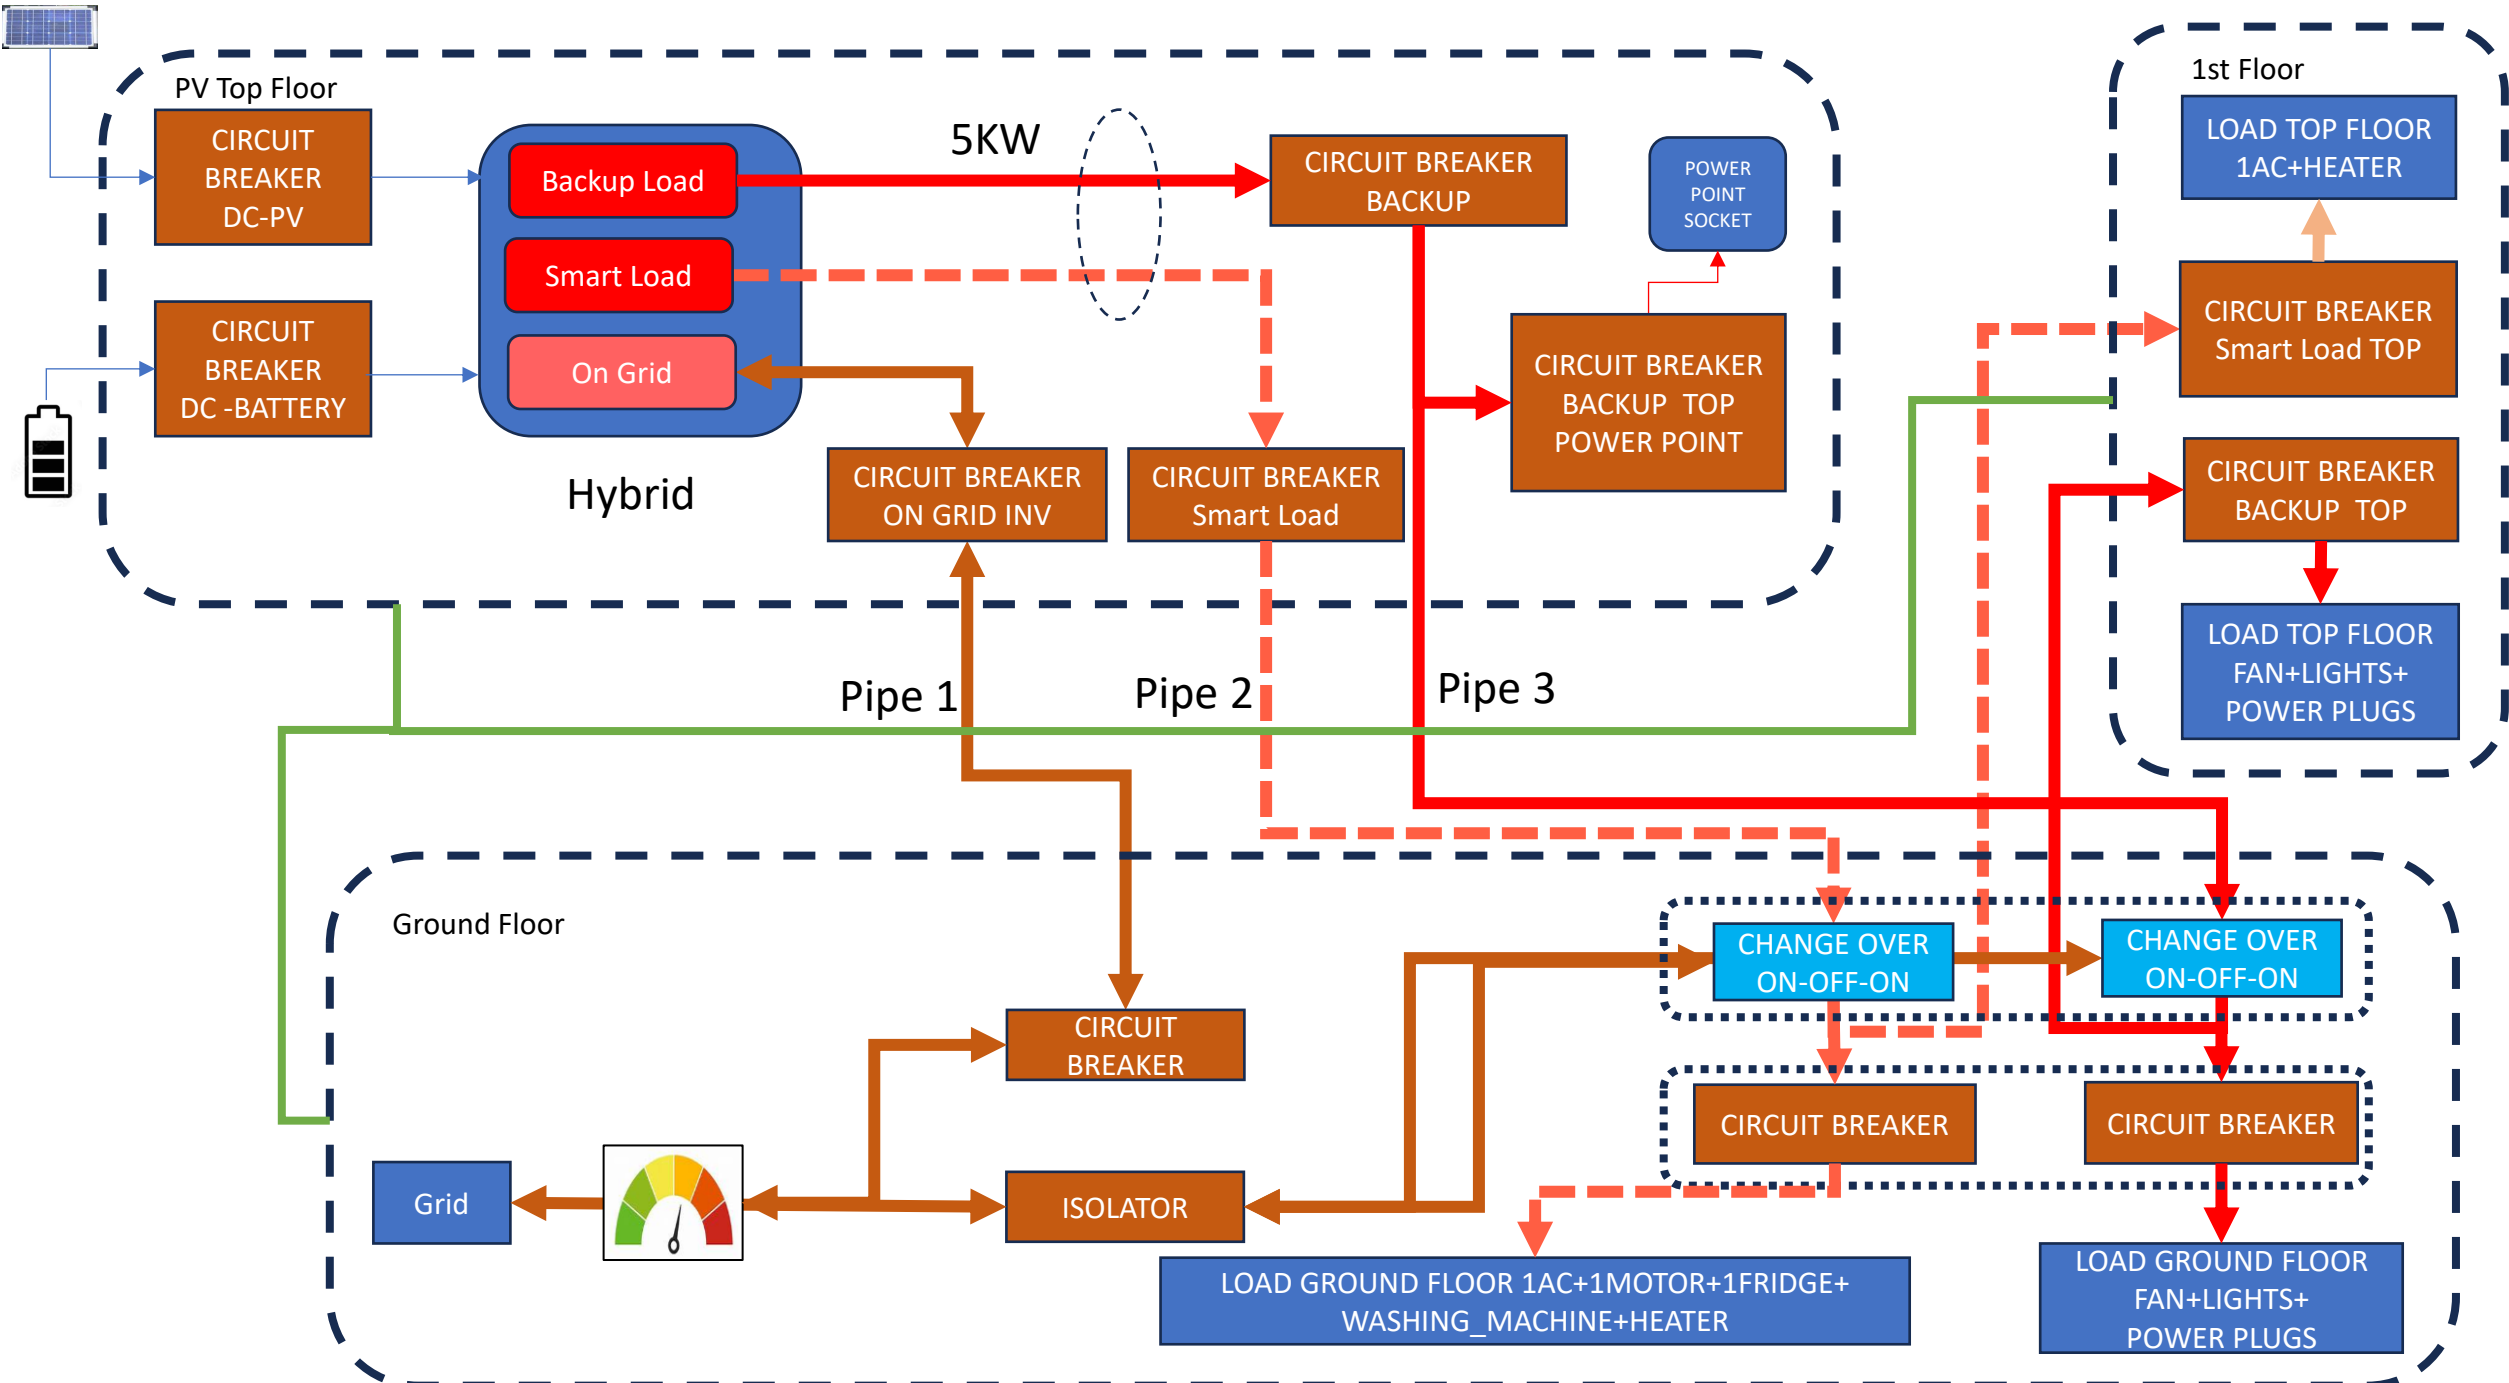

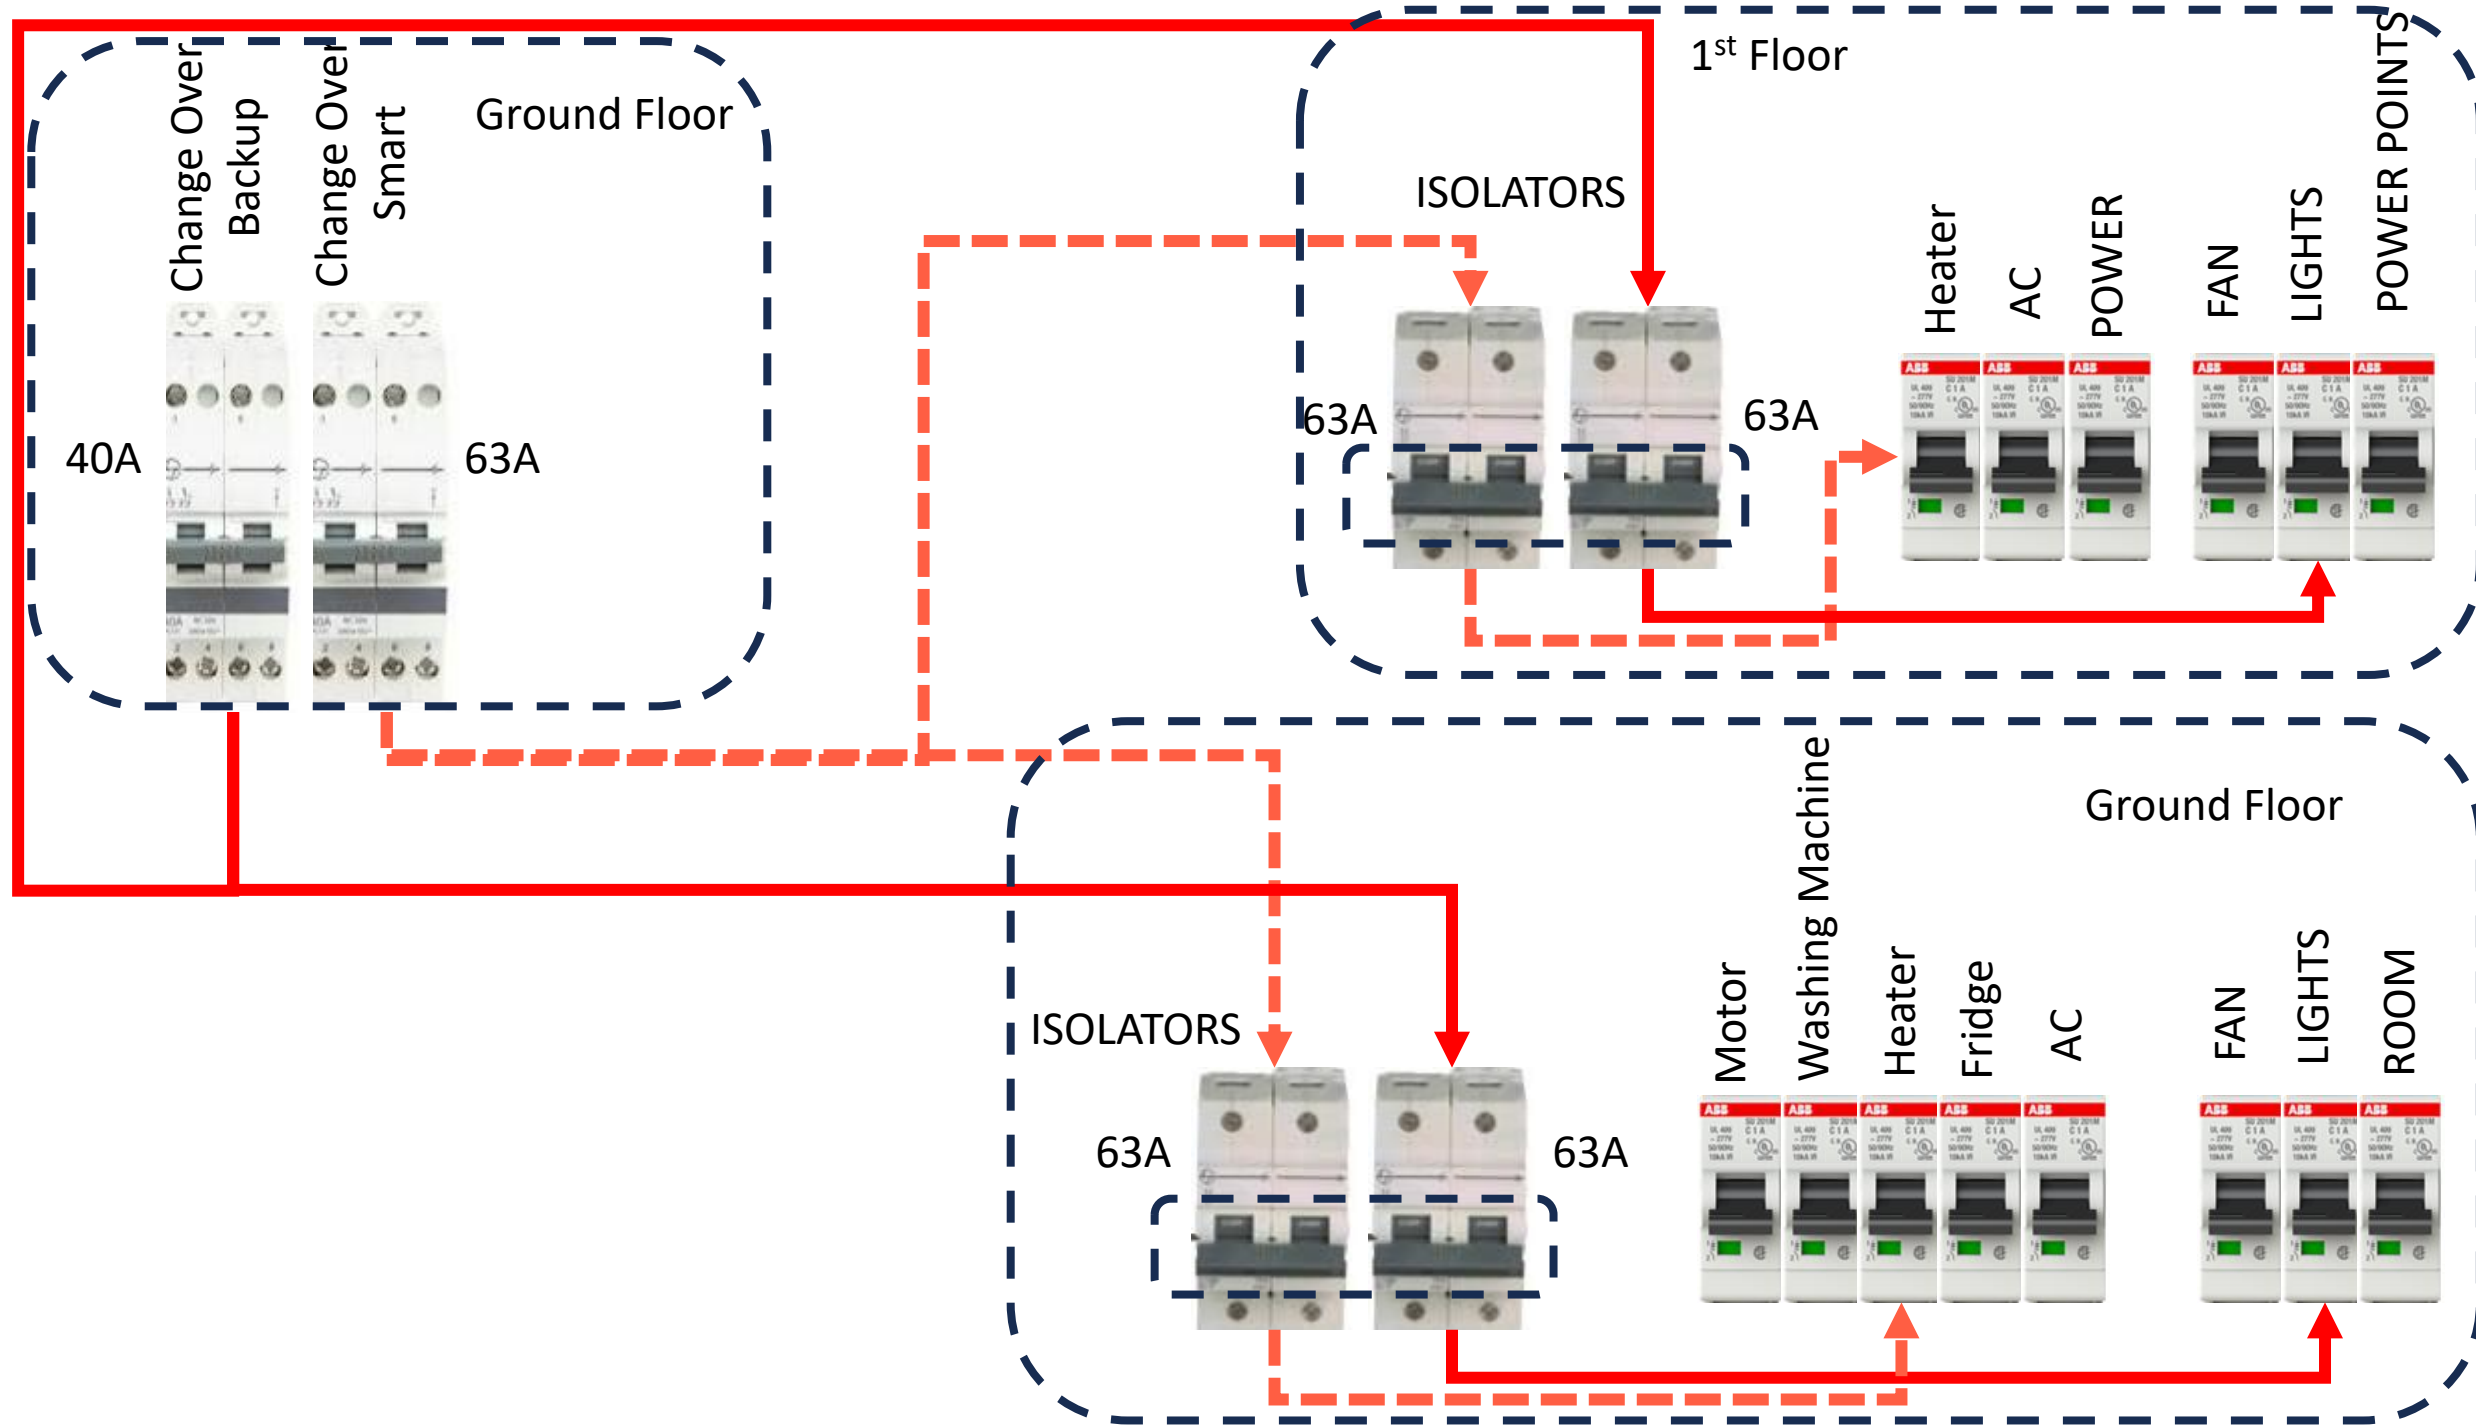


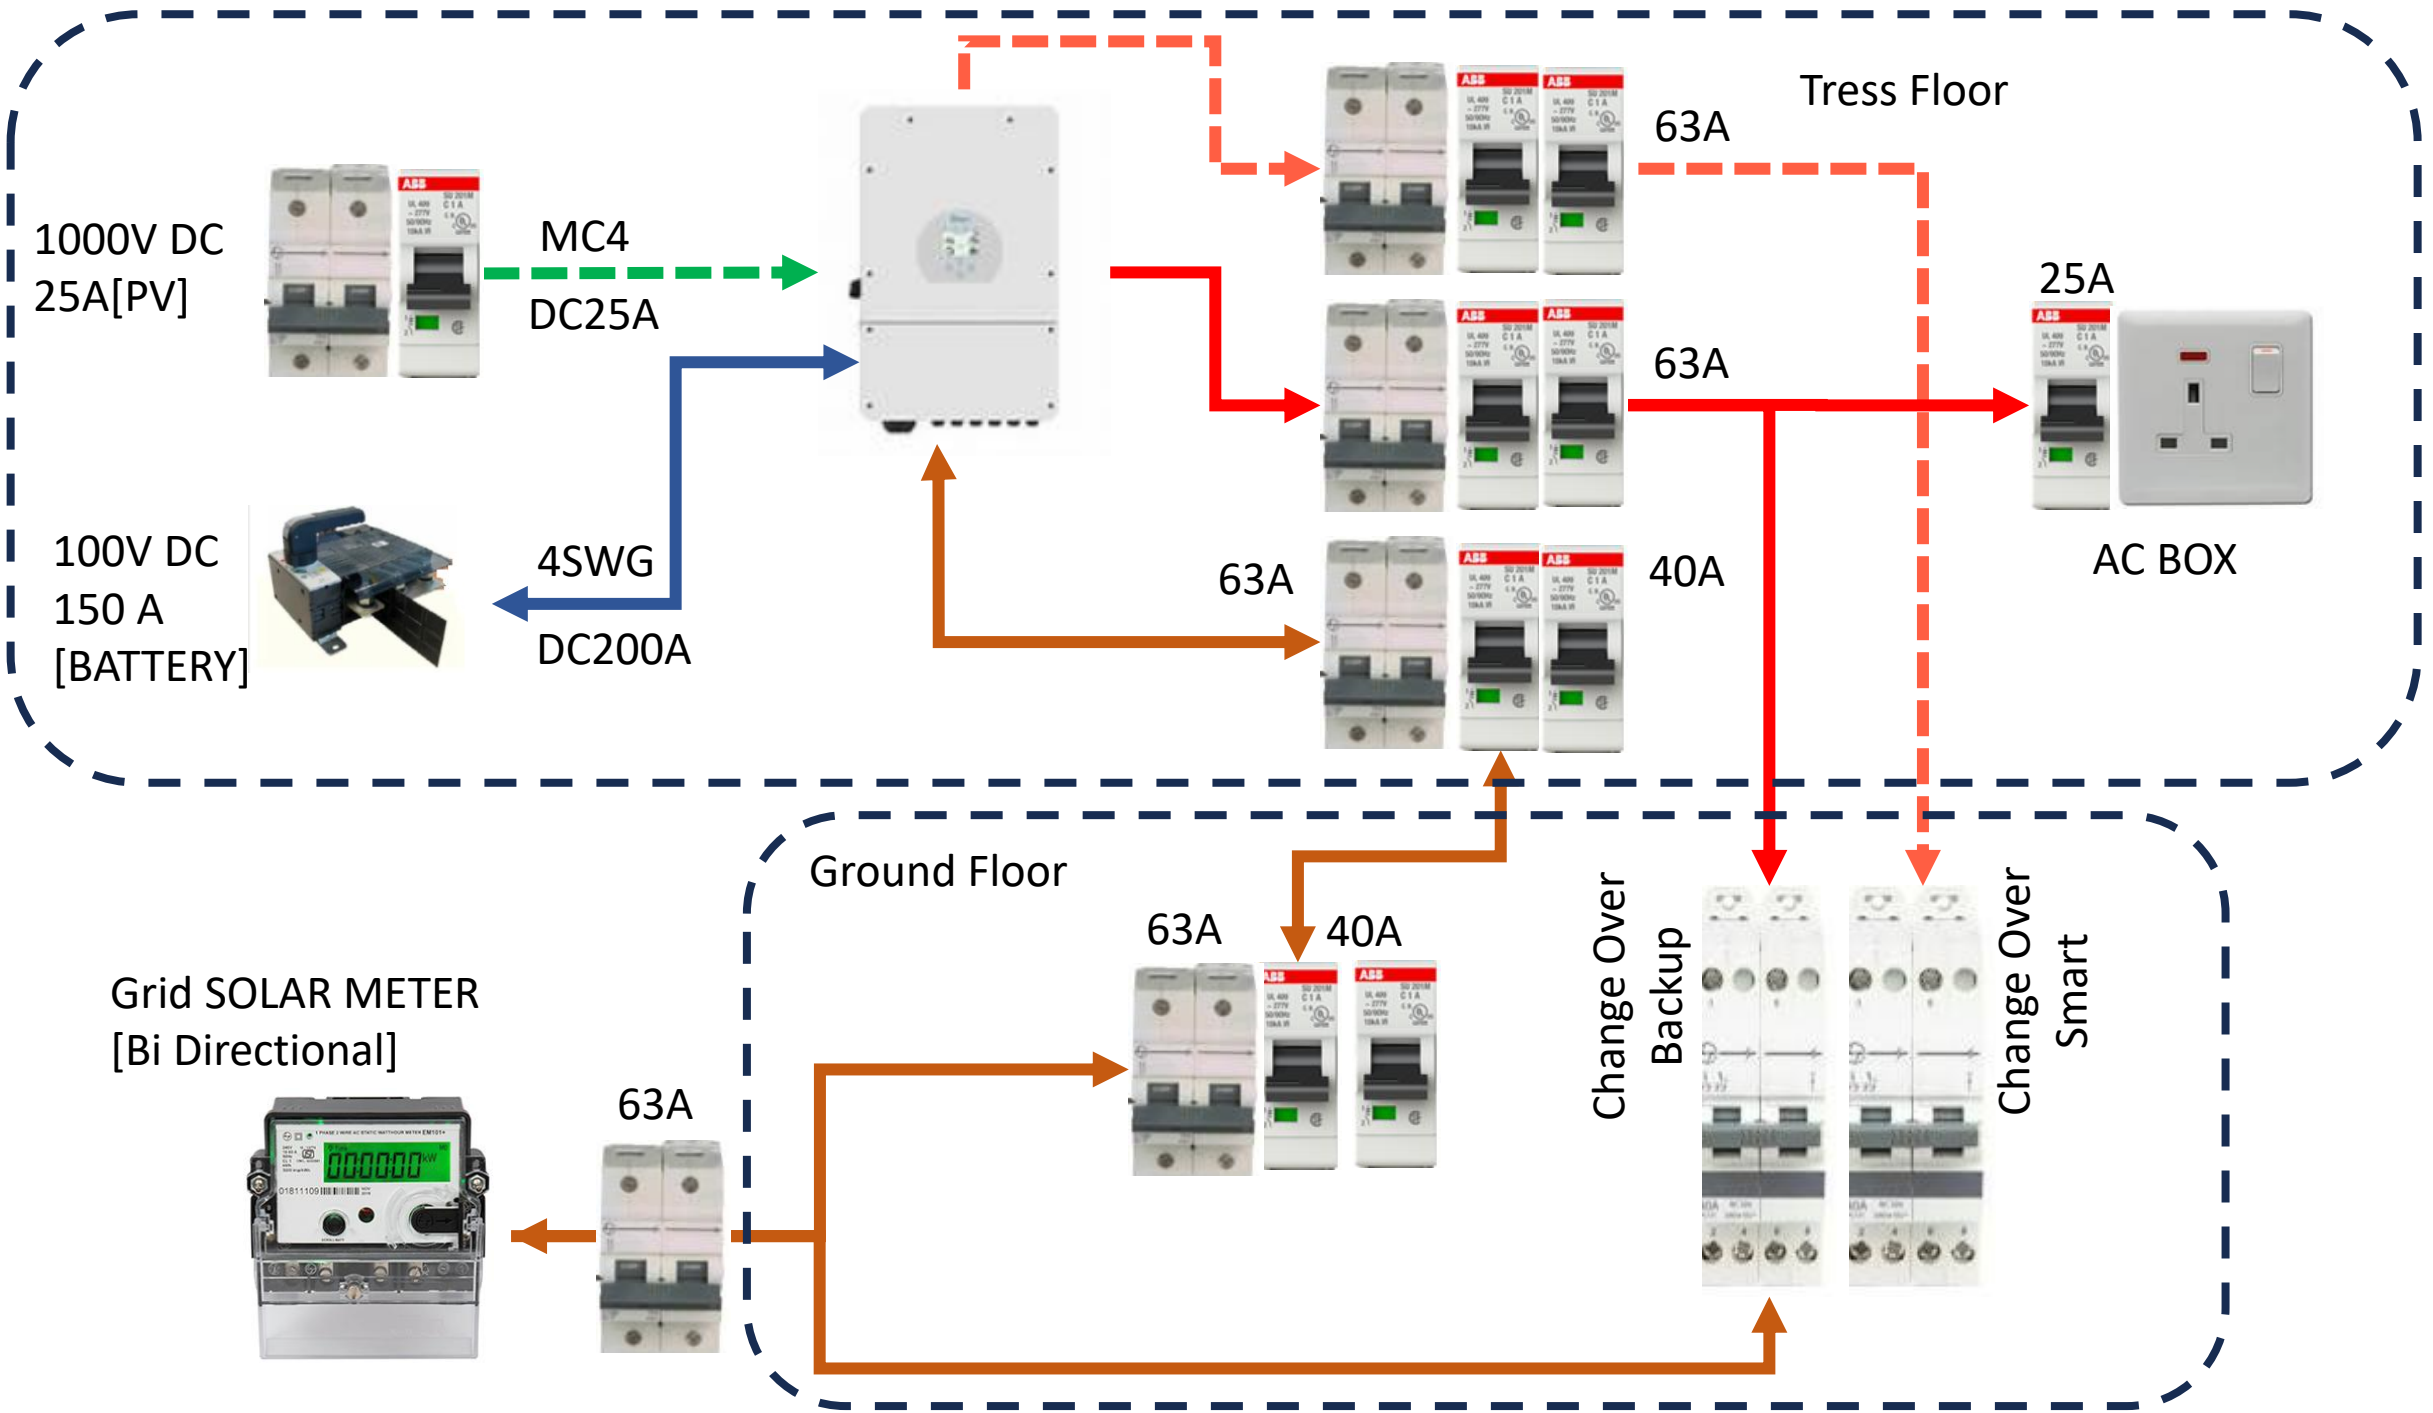

Tress Floor




SUN-5K-SG04LP1-EU

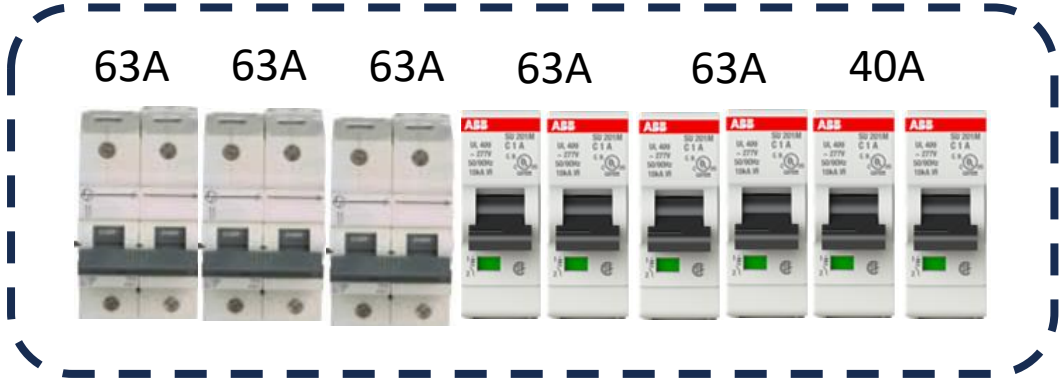

MCB Box with Cover 12 (AC)



MCB Box with Cover 8 (DC)

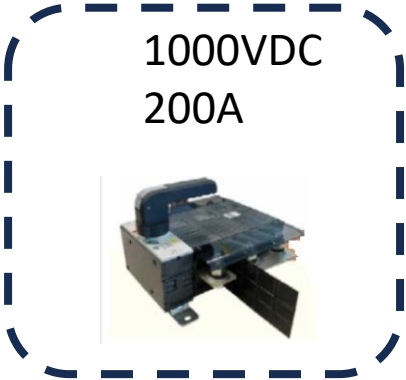

DC Isolator for Battery

1st Floor

40A 40A 6A 6A 6A 20A 20A 20A



MCB Box with Cover 12

Ground Floor

63A 63A



MCB Box with Cover 12



63A

40A

63A




63A

40A




MCB Box with Cover 12
Emergency shutdown
and changeover

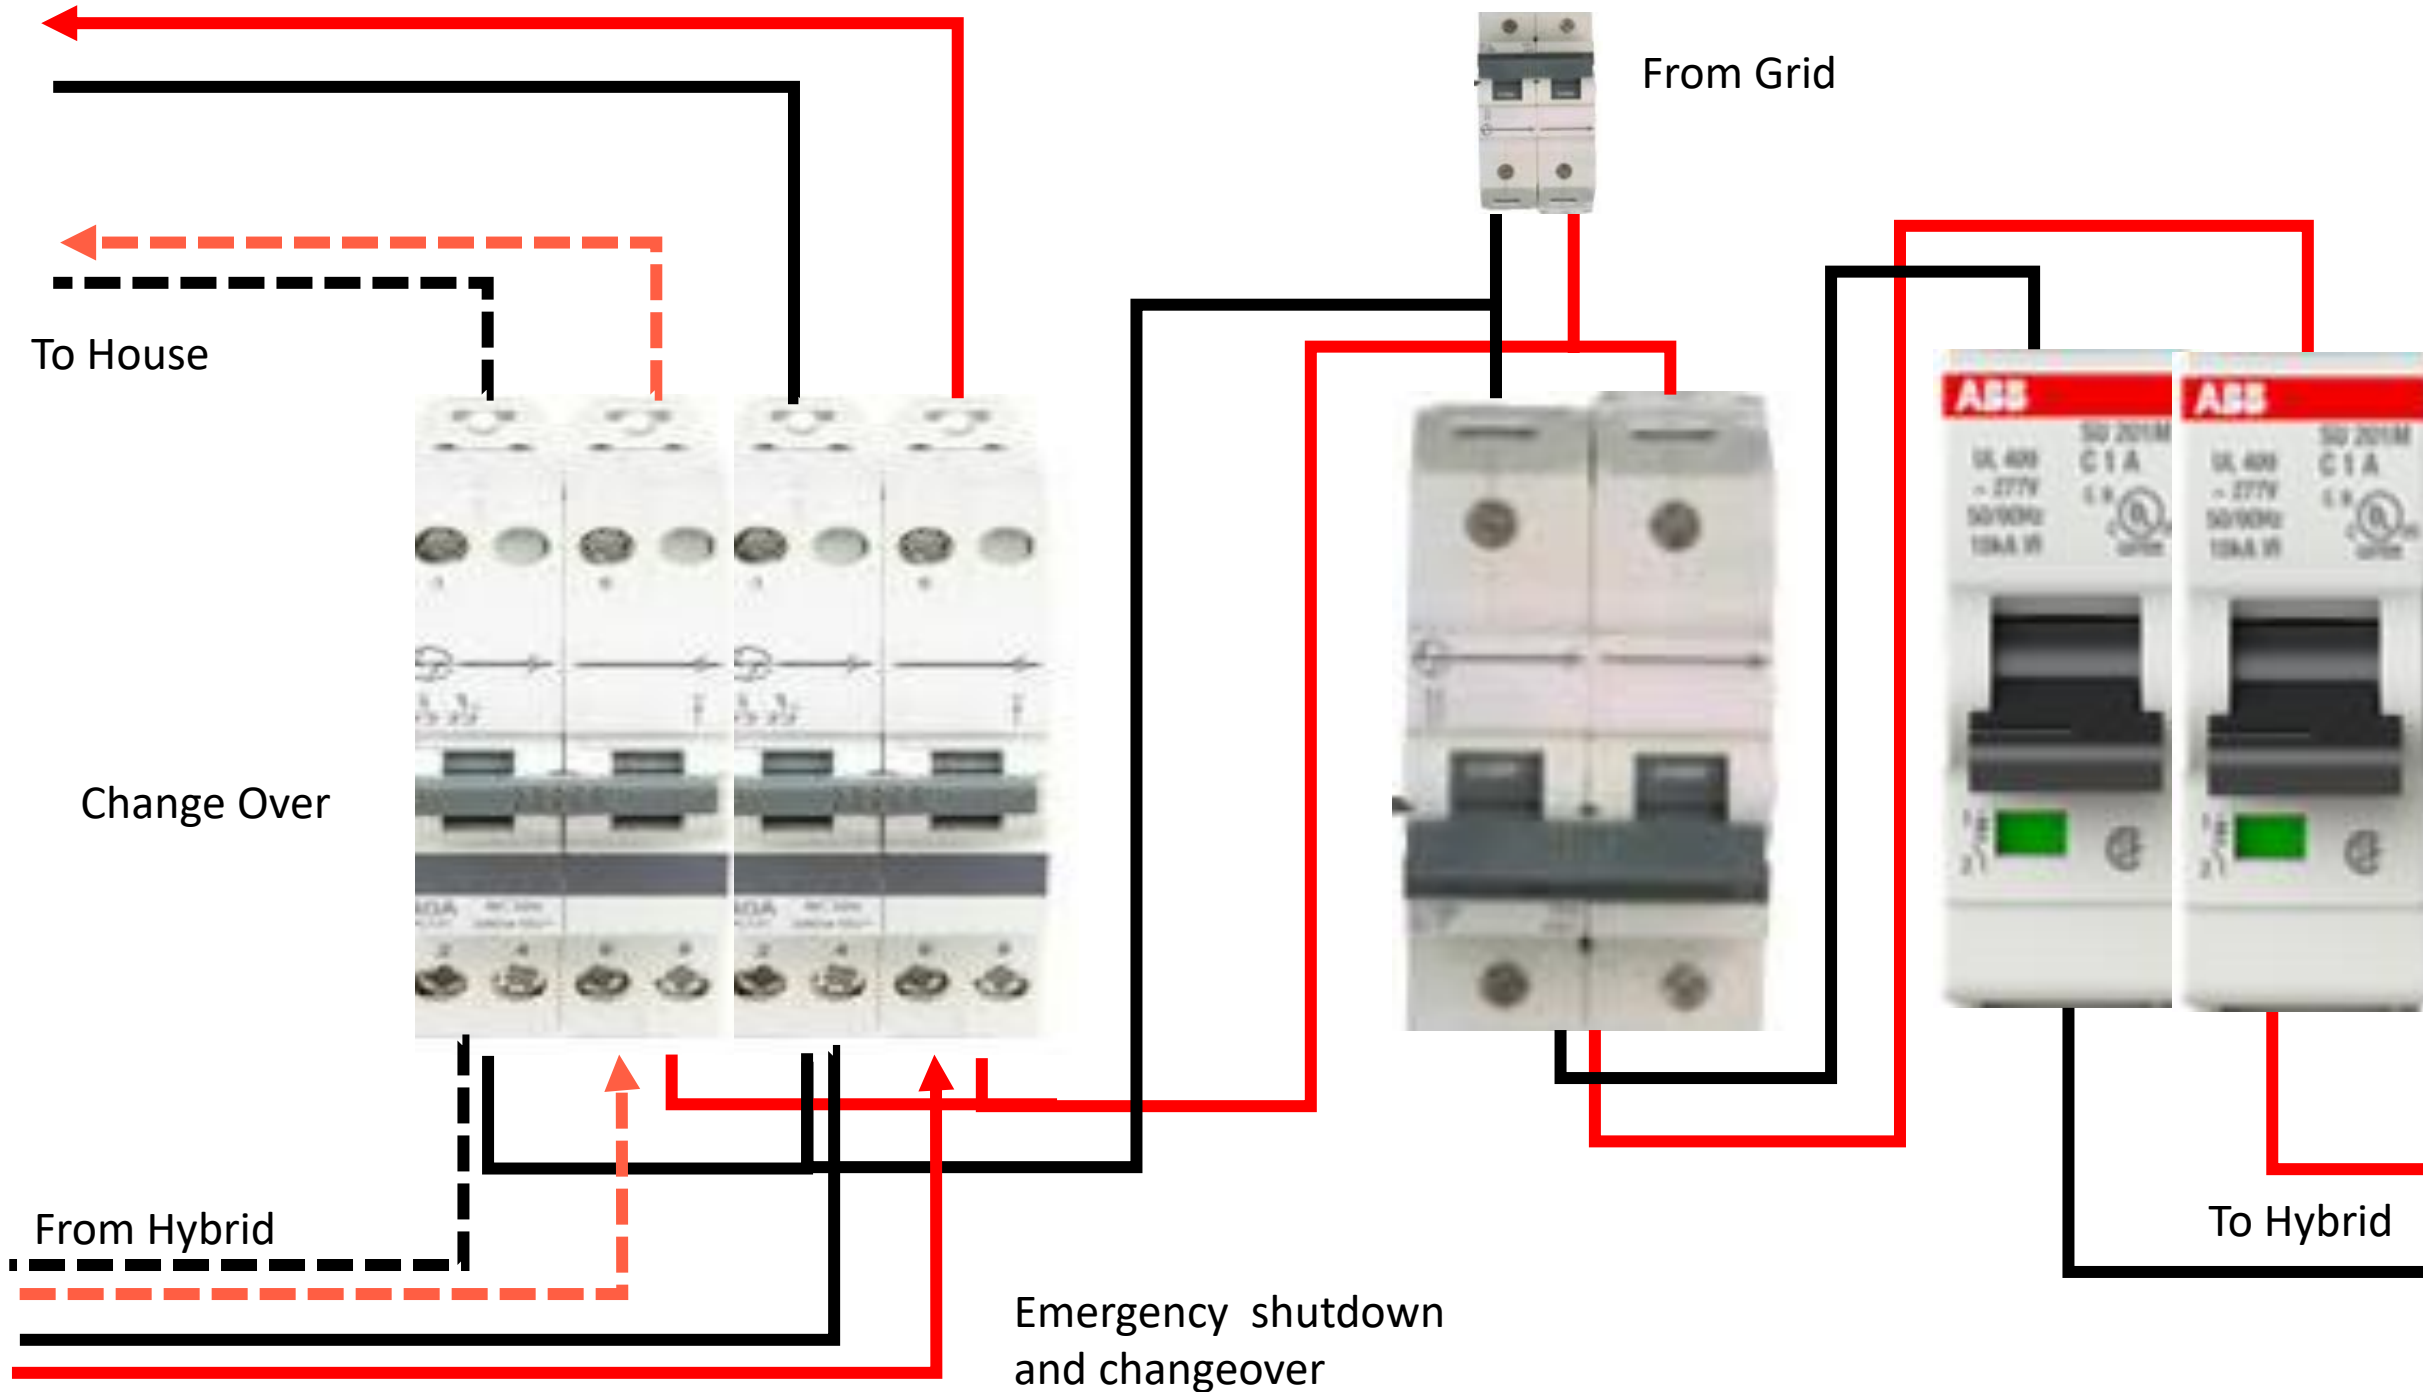




L Clamp Only here
Rest all are boxes

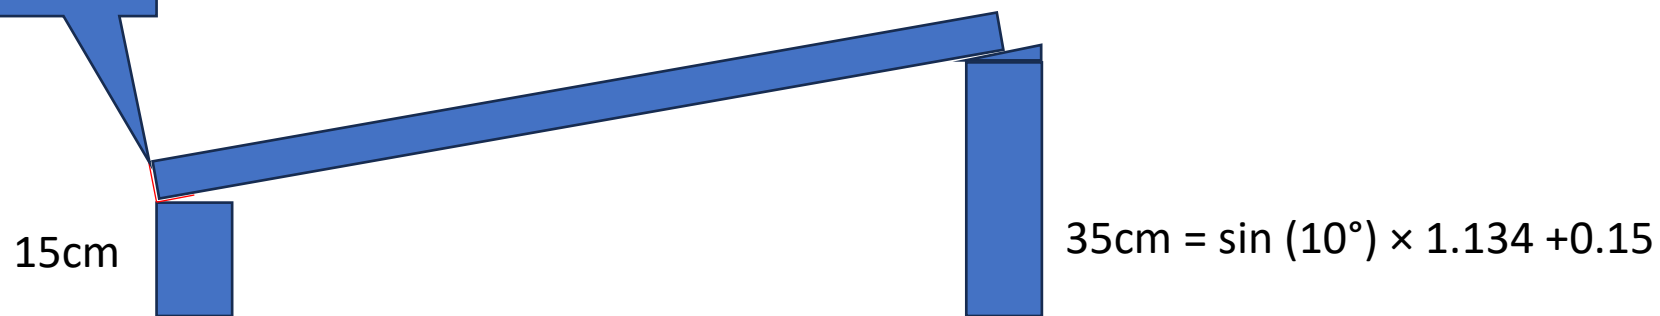


0.5 feet's

TBD

TBD

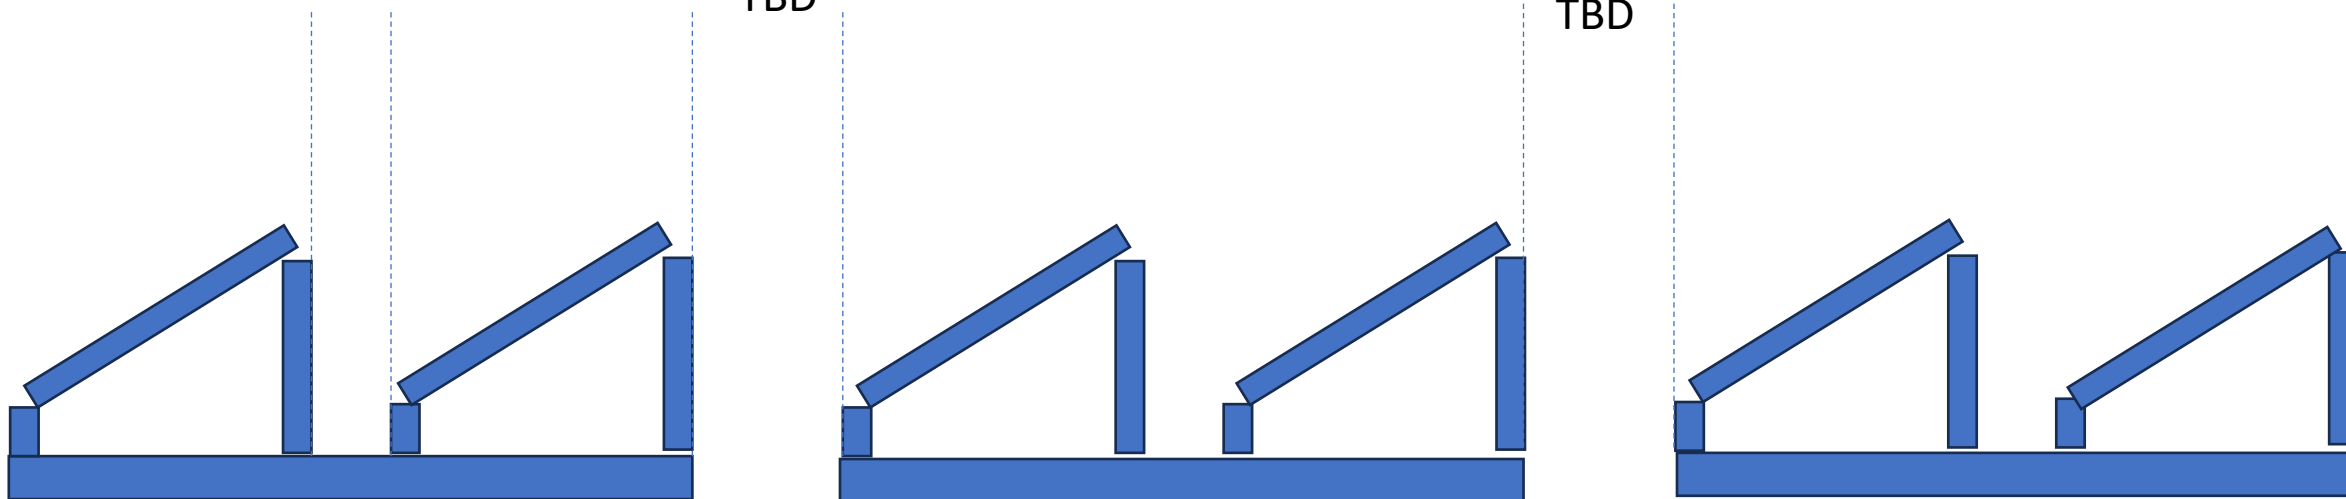


L Clamp Only here
Rest all are boxes

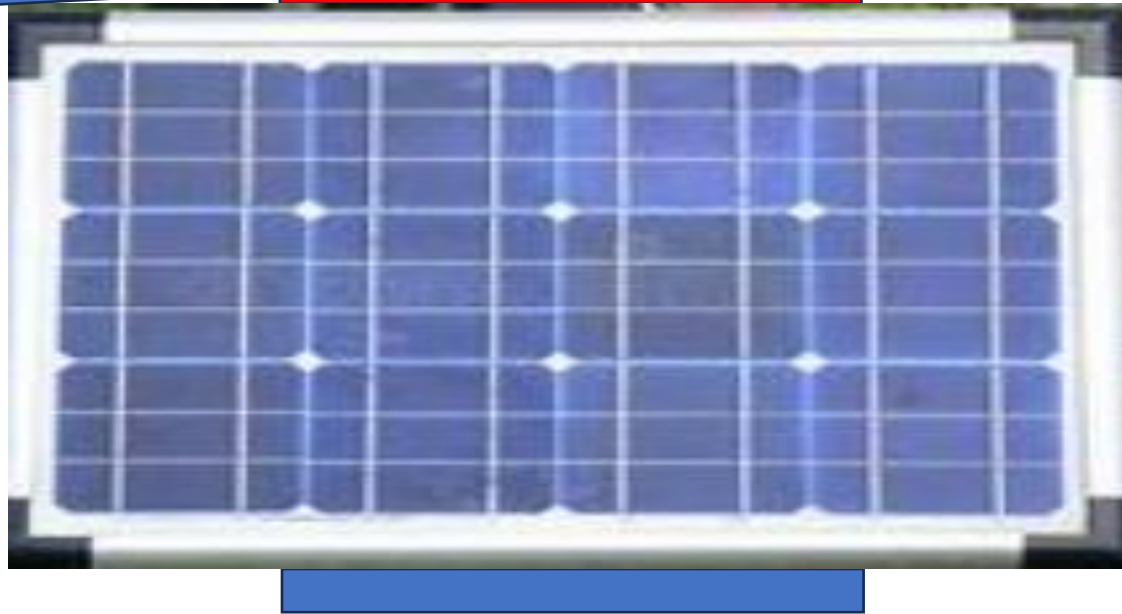

WEST

EAST

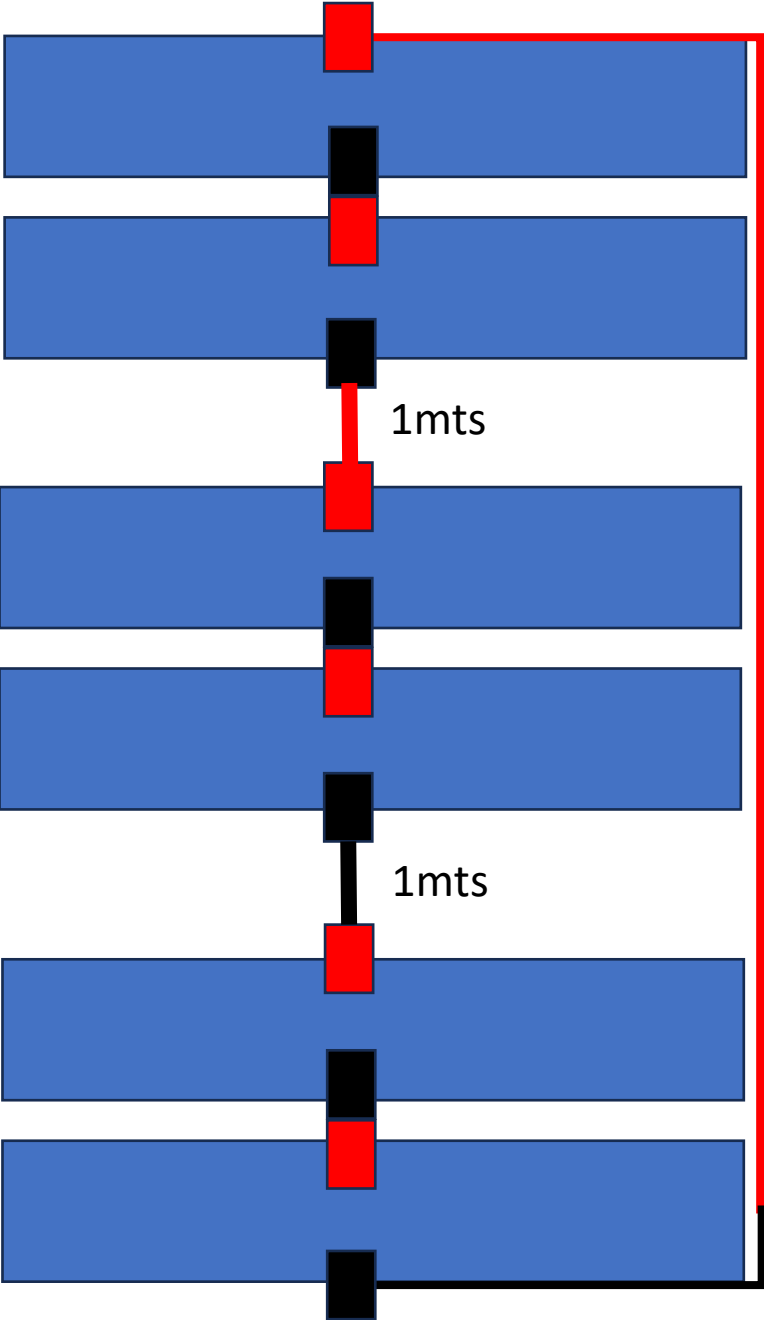

1mts

15mts


1mts

MPPT1


5mts

CIRCUIT
BREAKER
DC-PV


Power Room

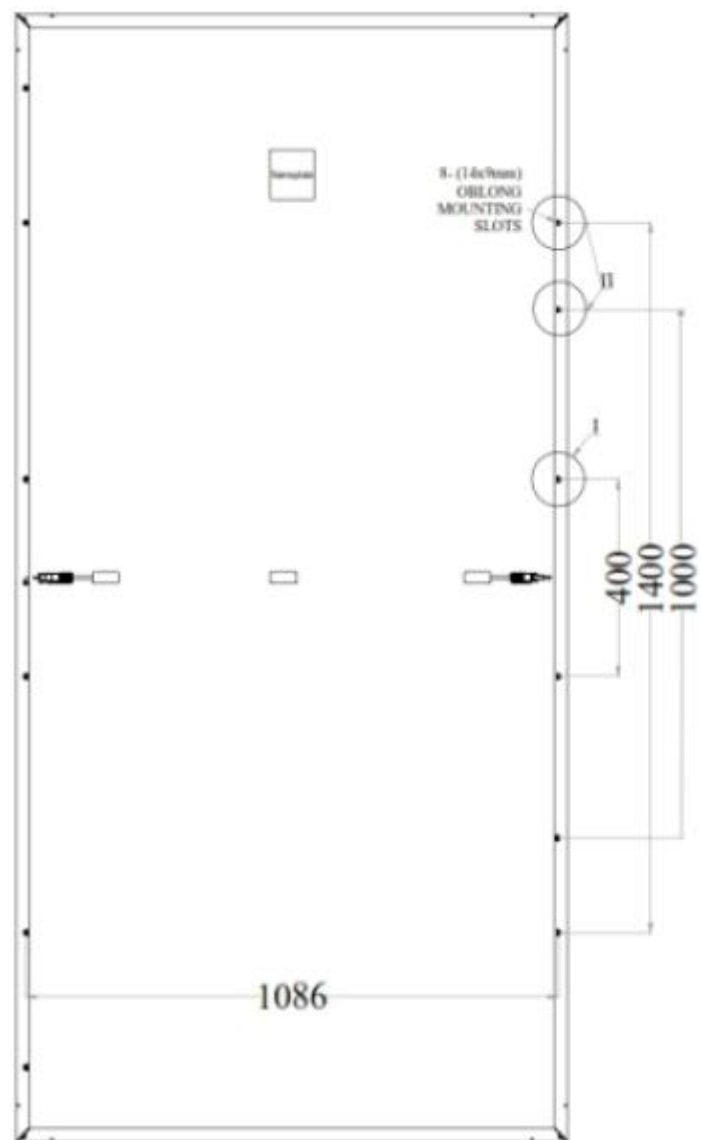

I




II


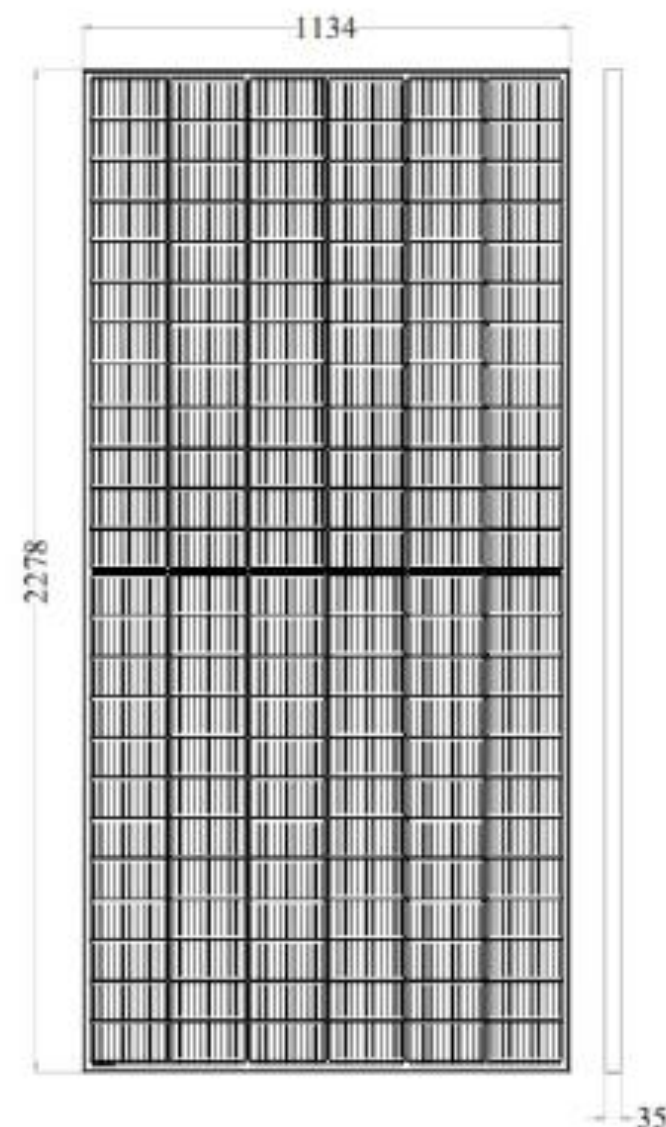


35

Monitoring System

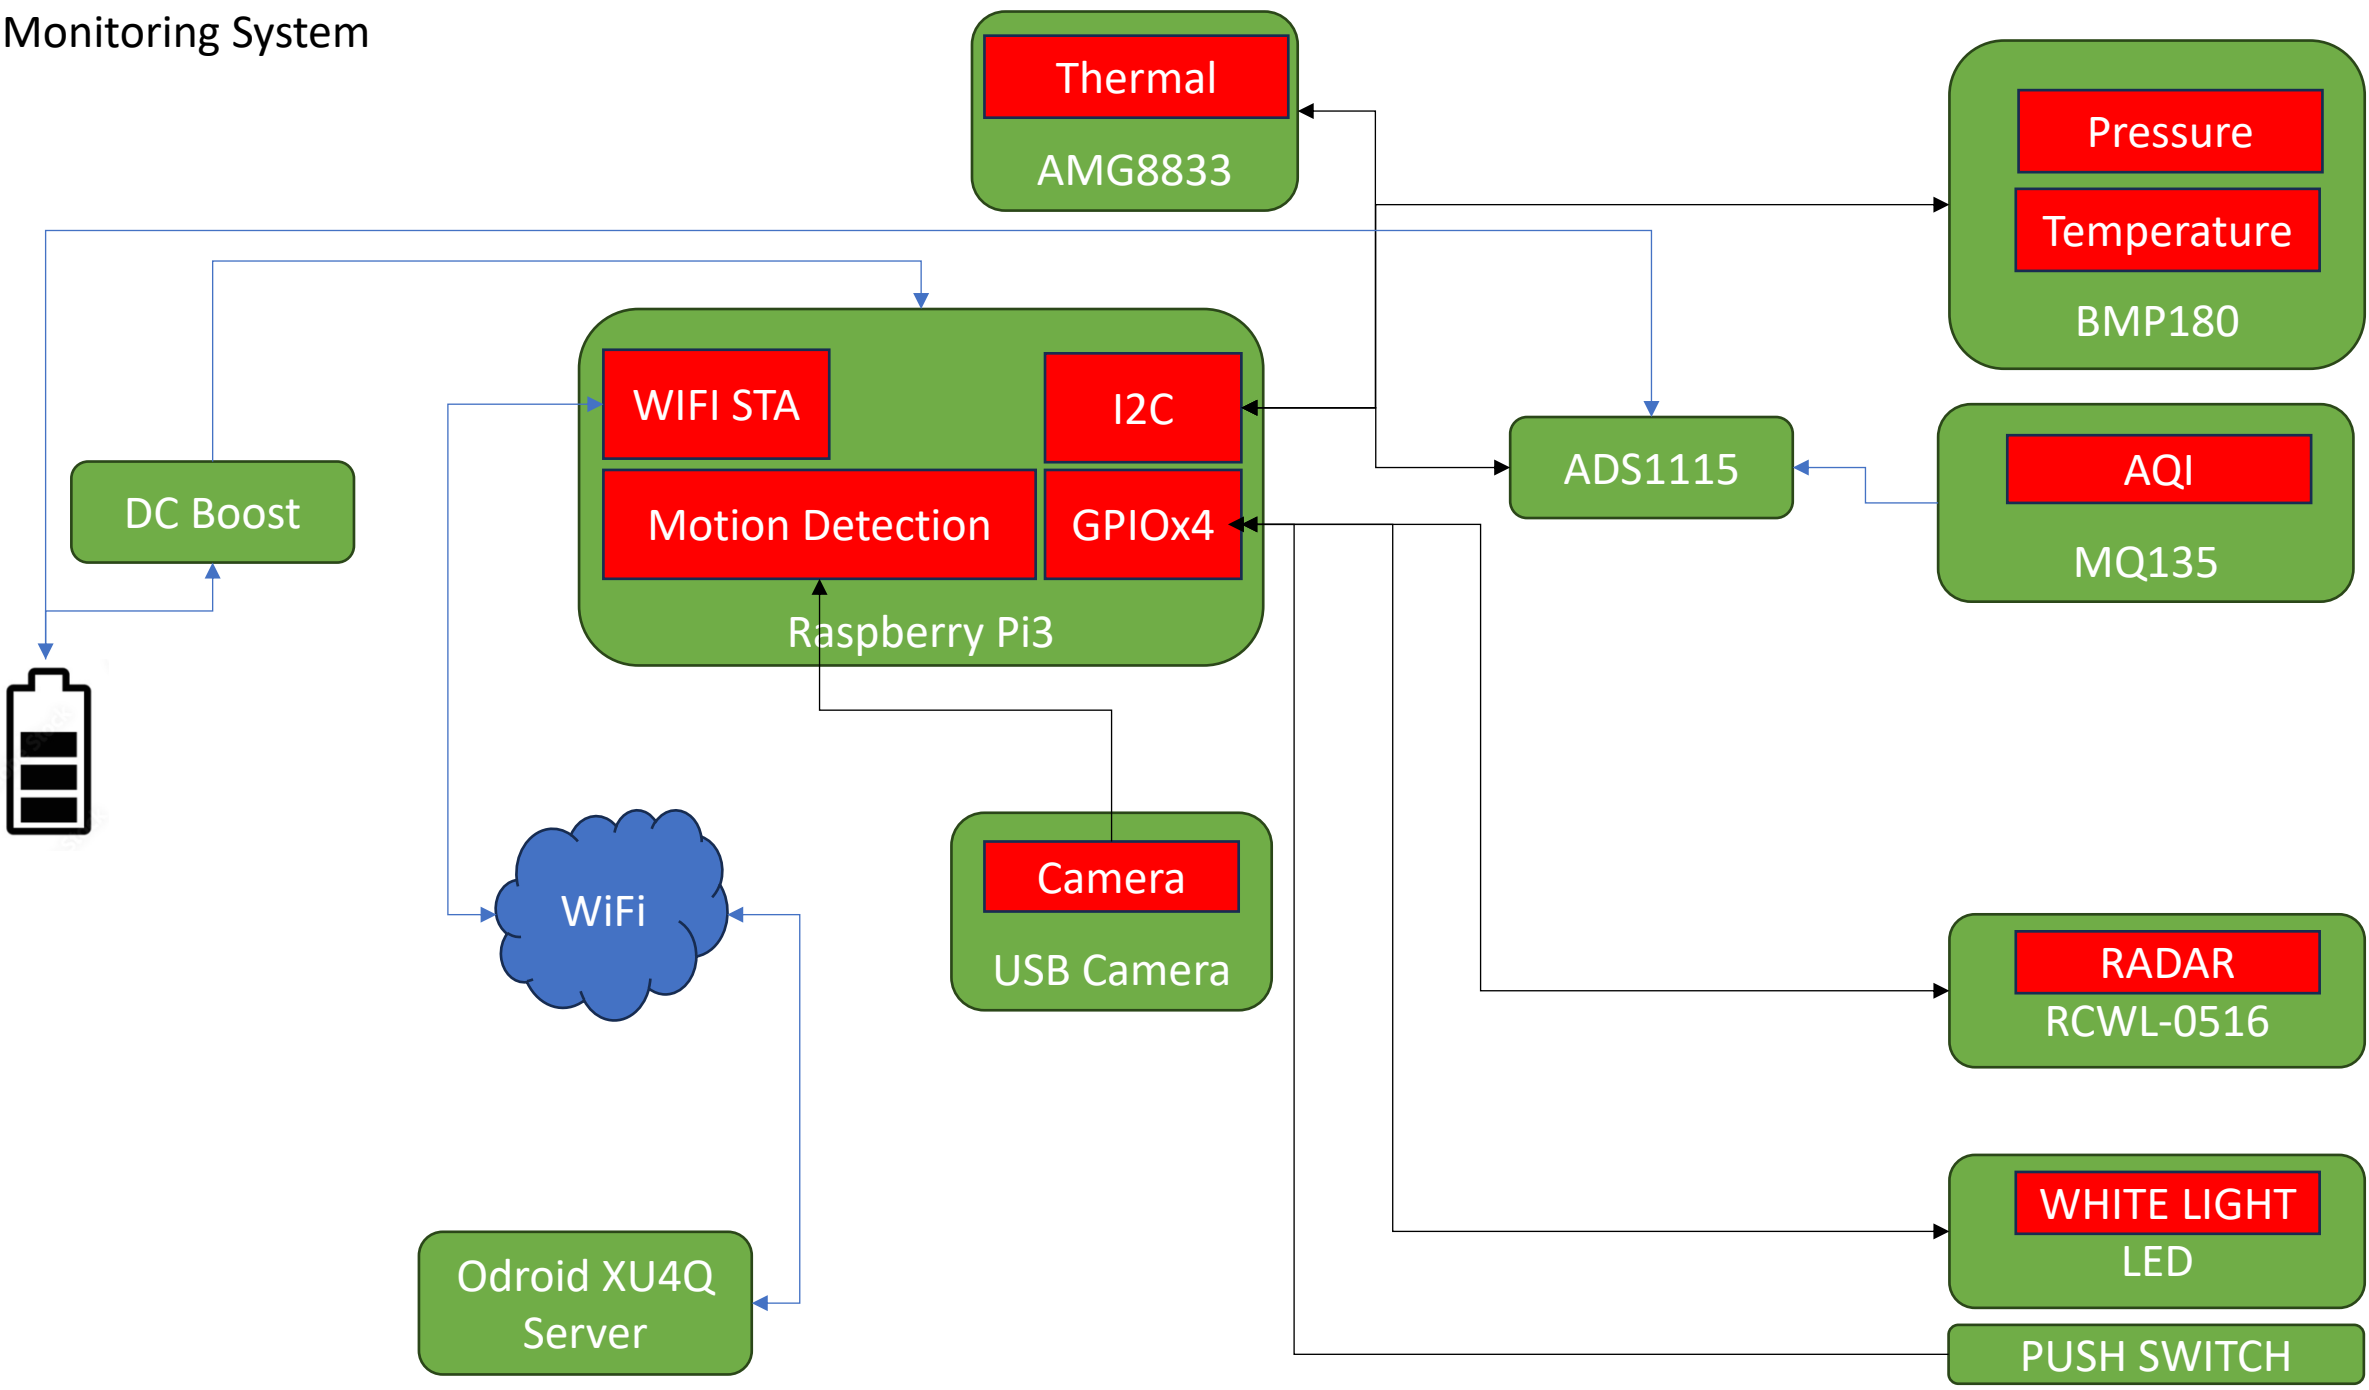

184355@1:5:19

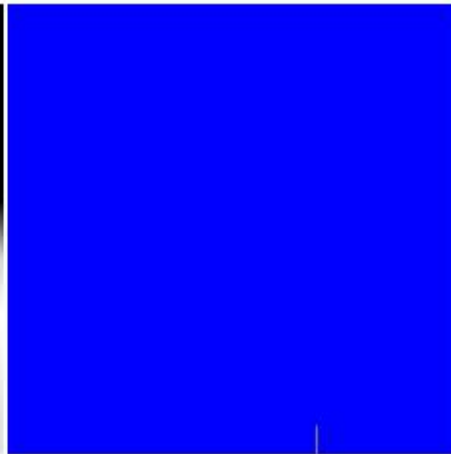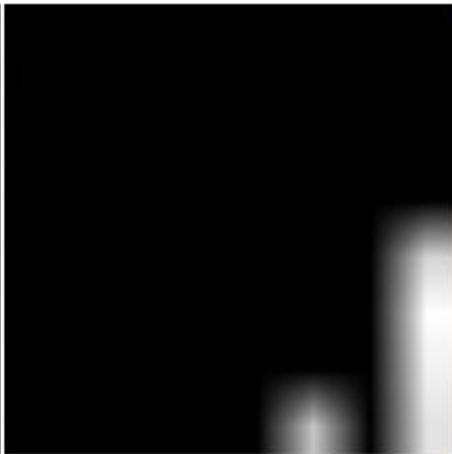

2025-08-18 18:43:55
[1]Days [5]Hours [14]Minutes

[Show Summary](#)

[Show Configuration](#)

Disk Usage



[Back to main page](#)

[Configurations](#)

DIR_MAX[1-255]	<input type="text" value="7"/>
IP Address	<input type="text" value="192.168.1.4"/>
Serial Number	<input type="text" value="3141237744"/>
ACCESS	<input type="text" value="admin"/>
Reboot	<input type="button" value="No"/>
WLED	<input type="button" value="OFF"/>
MASK	<input type="button" value="Add"/>

[MASKS](#)

ID	7	X 0	Y 330	W 30	H 30
ID	9	X 300	Y 190	W 60	H 170
ID	10	X 0	Y 0	W 70	H 310

ID	<input type="text"/>
X	<input type="text"/>
Y	<input type="text"/>
W	<input type="text"/>
H	<input type="text"/>
<input type="button" value="Submit"/>	

