


BARCO Unisee 2x (6x4) VIDEOWALL **RACK LAYOUT FOR BARCO EQUIPMENT**

RACK (1) 42U

(ATI)

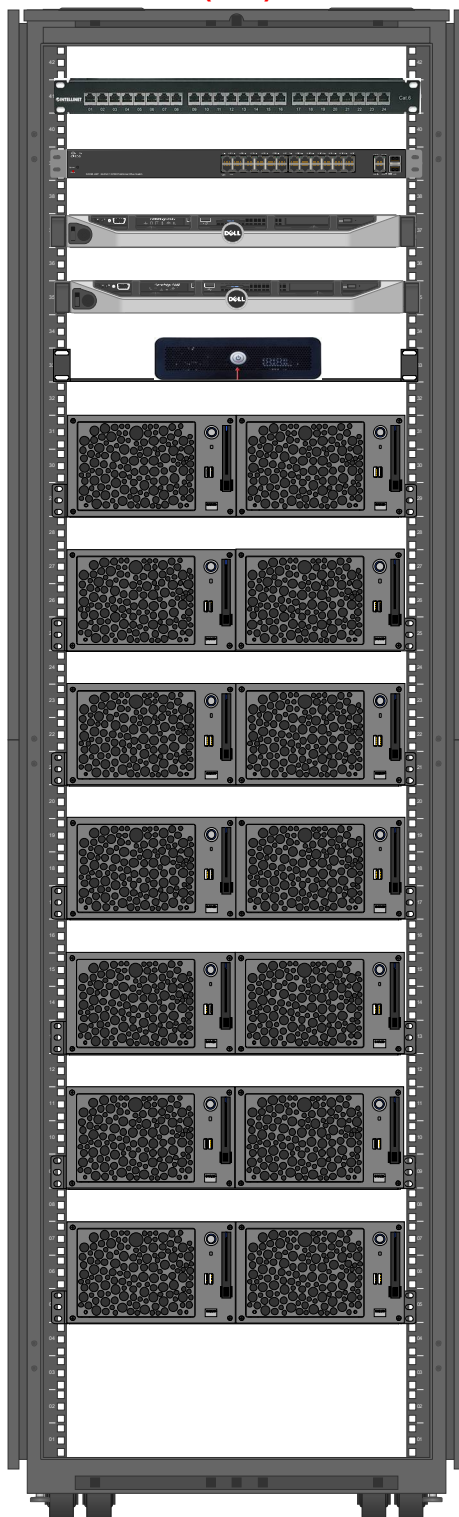

(ATI)

19 Power points in pdu

17 Network points in switch

Patch panel (ATI)

48ports Network Switch (ATI)

Barco CMS server 1 & 2

(1 Lan, 2 pw) each

NSD-110 Monitoring server

(2 Lan, 1 pw)

NDN-220 Lite (1&2) Left 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (3&4) Left 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (5&6) Left 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (7&8) Right 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (9&10) Right 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (11&12) Right 6x4 unisee

(4x 50m DP to V.W, 1 Lan, 1 pw) each

NDN-220 Lite (13&14) Left & Right back up

(4x 50m HDMI to V.W left& right, 1 Lan, 1 pw) each

Project ATI - Egypt sport city - COC Room

Description Barco Rack Layout

Id.-Nr. Rev00

ITV-PRS-R-Drawing Schematics V3.0

Date 26 Sept. 2021

Drawn M.Hamid

Scale NTS

Sheet 1/1

