

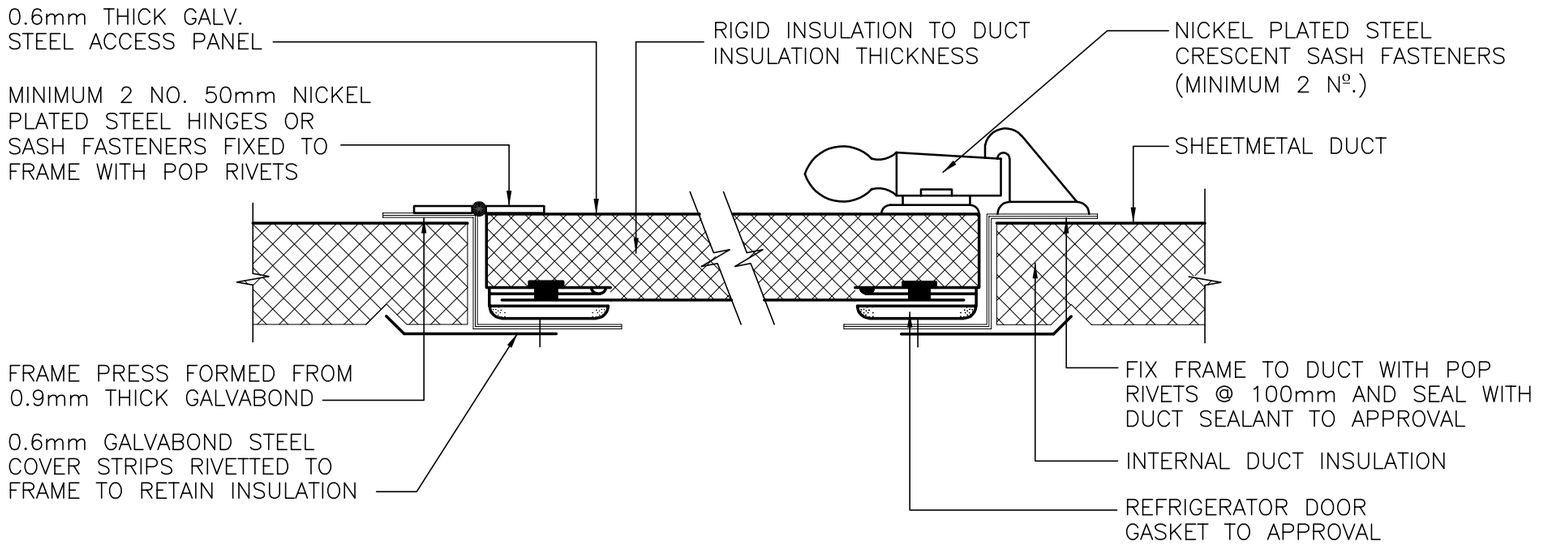


INTERNALLY INSULATED DUCTWORK

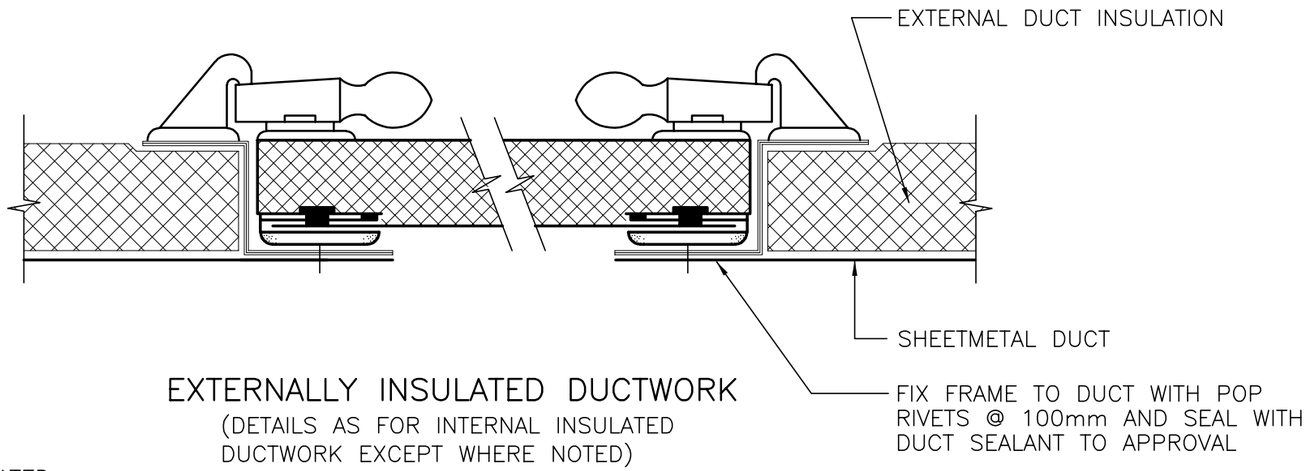

EXTERNALLY INSULATED DUCTWORK

(DETAILS AS FOR INTERNAL INSULATED
DUCTWORK EXCEPT WHERE NOTED)

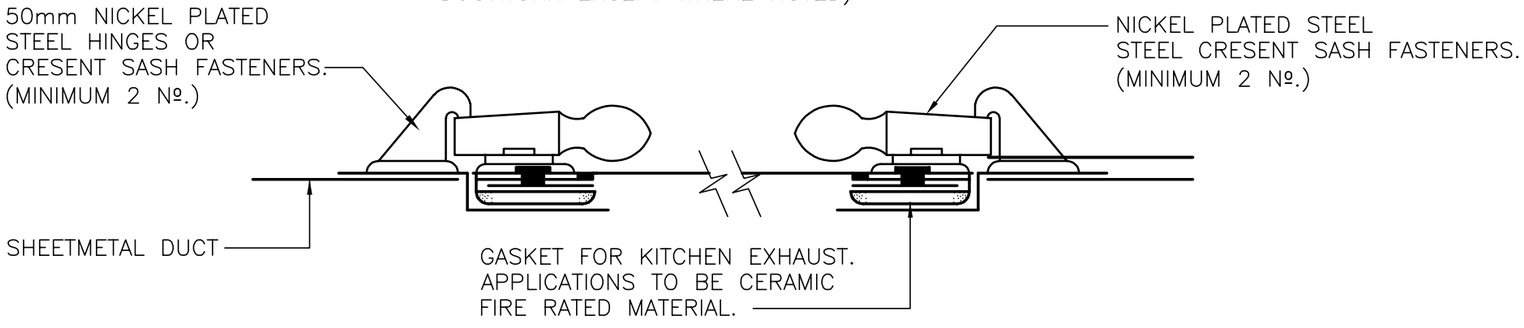

STANDARD DUCTWORK

(DETAILS AS FOR INTERNAL INSULATED
DUCTWORK EXCEPT WHERE NOTED)

NOTE:

1. GENERAL INSPECTION OPENINGS SHALL HAVE A MIN. 225x225 FREE AREA.
2. MANHOLE OPENINGS SHALL HAVE A MIN. 550x375 FREE AREA.
3. ALL OTHER SIZES TO APPROVAL.

REV.	REVISION DESCRIPTION		DATE
A	PRELIMINARY	A.S.	23/04/2018

AWP PROJECTS

Title
DUCTWORK ACCESS
PANELS

Drawn	Date	File
G.K.	23/04/2018	AWP TITLE BLOCK.dwg
Checked	Date	Approved Date
Scale N.T.S		Plotted Date 24/04/2018

Drawing Number
AWP-M-04

Revision
A