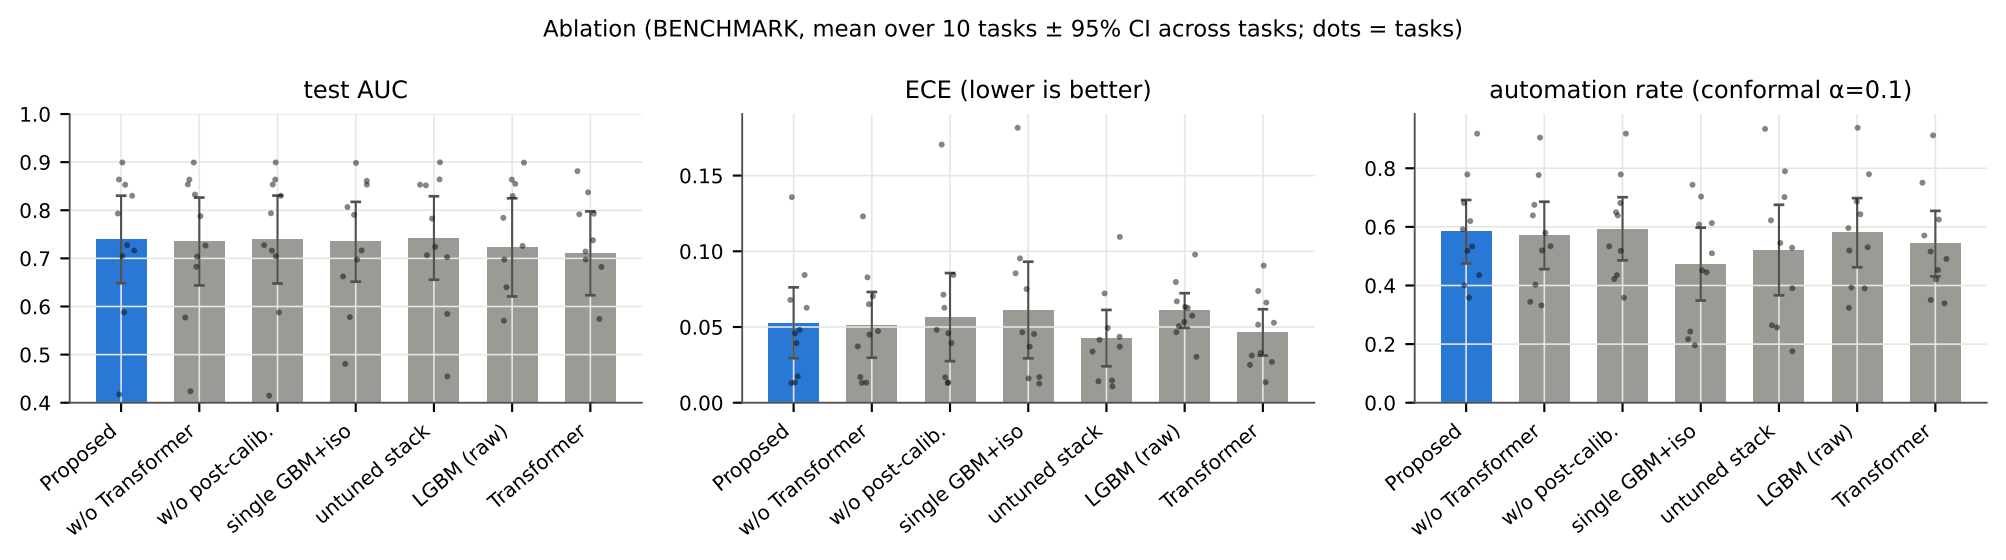
Ablation (BENCHMARK, mean over 10 tasks ± 95% CI across tasks; dots = tasks)
test AUC
ECE (lower is better)
automation rate (conformal α=0.1)
Proposed
w/o Transformer
w/o post-calib.
single GBM+iso
untuned stack
LGBM (raw)
Transformer