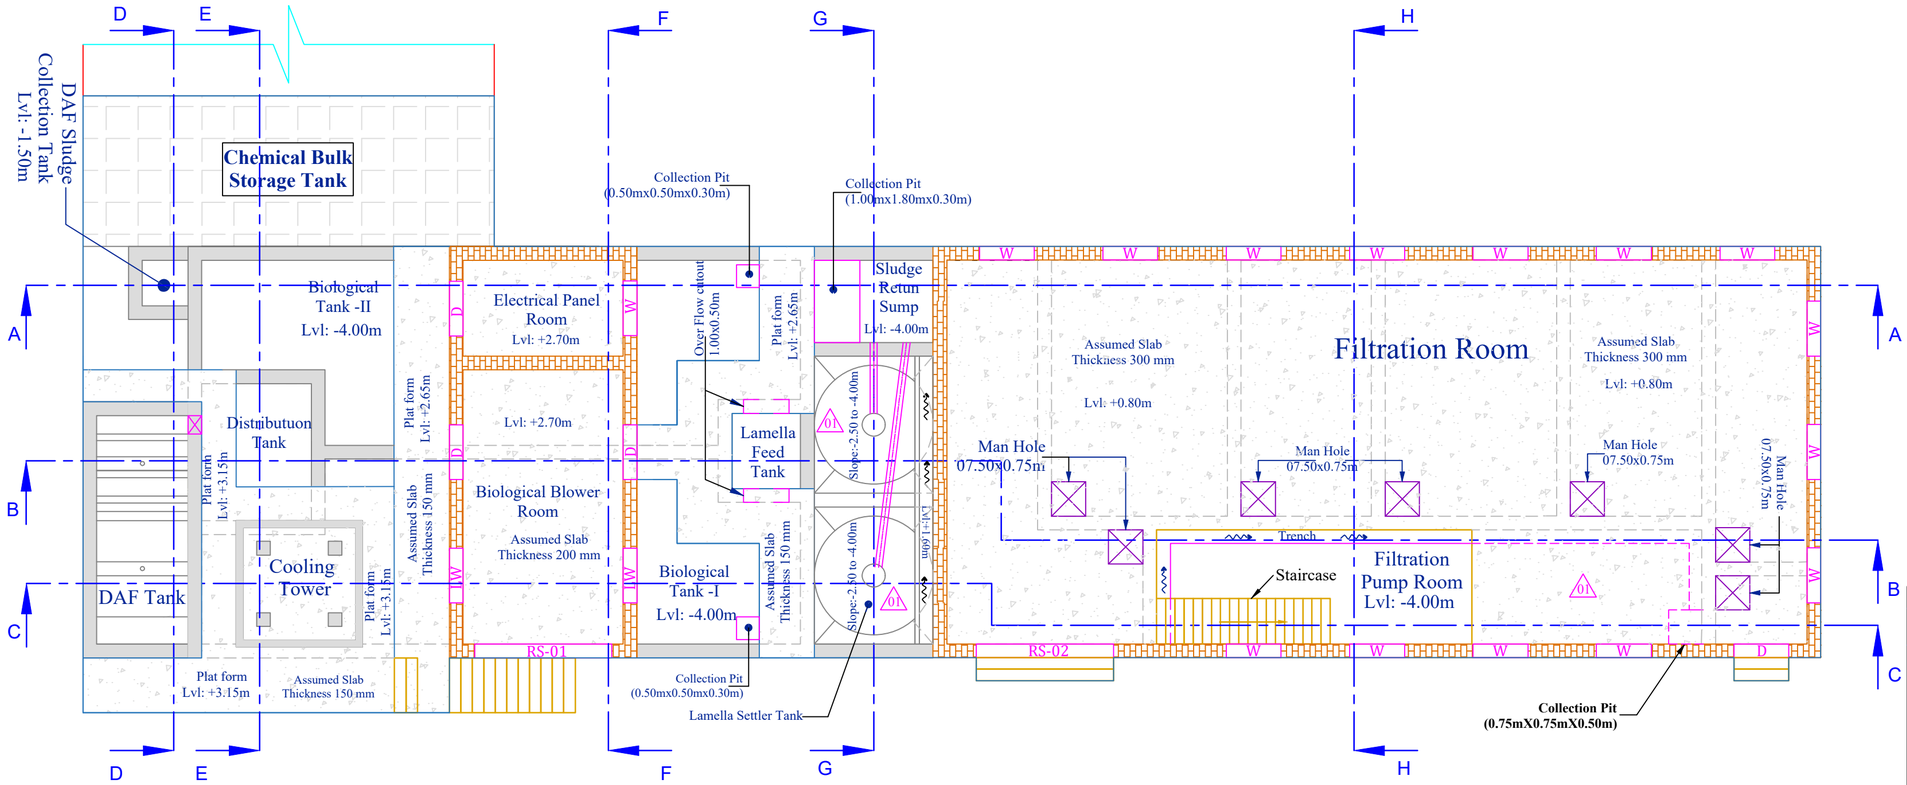

S No	Description	Size	MOC	STD	PN_CLS_SCH	Type	Qty
01	Pipe	DN125	HDPE	ASME	PE 100 -PN06	Plain	7.50m (Approx)

Note:
- HDPE Pipe -Customer Scope

PAY YOUR ATTENTION

1. The wall / slab thickness shown in the layout drawing is tentative only. Final wall thickness and layout of staircase shall be fix as per civil design.
2. All dimensions are in 'Meter' & Elevation levels are in 'Meter'.
3. Rungs shall be provided in all tanks for tank maintenance.
4. Handrails needed to be provided for all the staircase & walkways.
5. Client shall provide Air blower room with ACOUSTIC arrangements for noise cancellation & insulation.
6. Acid proof brick & tile should be used in chemical dosing area.

S.no	Date	Revision Description	By	Verified
01	31-03-2026	The lamella settler tank slope shape has been changed from a rectangular conical bottom tank to a circular conical bottom tank. The filtration room slab area has been increased. Lamella settler tank sludge HDPE pipe details have been added.	GK	SVN

Revision Details

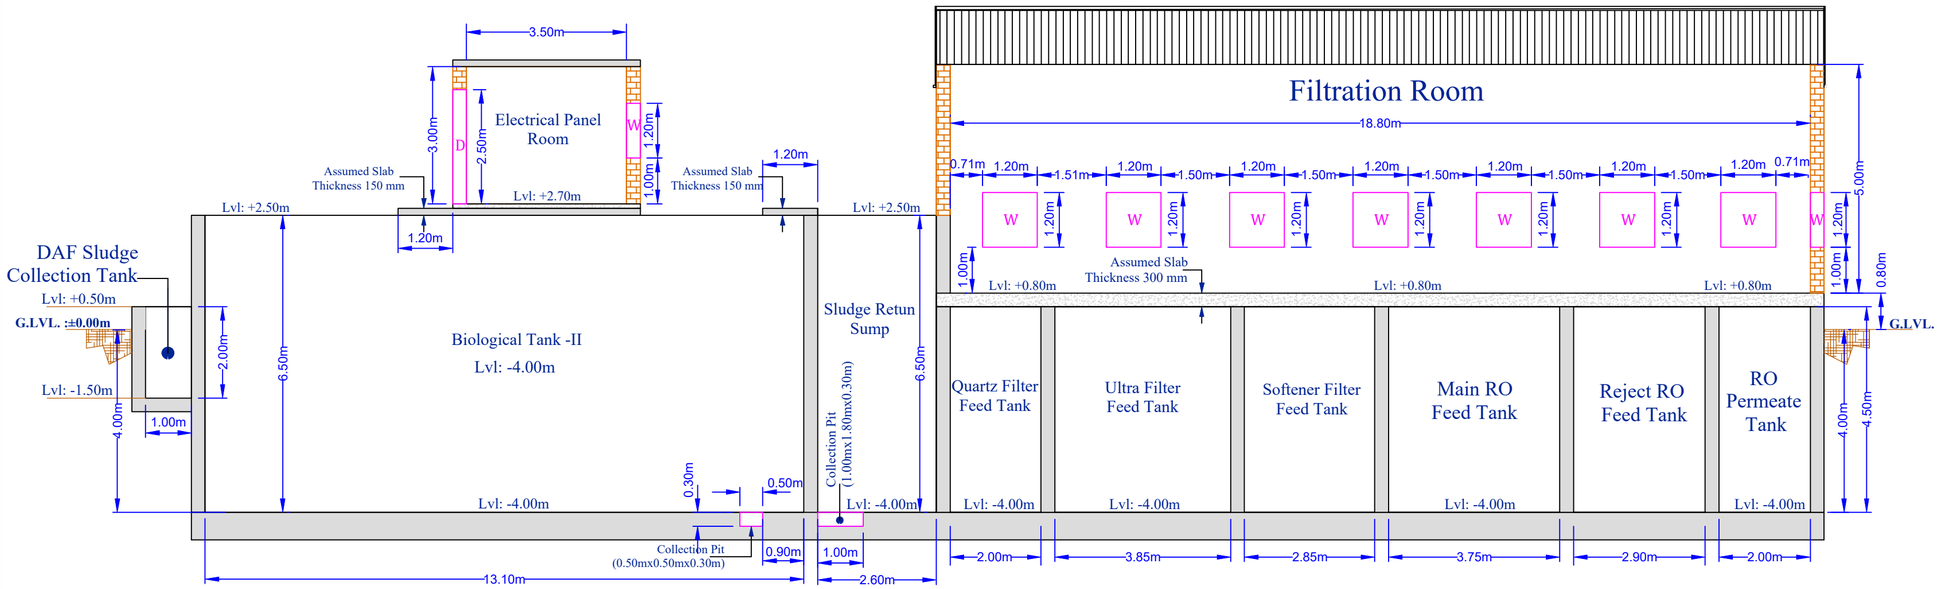

Section View- A-A

Pretreatment System :
Tank Height : 06 SWD + 0.5 FB
Below Ground Tank level :-4.0m
Above Ground Tank level :+2.50m

Filtration System :
Tank Height : 04 SWD + 0.5 FB
Below Ground Tank level :-4.00m
Above Ground Tank level :+0.50m
Filtration Room Height : 5m (Above ground level: +5.80m)

Effluent Water Inlet : 200 m3/day

All Dimensions are in Meters

NAME	: M/s GUETERMANN INDIA PVT LTD	NATIONALITY	
TYPE OF INDUSTRY	: Effluent Treatment Plant	INDIA	
DESCRIPTION	: Detailed Drawing	PROJECT NO	
DATE	31-03-2026	FORMAT	A3
SHEET	01 OF 03	DRAWING NO	WTT-0871
SCALE	–		
			WTT-0871-C100B-REV01
DRAWN	GK		
CHECKED	SVN		
APPROVED	DV		
REV NO	01		

WTT INTERNATIONAL PRIVATE LIMITED
3,College cross road,Avarangadu
Tirupur-641 602. Tamilnadu.
PH: +91 4212247770
E-mail: enquiry@wttint.com
Web: www.wttint.com

THIS DRAWING IS EXCLUSIVE PROPERTY OF WTT INTERNATIONAL PVT LTD. ANY REPRODUCTION WITHOUT THE EXPRESS WRITTEN CONSENT OF WTT INTERNATIONAL PVT LTD. IS PROHIBITED.