
Corvane Bank plc
Sustainability-Linked Loans, Agency
15 January 2027

## Pellow House missed its 2026 emissions target: 18.5 kg CO2e per square metre against 17.6

We enclose the 2026 KPI report for Pellow House under Schedule 9 of the facility agreement. The base building used 1,914 MWh of electricity in 2026, which at the schedule's factor is 396.3 tonnes of CO2e, or 18.5 kg CO2e per square metre of net lettable area. That is 0.9 kg over the 2026 target of 17.6 kg, so under paragraph 3.1 the margin steps up by 2.5 basis points for 2027.

The base building figure is the import through the revenue meter less the electricity supplied to the tenancies, each supply counted once. Four of the building management system's tenant meters (two comms rooms, a server room and a staff kitchen) sit inside their occupiers' own supply meters, so they are already within the tenancy supplies and are not taken off a second time. The second supplies three occupiers take on their own tap-offs, and the roof licensee's room, are supplies of their own and are taken off.

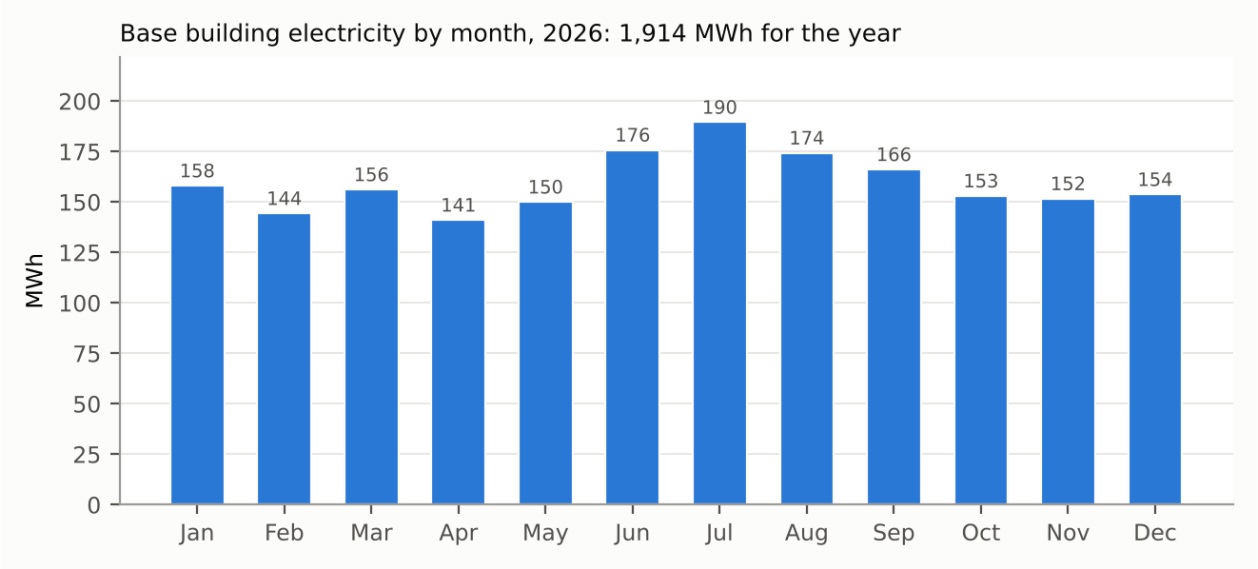


| Line | 2026 |
|---|---|
| Base building electricity | 1,914 MWh |
| Base building Scope 2 emissions | 396.3 t CO2e |
| KPI against target | 18.5 against 17.6 kg CO2e per m2 |
| Standby generator gas oil | 1,658 litres, 4,409 kg CO2e |
| Chiller refrigerant (R-134a) | 66.8 kg, 95,524 kg CO2e |

Source: the supplier's half-hourly data for MPAN 1600004417286 and the building management system's meter registers; quarters and months on the building's local clock. The months and the year are each rounded from unrounded kWh, so the monthly bars may not add exactly to the year. The Scope 1 detail is in the enclosed workbook.

Alice Evans
Head of Sustainability, Wexmoor Office Trust