CALDER COUNTY PUBLIC UTILITY DISTRICT NO. 1

Sign Juniper Draw, Kessling Creek and Ashby Gulch: 990 MW of the 1,000 MW baseload need

To: Board of Commissioners
From: Adrian Dunn, Manager, Resource Planning
Through: Victor Carr, General Manager
Date: 6 November 2026
Re: Emissions performance determination under RP-7 Section 5, 2026 Baseload Request for Offers

Seven of the ten plants offered emit at or under the state standard of 925 pounds of carbon dioxide per net megawatt-hour under their offered commitments. Taken in order of capacity price, each offer whole, passing over any that would take the District above its 1,000 MW need (request for offers 5.2), they fill 990 MW: Juniper Draw (500 MW at $11.55 per kW-month), Kessling Creek (245 MW at $12.10) and Ashby Gulch (245 MW at $12.40). Sorrel Butte, second by price, is passed over: with Juniper Draw it would make 1,030 MW. Tamarack Landing, Coldbrook and Brenmoor Mill emit more than 925 pounds under their offers and cannot be signed.

Offer	Plant	Contract Capacity (MW)	Capacity price ($/kW-mo)	lb CO2 per net MWh	Complies	Signed
BL26-01	Tamarack Landing	630	11.40	971	No	
BL26-02	Juniper Draw	500	11.55	890	Yes	Yes
BL26-03	Sorrel Butte	530	11.80	892	Yes	
BL26-04	Coldbrook	415	10.40	982	No	
BL26-05	Moraine Point	275	12.25	876	Yes	
BL26-06	Ochre Flat	315	16.20	791	Yes	
BL26-07	Lindgren Hill	265	13.10	876	Yes	
BL26-08	Ashby Gulch	245	12.40	885	Yes	Yes
BL26-09	Kessling Creek	245	12.10	884	Yes	Yes
BL26-10	Brenmoor Mill	170	9.80	1,064	No	

Source: EPA Clean Air Markets Program Data, hourly emissions for 2024 and 2025 (downloaded 6 October 2026); respondents' revenue-meter data; offers received to 30 September 2026; District analysis. Rates are compared with the standard unrounded (RP-7 5.4) and shown to the nearest pound.

Kessling Creek and Ashby Gulch left the EIA plant code blank on their offers; each was matched to its plant by name and county in Form EIA-860. Moraine Point's monitored unit reports as CT-1 to 30 June 2025 and as 1A after its data acquisition system was replaced; both are counted.

How the need was filled

The complying offers in order of capacity price: Juniper Draw, 500 MW at $11.55: taken, 500 MW; Sorrel Butte, 530 MW at $11.80: passed over, it would make 1,030 MW; Kessling Creek, 245 MW at $12.10: taken, 745 MW; Moraine Point, 275 MW at $12.25: passed over, it would make 1,020 MW; Ashby Gulch, 245 MW at $12.40: taken, 990 MW; Lindgren Hill, 265 MW at $13.10: passed over, it would make 1,255 MW; Ochre Flat, 315 MW at $16.20: passed over, it would make 1,305 MW.

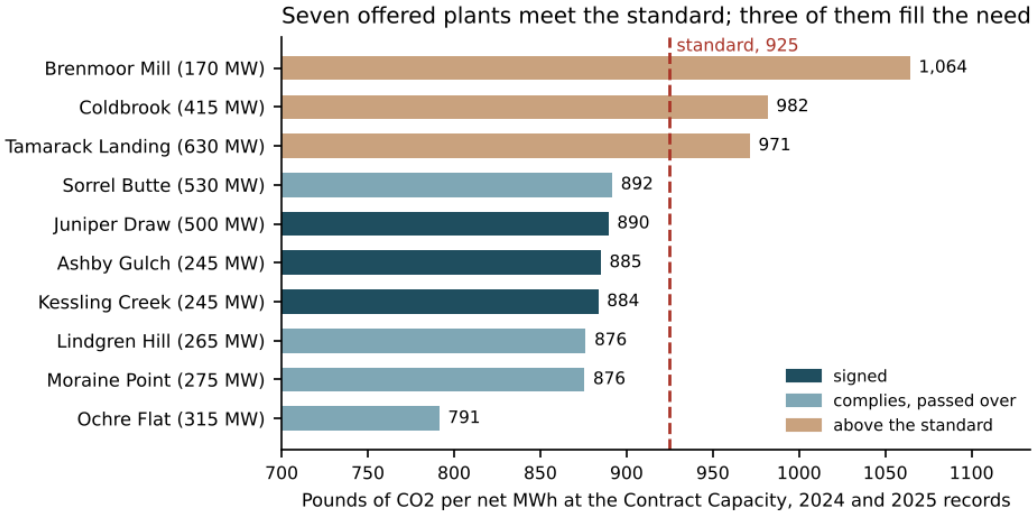


Figure 1. Each offered plant's carbon dioxide per net megawatt-hour at its Contract Capacity against the 925-pound standard; the plants signed darkest, the complying offers passed over lighter.

How the rates were determined

Each agreement has the plant deliver its Contract Capacity in every hour of the delivery term, and the plant may sell to no one else (request for offers 3.2); RP-7 5.2 rates a plant on the carbon dioxide it emits per net megawatt-hour it delivers under the commitment. A combined cycle's carbon dioxide per megawatt-hour depends on the output it runs at: part load and the hours after a start burn more fuel for each megawatt-hour, and duct burners add output at a far higher heat rate than the turbines. Each plant's rate was therefore read at its Contract Capacity, as EPA's hourly carbon dioxide over the revenue meter's net generation in the 2024 and 2025 hours in which the meter shows the plant delivering its Contract Capacity (within 2 per cent, every monitored unit operating the full hour): 294 to 1,020 hours a plant. A window of 1, 3 or 5 per cent, 2025 alone, or a curve fitted to each plant's hourly records leaves every plant on the same side of the standard.

The plants' 2025 annual averages would give a different list. Sorrel Butte, Ashby Gulch and Kessling Creek cycled through 2025, starting most days and running much of the time at part load, and averaged 986 to 998 pounds for the year; at their Contract Capacities they emit 884 to 892. Tamarack Landing averaged 902 pounds in 2025, running mostly at its unfired base load, but its 630 MW Contract Capacity is more than its turbines make without the duct burners in any season, so it fires them in every contract hour and emits 971. On the averages the fill would take Tamarack Landing and Moraine Point, 905 MW.

Availability and the records behind the rates

The workbook also gives each plant's 2025 forced outages from its GADS records, counting the hours the whole plant was out (every combustion turbine out on a forced event; a single turbine or a steam turbine the turbines can bypass leaves the plant running) from each unit's latest entry for an outage, since three first estimates of return to service ran past hours in which EPA's records show the plant running, and the 2025 hours in which a monitored unit's heat input, and with it the carbon dioxide EPA calculates from it, came from substitute data. Ochre Flat had the most forced outage hours (193 in 5 outages).

Adrian Dunn
Manager, Resource Planning