Delmont Power and Light, Engineering

To: Utility Director

From: Dustin Jones, Engineering Manager

Date: November 10, 2026

Subject: 2027 revenue protection sweep and 2027 technical losses


Sweep CHL-2, APT-4, NTH-4 and CHL-3 in 2027. They carried 1,310, 1,122, 700 and 699 MWh of non-technical loss in the twelve months to September 2026; the next feeder, NTH-3, carried 503.

APT-3 and NTH-3 look like candidates on a raw residual and are not. APT-3's excess is its own network losses: with the cold store and the grow at the end of the feeder its lines and transformers lost 1,787 MWh, where the 2019 study's 4.78 per cent of its energy gives 833. NTH-3 looks high only if every customer is kept on today's feeder; the switching log moved one of its laterals to NTH-4 on April 21.

CHL-3 belongs on the list even though its breaker metering was down through the January ice storm, when it was also carrying CHL-2's customers. Its energy in for the year is 12,233 MWh, rebuilt for those hours from the Cherry Hill delivery point.

Line loss rose from 7.74 to 8.24 per cent between the twelve months to September 2024 and to September 2026. Technical losses account for 0.44 points of the rise and non-technical losses for 0.30; the lights, billing timing and the substations take 0.24 points off.

For the 2027 budget, technical losses come to 13,455 MWh on the fourteen feeders, including 1,721 MWh on APT-4 once the Flint Ridge grow connects in May. The three approved connections will add 522, 931 and 541 kW at their peaks, well under what they applied for.

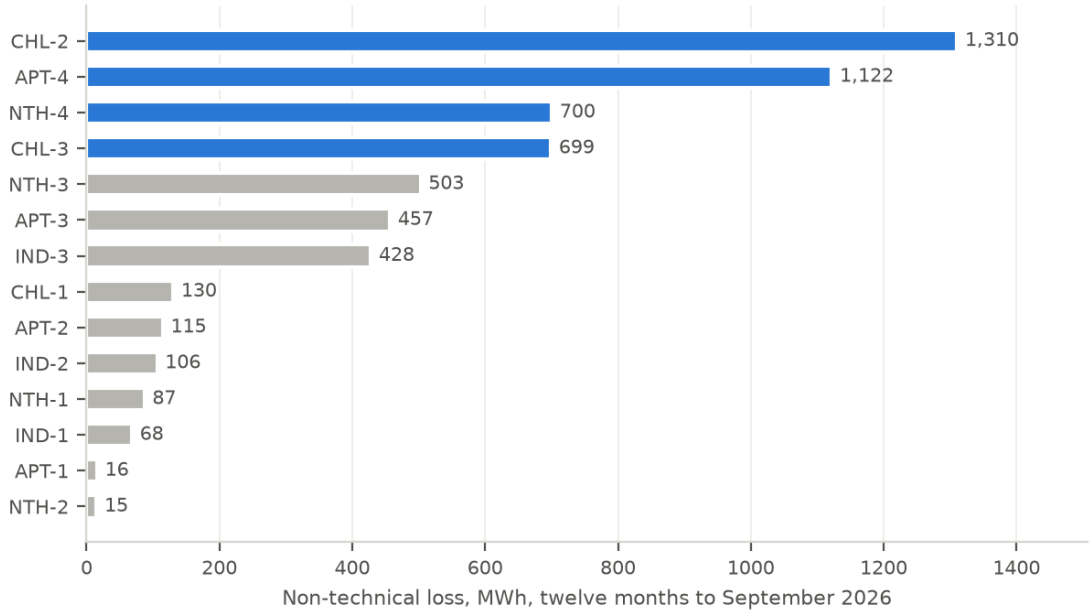

Non-technical loss by feeder as RFP 2026-14 scope A.3 defines it, the four to sweep in blue. Monthly detail in the feeder energy balance workbook.