

Comprehensive Solar PV System Design and Performance Analysis for Los Angeles, CA

Q-1 Choose a site location within the continental US to focus on for this project. For your chosen location report the city and state, latitude and longitude coordinates in decimal degrees to the nearest 0.01, lowest historical temperature on record, average high temperature for the hottest month (all temperatures should be in °C). The site weather.com offers good historical weather data for locations under the "monthly" tab.

Choose a roof mounted system size target between 2 and 10 kW to the nearest 0.1 kW. Choose a roof azimuth angle that deviates from due south by 6 to 15 degrees in either direction, and select one of the standard roof pitches below to use for all your system calculations. and other relevant items from the basic installer checklist. Use PV Watts to calculate and report the total annual hours of full sun at your location under the site conditions. Use the default PV Watts values for all other sections in the calculator.

Report the chosen system size (nameplate rating in kW), system azimuth angle, and system tilt, along with the calculated annual hours of full sun for this system setup at this location from PV Watts.

Roof pitch Roof Tilt in Degrees

4/12	18.43°
6/12	26.57°
8/12	33.69°
10/12	39.81°
12/12	45°

Ans-



- State - California
- City - Los Angeles
- Latitude, Longitude: 34.05°C, -118.26°C
- Lowest historical temperature on record - 12°C
- Average high temperature for the hottest month - 29°C
- Standard Roof mounted System size - 8KW
- Azimuthal angle - 10° from due south
- Tilt angle- 26.57°
- System output - 13489 kWh/year
- Calculated Annual hours of full sun - 2234 hour


Q-2 Select the solar pathfinder sheet below appropriate for use at your chosen location. The latitude range is included in the file name. Calculate percent of sunlight lost in each month with shading based on that solar pathfinder diagram.

Create a table or spreadsheet with the following columns of information and calculations:

- Month= Include a row for each month starting in January, include an additional row at the bottom labelled Annual.
- Days= The number of the days in the month (or year in the Annual row).
- Daily solar radiation= The average daily solar radiation for each month from the PV Watts output for your particular location and system specs.
- Monthly solar radiation= The total solar radiation received each month (kWh/m² or full sun hours), and include the annual total in the last row.
- Shading= The portion of sunlight lost each month due to shading based on the solar pathfinder sheet, report as the decimal value rather than a percent. Use 0 for months that don't have any shading.
- Solar loss= The amount of the monthly solar radiation lost to shading in that month. Include the total of all the monthly shading losses in the Annual row.

Finally, calculate the annual percentage of sunlight lost due to shading relative to the same setup without shading to the nearest 0.1%. Include your calculated annual shading loss somewhere below your table with a label of "Annual Shading Loss". Also be sure to include the name of your location, the location's latitude, and which solar pathfinder sheet you used somewhere nearby to your table. Attach your completed table as a pdf in a single document.

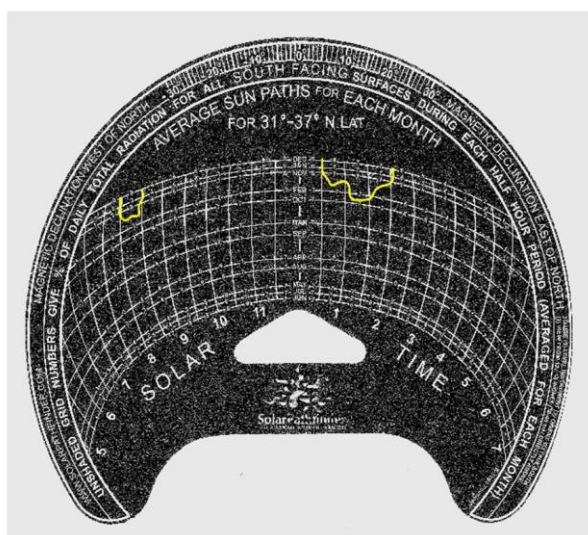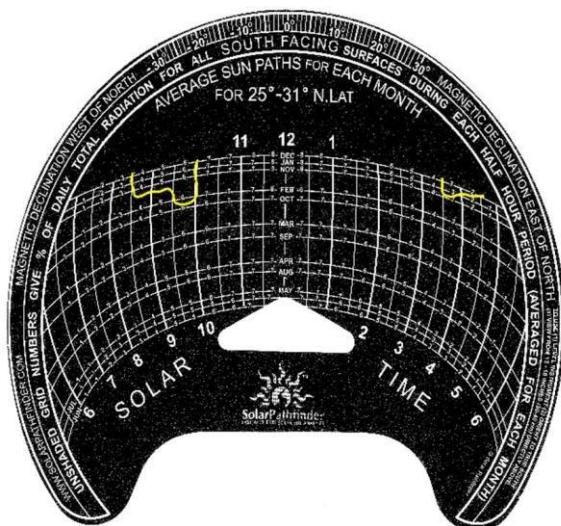

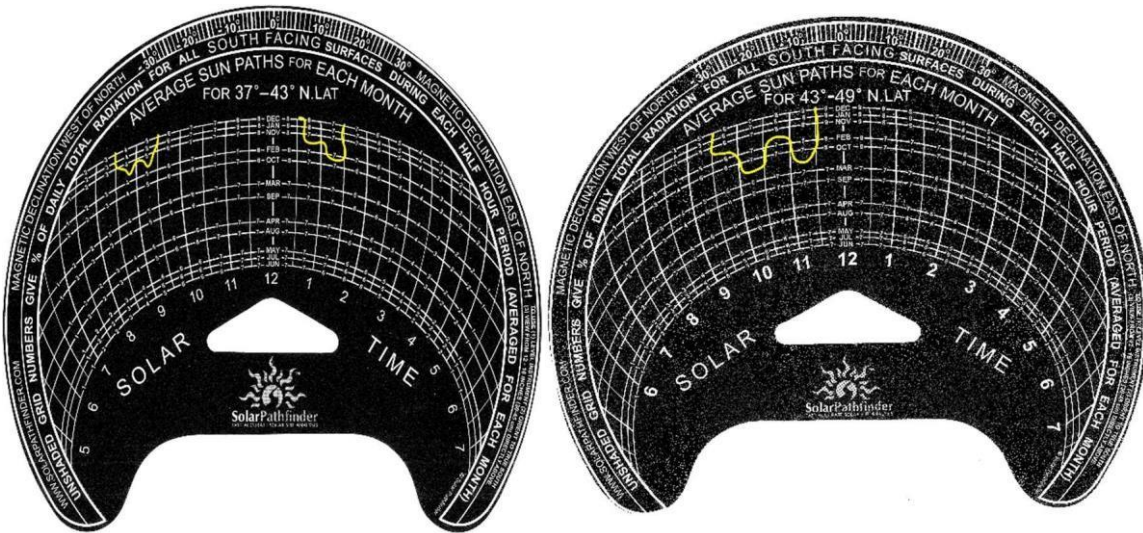

Ans-

Shading Analysis-

Location:	Los Angeles, CA	
Latitude:	34.05°N	Longitude: -118.26°W
Pathfinder sheet ID:	1	

Month	Days	Daily solar radiation	Monthly solar radiation	Shading %	Solar loss
January	31	4.76	147.56	0.18	26.5608
February	28	5.24	146.72	0.06	8.8032
March	31	6.02	186.62	0	0
April	30	6.79	203.7	0	0
May	31	6.4	198.4	0	0
June	30	6.99	209.7	0	0
July	31	7.24	224.44	0	0
August	31	7.47	231.57	0	0
September	30	6.85	205.5	0	0
October	31	5.98	185.38	0	0
November	30	5.31	159.3	0.15	23.895
December	31	4.37	135.47	0.2	27.094
Annual	365	6.12	2234.36	Annual Shading Loss	86.353



Q-3 Module Selection and Array Power

Choose a readily available polycrystalline PV module to construct your PV Array from among one manufacturer's linked below. You can choose any PV module but include the following key specifications in your response in the text box: the company and specific model name, a link to the module specification sheet (usually pdf), along with the module's Voc, Vmp, Isc, Imp, Pmax, and voltage- based temperature coefficient (often listed as Temp. Coefficient of Voc).

Module manufacturers

- SunPower (E-series)
- Trina Solar
- LG Solar
- First Solar (4 or 6 series)

Then, calculate the number of modules required to build a system as close to the target system size you chose in part 1. Calculate the actual system power nameplate rating in kW to the nearest 0.01 based on the PV module you have selected.

Inverter Selection

Next, identify a single matching inverter (not microinverter) that meets the input and output requirements for power and energy. Choose from the available manufacturers linked below. Include the following key specifications in your response: the company and inverter model name, a link to the inverter specification sheet, the number of series inputs, V input - max, Turn- on Voltage,

I input - max, P input - max, P output - max. Note that sometimes inverter specifications may be towards the end of Technical or Installation guide documents. If the selected inverter specs are located in a long document also include the page number where the spec sheet is located within the document next to the link to the document.

Inverter Manufacturers

- Fronius Primo
- SMA Sunny Boy
- SolarEdge single-phase

String sizing

Finally, determine the optimal configuration for connecting the panels of your array to the inverter. Be sure to include the number of strings connecting to the inverter, the number of modules connected together in series, and (if applicable) any parallel connections of modules or strings. For the connection(s) to the inverter, calculate the V_{mp} and I_{mp} of the string as it connects to the inverter, the I_{sc} of the string, and the cold and warm temperature voltages of concern for the string.

Make sure all your calculated connection specs will safely work with your selected inverter specifications. Always try to favor higher voltage over higher current if you have options.

Ans-

Module Selection and Array Power :-

Company- First Solar

Specific Model name- FS-6430, FS-6430A

firstsolar.com/-/media/First-Solar/Technical-Documents/Series-6-Datasheets/Series-6-Datasheet.ashx

$V_{oc} = 219.2 \text{ V}$

$V_{mp} \text{ (at } P_{max}) = 182.6 \text{ V}$

$I_{sc} = 2.54 \text{ A}$

$I_{mp} \text{ (at } P_{max}) = 2.36 \text{ A}$

$P_{max} = 430 \text{ W}$

Temperature coefficient of $V_{oc} = -0.28\%/^{\circ}\text{C}$

No. of module = $8000/430 = 18.6 = 18$

Actual system power nameplate = $18 \times 430 = 7.74 \text{ KW}$

Inverter Selection and Key Specification-

Company – SolarEdge

Model name = SE9KUS

knowledge-center.solaredge.com/sites/kc/files/se-three-phase-us-inverter-208V-setapp-datasheet.pdf

Number of Series inputs = 1

$V_{input_max} = 500 \text{ V}$

Turn-on Voltage = 200 V

$I_{input_max} = 2.65 \text{ A}$

$P_{input_max} = 12150 \text{ W} = 12.15 \text{ kW}$

$P_{output_max} = 9000 \text{ W} = 9 \text{ kW}$

String Sizing-

No. of strings connected to inverter = 10

No. of modules in Series = 2

$V_{mp} \text{ of the string} = 365.2 \text{ V}$

$I_{mp} \text{ of the string} = 23.6 \text{ A}$

$I_{sc} \text{ of the string} = 2.54 \text{ A}$

$V_{oc} \text{ at hot temperature} = 180.55 \text{ V}$

$V_{oc} \text{ at cold temperature} = 227.18 \text{ V}$

Net output DC from system = 8.6 kW

Net Output AC from inverter = 8.3 kW

New Output of annual adjusted system output = 13680 kWh/year

New adjusted table-

Location:	Los Angeles,CA	
Latitude:	34.05°C	Longitude: -118.26°C
Pathfinder sheet ID:	1	

Month	Days	Daily solar radiation	Monthly solar radiation	Shading %	Solar loss
January	31	4.76	147.56	0.18	26.5608
February	28	5.24	146.72	0.06	8.8032
March	31	6.02	186.62	0	0
April	30	6.79	203.7	0	0
May	31	6.4	198.4	0	0
June	30	6.99	209.7	0	0
July	31	7.24	224.44	0	0
August	31	7.47	231.57	0	0
September	30	6.85	205.5	0	0
October	31	5.98	185.38	0	0
November	30	5.31	159.3	0.15	23.895
December	31	4.37	135.47	0.2	27.094
Annual	365	6.12	2234.36	Annual Shading Loss	86.353

New annual energy adjusted output = 14371 kWh/year

Q-4 Use your new calculated loss due to shading from prompt 2 and your new system nameplate rating from prompt 3 to calculate the expected annual output of the PV system you designed using PV Watts. Make sure to use all the other system parameters you outlined in Prompt 1. This is the final output adjusting for the true system size and corrections for shading losses, tilt, and azimuth. Click the print results link above the table in PV Watts and save the output as a single pdf or image.

Ans-



Caution: Photovoltaic system performance predictions calculated by PVWatts[®] include many inherent assumptions and uncertainties and do not reflect variations between PV technologies nor site-specific characteristics except as represented by PVWatts[®] inputs. For example, PV modules with better performance are not differentiated within PVWatts[®] from lesser performing modules. Both NREL and private companies provide more sophisticated PV modeling tools (such as the System Advisor Model at sam.nrel.gov) that allow for more precise and complex modeling of PV systems.

The expected range is based on 30 years of actual weather data at the given location and is intended to provide an indication of the variation you might see. For more information, please refer to this NREL report: The Error Report.

Disclaimer: The PVWatts[®] Model ("Model") is provided by the National Renewable Energy Laboratory ("NREL"), which is operated by the Alliance for Sustainable Energy, LLC ("Alliance") for the U.S. Department of Energy ("DOE") and may be used for any purpose whatsoever.

The names DOE/NREL/ALLIANCE shall not be used in any representation, advertising, publicity or other manner whatsoever to endorse or promote any entity that adopts or uses the Model. DOE/NREL/ALLIANCE shall not provide any support, consulting, training or assistance of any kind with regard to the use of the Model or any updates, revisions or new versions of the Model.

YOU AGREE TO INDEMNIFY DOE/NREL/ALLIANCE, AND ITS AFFILIATES, OFFICERS, AGENTS, AND EMPLOYEES AGAINST ANY CLAIM OR DEMAND, INCLUDING REASONABLE ATTORNEYS' FEES, RELATED TO YOUR USE, RELIANCE, OR ADOPTION OF THE MODEL FOR ANY PURPOSE WHATSOEVER. THE MODEL IS PROVIDED BY DOE/NREL/ALLIANCE 'AS IS' AND ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY DISCLAIMED. IN NO EVENT SHALL DOE/NREL/ALLIANCE BE LIABLE FOR ANY SPECIAL, INDIRECT OR CONSEQUENTIAL DAMAGES OR ANY DAMAGES WHATSOEVER, INCLUDING BUT NOT LIMITED TO CLAIMS ASSOCIATED WITH THE LOSS OF DATA OR PROFITS, WHICH MAY RESULT FROM ANY ACTION IN CONTRACT, NEGLIGENCE OR OTHER TORTIOUS CLAIM THAT ARISES OUT OF OR IN CONNECTION WITH THE USE OR PERFORMANCE OF THE MODEL.

The energy output range is based on analysis of 30 years of historical weather data, and is intended to provide an indication of the possible interannual variability in generation for a Fixed (open rack) PV system at this location.

RESULTS

14,371 kWh/Year*

System output may range from 13,691 to 14,671 kWh per year near this location.

Month	Solar Radiation (kWh / m ² / day)	AC Energy (kWh)
January	4.76	998
February	5.24	975
March	6.02	1,215
April	6.79	1,311
May	6.40	1,265
June	6.99	1,319
July	7.24	1,400
August	7.47	1,447
September	6.85	1,295
October	5.98	1,182
November	5.31	1,045
December	4.37	920
Annual	6.12	14,372

Location and Station Identification

Requested Location	los angeles		
Weather Data Source	Lat, Lng: 34.05, -118.26	0.9 mi	
Latitude	34.05° N		
Longitude	118.26° W		

PV System Specifications

DC System Size	8.6 kW					
Module Type	Standard					
Array Type	Fixed (roof mount)					
System Losses	14.84%					
Array Tilt	26.57°					
Array Azimuth	170°					
DC to AC Size Ratio	1.2					
Inverter Efficiency	96%					
Ground Coverage Ratio	0.4					
Albedo	From weather file					
Bifacial	No (0)					
Monthly Irradiance Loss	Jan	Feb	Mar	Apr	May	June
	0%	0%	0%	0%	0%	0%
Monthly Irradiance Loss	July	Aug	Sept	Oct	Nov	Dec
	0%	0%	0%	0%	0%	0%

Performance Metrics

DC Capacity Factor	19.1%
--------------------	-------