Power Grid Bangladesh PLC
National Load Dispatch Center (NLDC)
System Summary Report


Date : 19-03-2026


Power Supply Scenario

Day Peak Generation	9012.51	MW	12:00 Hr.	Energy Generated	224.21659	MKWHr.
Day Peak Demand	9012.51	MW	12:00 Hr.	Energy Unserverd	0.00000	MKWHr.
Evening Peak Generation	11630.91	MW	21:00 Hr.	Energy Demand	224.21659	MKWHr.
Evening Peak Demand	11630.91	MW	21:00 Hr.	Maximum Temperature	30.50	°C
Minimum Generation of the Day	6669.15	MW	07:00 Hr.	Total Gas Supplied	818.46	MMCFD
Maximum Generation of the Day	11630.91	MW	21:00 Hr.	Production Cost per KWHr	5.32519	Tk.

Zone-wise Generation Summary (MKWHr.)

	Gas	Coal	HFO	HSD	Hydro	Solar	Import	Wind	**Total**
Dhaka Zone	31.02	0.00	0.49	0.00	0.00	0.19	0.00	0.00	31.69
Chattogram Zone	5.09	26.02	1.43	0.00	1.42	0.15	0.00	0.10	34.21
Cumilla Zone	17.02	0.00	0.01	0.00	0.00	0.51	2.50	0.00	20.05
Mymensingh Zone	3.05	0.00	0.72	0.00	0.00	0.35	0.00	0.00	4.11
Sylhet Zone	23.77	0.00	0.00	0.00	0.00	0.08	0.00	0.00	23.86
Khulna Zone	7.49	20.65	0.00	0.00	0.00	0.55	18.29	0.00	46.97
Barishal Zone	6.78	21.57	0.00	0.00	0.00	0.00	0.00	0.00	28.35
Rajshahi Zone	8.60	0.00	0.00	0.00	0.00	1.37	22.28	0.00	32.25
Rangpur Zone	0.00	1.30	0.01	0.00	0.00	1.41	0.00	0.00	2.73
Total	102.81	69.54	2.66	0.00	1.42	4.61	43.07	0.10	224.22

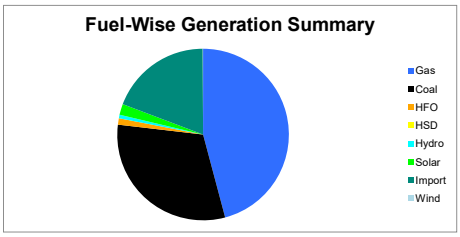

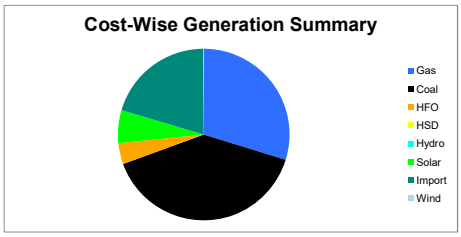

Production Cost (Tk.)

Fuel	**Tk.**	**Fuel**	**Tk.**
Gas	355607061.1	Hydro	142470
Coal	473617809.6	Solar	73686341.63
HFO	46899454.04	Import	242610269.4
HSD	0	Wind	1433342.4
	Total:	119,39,96,748	Tk.

E-W Interconnector & Import Scenario

Energy Flow from East to West:	KWHr:	0	Import through HVDC C/B Interconnector:	MKWHr:	18.288727	Peak Hr Flow	96.00 MW at 21:00 hrs
Energy Flow from West to East:	KWHr:	26035436.36	Import through Adani C/B Interconnector:	MKWHr:	22.28304	Peak Hr Flow	129.91 MW at 21:00 hr
low during Peak Demand (W-E):	MW:	1412	Import through Cumilla C/B Interconnector:	MKWHr:	2.50272	Peak Hr Flow	30.00 MW at 21:00 hrs
Maximum Power Flow (W-E):	MW:	1597	Total Import through C/B Interconnector:	MKWHr:	43.074487	Peak Hr Flow	155.91 MW at 21:00 hr

Zone-wise Load-shed and Demand Summary (MW) at evening peak Hour (21:00 Hr.)

Zone	**Load-Shed**	**Demand**
Dhaka	0	3220
Chattogram	0	1278
Cumilla	0	1233
Mymensingh	0	976
Sylhet	0	469
Khulna	0	1637
Barishal	0	430
Rajshahi	0	1243
Rangpur	0	742
Total	**0**	**11228**

Status of unavailable Power Plant

Planned S/D			**Forced S/D**		
Sl	Plant Name	Capacity	Sl	Plant Name	Capacity
1	Baghabari 100 MW GTPP	100	1	Rangpur 20 MW GTPP	20
2	Barapukuria TPP Unit-2	85			
3	Siddhirgonj 210 MW TPP	115			
	Total	300		Total	20
	Total Unavailable Capacity	**320**			

Event Summary

Outage Time	Restoration	Description of Event	Description of Event
08:25	10:57	BIPTC S/S 10CF15 Forced S/D Due to Shutdown is taken for emergency maintenance	
08:38	11:10	Ishurdi 132/33kV S/S 132/33 kV T-3 LT Scheduled S/D	15.0MW load interrup.
08:38	11:09	Ishurdi 132/33kV S/S 132/33 kV T-3 HT Scheduled S/D	15.0MW load interrup.
08:55	10:34	Mahasthangarh 132/33kV S/S 406T MTR1 HT Forced S/D Due to 33 KV Bus-1 work	15.0MW load interrup.
08:55	10:34	Mahasthangarh 132/33kV S/S 406T MTR1 LT Forced S/D Due to 33 KV Bus-1 work	15.0MW load interrup.
09:09		BIPTC S/S 10CF16 Tripped showing 87.1 Differential Relay relays Due to Tripped by differential protection Y phase OPTD.	
09:34	10:59	Ramganj 132/33kV S/S Transformer-01 HT Scheduled S/D Due to 33 KV PBS Feeder Red hot maintenance work at 33 kv Bus Ds	
09:34	10:59	Ramganj 132/33kV S/S Transformer-01 LT Scheduled S/D Due to 33 KV PBS Feeder Red hot maintenance work at 33 kv Bus Ds	
10:49	11:30	Sherpur 132/33kV S/S Transformer- 01 HT Scheduled S/D Due to OLTC oil Fill.	
10:49	11:31	Sherpur 132/33kV S/S Transformer- 01 LT Scheduled S/D Due to OLTC oil Fill.	
11:32	11:59	Sherpur 132/33kV S/S Transformer- 02 LT Scheduled S/D Due to OLTC oil Fill	
11:32	11:58	Sherpur 132/33kV S/S Transformer- 02 HT Scheduled S/D Due to OLTC oil Fill	

Power Grid Bangladesh PLC
National Load Dispatch Center (NLDC)
System Summary Report

Date : 19-03-2026

12:00		Day peak 9008 MW	
12:35	13:34	Mahasthangarh 132/33kV S/S 406T MTR1 HT Tripped showing Differential relay ,Micom P741 relays Due to Nesco 33 kv feeder Fault.	20.0MW load interrup.
12:35	13:37	Mahasthangarh 132/33kV S/S 406T MTR1 LT Tripped showing over curent P142 relays Due to Nesco 33 kv feeder Fault.	20.0MW load interrup.
12:35	12:52	Mahasthangarh 132/33kV S/S 416T MTR 2 LT Tripped showing OVER Current P142 relays Due to Nesco 33 kv feeder Fault.	20.0MW load interrup.
13:47	15:32	Ashuganj-Kishoreganj 132kV Ckt-1 Scheduled S/D from Bajitpur 132/33kV end Due to Tree trimming.	
14:18	15:56	Dhamrai 132/33kV S/S Transformer-2 HT Scheduled S/D Due to PBS work	
14:18	15:56	Dhamrai 132/33kV S/S Transformer-2 LT Scheduled S/D Due to PBS work	
14:22	15:27	Munshiganj 132/33kV S/S Transformer-2 LT Project Work S/D Due to Maintenance by pbs bus-2	
14:22	15:26	Munshiganj 132/33kV S/S Transformer-2 HT Scheduled S/D Due to Maintenance by pbs bus-2	
14:28	15:51	Dhamrai 132/33kV S/S 33 KV Bus Section-02 Scheduled S/D Due to PBS WORK	
	14:49	Keranigonj 230/132/33kV S/S 132 kV Hasnabad Ckt. 1 is restored.	
15:02	21:42	Bhulta 400/230kV S/S 400kV Bus-1 Forced S/D	
15:12		Ghorashal unit-7 GT was sync.	
15:37	16:29	Kabirpur -Tongi 132kV Ckt-1 Scheduled S/D from Tongi 230/132/33kV end Due to for Nest romove	
17:35		Shahjibazar 330 MW CCPP GT was sync.	
17:48	05:08	Bogura 400/230kV S/S 400 KV Reactor (125 MVAR) Forced S/D Due to As per NLDC"s instruction	
18:44		Chandpur CCPP GT was sync.	
19:50	20:11	Kulaura 132/33kV S/S TR-1 AB LT Scheduled S/D Due to TR-01(A+B) 33kV Side CT Redhot maintenance	5.0MW load interrup.
19:52	20:10	Kulaura 132/33kV S/S TR-1 AB HT Scheduled S/D Due to TR-01(A+B) 33kV Side CT Redhot maintenance	5.0MW load interrup.
21:03		JERA Meghnaghat Power Limited 718 MW CCPP GT2 was sync.	
21:05	00:41	Kabirpur 132/33kV S/S XFR, T-2 LT Forced S/D Due to Red hot at 33 kV bus DS of TR-2	24.0MW load interrup.
21:06	00:38	Kabirpur 132/33kV S/S XFR, T-2 HT Forced S/D Due to Red hot at 33 kV Bus DS of TR -2	24.0MW load interrup.
22:14	23:21	Kulaura 132/33kV S/S TR-1 AB LT Scheduled S/D Due to TR-01(A+B) 33kV Side CT Redhot maintenance	5.0MW load interrup.
22:14	23:19	Kulaura 132/33kV S/S TR-1 AB HT Scheduled S/D Due to TR-01(A+B) 33kV Side CT Redhot maintenance	5.0MW load interrup.
05:00	05:20	Jaldhaka-Saidpur 132kV Ckt-1 Tripped from Saidpur 132/33kV end showing Distance relay zone 2 relays Due to Distance relay	
06:15	06:28	Saidpur 132/33kV S/S TR-4 (414T) LT Tripped showing Siemens relays Due to O/C	
06:30	07:14	Mithapukur-Rangpur Confidence(100MW) 132kV Ckt-1 Tripped from Mithapukur 132/33kV end showing O/C L 1,286 LO RELAY relays Due to None	
07:00		Minimum Generation: 7852 MW.	

Sub-Divisional Engineer
Network Operation Division

Executive Engineer
Network Operation Division

Superintendent Engineer
Network Operation Division