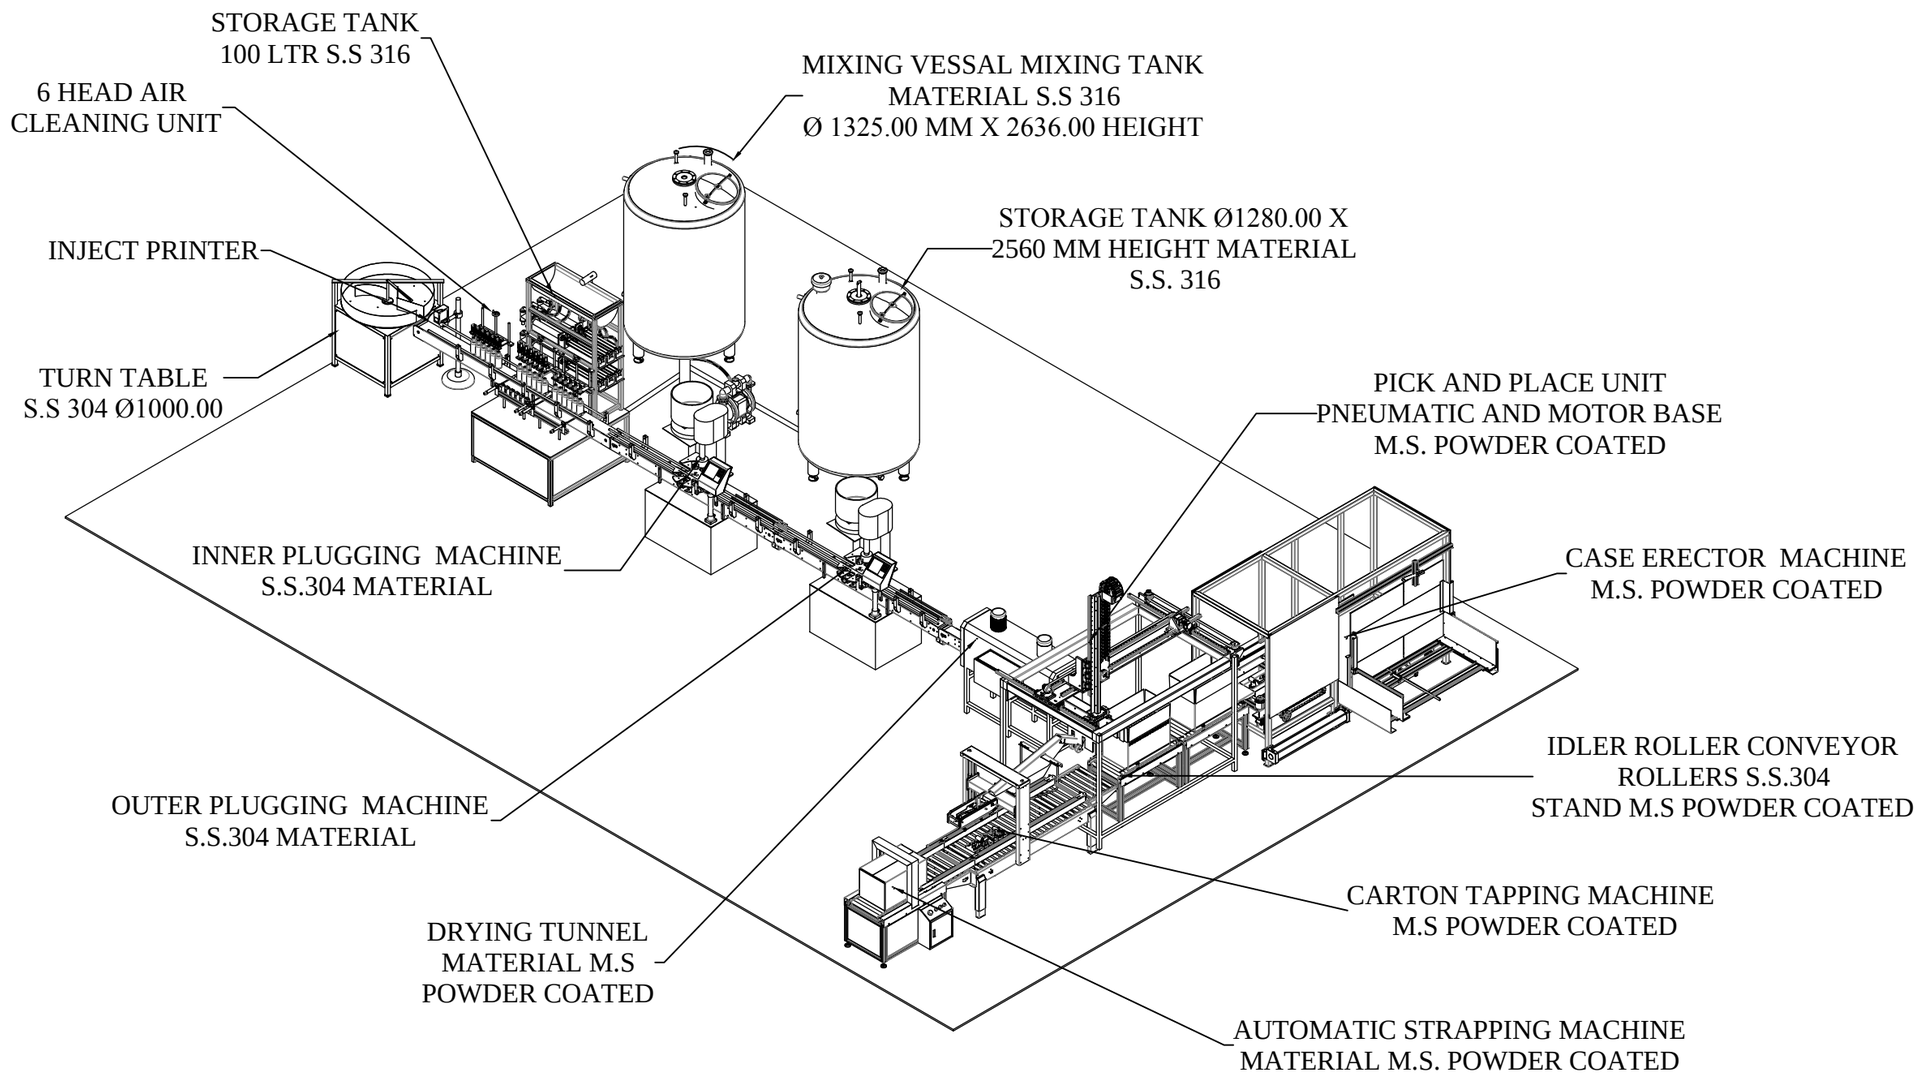


Note:

1) Power connection upto main control panel of Bottle syrup filling line is in client scope.

2) Air supply upto FRL of Bottle syrup filling line is in client scope.

3) Water supply upto inlet of Mixing tank is in client scope.

4) Air consumption of line is 30CFM at 8 bar.

5) Power consumption of line is 35HP.

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE
FULLY AUTOMATIC BOTTLE SYRUP FILLING LINE

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	SIGN	DATE
DRAWN	G.P.		30/03/22
CHECK	P.M.		30/03/22
APPROVAL	A.K.		30/03/22

CLIENT - TANUWAS ANIMAL NEUTRITION

PROJECT -PRIMARY & SECONDARY PACKAGING

SITE - CHENNAI

If any queries contact : design@nihva.com

DWG. NO. : NIHVA/21-22/CLT/382 REV. - 00

ALL DIMENSION ARE IN mm

SCALE: NTS WT: SHEET: 01 OF 03