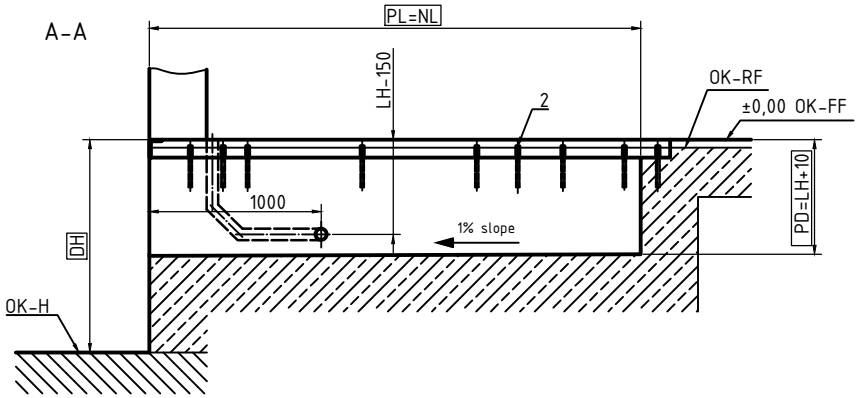

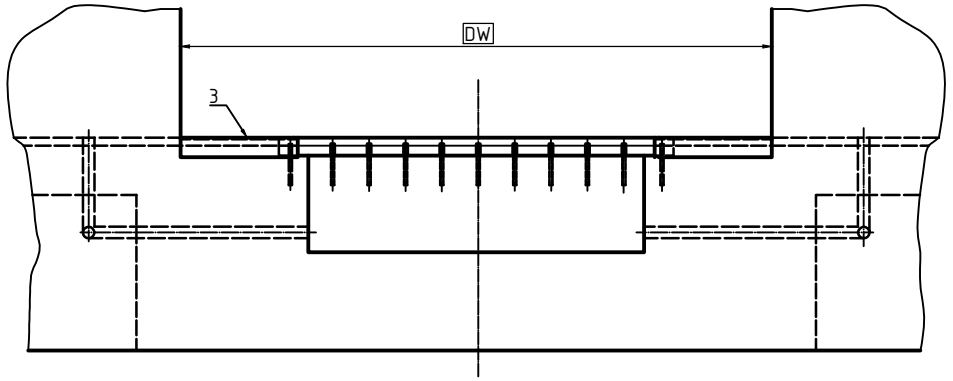

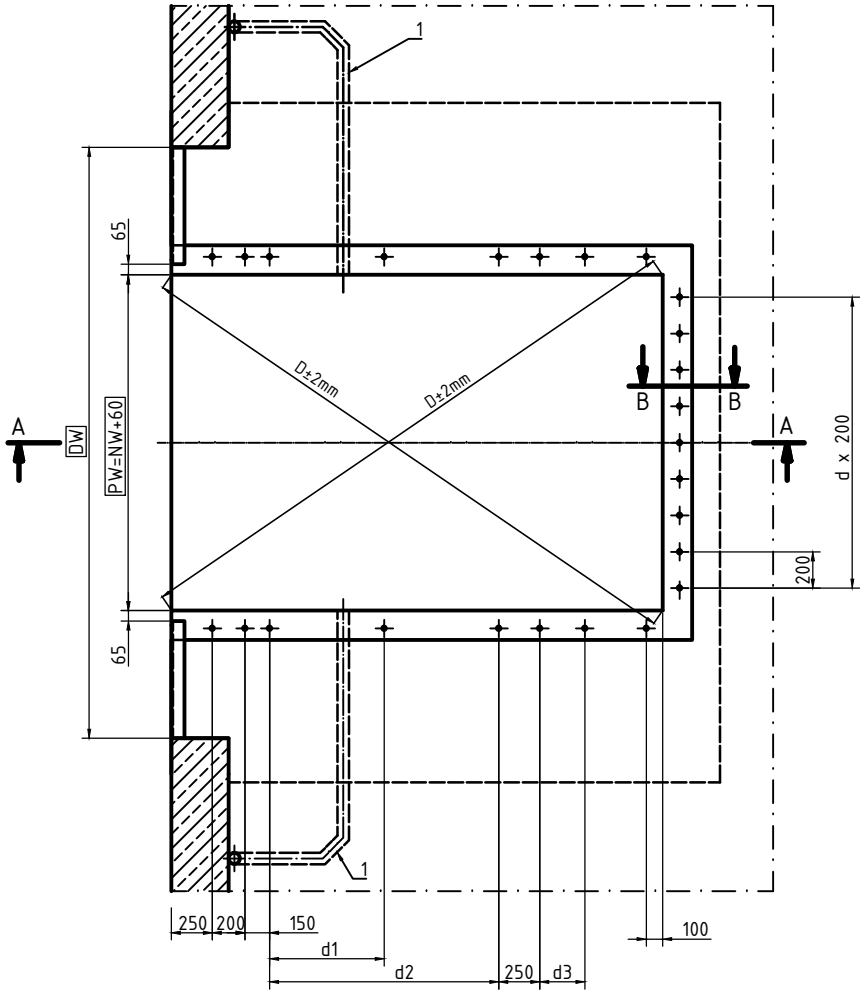

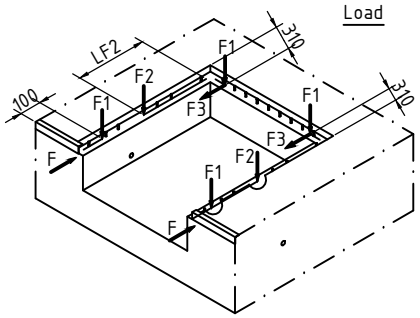

load capacity
F = The horizontal impact load (100kN) must be absorbed by the structure recommended according to DIN 1055-9
F1 = 95 kN (cross traffic position)
F2 = 70 kN (emergency stop)
F3 = 30 kN (brake force)

NL	2000	2500	3000	3500	4000
LH	700	700	700	800	900
n	12	12	14	14	16
d1	--	--	700	800	900
d2	750	1050	1400	1600	1850
d3	--	--	--	--	600
LF2	500	700	850	1150	1400

NW	PW	d	n1
2000	2060	8	9
2200	2260	10	11

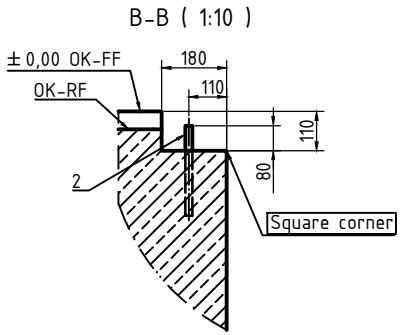

DH = dock height
DW = door width
OK-FF = finish floor level
OK-RF = floor base
OK-H = yard level
PL = pit length
PW = pit width
NL = nominal length
NW = nominal width
LH = leveller height
PD = pit depth
n = number of steel dowels (left and right side)
n1 = number of steel dowels (on the rear)

by others
1 - Conduit for wiring internal diameter min. 70 mm angles < 45° (left/right, acc. specification of sales company)
2 - Plain steel dowel Ø20 - 250 mm
3 - Steel profile e.g. angle 120x80x10

Attention
- Do not deviate from the measurments given
- The pit walls must be vertical
- The corners of the pit must be square (diagonals must be equal)
- The preparation of the pit and the dowels by other

ASSA ABLOY
ASSA ABLOY Entrance Systems

Tolerance: EN ISO 13920-BF
Scale: 1 : 25
Format: A2
Material: Weight: N/A
Norm:
Treatment:
Semifinished product:
Subject: DL6111S SD 100kN TypeT without tail lift

	Date:	Name:
Drawn:	20.07.2016	SEBU01
Checked:	14.02.2017	BECZE
Blocked:		
Archived:		

Replaced by:

It is forbidden by law to copy, duplicate this document, to transmit it to any third party or to misuse it in any way. The drawing remains our property and is to be returned immediately after use.

Drawing number: 51510010
Revision: 01
Sheet/of: 1/1
Filename: Building preparation.iam

Index	Modification	Date	Name