




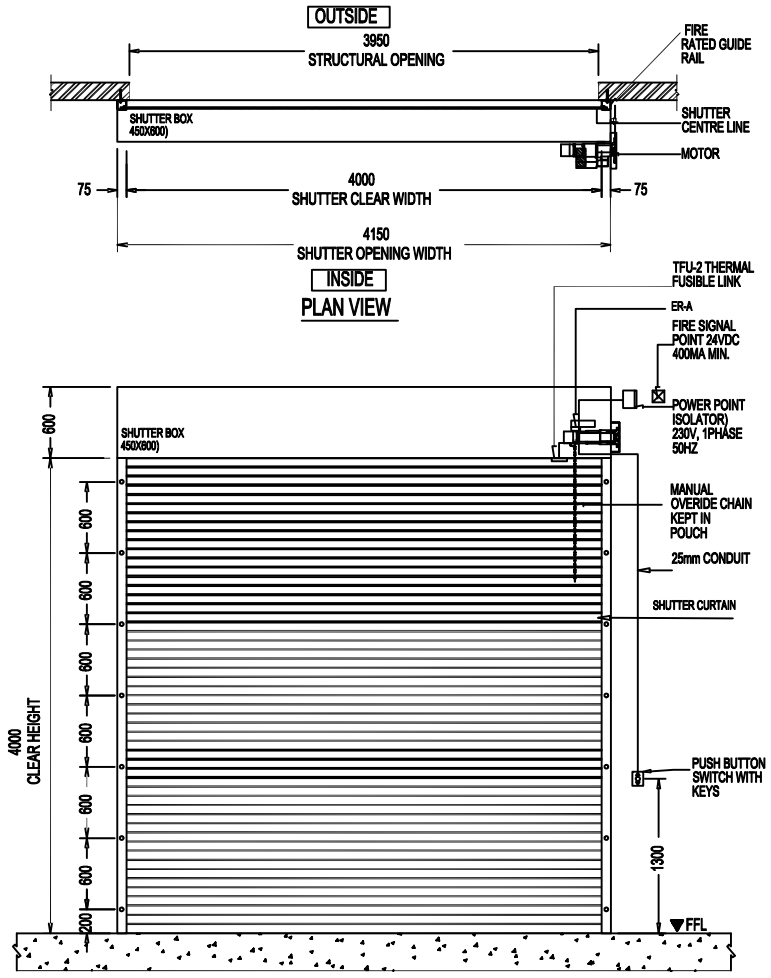


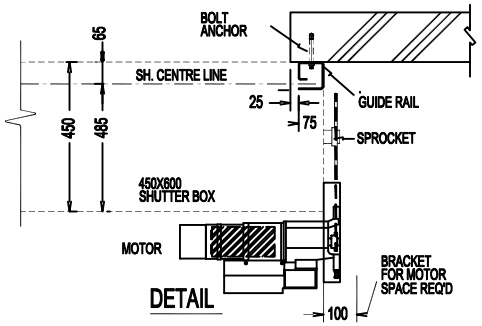


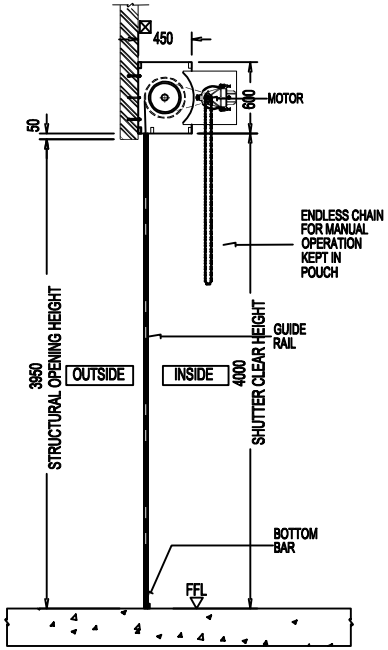





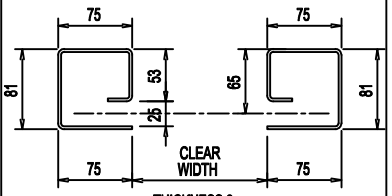



TECHNICAL SPECIFICATIONS :

Sr .No.	Specification	Description
1	Certification	BS 476 Part 22 & MS 1073 Part 3 1988 Tested in Warrington Fire Reasearch Centre UK & Sirim Malasiya
2	Shutter Curtain	Roll formed from 1st grade BHP Zincalume steel SKB-A7 curve slat curtain
3	Guide Rail	Fabricated from hot-dipped galvanised steel of 3.0 mm with one piece design surface mounted type.
4	Bottom Bar	Assembled of 2 Pieces of 38 x 38 x 3 mm galvanised steel angle bolted 800 mm pitch with galvanised bolts and nuts or 2 pieces of 40 x 40 x 6 mm steel flat bar.
5	Shutter Enclosure Box	Pressed Galvanised steel sheet to suite box size comply to fire test approved thickness.
6	Operation Control	Gear motor with Thermal protector, limit switches, manual overide, c/w push button switch with keys lockable.
7	Motor Drive Unit	Power Source: 110v 60Hz 1 phase 220v 60Hz 1 phase 230v 50Hz 1 phase 400v 50Hz 3 phase Manual Chain Overide One unit push button switch Gravity drop level Auto close by relay switch after receive of 24vdc fire signal
8	Fire Mode	Fire Shutter will auto close via upon receiving of 24VDC fire signal

SIZES :

SHUTTER NO.	CLEAR WIDTH	CLEAR HEIGHT	MOTOR POSITION	QTY
01	4000 mm	4000 mm	RIGHT	02

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern

TITLE :-
MOTORISED FIRE RATED ROLLING SHUTTER

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

	NAME	DATE
DRAWN	J.S.	19/01/2024
CHECK	A.K.	19/01/2024
APPROVAL	V.T.	19/01/2024

CLIENT - TATA
PROJECT -MOTORISED FIRE RATED ROLLING SHUTTER
DWG. NO. : NIHVA-23-24-CLT-102 | REV-00
ALL DIMENSION ARE IN mm
SCALE: NTS | WT: | SHEET: 01 OF 01
If any queries contact : design@nihva.com