



Phase : II

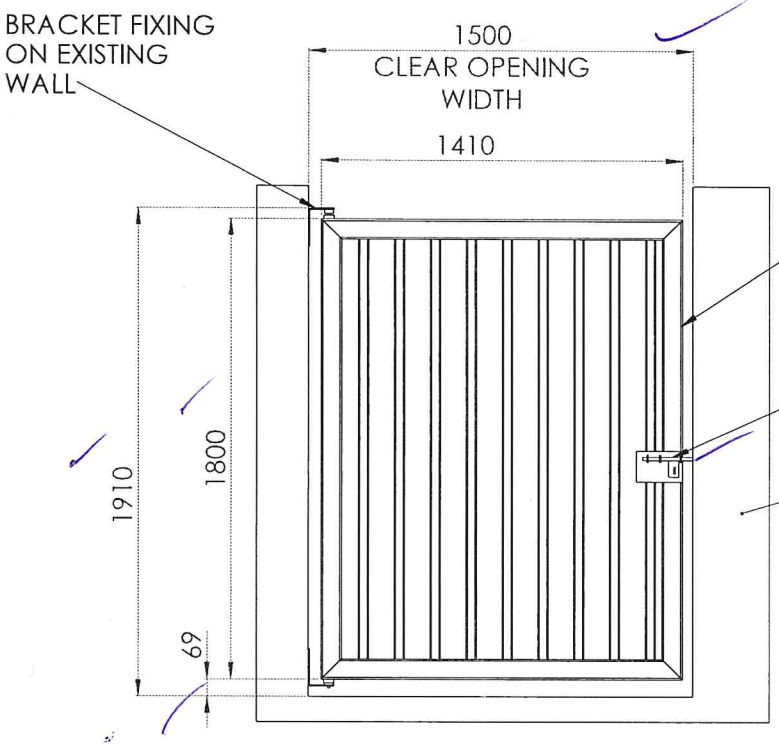

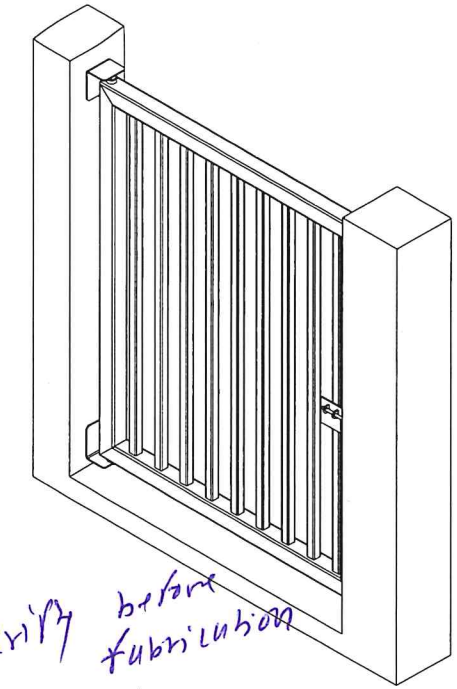

please verify before fabrication

Approved with comment

08.09.2021.

EPICONS CONSULTANTS PVT. LTD.

GA OK.
VENDOR TO VERIFY ACTUAL SIZES AT SITE. FOR COMMENTS CHECK MAIL DT.26&29/07/21.

Manisha

SPECIFICATIONS OF MANUAL WICKET GATE -
1. CLEAR OPENING WIDTH 1500MM
2. CLEAR OPENING HEIGHT - 1800 MM
3. BRACKET FIXING ON EXISTING WALL
4. OUTER TUBE - SQUARE TUBE 80X3.2MM THK
5. INNER TUBE -SQUARE TUBE 40X2 MM THK
6. FINISH - PAINTING AS PER APPROVED RAL SHADE

as per TDS

Please check HDGS No Painting Required.

NOTES -
1. SWING GATE TO BE INSTALLED ON EXISTING WALL AT SITE .
2. PROVIDE RAL SHADE FOR PAINTING OF GATE .

RAL as per TDS.

NIHVA
We Make Possible


CLIENT - SUBHASHREE ENGINEERING & CONSTRUCTIONS PVT LTD

WICKET GATE


MATERIAL: M.S.

NIHVA/21-22/037/MWG


A1

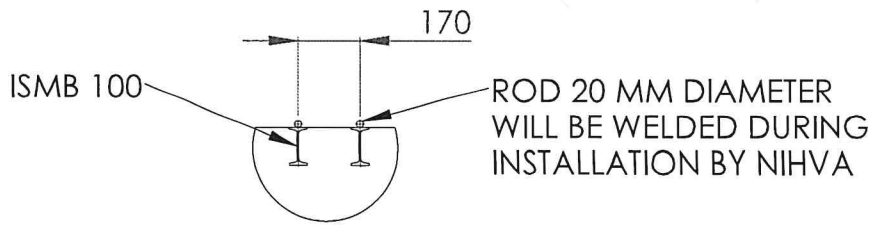

DETAIL C
SCALE 1 : 10

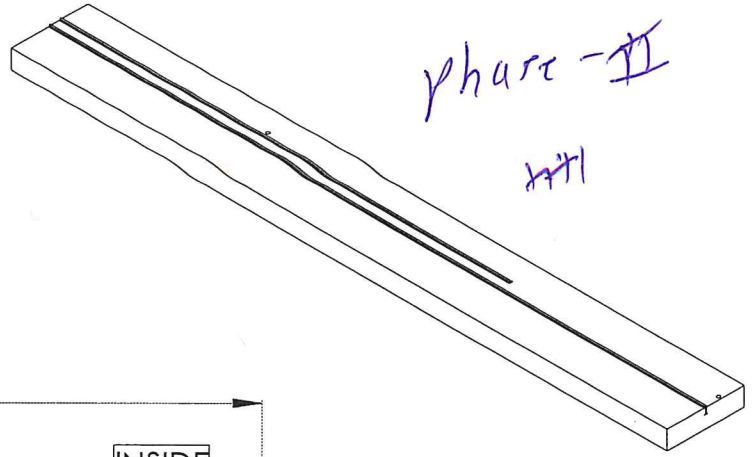


phase - II

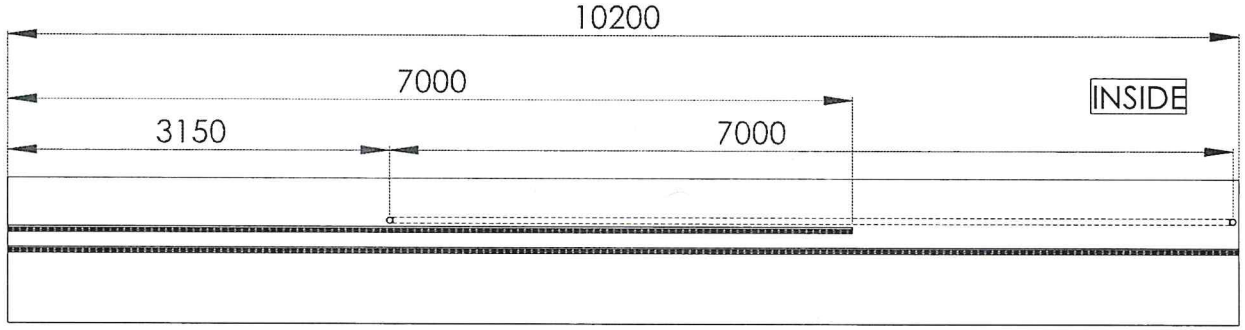

Kindly submit the drg. after site inspection During phase II will Hold

08.05.2021

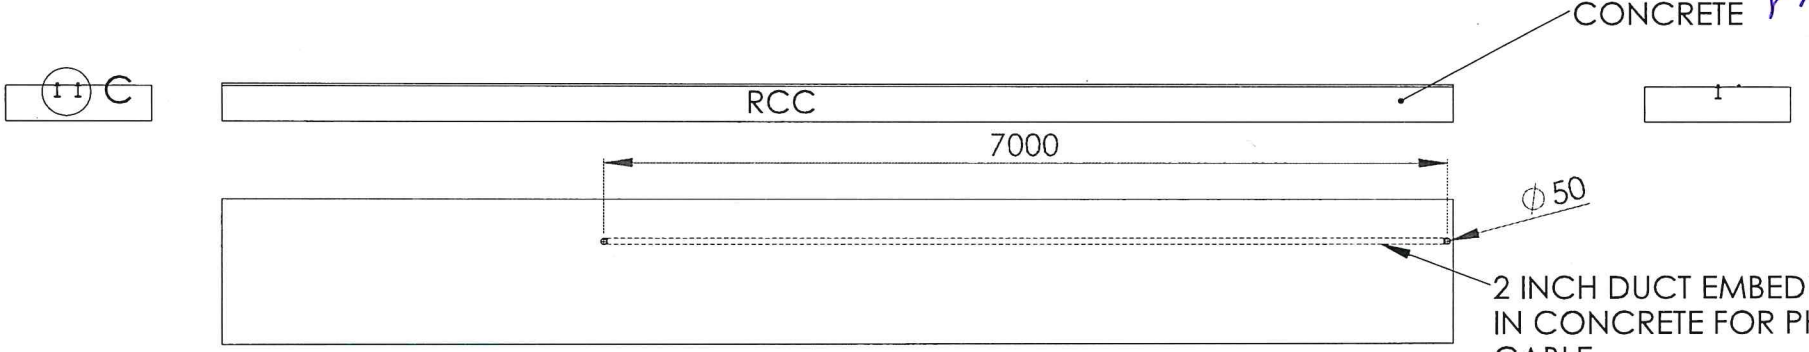

NOTES-
1. ALL CIVIL WORK IS IN CLIENT SCOPE .
2. ISMB 100 TO BE EMBEDED IN CONCRETE AS PER ATTACHED DRAWING .
3. 2 INCH DUCT TO BE PROVIDEDFOR PHOTOCELL CABLE AS PER GA DRAWING (DUCT IS IN CLIENT SCOPE).

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH: TOLERANCES: LINEAR: ANGULAR:

NIHVA
We Make Possible

DEBURR AND BREAK SHARP EDGES

DO NOT SCALE DRAWING | REVISION

CLIENT - SUBHASHREE ENGINEERING & CONSTRUCTIONS PVT LTD

	NAME	SIGNATURE	DATE
DRAWN	SIDDHESHWAR		8.5.2021
CHK'D			
APP'D			
MFG			
Q.A			

MATERIAL:


WEIGHT:

TITLE: GATE FOUNDATION FOR TELESCOPIC GATE6000X1800

DWG NO. NIHVA/21-22/035/TGFOUND


A2

SCALE:1:50 SHEET 1 OF 1

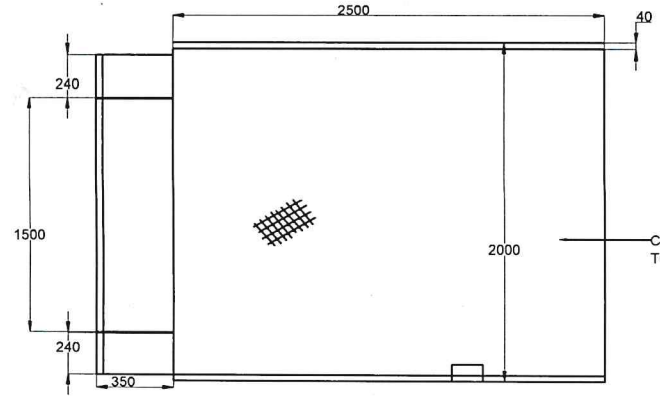


HDGT.

TRUCK LOADIND DIRECTION

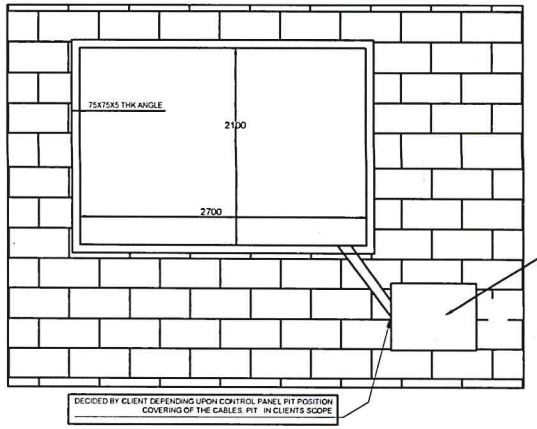

inside the building


as per TDS

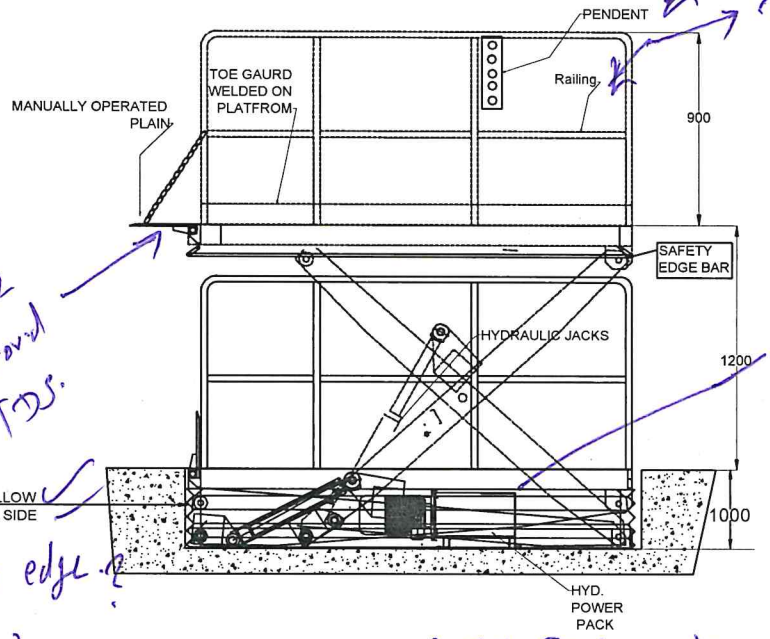

as per approval TDS.

Power pack mounting on Lifting member

Safety edge

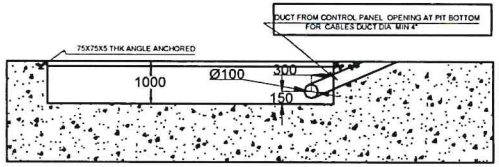

PIT DRAWING

NOTE :

1. PIT FOR SCISSORLIFT HAS TO BE DIAGONALLY WITHIN 3-5 MM
2. BASE OF THE PIT HAS TO BE IN WATER LEVEL AND RIGHT ANGLE TO THE VERTICAL SIDE WALLS
3. PROPER ARRANGEMENT FOR ROUTING HOSES AND CABLES HAVE TO BE MADE DEPENDING ON SITE CONDITIONS AND POSITION OF POWER PACK
4. COVERING REQUIRED FOR HOSES AND CABLES AND RELATED CIVIL WORK IS IN CLIENTS SCOPE
5. WATER DRAINAGE AND PIT CLEANING NEEDS TO BE CONSIDERED AND DONE BY CLIENT.
6. PIT & ALL CIVIL WORK IS IN CLIENT SCOPE .

Approval will comments

08.09.2021.

GA OK,
PIT SIZES TO BE CONFIRM BY SITE TEAM,
CHECK MAIL DT.26/29/07/21.
VENDOR TO VERIFY ACTUAL SIZES AT SITE

SPECIFICATIONS OF SCISSOR LIFT -


1. PLATFORM SIZE -2000WX2500L
2. CLOSE HEIGHT - 1000 MM
3. LIFT HEIGHT ABOVE FLOOR LEVEL - 1200 MM
4. CAPACITY - 6 TON UDL
5. FINISH - HOT DEEP GALVANISING
6. QTY - TOTAL 4 NOS OF SCISSOR LIFT (2 NOS FOR PHASE 1 & 2 NOS FOR PHASE 2)
7. HYDRAULIC POWERPACK - 7.5 HP , 3 PHASE AC , 50 Hz , MOUNTED INSIDE PIT
8. LIP - ONE SIDE MANUAL , 3 PIECE SPLIT TYPE(240+1500+240) - as per chota Hathi
9. SAFETY BELLOW - ALL SIDE
10. CUTOFF LIMIT SWITCH FOR MAXIMUM LIFT
11. MAINTENANCE STOPPER - MANUAL , 2 NOS
12. SCISSOR LIFT INTERLOCK PROVIDED WITH SECTIONAL DOOR & DOCK LEVELER


as per TDS. only Deviation is utilized for hydrolic power pack make - ji NIHVA.


This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.


TITLE			
PIT MOUNTED ELECTRO-HYDRAULIC SCISSOR LIFT			NIHVA TECHNOLOGIES PVT. LTD.
	SIGN	DATE	
DRAWN	SS	17.7.2021	CLIENT - SUBHASHREE ENGG & CONSTRUCTIONS PVT LTD
CHECK	VJ		PROJECT - E+H FLOWTECH INDIA PVT LTD
REV.	AK		SITE - AURANGABAD
APPROVAL	VT		DWG. NO. : NIHVA/21-22/045/SL — REV NO - R00
If any queries contact : nihvacare@nihva.com			SCALE: NTS — WT: — SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			


NIHVA TECHNOLOGY PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

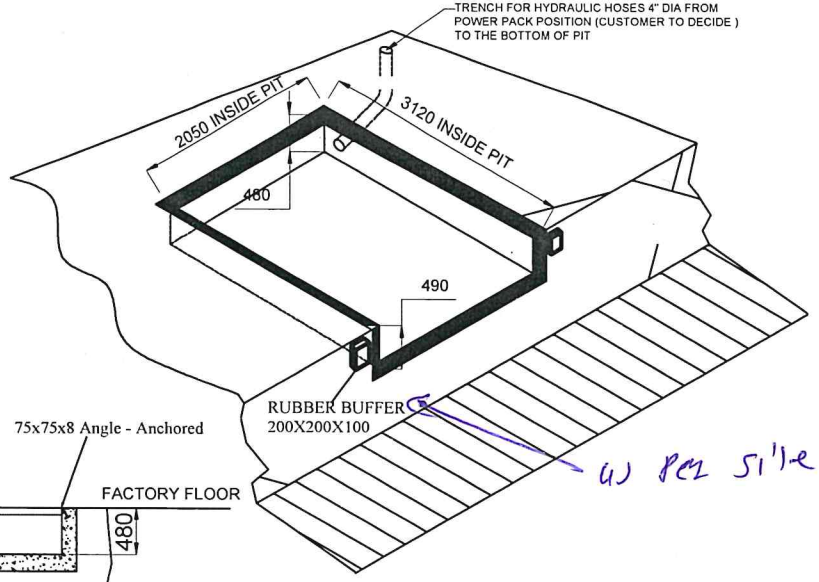

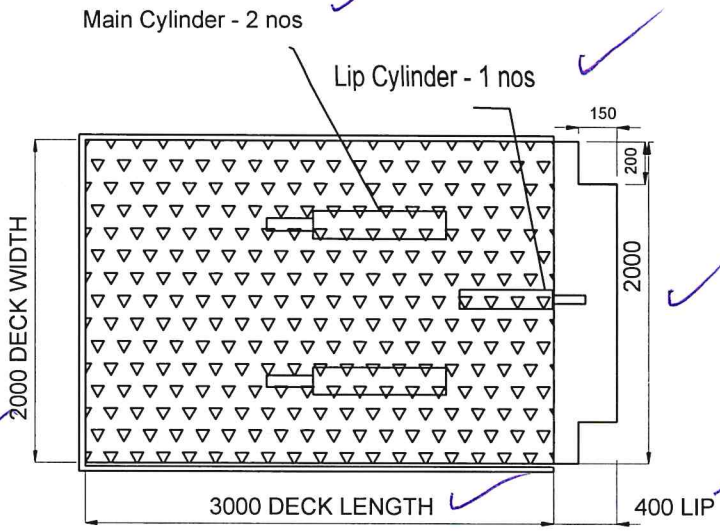

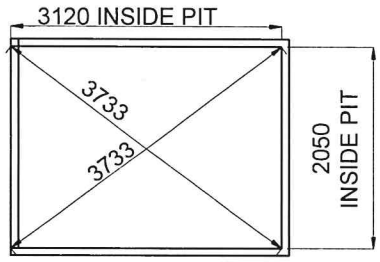

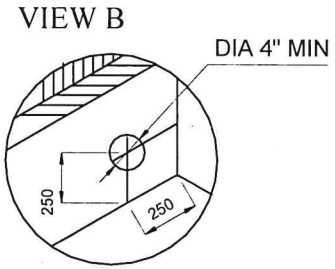

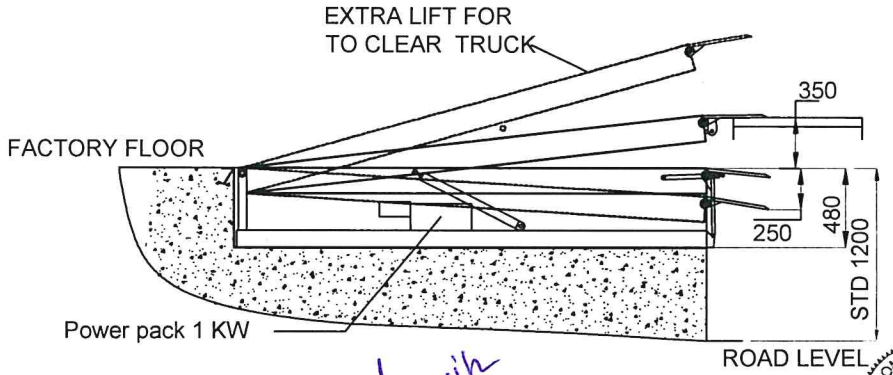

NOTE:
1. PROPER DRAINAGE SHOULD BE DONE
2. TRENCH AS SHOWN SHOULD BE MADE BY DECIDING THE POWER PACK POSITION (SUPPLY HOSE LENGTH STD. 3000 MM)
3. LEVEL OF THE PIT SHOULD BE PLAIN AND SHOULD TAKE AT LEAST 18000 KGB FLOOR LOADING
4. FABRICATION TOLERANCE FOR PLATFORM SIZE WILL BE ± 10 MM .
5. PIT, DUCT FOR HOSES & ALL CIVIL WORK IS IN CLIENT SCOPE .

SPECIFICATIONS OF DOCK LEVELER -
1. PLATFORM SIZE -2000WX3000L
2. LIFT ABOVE- 350 MM
3. LIFT DOWN-250 MM
4. PIT SIZE- 2050WX3120LX480D
5. CAPACITY - 6 TON POINT LOAD 15 TON UDL
6. FINISH - HOT DEEP GALVANISING
7. QTY - TOTAL 4 NOS OF DOCK LEVER (2 NOS FOR PHASE 1 & 2 NOS FOR PHASE 2)
8. HYDRAULIC POWERPACK - 1kW , 3 PHASE AC , 50 Hz

approved with comments 08.05.2021

This drawing & designing is the property of NIHVA TECHNOLOGIES. Not be sold or copy to any other concern.

TITLE			NIHVA TECHNOLOGY PVT. LTD. PUNE
PIT MOUNTED ELECTRO-HYDRAULIC DOCK LEVELER			NIHVA TECHNOLOGIES PVT. LTD. Tel : 020 66304033 Email:- info@nihva.com Website:- www.nihva.com
	SIGN	DATE	
DRAWN	SS	17.7.2021	CLIENT - SUBHASHREE ENGG & CONSTRUCTIONS PVT LTD
CHECK	VJ		PROJECT - E+H FLOWTECH INDIA PVT LTD
REV.	AK		SITE - AURANGABAD
APPROVAL	VT		DWG. NO. : NIHVA/21-22/044/DL / REV NO - R00
If any queries contact : nihvacare@nihva.com			SCALE: NTS / WT: / SHEET: 01 OF 01
ALL DIMENSION ARE IN mm			